Wildland Urban Interface Notes

w/TEST PROCEDURES SET FORTH IN S.F.M. STANDARD 12-7A-3.

• THIS PROJECT IS LOCATED WITHIN THE DESIGNATED "WILDLAND-URBAN INTERFACE FIRE ZONE. THE BUILDING MATERIALS AND CONSTRUCTION METHODS FOR EXTERIOR WILDFIRE EXPOSURE SHALL COMPLY WITH THE PROVISIONS OF CRC R337 (CALIFORNIA RESIDENTIAL CODE) & CBC CHAPTER TA CALIFORNIA

THE EXPOSED UNDERSIDE OF EXTERIOR PORCH CEILINGS SHALL BE PROTECTED BY ONE OF THE FOLLOWING, CRC R337.76.

- A. NONCOMBUSTIBLE MATERIAL B. IGNITION-RESISTANT MATERIAL
- C. I LAYER OF "TYPE "X" GYP. SHEATHING APPLIED BEHIND THE EXTERIOR COVERING ON THE UNDERSIDE OF THE CEILING.
- D. THE EXTERIOR PORTION OF A I HOUR FIRE RESISTIVE EXTERIOR WALL ASSEMBLY APPLIED TO THE UNDERSIDE OF THE CEILING ASSEMBLY INCLUDING ASSEMBLIES USING THE GYP. PANE & SHEATHING PRODUCTS LISTED IN THE GYPSUM ASSOC. FIRE RESISTANT DESIGN MANUAL EXISTING PORCH CEILING ASSEMBLIES W/A HORIZONTAL UNDERSIDE THAT MEET THE PERFORMANCE CRITERIA IN ACCORDANCE

THE UNDER FLOOR AREA OF ELEVATED OR OVERHANGING BUILDINGS SHALL BE ENCLOSED TO GRADE IN ACCORDANCE w/ THE REQUIREMENTS OF THIS CHAPTER OF THE UNDERSIDE OF THE EXPOSED UNDER FLOOR SHALL CONSIST OF ONE OF THE FOLLOWING, CRC R337.7.7

- A. NONCOMBUSTIBLE MATERIAL. B. IGNITION-RESISTANT MATERIAL
- C. I-LAYER OF "TYPE "X" GYP. SHEATHING APPLIED BEHIND THE EXTERIOR COVERING ON THE UNDERSIDE
- D. THE EXTERIOR PORTION OF A 1-HOUR FIRE RESISTIVE EXTERIOR WALL ASSEMBLY APPLIED TO THE UNDERSIDE OF THE CEILING ASSEMBLY INCLUDING ASSEMBLIES USING THE GYP. PANE & SHEATHING PRODUCTS LISTED IN THE GYPSUM ASSOC. FIRE RESISTANT DESIGN MANUAL.
- E. PORCH CEILING ASSEMBLIES W/A HORIZONTAL UNDERSIDE THAT MEET THE PERFORMANCE CRITERIA IN ACCORDANCE W/TEST PROCEDURES SET FORTH IN SFM STANDARD 12-7A-3.

THE UNDERSIDE OF OVERHANGING APPENDAGES SHALL BE ENCLOSE TO GRADE IN ACCORDANCE W/ THE REQUIREMENTS OF THIS CHAPTER OR THE UNDERSIDE OF THE EXPOSED UNDERFLOOR SHALL CONSIST OF ONE OF THE FOLLOWING, CRC R337.7.4

- A. NONCOMBUSTIBLE MATERIAL. B. IGNITION-RESISTANT MATERIAL
- C. 1-LAYER OF "TYPE "X" GYP. SHEATHING APPLIED BEHIND THE EXTERIOR COVERING ON THE UNDERSIDE
- D. THE EXTERIOR PORTION OF A 1-HOUR FIRE RESISTIVE EXTERIOR WALL ASSEMBLY APPLIED TO THE UNDERSIDE OF THE CEILING ASSEMBLY INCLUDING ASSEMBLIES USING THE GYP. PANE & SHEATHING
- PRODUCTS LISTED IN THE GYPSUM ASSOC. FIRE RESISTANT DESIGN MANUAL E. PORCH CEILING ASSEMBLIES W/A HORIZONTAL UNDERSIDE THAT MEET THE PERFORMANCE CRITERIA IN ACCORDANCE W/TEST PROCEDURES SET FORTH IN SFM STANDARD 12-7A-3.

EXTERIOR WINDOWS & EXTERIOR GLAZED DOOR ASSEMBLIES SHALL COMPLY WONE OF THE FOLLOWING REQUIREMENTS, CRC R337.8.2

- A. BE CONSTRUCTED OF MULTI-PANE GLAZING W/A MIN. OF ONE TEMP. PANE MEETING THE REQUIREMENTS OF SECTION 2406 SAFETY GLAZING, OR,
- B. BE CONSTRUCTED OF GLASS BLOCK UNITS, OR, C. HAVE A FIRE-RESISTANT RATING OF NOT LESS THAN 20 MINUTES WHEN TESTED ACCOURDING TO NFPA 257, OR D. BE TESTED TO MEET THE PERFORMANCE REQUIREMENTS OF SFM STANDARD 12-74-2.

EXTERIOR DOORS SHALL COMPLY WONE OF THE FOLLOWING REQUIREMENTS, CRC R337.8.3

- A. THE EXTERIOR SURFACE OR CLADDING SHALL BE OF NON-COMBUSTIBLE OR IGNITION-RESISTANT
- SHALL BE CONTRUCTED OF SOLID CORE WOOD THAT COMPLY WITH THE FOLLOWING REQUIREMENTS: STILES & RAILS SHALL NOT BE LESS THAT I" THICK.
- B. RAISED PANELS SHALL NOT BE LESS THAN 1 1/4" THICK, EXCEPT FOR THE EXT. PERIMETER OF THE RAISED PANEL THAT MAY TAPER TO A TONGUE NOT LESS THAN " THICK.
- C. HAVE A FIRE-RESISTANT RATING OF NOT LESS THAN 20 MINUTES WHEN TESTED ACCOURDING TO NFPA
- D. BE TESTED TO MEET THE PERFORMANCE REQUIREMENTS OF SFM STANDARD 12-7A-2.

Deferred Approvals

DEFERRED APPROVALS ARE SUBJECT TO CITYS APPROVAL

A NFPA 13 FIRE SPRINKLER SYSTEM AND NFPA 1142 WATER TANK SIZING CALCS TO BE SUBMITTED AND APPROVED UNDER A

Basis of Design

all wor	K TO BE IN CONFORMANCE WITH:	
CBC	CALIFORNIA BUILDING CODE	2019 EDITION
CRC	CALIFORNIA RESIDENTIAL CODE	2019 EDITION
CEC	CALIFORNIA ELECTRICAL CODE	2019 EDITION
CENC	CALIFORNIA ENERGY CODE	2019 EDITION
CFC	CALIFORNIA FIRE CODE	2019 EDITION
CMC	CALIFORNIA MECHANICAL CODE	2019 EDITION
CPC	CALIFORNIA PLUMBING CODE	2019 EDITION
CGC	CALIFORNIA GREEN CODE	2019 EDITION
ASCE	AMERICAN SOCIETY OF CIVIL ENGINEERS	7-16
ACI	AMERICAN CONCRETE INSTITUTE	318-19

AND ALL PERTINENT LOCAL CODES AND ORDINANCES.

General Notes

- ALL WRITTEN DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALED DIMENSIONS. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF STOTLER DESIGN GROUP PRIOR TO COMMENCING.
- · YERIFY LOCATION OF UTILITIES AND EXISTING CONDITIONS AT SITE PRIOR TO CONSTRUCTION AND BIDDING.
- CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR METHOD AND MANNER OF CONSTRUCTION AND FOR ALL JOB SITE SAFETY DURING CONSTRUCTION.
- CRC R4013, SURFACE DRAINAGE SHALL BE DIVERTED TO A STORM SEWER CONVEYANCE OR OTHER APPROVED POINT OF COLLECTION THAT DOES NOT CREATE A HAZARD. LOTS SHALL BE GRADED TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS. THE GRADE SHALL FALL A MINIMUM OF 6" WITHIN THE FIRST 10'. IMPERVIOUS AREAS WITH-IN 10' OF BUILDING FOUNDATION SHALL BE SLOPED A MINIMUM OF 2% MIN. AWAY FROM BUILDING
- SEPARATE PERMITS ARE REQUIRED FOR MECHANICAL, ELECTRICAL & PLUMBING WORK.
- THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE DESIGNER, WITHOUT PREJUDICE, VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF
- ALL EARTHWORK AND SITE DRAINAGE, INCLUDING DRILLED PIER, SPREAD FOOTING, AND MAT SLAB EXCAYATIONS, SWIMMING POOL EXCAYATION, SUBGRADE PREPARATION BENEATH HARDSCAPE, PLACEMENT AND COMPACTION OF ENGINEERED FILL BENEATH HARDSCAPE, UTILITY TRENCH BACKFILL AND INSTALLATION OF SURFACE AND SUBSURFACE DRAINAGE SHOULD BE PERFORMED IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL REPORT PREPARED BY MURRAY ENGINEERS, INC. DATED MARCH 30, 2011. MURRAY ENGINEERS, INC. SHOULD BE PROVIDED AT LEAST 48 HOURS ADVANCE NOTIFICATION (650-326-0440) OF ANY EARTHWORK OPERATIONS AND SHOULD BE PRESENT TO OBSERVE AND/OR TEST AS NECESSARY THE EARTHWORK AND FOUNDATION INSTALLATION PHASES OF THE PROJECT.

Fire Department Notes

- THIS PROJECT IS LOCATED WITHIN THE DESIGNATED "WILDLAND-URBAN INTERFACE FIRE ZONE. THE BUILDING CONSTRUCTION SHALL COMPLY WITH THE PROVISIONS OF CRC R337 (CALIFORNIA RESIDENTIAL CODE) & CBC CHAPTER TA CALIFORNIA BUILDING CODE
- THE PROPERTY SHALL BE IN A COMPLIANCE WITH THE VEGETATION MANAGEMENT REQUIREMENTS PRESCRIBED IN THE CALIFORNIA BUILDING CODE CBC SECTION 101A.3.2.4, FIRE CODE SECTION 4906, INCLUDING CALIFORNIA PUBLIC RESOURCES CODE 4291 OR CALIFORNIA GOVERNMENT CODE SECTION 51182
- APPROVED AUTOMATIC FIRE SPRINKLER SYSTEM: A NFPA 13 FIRE SPRINKLER SYSTEM WILL REQUIRE A WATER TANK MEETING MFPA 1142 SIZING. THE OWNER(S), OCCUPANT(S) AND ANY CONTRACTOR(S) OR SUBCONTRACTOR(S) ARE RESPONSIBLE FOR CONSULTING WITH THE WATER PURVEYOR OF RECORD IN ORDER TO DETERMINE IF ANY MODIFICATION OR UPGRADE OF THE EXISTING WATER SERVICE IS REQUIRED. A STATE OF CALIFORNIA LICENSED (C-16) FIRE PROTECTION CONTRACTOR SHALL SUBMIT PLANS, CALCULATIONS, A COMPLETED PERMIT APPLICATION AND APPROPRIATE FEES TO THIS DEPARTMENT FOR REVIEW AND APPROVAL PRIOR TO BEGINNING THEIR WORK.
- WATER SUPPLY REQUIREMENTS: POTABLE WATER SUPPLIES SHALL BE PROTECTED FROM CONTAMINATION CAUSED BY FIRE PROTECTION SUPPLIES. IT IS THE RESPONSIBILITY OF THE APPLICANT AND ANY CONTRACTORS AND SUBCONTRACTORS TO CONTACT THE WATER PURVEYOR SUPPLYING THE SITE OF SUCH PROJECT, AND TO COMPLY WITH THE REQUIREMENTS OF THAT PURVEYOR. SUCH REQUIREMENT SHALL BE INCORPORATED INTO THE DESIGN OF ANY WATER-BASED FIRE PROTECTION SYSTEMS, AND / OR FIRE SUPPRESSION WATER SYSTEMS OR STORAGE CONTAINERS THAT MAY BE PHYSICALLY CONNECTED IN ANY MANNER TO AN APPLIANCE CAPABLE OF CAUSING CONTAMINATION OF THE POTABLE WATER SUPPLY OF THE PURVEYOR OF RECORD. FINAL APPROVAL OF THE SYSTEM(S) UNDER CONSIDERATION WILL NOT BE GRANTED BY THIS OFFICE UNTIL COMPLIANCE WITH THE REQUIREMENTS OF THE WATER PURVEYOR OF RECORD ARE DOCUMENTED BY THAT PURVEYOR AS HAVING BEEN MET BY THE APPLICANT(S), 2016 CFC 903.3.5 AND HEALTH AND SAFETY CODE 13114.7.
- FIRE APPARATUS (ENGINE) ACCESS DRIVEWAY REQUIRED : PROVIDE AN ACCESS DRIVEWAY WITH A PAYED ALL WEATHER SURFACE, A MINIMUM UNOBSTRUCTED WIDTH OF 14 FEET, VERTICAL CLEARANCE OF 13 FEET 6 INCHES, MINIMUM CIRCULATING TURNING RADIUS OF 36 FEET OUTSIDE AND 23 FEET INSIDE, AND A MAXIMUM SLOPE OF 15%. INSTALLATIONS SHALL CONFORM TO FIRE DEPARTMENT STANDARD DETAILS AND SPECIFICATIONS SHEET D-1. CFC SEC 503.
- ADDRESS IDENTIFICATION: NEW AND EXISTING BUILDINGS SHALL HAVE APPROVED ADDRESS NUMBERS, BUILDING NUMBERS OR APPROVED BUILDING IDENTIFICATION PLACED IN A POSITION THAT IS PLAINLY LEGIBLE AND VISIBLE FROM THE STREET OR ROAD FRONTING THE PROPERTY. THESE NUMBERS SHALL CONTRAST WITH THEIR BACKGROUND. WHERE REQUIRED BY THE FIRE OFFICIAL, ADDRESS NUMBERS SHALL BE PROVIDED IN ADDITIONAL APPROVED LOCATIONS TO FACILITATE EMERGENCY RESPONSE. ADDRESS NUMBERS SHALL BE ARABIC NUMBERS OR ALPHABETICAL LETTERS. NUMBERS SHALL BE A MINIMUM OF 4 INCHES (101,6mm) HIGH WITH A MINIMUM STROKE WIDTH OF 0.5 INCH (12.7mm), WHERE ACCESS IS BY MEANS OF A PRIVATE ROAD AND THE BUILDING CANNOT BE VIEWED FROM THE PUBLIC WAY, A MONUMENT, POLE OR OTHER SIGN OR MEANS SHALL BE USED TO IDENTIFY THE STRUCTURE. ADDRESS NUMBERS SHALL BE MAINTAINED. CFC SEC 505.1.

Consultants **CIVIL ENGINEER**

Hanna Brunetti Associates 7651 Eigleberry Street Gilroy, California 95020 (408) 842-2173 amanda@hannabrunetti.com

STRUCTURAL ENGINEER Wesley Liu Engineering, Inc. 7246 Sharon Drive, Suite #O San Jose, California 95129 (408) 973-1839 wesleyliu@yahoo.com

Drawing Index

Title Sheet

T1.1 FAR Diagram / Calculations

SURVEY

Existing Topographic Survey

CIVIL

Grading & Drainage Plan

Construction BMPs

ARCHITECTURAL

- A1 Architectural Site Plan
- **A2** Lower Level Floor Plan
- **Upper Level Floor Plan**
- **Exterior Elevations**
- **Exterior Elevations**
- **Cross Sections**
- Roof Plan **A7**

STRUCTURAL

Shear Wall Schedule, Abbreviations, General Notes

- Foundation Plan **S1**
- **Foundation Details**
- 2nd Level Floor Framing Plan
- **Roof Framing Plan**
- **Structural Details**
- **Structural Details**

ELECTRICAL

E1 Entry Level Electrical Plan

E2 2nd Level Electrical Plan

LANDSCAPE

L-1 Landscape Plan

L-1.1 Tree Replacement Plan

Project Data

Owner Data

1975 Hayes Lane San Martin, California 95046

Lot Data

779-46-007 Lot Size: **Property Submittal Location:** Santa Clara County

Existing Uses: Single Family Residence **Zoning District:**

Occupancy Groups: R-3/U Type Of Construction:

Fire Sprinklered: **YES, NFPA 13 w/ NFPA 1142** NFPA 1142 Tank Sizing

Slope at Building Site: Average Site Slope: Allowable Floor Area: - sq.ft. **Allowable Building Coverage:** - sq.ft. **Site Setbacks:**

Side (1st flr): 30'

Side (2nd flr): 30'

Maximum Building Height: Proposed Conditions


Front:30'

Entry Level Living Area: 2880 sq.ft. 2nd Level Living Area: 2933 sq.ft. **Total Floor Area: 5813** sq.ft.

Covered Area Allowed: - sq.ft. Proposed Covered Area: 0 sq.ft.

5046

LOS ALTOS, CALIFORNIA 94022 PHONE: (408) 309-2163 FAX: (650) 559-0458 E-MAIL: scott@stotlerdesigngroup.com



Sheet


cesso]

None PROJECT MANAGER <u>S. Stotler</u>

SDG SHEET


Mar Ø1, 2023



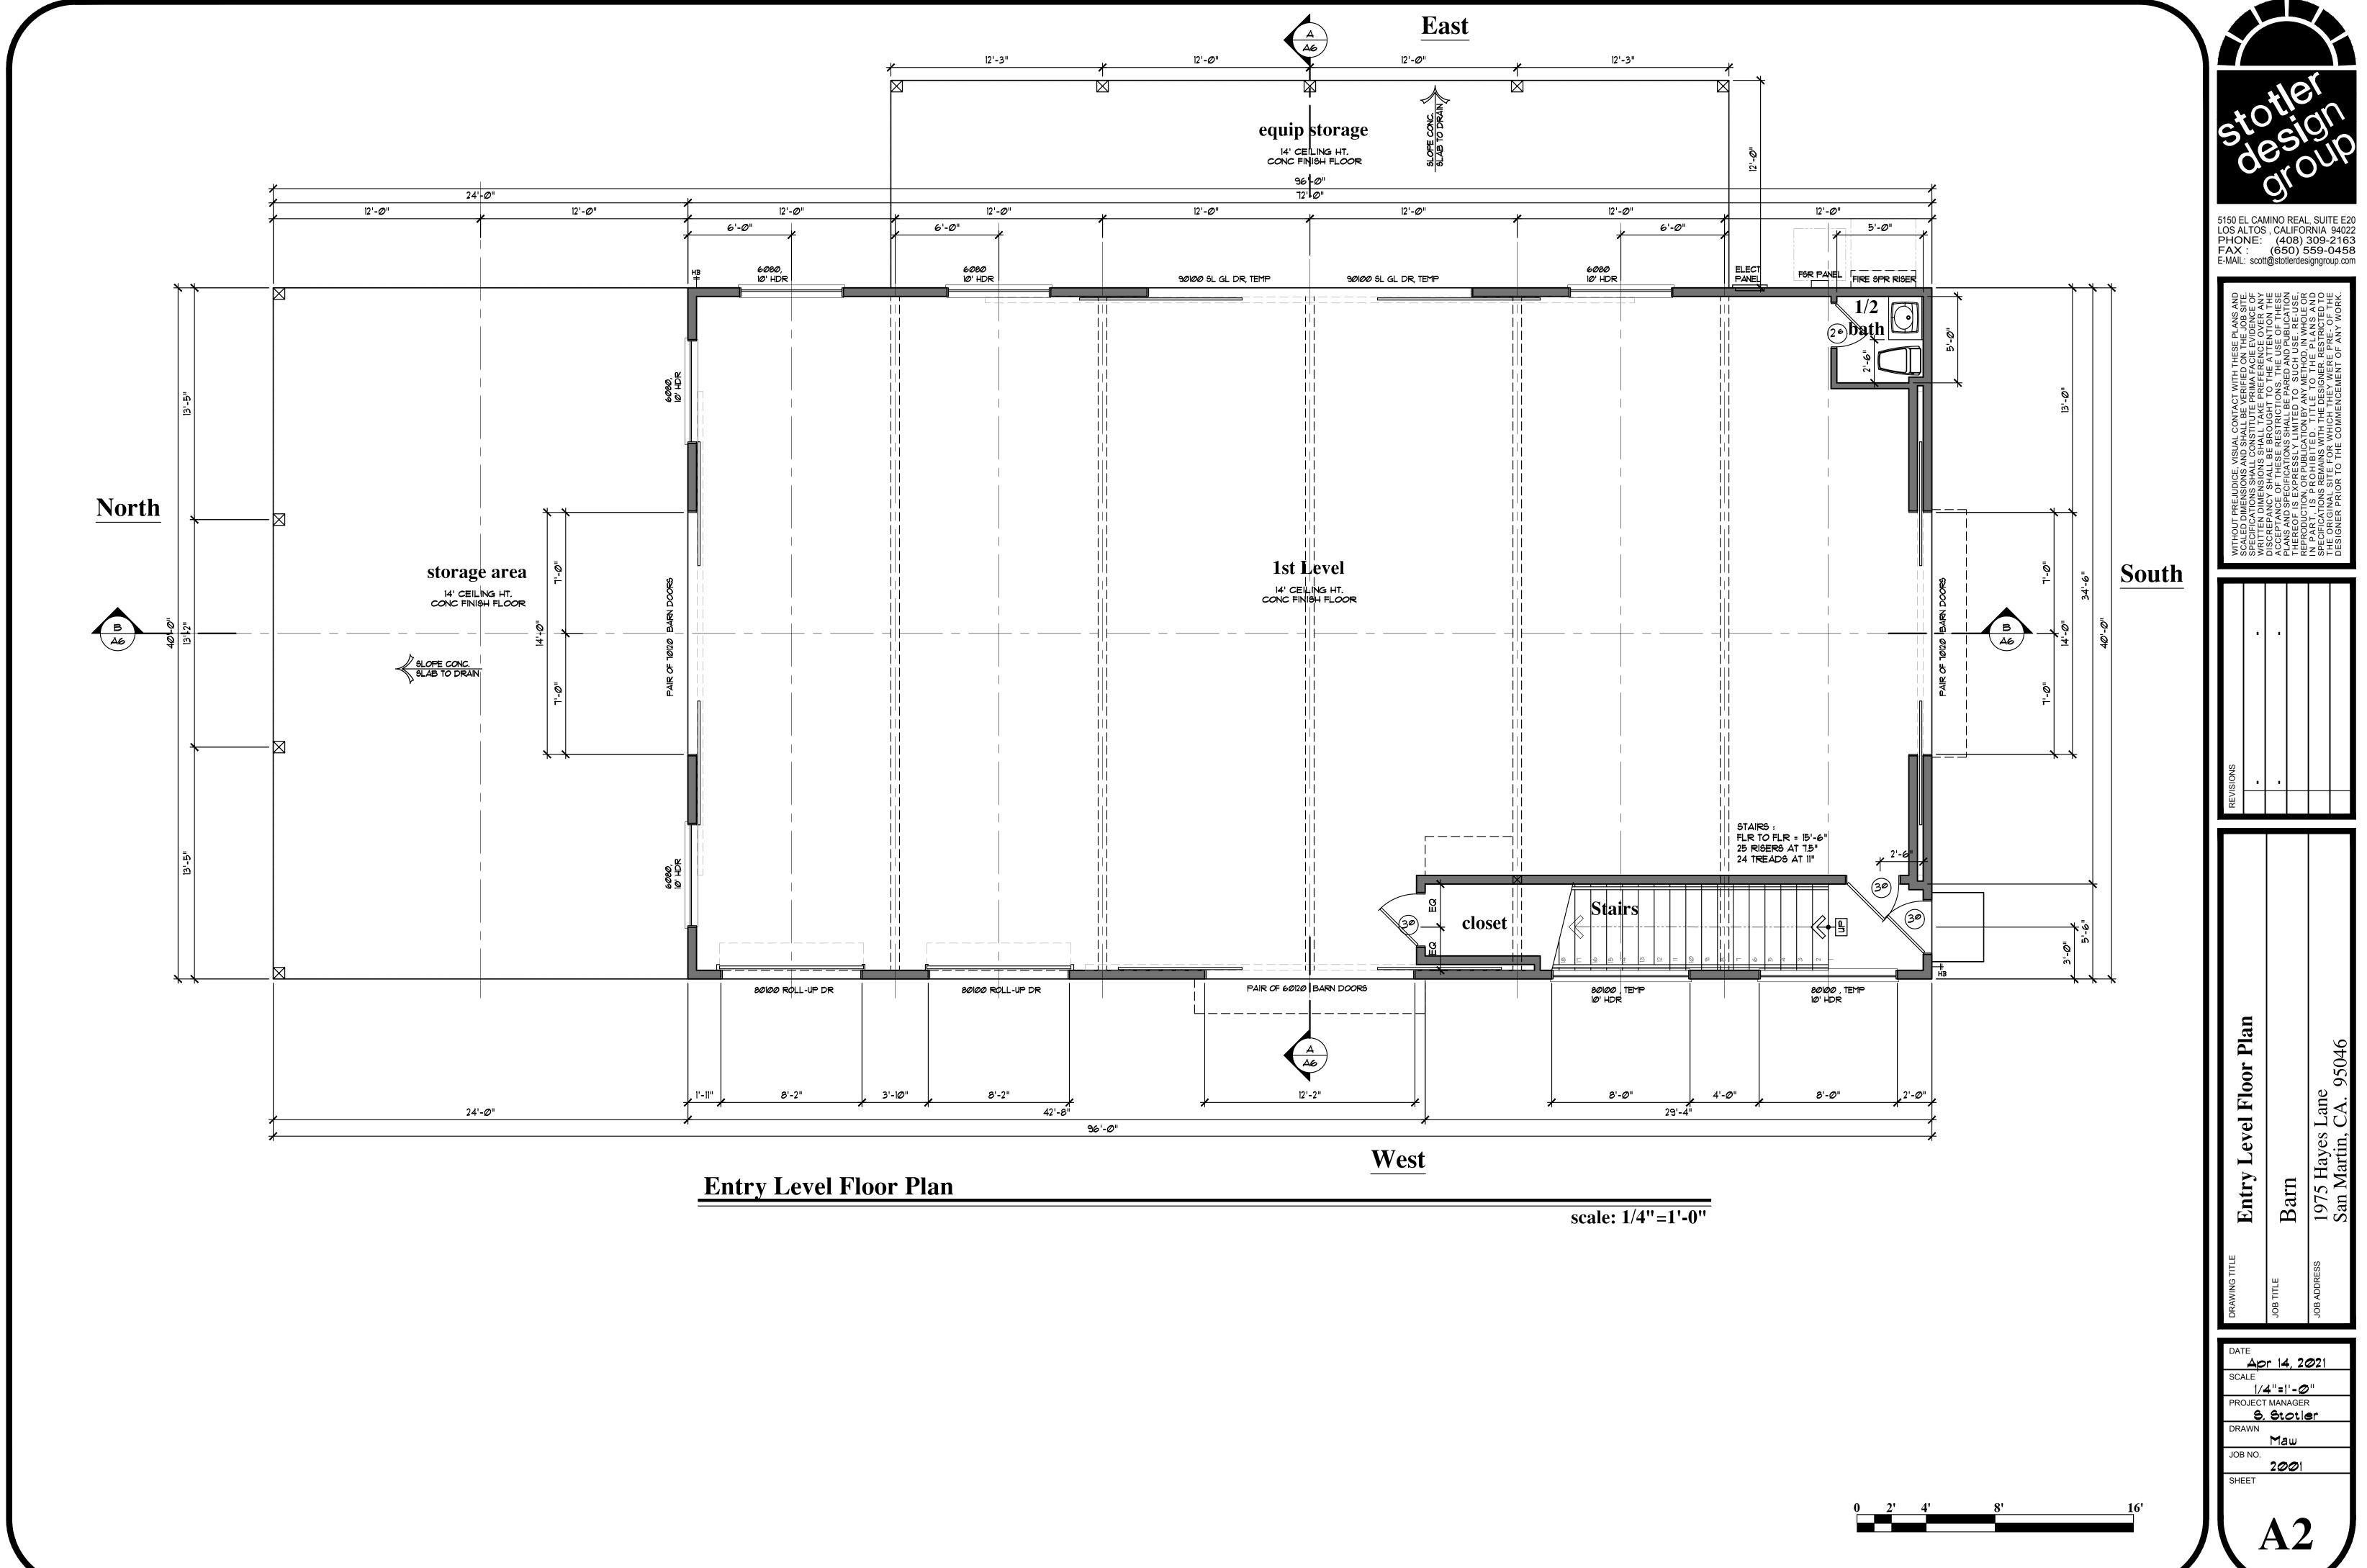


	•	•		
SNC				
REVISIONS	_	_		

Entry Level Floor Plan	Barn	1975 Hayes Lane San Martin, CA. 95046
DRAWING TITLE	JOB TITLE	JOB ADDRESS

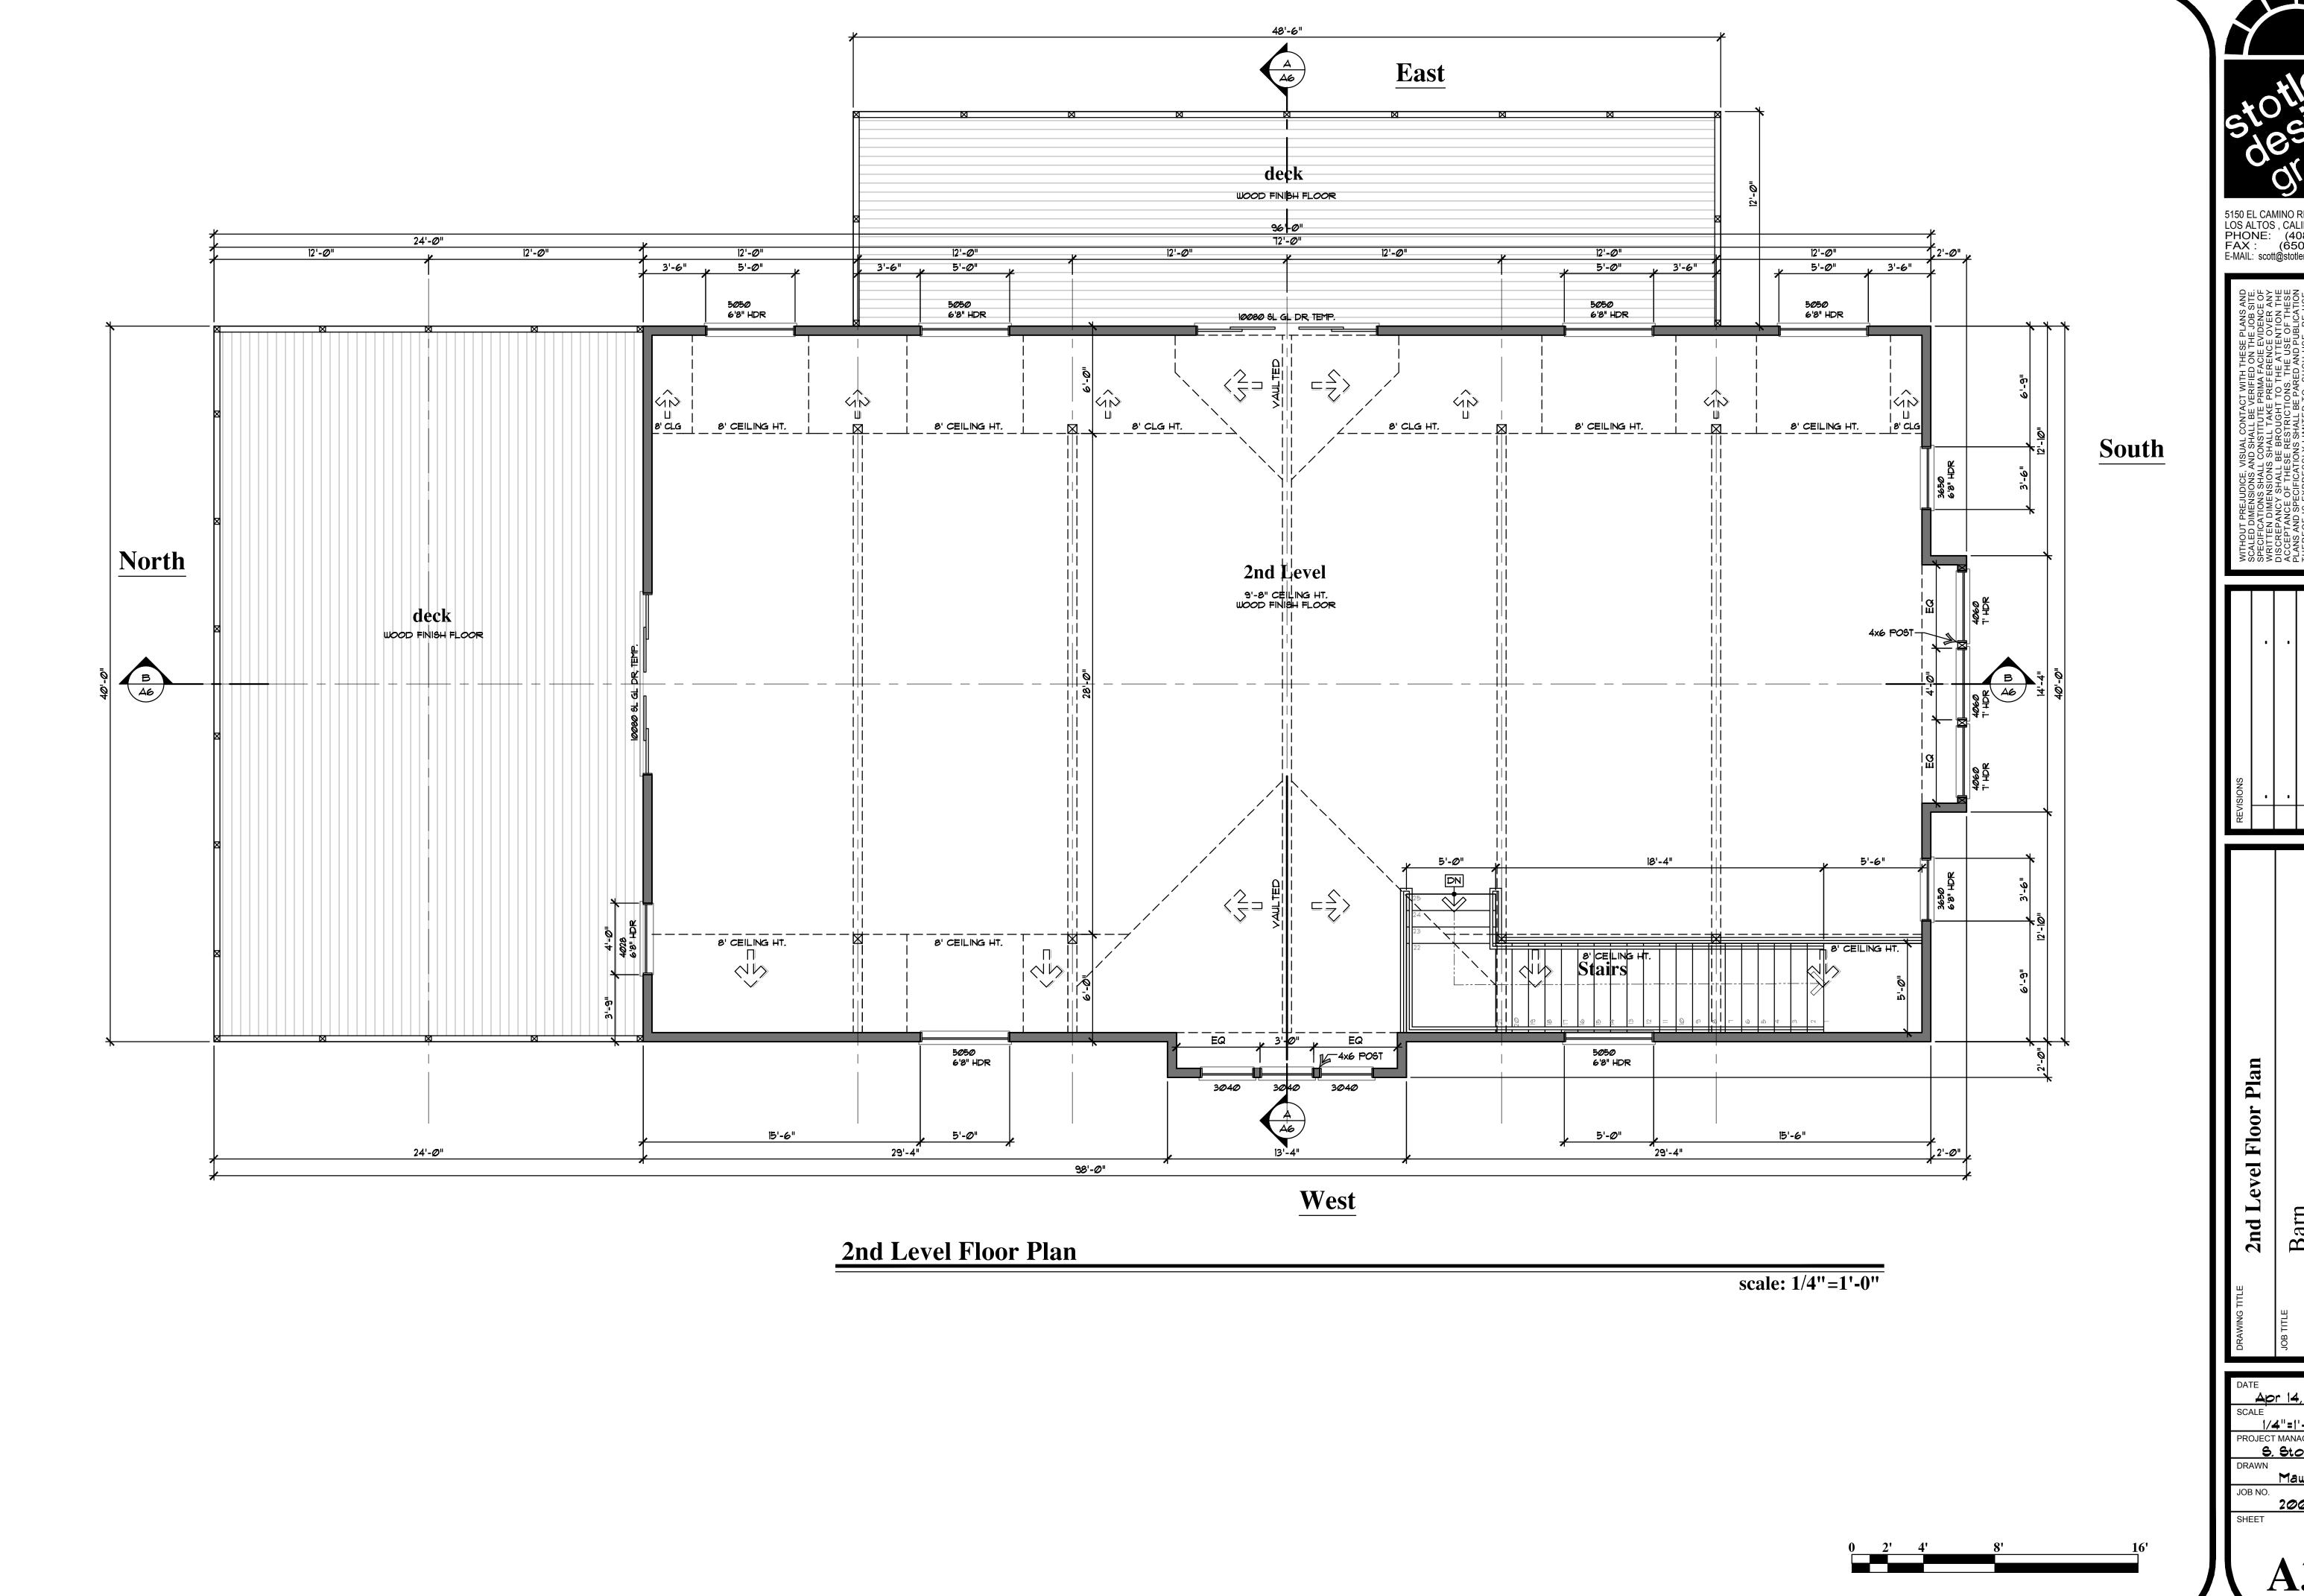

5150 EL CAMINO REAL, SUITE E20 LOS ALTOS , CALIFORNIA 94022 PHONE: (408) 309-2163 FAX: (650) 559-0458 E-MAIL: scott@stotlerdesigngroup.com

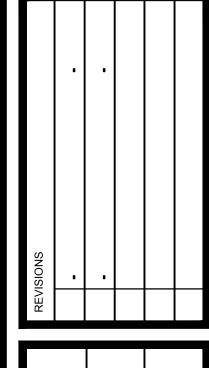

AAWING TITLE DB TITLE	2nd Level Floor Plan Barn
OB ADDRESS	1975 Hayes Lane San Martin, CA. 95046

|**/4"=|'-⊘"**PROJECT MANAGER S. Stotler



Exterior Elevation - Front - South

scale: 1/4"=1'-0"

Keyed Notes

- 1. .75"x3.5" 'HARDIETRIM' BD. 4/4 SMOOTH AT WINDOW HEADER TRIM, WITH Z-FLASHING, TYP.
- 2. PROVIDE I" OVERLAP AT TOP TRIM.
- 3. .75"x3.5" 'HARDIETRIM' BD. 4/4 \$MOOTH AT WINDOW & DOOR TRIM, TYP.
- 4. 2x4 546 ADVANTAGE PLUS SILL, SLOPED FOR DRAINAGE, TYP.
- 5. .75"x3.5" 'HARDIETRIM' BD. 4/4 SMOOTH AT WINDOW TRIM, TYP.
- 6. 6x10 SHAPED CORBEL.
- 7. 2x6 545 ADVANTAGE PLUS CORNER TRIM, TYP.
- 8. ROOFING SHALL BE METAL RIBBED ROOFING, MFG'D BY "TUFF-RIB METAL ROOFING" OR EQUAL, INSTALL PER MFG'S SPEC'S, O/ CLASS "A" ROOFING.
- 9. 5" MIN, 26 GAUGE GALY. FASCIA GUTTER W/ DOWNSPOUTS, AS NECESSARY.
- 10. 2x8 545 ADVANTAGE PLUS FASCIA BOARD, TYP.
- 11. HARDIE PANEL EXTERIOR W/.75"x2.5" HARDIETRIM BATTENS, o/ 1/2" PLYWOOD SHEATHING (REFER TO STRUCTURAL DWGS) o/ #15 ASPHALT FELT, CRC R703.
- 12. BARN DOOR AND TRACK
- 13. 2x12 D.F. GABLE END BARGE RAFTER, PAINTED.
- 14. 42" HIGH GUARDRAIL.
- 15. 8x8 POST

EXTERIOR ELEVATION GENERAL NOTES :

THIS PROJECT IS LOCATED WITHIN THE DESIGNATED "WUI" ZONE (WILDLAND-URBAN INTERFACE) FIRE ZONE. THE BUILDING CONSTRUCTION SHALL COMPLY WITH THE PROVISIONS OF CRC R32T (CALIFORNIA RESIDENTIAL CODE) & CBC CHAPTER TA CALIFORNIA BUILDING CODE , REFER TO "WILDLAND-URBAN INTERFACE NOTES" ON SHEET TI.

ROOFING-3: PROVIDE METAL RIBBED ROOFING, MFGR BY "TUFF-RIB METAL ROOFING" OR BY OTHERS, INSTALL PER MFGR SPECS. OVER CLASS "A" UNDERLAYMENT: *30 FELT OR (2)-LAYER *15 FELT o/ 1/2" PLYWOOD SHEATHING W/8d @ 6" O.C.E. & 12"O.C.F., REFER TO STRUCTURAL DRAWINGS FOR PLYWD AND NAILING SPECS.

GUTTER: 5" 26 G.A. G.I. FASCIA GUTTER 0/2x8 S4S ADVANTAGE PLUS FASCIA BOARD, TYPICAL. PROVIDE SCREEN TO PROTECT FROM LEAF ACCUMULATION.

EAVE SOFFIT: TAG DECKING.

SIDING: HARDIE PANEL EXTERIOR W/ .75"x2.5" HARDIETRIM BATTENS, o/ HARDI PANEL o/"
PLYWOOD SHEATHING (REFER TO STRUCTURAL DWGS) o/ WATER RESISTIVE BARRIER

TRIM BOARDS: 2x ADVANTAGE PLUS MATERIAL & HARDIETRIM MATERIAL AS SHOWN



stotler stotler design deroup

5150 EL CAMINO REAL, SUITE E20 LOS ALTOS, CALIFORNIA 94022 PHONE: (408) 309-2163 FAX: (650) 559-0458 E-MAIL: scott@stotlerdesigngroup.com

Exterior Elevations	Barn	1975 Hayes Lane San Martin CA 95046
	JOB TITLE	JOB ADDRESS

	DATE
	May 19, 2022
ı	SCALE
	1/4"=1'-Ø"
	PROJECT MANAGER
	S. Stotler
	DRAWN
	Maw
ı	IOD NO

A4

DESCRIPTION OF THE PLAT TO STAND THE PLAT THE PLAT THE PLAND THE PLAT THE PLAND THE PL

Exterior Elevation - Rear - North

Keyed Notes

- 1. ...15"x3.5" 'HARDIETRIM' BD. 4/4 SMOOTH AT WINDOW HEADER TRIM, WITH Z-FLASHING, TYP.
- 2. PROVIDE I" OVERLAP AT TOP TRIM.
- 3. .75"x3.5" 'HARDIETRIM' BD. 4/4 SMOOTH AT WINDOW & DOOR TRIM, TYP.
- 4. 2x4 646 ADVANTAGE PLUS SILL, SLOPED FOR DRAINAGE, TYP.
- 5. .75"x3.5" 'HARDIETRIM' BD. 4/4 SMOOTH AT WINDOW TRIM, TYP.
- 6. 6xIØ SHAPED CORBEL.
- 1. 2x6 949 ADVANTAGE PLUS CORNER TRIM, TYP.
- 8. ROOFING SHALL BE METAL RIBBED ROOFING, MFG'D BY "TUFF-RIB METAL ROOFING" OR EQUAL, INSTALL PER MFG'S SPEC'S, 0/ CLASS "A" ROOFING.
- 9. 5" MIN, 26 GAUGE GALY. FASCIA GUTTER W/ DOWNSPOUTS, AS NECESSARY.
- 10. 2x8 545 ADVANTAGE PLUS FASCIA BOARD, TYP.
- 11. HARDIE PANEL EXTERIOR W/ .75"x2.5" HARDIETRIM BATTENS, o/ 1/2" PLYWOOD SHEATHING (REFER TO STRUCTURAL DWGS) o/ #15 ASPHALT FELT, CRC R703.
- 12. BARN DOOR AND TRACK
- 13. 2x12 D.F. GABLE END BARGE RAFTER, PAINTED.
- 14. 42" HIGH GUARDRAIL.
- 15. 8x8 POST

scale: 1/4"=1'-0"

EXTERIOR ELEVATION GENERAL NOTES :

THIS PROJECT IS LOCATED WITHIN THE DESIGNATED "WUI" ZONE (WILDLAND-URBAN INTERFACE) FIRE ZONE. THE BUILDING CONSTRUCTION SHALL COMPLY WITH THE PROVISIONS OF CRC R327 (CALIFORNIA RESIDENTIAL CODE) & CBC CHAPTER TA CALIFORNIA BUILDING CODE , REFER TO "WILDLAND-URBAN INTERFACE NOTES" ON SHEET TI.

ROOFING-3: PROVIDE METAL RIBBED ROOFING, MFGR BY "TUFF-RIB METAL ROOFING" OR BY OTHERS, INSTALL PER MFGR SPECS. OVER CLASS "A" UNDERLAYMENT: *30 FELT OR (2)-LAYER *15 FELT O/ 1/2" PLYWOOD SHEATHING W/8d @ 6" O.C.E. & 12"O.C.F., REFER TO STRUCTURAL DRAWINGS FOR PLYWD AND NAILING SPECS.

GUTTER: 5" 26 G.A. G.I. FASCIA GUTTER 0/2x8 S4S ADVANTAGE PLUS FASCIA BOARD, TYPICAL. PROVIDE SCREEN TO PROTECT FROM LEAF ACCUMULATION.

EAVE SOFFIT: T&G DECKING.

SIDING: HARDIE PANEL EXTERIOR W/ .75"x2.5" HARDIETRIM BATTENS, O/ HARDI PANEL O/"
PLYWOOD SHEATHING (REFER TO STRUCTURAL DWGS) O/ WATER RESISTIVE BARRIER

TRIM BOARDS: 2x ADVANTAGE PLUS MATERIAL & HARDIETRIM MATERIAL AS SHOWN

stotler stotler design deroup

5150 EL CAMINO REAL, SUITE E20 LOS ALTOS, CALIFORNIA 94022 PHONE: (408) 309-2163 FAX: (650) 559-0458 E-MAIL: scott@stotlerdesigngroup.com

SCALED DIMENSIONS AND SHALL BE VERIFIED ON THE JOBS SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE WRITTEN DIMENSIONS SHALL TAKE PREFERENCE OVER A DISCREPANCY SHALL BE BROUGHT TO THE ATTENTION ACCEPTANCE OF THESE RESTRICTIONS. THE USE OF THIS PLANS AND SPECIFICATIONS SHALL BE PARED AND PUBLICAT THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-UREPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE IN PART, IS PROHIBITED. TITLE TO THE PLANS A SPECIFICATIONS REMAINS WITH THE DESIGNER. RESTRICTET THE ORIGINAL SITE FOR WHICH THEY WERE PRE-OF DESIGNER PRIOR TO THE COMMENCEMENT OF ANY WO

REVISIONS
-

Exterior Elevations

Barn

Barn

1975 Hayes Lane

San Martin CA 95046

DATE

May 19, 2022

SCALE

1/4"=1'-0"

PROJECT MANAGER

S. Stotler


DRAWN

Maw

JOB NO.

A5



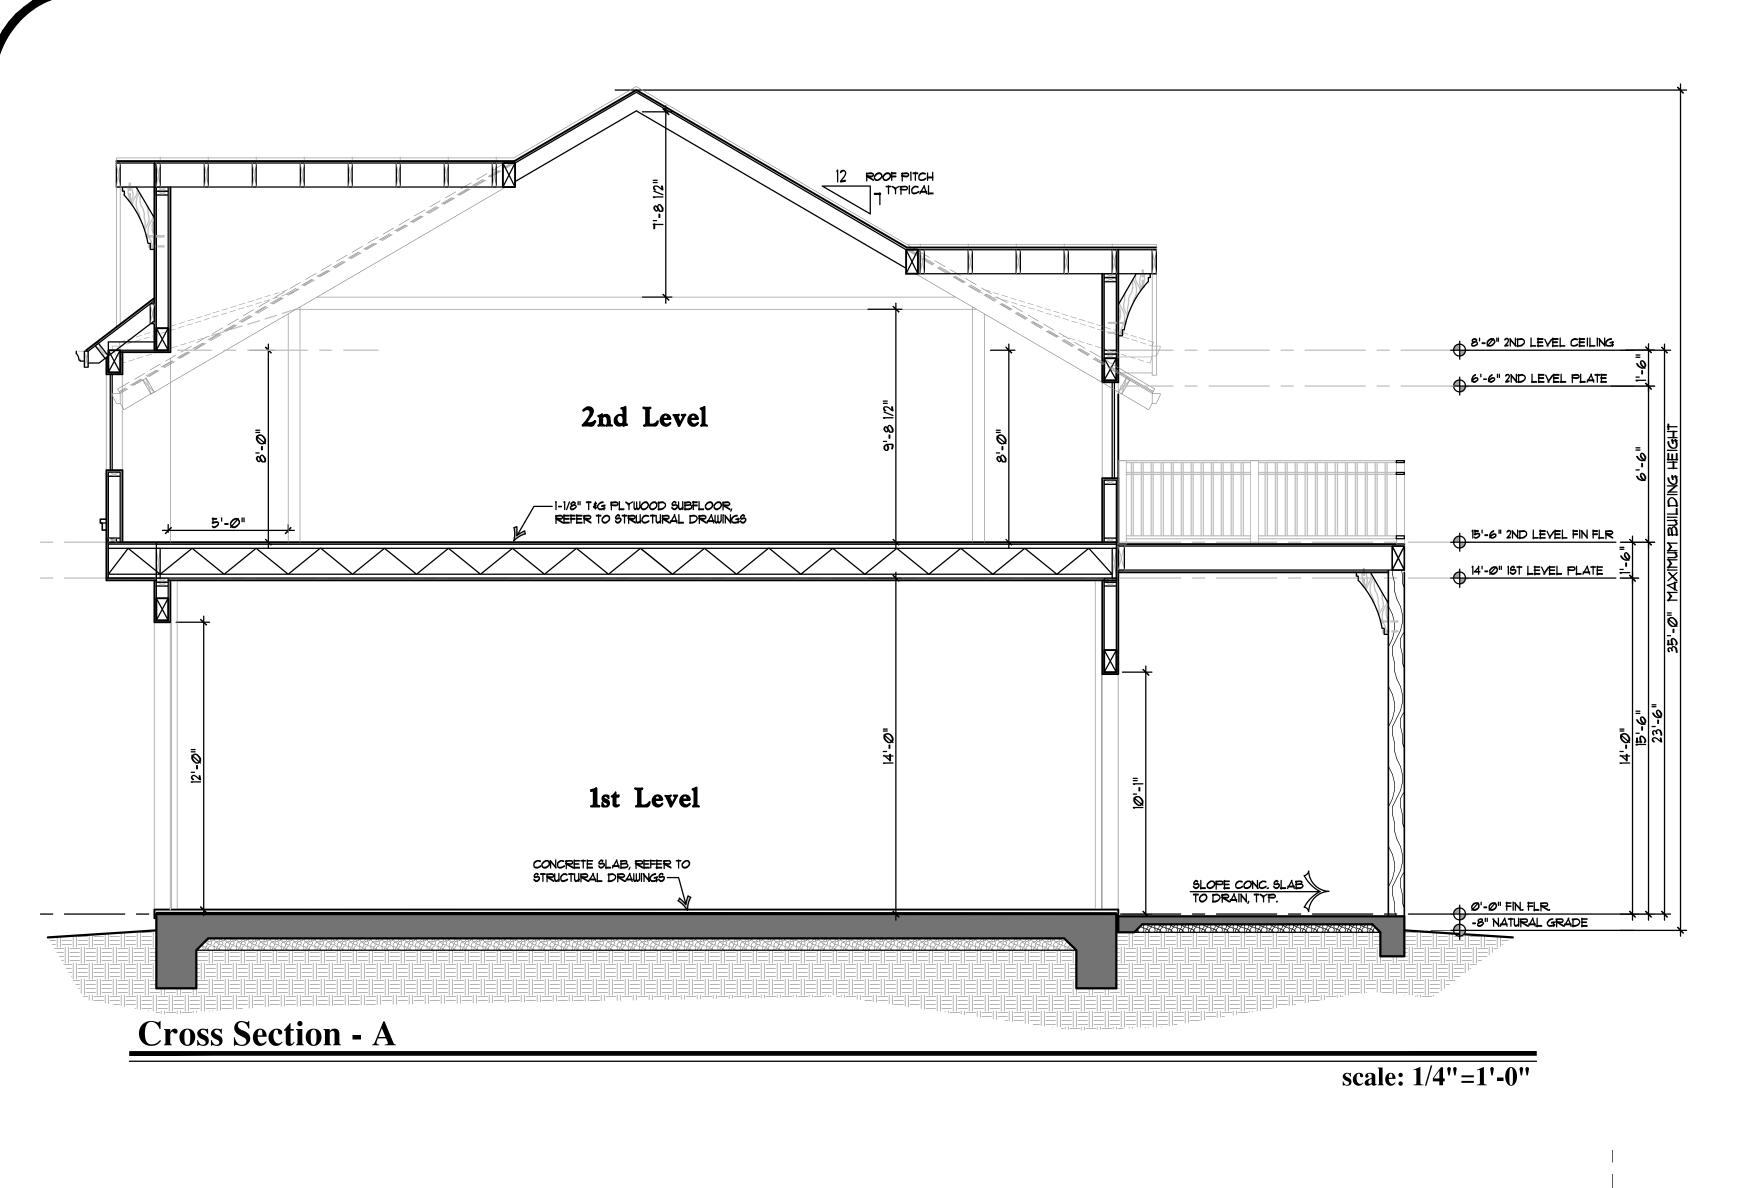

Keyed Notes

- 1. .75"x3.5" 'HARDIETRIM' BD. 4/4 SMOOTH AT WINDOW HEADER TRIM, WITH Z-FLASHING, TYP.
- 2. PROVIDE I" OVERLAP AT TOP TRIM.
- 3. . . 15"x3.5" 'HARDIETRIM' BD. 4/4 SMOOTH AT WINDOW & DOOR TRIM, TYP.
- 4. 2x4 545 ADVANTAGE PLUS SILL, SLOPED FOR DRAINAGE, TYP.
- 5. .75"x3.5" 'HARDIETRIM' BD. 4/4 SMOOTH AT WINDOW TRIM, TYP.
- 6. 6x10 SHAPED CORBEL.
- 1. 2x6 545 ADVANTAGE PLUS CORNER TRIM, TYP.
- 8. ROOFING SHALL BE METAL RIBBED ROOFING, MFG'D BY "TUFF-RIB METAL ROOFING" OR EQUAL, INSTALL PER MFG'S SPEC'S, o/ CLASS "A" ROOFING.
- 9. 5" MIN, 26 GAUGE GALY. FASCIA GUTTER W/ DOWNSPOUTS, AS NECESSARY.
- IØ. 2x8 949 ADVANTAGE PLUS FASCIA BOARD, TYP.
- 11. HARDIE PANEL EXTERIOR W/.75"x2.5" HARDIETRIM BATTENS, O/ 1/2" PLYWOOD SHEATHING (REFER TO STRUCTURAL DWGS) O/ #15 ASPHALT FELT, CRC R703.
- 12. BARN DOOR AND TRACK
- 13. 2x12 D.F. GABLE END BARGE RAFTER, PAINTED.
- 14. 42" HIGH GUARDRAIL.
- 15. 8x8 POST

CROSS SECTION GENERAL NOTES :

THIS PROJECT IS LOCATED WITHIN THE DESIGNATED "WUI" ZONE (WILDLAND-URBAN INTERFACE)
FIRE ZONE. THE BUILDING CONSTRUCTION SHALL COMPLY WITH THE PROVISIONS OF CRC R327
(CALIFORNIA RESIDENTIAL CODE) & CBC CHAPTER TA CALIFORNIA BUILDING CODE , REFER TO
"WILDLAND-URBAN INTERFACE NOTES" ON SHEET TI.

CROSS SECTIONS ARE DIAGRAMMATIC AND USED FOR CONSTRUCTION FRAMING PURPOSES ONLY AND MAY NOT REPRESENT EXACT FRAMING METHODS, CONTRACTOR TO USE FRAMING METHOD OUTLINED IN I.B.C., C.R.C. OR REGISTERED ENGINEERS FRAMING DETAILS, SEE STRUCTURAL FRAMING DRAWINGS AND DETAILS.

ROOFING-3: PROVIDE METAL RIBBED ROOFING, MFGR BY "TUFF-RIB METAL ROOFING" OR BY OTHERS, INSTALL PER MFGR SPECS. OVER CLASS "A" UNDERLAYMENT: *30 FELT OR (2)-LAYER *15 FELT O/ 1/2" PLYWOOD SHEATHING W/8d @ 6" O.C.E. & 12"O.C.F., REFER TO STRUCTURAL DRAWINGS FOR PLYWD AND NAILING SPECS.

GUTTER: 5" 26 G.A. G.I. FASCIA GUTTER 0/2x8 S4S ADVANTAGE PLUS FASCIA BOARD, TYPICAL. PROVIDE SCREEN TO PROTECT FROM LEAF ACCUMULATION.

EAVE SOFFIT: T&G DECKING.

scale: 1/4"=1'-0"


SIDING: HARDIE PANEL EXTERIOR w/.75"x2.5" HARDIETRIM BATTENS, o/ 1/2" PLYWOOD SHEATHING (REFER TO STRUCTURAL DWGS) o/ WATER RESISTIVE BARRIER

TRIM BOARDS: 2x ADVANTAGE PLUS MATERIAL & HARDIETRIM MATERIAL AS SHOWN



5150 EL CAMINO REAL, SUITE E20 LOS ALTOS, CALIFORNIA 94022 PHONE: (408) 309-2163 FAX: (650) 559-0458 E-MAIL: scott@stotlerdesigngroup.com

WITHOUT PREJUDICE, VISUAL CONTACT WITH THESE PLANS AND SCALED DIMENSIONS AND SHALL BE VERFIED ON THE JOB SITE. SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF WRITTEN DIMENSIONS SHALL TAKE PREFERENCE OVER ANY DISCREPANCY SHALL BE BROUGHT TO THE ATTENTION THE ACCEPTANCE OF THESE RESTRICTIONS. THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE PARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE DESIGNER. RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PRE- OF THE DESIGNER PRIOR TO THE COMMENCEMENT OF ANY WORK.

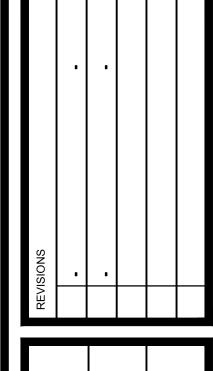

	l	
Cross Sections	Barn	1975 Hayes Lane San Martin, CA. 95046
		SS

DATE
Apr 14, 2021


SCALE
1/4"=1'-0"


PROJECT MANAGER
S. Stotler

DRAWN
Maw

JOB NO.
2001

A6

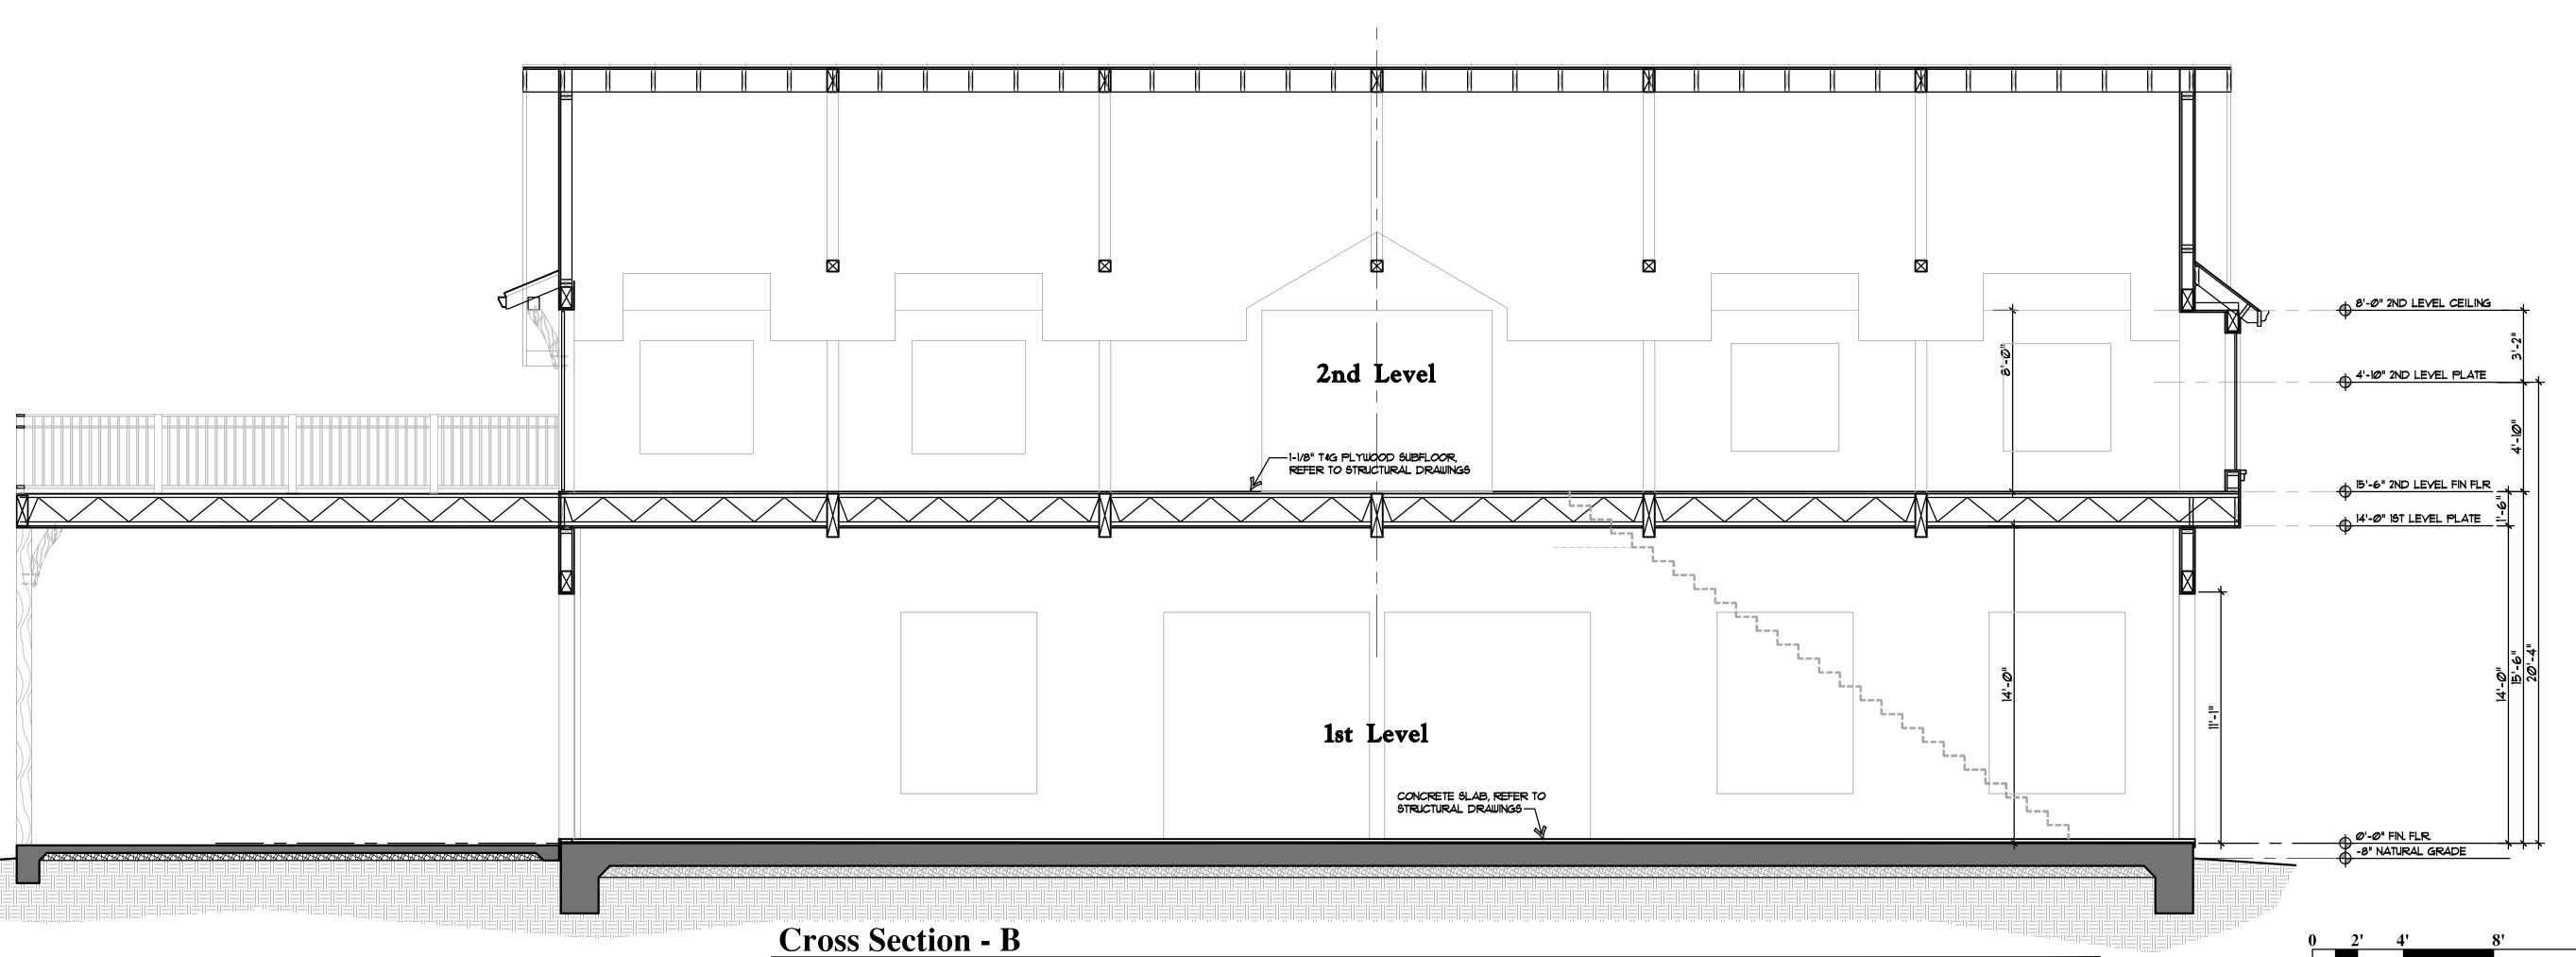

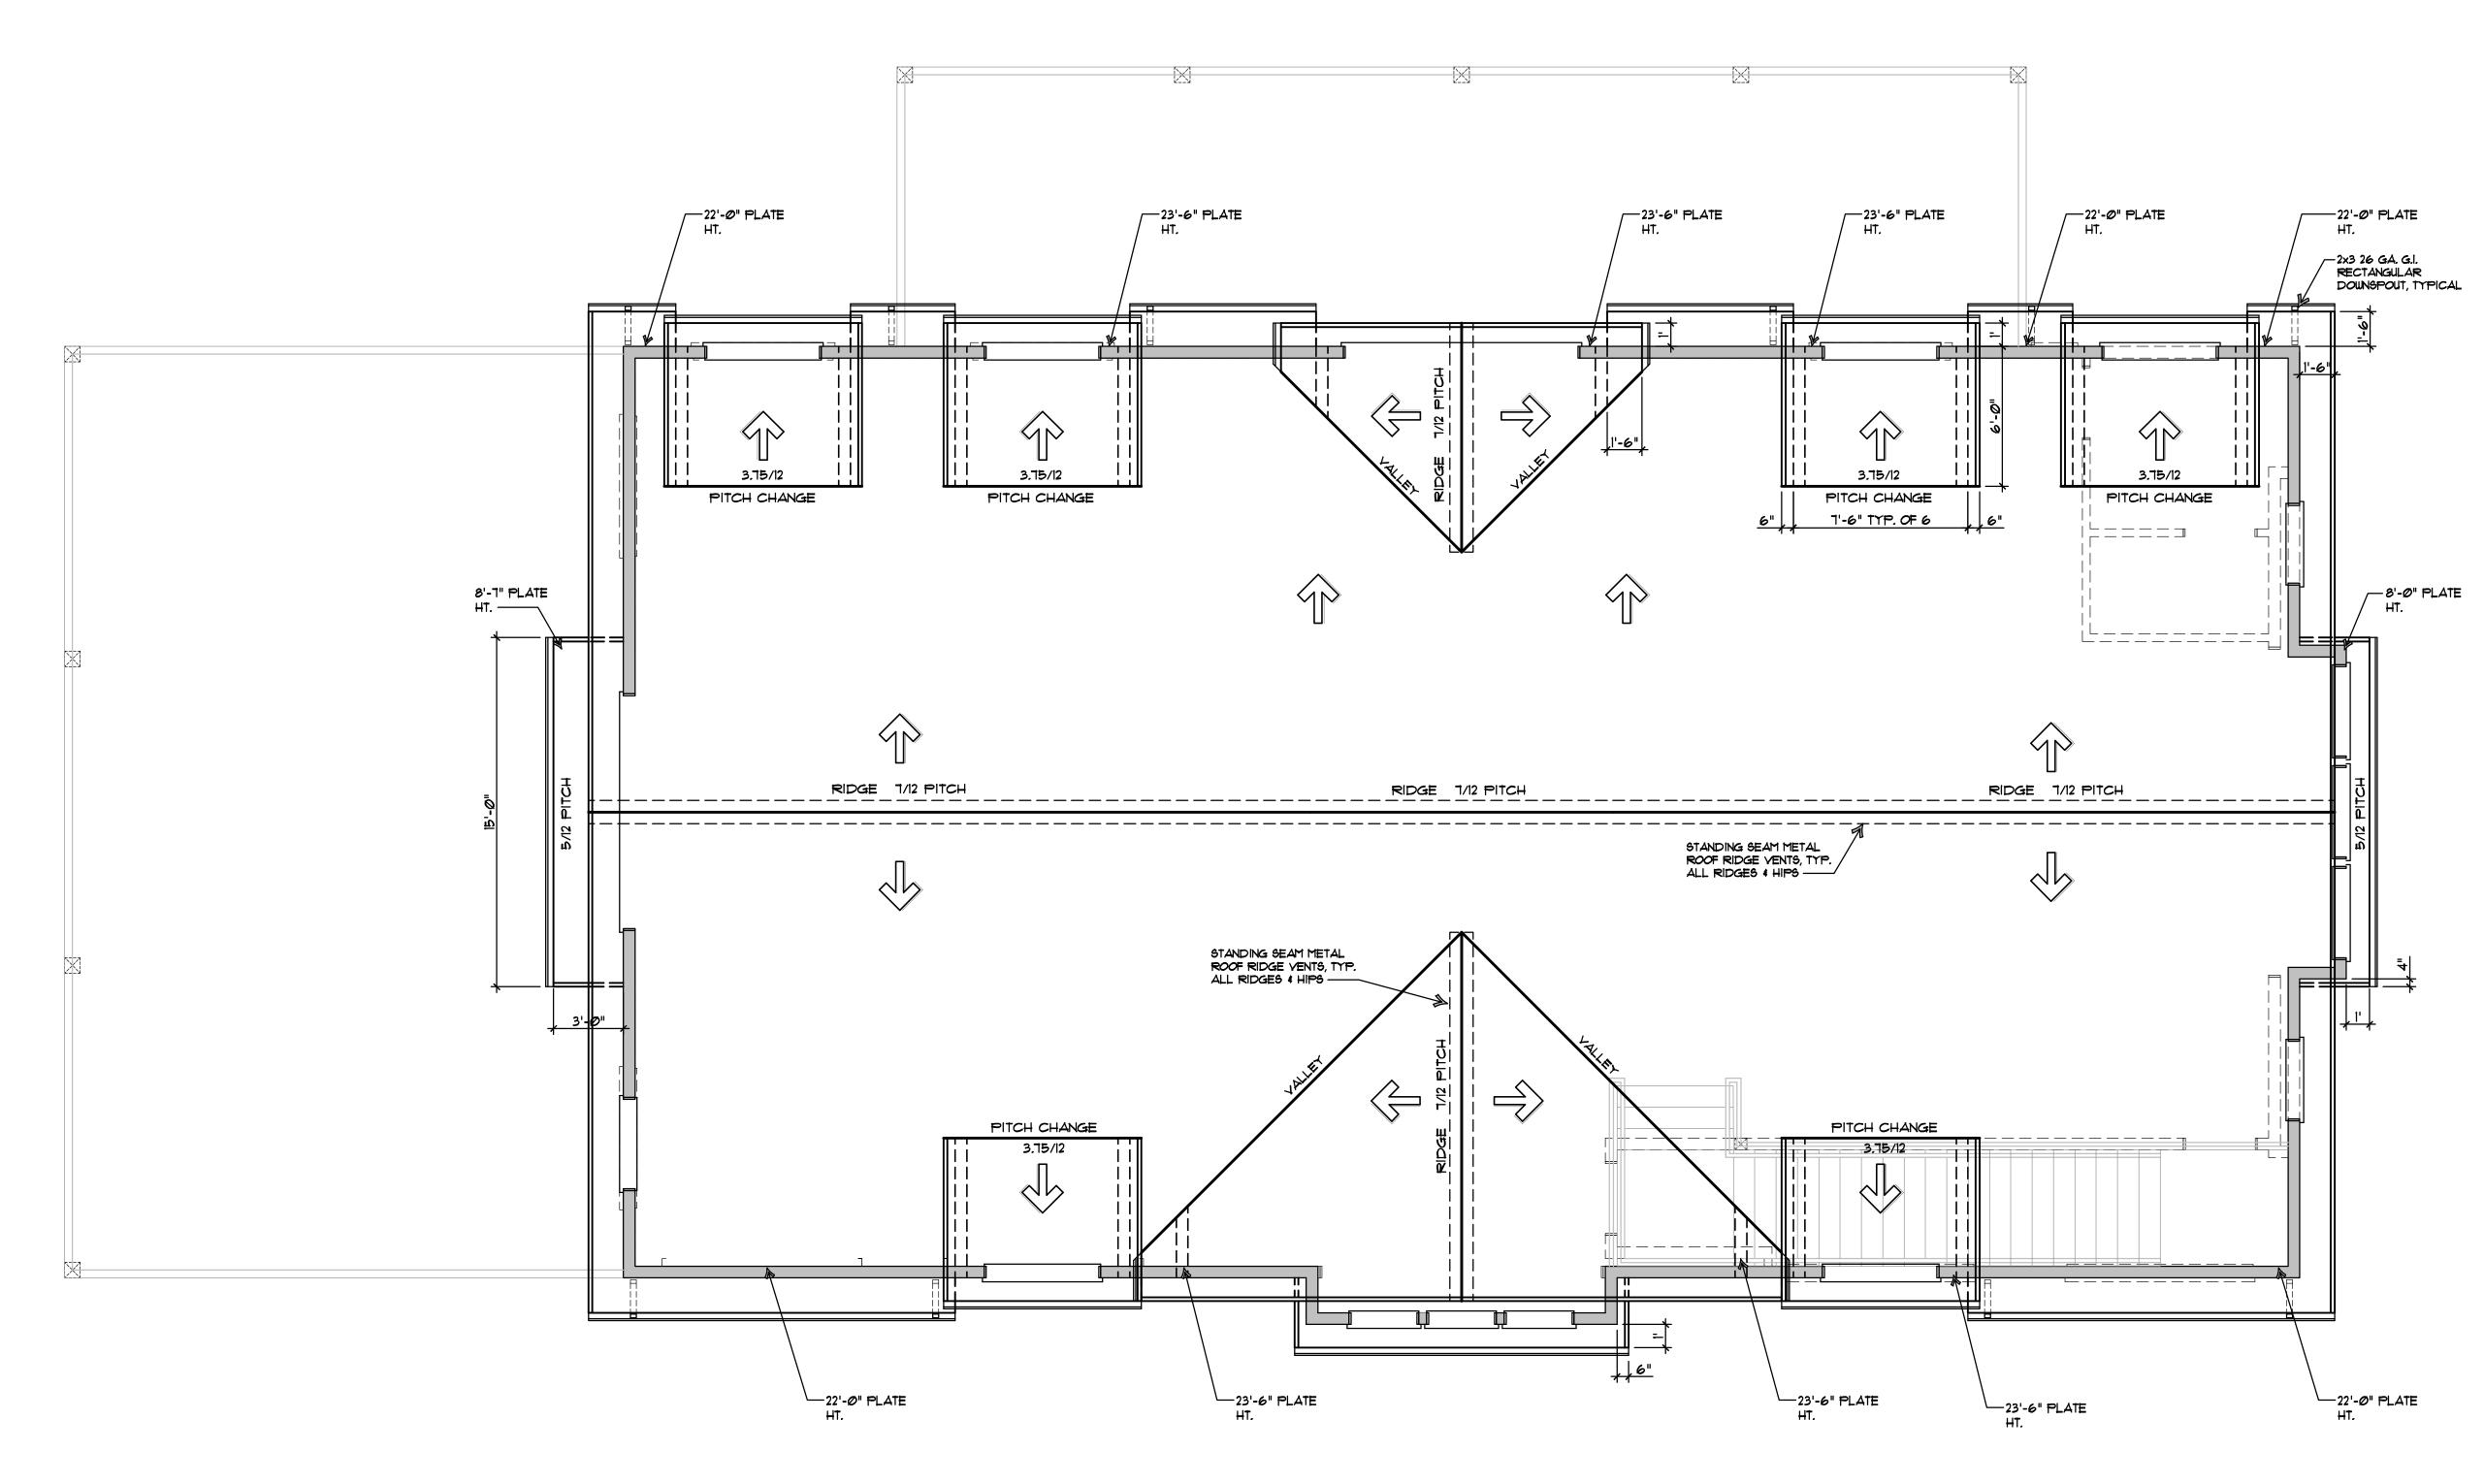

Roof Plan

scale: 1/4"=1'-0"

GENERAL ROOF PLAN NOTES:

THIS PROJECT IS LOCATED WITHIN THE DESIGNATED "WUI" ZONE (WILDLAND-URBAN INTERFACE) FIRE ZONE. THE BUILDING CONSTRUCTION SHALL COMPLY WITH THE PROVISIONS OF CRC R327 (CALIFORNIA RESIDENTIAL CODE) & CBC CHAPTER TA CALIFORNIA BUILDING CODE , REFER TO "WILDLAND-URBAN INTERFACE NOTES" ON SHEET TI.

ROOF COVERING SHALL BE NON-COMBUSTIBLE (I.E. CEMENT SHINGLES/SHEETS, CONCRETE SLAB ROOF, FERROUS OR COPPER SHINGLES/SHEETS, SLATE SHINGLES, CLAY OR CONCRETE ROOFING TILE, ETC.), OR HAS A CLASS-A RATING, (WILLI. REQUIREMENT)

ROOFING-3: PROVIDE METAL RIBBED ROOFING, MFGR BY "TUFF-RIB METAL ROOFING" OR BY OTHERS, INSTALL PER MFGR SPECS. OVER CLASS "A" UNDERLAYMENT: *30 FELT OR (2)-LAYER *15 FELT o/ 1/2" PLYWOOD SHEATHING: w/8d @ 6" O.C.E. & 12"O.C.F., REFER TO STRUCTURAL DRAWINGS FOR PLYWD AND NAILING: SPECS.

EAVE SOFFIT: TEG DECKING.

PLATE HEIGHT TO BE 22'-0", UN.O.

ROOF SLOPE IS TO BE 7:12, TYPICAL UN.O.

OVERHANGS ARE TO BE 18" AT EAVES & 18" AT RAKES, TYPICAL UN.O.

ARROWS INDICATE DIRECTION OF ROOF SLOPE.

PROVIDE 26 GA. MIN. GALV. SHT. MTL. FLASHING AS NECESSARY, AT EAVES, & AND ALL POINT TO PROTECT FROM WEATHERING, TYP.

0 2' 4' 8' 16'



5150 EL CAMINO REAL, SUITE E20 LOS ALTOS, CALIFORNIA 94022 PHONE: (408) 309-2163 FAX: (650) 559-0458 E-MAIL: scott@stotlerdesigngroup.com

WITHOUT PREJUDICE, VISUAL CONTACT WITH THESE PLANS AND
SCALED DIMENSIONS AND SHALL BE VERIFIED ON THE JOB SITE.
SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF
WRITTEN DIMENSIONS SHALL TAKE PREFERENCE OVER ANY
DISCREPANCY SHALL BE BROUGHT TO THE ATTENTION THE
ACCEPTANCE OF THESE RESTRICTIONS. THE USE OF THESE
PLANS AND SPECIFICATIONS SHALL BE PARED AND PUBLICATION
THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE,
REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR
IN PART, IS PROHIBITED. TITLE TO THE PLANS AND
SPECIFICATIONS REMAINS WITH THE DESIGNER. RESTRICTED TO
THE ORIGINAL SITE FOR WHICH THEY WERE PRE- OF THE
DESIGNER PRIOR TO THE COMMENCEMENT OF ANY WORK.

WING TITLE	Roof Plan
ПТСЕ	Barn
ADDRESS	1975 Hayes Lane San Martin, CA. 95046

DATE
Apr 14, 2021

SCALE
1/4"=1'-0"

PROJECT MANAGER
S. Stotler

DRAWN
Maw

JOB NO.
2001

SHEET

47

COUNTY OF SANTA CLARA

GENERAL CONDITIONS

- ALL CONSTRUCTION WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE SOILS AND/OR GEOTECHNICAL REPORT PREPARED BY
- THIS REPORT IS SUPPLEMENTED BY: 1) THESE PLANS GRADING AND SPECIFICATIONS, 2) THE COUNTY OF SANTA CLARA STANDARD DETAILS. 3) THE COUNTY OF SANTA CLARA STANDARD SPECS, 4) STATE OF CALIFORNIA STANDARD DETAILS. 5) STATE OF CALIFORNIA STANDARD SPECIFICATIONS. IN THE EVENT OF CONFLICT THE FORMER SHALL TAKE PRECEDENCE OVER THE LATTER. THE PERFORMANCE AND COMPLETION OF ALL WORK MUST BE TO THE SATISFACTION OF THE COUNTY.
- DEVELOPER IS RESPONSIBLE FOR INSTALLATION OF THE IMPROVEMENTS SHOWN ON THESE PLANS AND HE OR HIS SUCCESSOR PROPERTY OWNERS ARE RESPONSIBLE FOR THEIR CONTINUED MAINTENANCE DEVELOPER SHALL BE RESPONSIBLE FOR CORRECTION OF ANY ERRORS OR OMISSIONS IN THESE PLANS. THE COUNTY SHALL BE AUTHORIZED TO REQUIRE DISCONTINUANCE OF ANY
- WORK AND SUCH CORRECTION AND MODIFICATION OF PLANS AS MAY BE NECESSARY TO COMPLY WITH COUNTY STANDARDS OR CONDITIONS OF DEVELOPMENT APPROVAL. DEVELOPER SHALL OBTAIN ENCROACHMENT PERMITS FROM THE SANTA CLARA VALLEY WATER DISTRICT AND CALIFORNIA DEPARTMENT OF TRANSPORTATION WHERE NEEDED. COPIES OF THESE PERMITS SHALL BE KEPT AT THE JOB SITE FOR REVIEW BY THE
- COUNTY'S INSPECTOR (15) FOOT VERTICAL CLEARANCE FOR ROADWAY AREA.
- THIS PLAN AUTHORIZES THE REMOVAL OF ONLY THOSE TREES WITH TRUNK DIAMETERS GREATER THAN 12 INCHES MEASURED 4.5 FEET ABOVE THE GROUND THAT ARE SHOWN TO BE REMOVED UNLESS AN AMENDED PLAN IS APPROVED OR A SEPARATE TREE REMOVAL PERMIT IS OBTAINED FROM THE PLANNING OFFICE. IT IS THE CONTRACTOR'S
- DEVELOPER SHALL PROVIDE ADEQUATE DUST CONTROL AS REQUIRED BY THE COUNTY ALL PERSONS MUST COMPLY WITH SECTION 4442 OF THE PUBLIC RESOURCES CODE AND

SECTION 13005 OF THE HEALTH AND SAFETY CODE RELATING TO THE USE OF SPARK

- UPON DISCOVERING OR UNEARTHING ANY BURIAL SITE AS EVIDENCED BY HUMAN SKELETAL REMAINS OR ARTIFACTS, THE PERSON MAKING SUCH DISCOVERY SHALL IMMEDIATELY NOTIFY THE COUNTY CORONER AT (408) 454-2520 AND LAND DEVELOPMENT ENGINEERING OFFICE AT (408) 299-5730. NO FURTHER DISTURBANCE OF THE SITE MAY BE MADE EXCEPT AS AUTHORIZED BY THE LAND DEVELOPMENT OFFICE IN ACCORD WITH PROVISIONS OF THIS ORDINANCE (COUNTY ORDINANCE CODE SECTION B6-18).
- THESE PLANS ARE FOR THE WORK DESCRIBED IN THE SCOPE OF WORK ONLY. A SEPARATE PERMIT WILL BE REQUIRED FOR THE SEPTIC LINE CONSTRUCTION. ANY DEVIATION FROM THESE APPROVED PLANS SHALL BE RE-APPROVED IN WRITING BY THE COUNTY ENGINEER PRIOR TO CONSTRUCTION.

CONSTRUCTION STAKING

- THE DEVELOPER'S ENGINEER IS RESPONSIBLE FOR THE INITIAL PLACEMENT AND REPLACEMENT OF CONSTRUCTION GRADE STAKES. THE STAKES ARE TO BE ADEQUATELY IDENTIFIED, LOCATED, STABILIZED, ETC. FOR THE CONVENIENCE OF CONTRACTORS. LATERAL OFFSET OF STAKES SET FOR CURBS AND GUTTERS SHALL NOT EXCEED 2 1/2 FEET FROM BACK OF CURB.
- ANY PROPERTY LINE STAKES OR ROAD MONUMENTS DISTURBED DURING CONSTRUCTION SHALL BE REPLACED BY DEVELOPER'S ENGINEER AND LICENSED LAND SURVEYOR.
- PROPERTY LINE STAKING MUST BE PERFORMED BY THE PROJECT ENGINEER OR LAND SURVEYOR TO ESTABLISH OR RE-ESTABLISH THE PROJECT BOUNDARY AND SHALL BE INSPECTED BY THE COUNTY INSPECTOR PRIOR TO THE BEGINNING OF THE WORK. PROPER CONSTRUCTION STAKES SHALL BE SET IN THE FIELD BY THE PROJECT
- ENGINEER OR LAND SURVEYOR AND VERIFIED BY THE COUNTY INSPECTOR PRIOR TO THE COMMENCEMENT OF GRADING. IN ACCORDANCE WITH THE CALIFORNIA PROFESSIONAL LAND SURVEYORS' ACT
- (BUSINESS AND PROFESSIONS CODE) CHAPTER 15 SECTIONS 8771 AND 8725.1, CALIFORNIA PENAL CODE 605, AND CALIFORNIA GOVERNMENT CODE 27581, ANY PERSON PERFORMING CONSTRUCTION ACTIVITIES THAT WILL OR MAY DISTURB AN EXISTING ROADWAY/STREET MONUMENT, PROPERTY CORNER, OR ANY OTHER PERMANENT SURVEYED MONUMENT AND/OR AS SHOWN ON THIS TENTATIVE MAP SHALL ENSURE THAT A CORNER RECORD AND/OR RECORD OF SURVEY ARE FILED WITH THE OCUNTY SURVEYOR OFFICE PRIOR TO DISTURBING SAID MONUMENTS. ALL DISTURBED OR DESTROYED MONUMENTS SHALL BE RESET AND FILED IN COMPLIANCE WITH SECTION 8771.

CONSTRUCTION INSPECTION

- CONTRACTOR SHALL NOTIFY PERMIT INSPECTION UNIT, SANTA CLARA COUNTY PRIOR TO COMMENCING WORK AND FOR FINAL INSPECTION OF WORK AND SITE. THE COUNTY REQUIRES A MINIMUM OF 24 HOURS ADVANCE NOTICE FOR GENERAL INSPECTION, 48 HOURS FOR ASPHALT CONCRETE INSPECTION.
- INSPECTION BY SANTA CLARA COUNTY SHALL BE LIMITED TO INSPECTION OF MATERIALS AND PROCESSES OF CONSTRUCTION TO OBSERVE THEIR COMPLIANCE WITH PLANS & SPECIFICATIONS BUT DOES NOT INCLUDE RESPONSIBILITY FOR THE SUPERINTENDENT OF CONSTRUCTION, SITE CONDITIONS, EQUIPMENT OR PERSONNEL CONTRACTOR SHALL NOTIFY THE COUNTY LAND DEVELOPMENT INSPECTOR AT PHONE (408) 299-6868 AT LEAST 24 HOURS PRIOR TO COMMENCING WORK AND FOR FINAL INSPECTION OF WORK AND SITE.
- DEVELOPER AND/OR HIS AUTHORIZED REPRESENTATIVE MUST SUBMIT WRITTEN REQUEST FOR FINAL INSPECTION AND ACCEPTANCE. SAID REQUEST SHALL BE DIRECTED TO THE INSPECTION OFFICE NOTED ON THE PERMIT FORM. THE CONTRACTOR SHALL PROVIDE TO THE COUNTY CONSTRUCTION INSPECTOR WITH PAD ELEVATION AND LOCATION CERTIFICATES, PREPARED BY THE PROJECT ENGINEER OR LAND SURVEYOR, PRIOR COMMENCEMENT OF THE BUILDING FOUNDATION.

SITE PREPARATION (CLEARING AND GRUBBING)

- TO BE IMPROVED WILL BE REMOVED TO AN AUTHORIZED DISPOSAL SITE AS FOLLOWS: TO A MINIMUM DEPTH OF TWO FEET BELOW THE FINISHED GRADE OF PROPOSED ROADWAYS (EITHER PRIVATE OR TO BE DEDICATED TO PUBLIC USE)
- FROM AREAS AFFECTED BY THE PROPOSED GRADING EXCEPT WHERE NOTED ON THE PLANS.
- IT SHALL BE THE RESPONSIBILITY OF THE DEVELOPER TO MOVE OR RELOCATE UTILITY POLES AND OTHER OBSTRUCTIONS IN THE WAY OF CONSTRUCTION.

<u>UTILITY LOCATION, TRENCHING & BACKFILI</u>

- CONTRACTOR SHALL NOTIFY USA (UNDERGROUND SERVICE ALERT) AT 1-800-277-2600 A MINIMUM OF 24 HOURS BEFORE BEGINNING UNDERGROUND WORK FOR VERIFICATION OF THE LOCATION OF UNDERGROUND UTILITIES
- ACCURATE VERIFICATION AS TO SIZE, LOCATION, AND DEPTH OF EXISTING UNDERGROUND CONDUITS OR FACILITIES SHALL BE THE INDIVIDUAL CONTRACTORS RESPONSIBILITY. PLAN LOCATIONS ARE APPROXIMATE AND FOR GENERAL INFORMATION
- ALL UNDERGROUND INSTALLATIONS SHALL BE IN PLACE AND THE TRENCH BACKFILLED AND COMPACTED BEFORE PLACING AGGREGATE BASE MATERIAL OR SURFACE STRUCTURES. SURFACING MAY BE DONE IF THE UTILITY COMPANY CONCERNED INDICATES BY LETTER THAT IT WILL BORE. UNLESS SPECIFICALLY AUTHORIZED BY THE COUNTY, GAS AND WATER MAINS SHALL BE INSTALLED OUTSIDE THE PAVED AREAS.
- TRENCH BACKFILL IN EXISTING PAVEMENT AREAS SHALL BE SAND MATERIAL IN ACCORDANCE WITH THE APPLICABLE PROVISIONS OF THE STATE SPECIFICATIONS. THE STRUCTURAL SECTION FOR TRENCH REPLACEMENT SHALL CONSIST OF NOT LESS THAN 12 INCHES OF APPROVED AGGREGATE BASE MATERIAL COMPACTED TO A RELATIVE COMPACTION OF AT LEAST 95% AND 4 INCHES OF HOT ASPHALT CONCRETE PLACED IN TWO LIFTS. TRENCH RESTORATION FOR HIGHER TYPE PAVEMENTS SHALL BE MADE IN
- KIND OR AS DIRECTED BY THE COUNTY. TRENCH BACKFILL IN NEW CONSTRUCTION AREAS SHALL BE SAND MATERIAL COMPACTED TO A RELATIVE COMPACTION OF AT LEAST 90%. THE REQUIREMENT FOR SELECT MATERIAL MAY BE WAIVED BY COUNTY IF THE NATIVE SOIL IS SUITABLE FOR
- USE AS TRENCH BACKFILL BUT THE COMPACTION REQUIREMENTS WILL NOT BE THEREBY WAIVED.
- BACKFILL AND TRENCH RESTORATION REQUIREMENTS SHALL APPLY AS MINIMUM STANDARDS TO ALL UNDERGROUND FACILITIES INSTALLED BY OTHER FIRMS OR PUBLIC AGENCIES.

<u>RETAINING WALLS</u>

FOUNDATION AND REINFORCEMENT INSPECTED BY THE COUNTY ENGINEERING INSPECTOR AND ENGINEER OF RECORD PRIOR TO POURING THE FOUNDATION AND FORMING THE WALL. 2. SEGMENTAL BLOCK RETAINING WALLS SHALL HAVE FOUNDATION AND REINFORCEMENT

REINFORCED CONCRETE AND CONCRETE MASONRY UNIT RETAINING WALLS SHALL HAVE INSPECTED BY THE COUNTY ENGINEERING INSPECTOR.

1. EXCAVATED MATERIAL SHALL BE PLACED IN THE FILL AREAS DESIGNATED OR SHALL BE HAULED AWAY FROM THE SITE TO A COUNTY APPROVED DISPOSAL SITE. WHERE FILL MATERIAL IS TO BE PLACED ON NATURAL GROUND, IS SHALL BE STRIPPED OF ALL VEGETATION. TO ACHIEVE A PROPER BOND WITH THE FILL MATERIAL, THE SURFACE OF THE GROUND SHALL BE SCARIFIED TO DEPTH OF 6" BEFORE FILL IS PLACED. WHERE NATURAL GROUND IS STEEPER THAN 5:1, IT SHALL BE BENCHED AND THE FILL KEYED IN TO ACHIEVE STABILITY. WHERE NEW FILL IS TO BE PLACED ON EXISTING FILL THE EXISTING FILL SHALL BE REMOVED UNTIL MATERIAL COMPACTED TO 90% RELATIVE COMPACTION IS EXPOSED. THEN THE NEW FILL MATERIAL SHALL BE PLACED AS PER THESE CONSTRUCTION NOTES. FILL MATERIAL SHALL BE PLACED IN UNIFORM LIFTS NOT EXCEEDING 6" IN UNCOMPACTED THICKNESS. BEFORE COMPACTION BEGINS, THE FILL SHALL BE BROUGHT TO A WATER CONTENT THAT WILL PERMIT PROPER COMPACTION BY EITHER 1) AERATING THE FILL IF IT IS TOO WET OR 2) MOISTENING THE FILL WITH WATER IF IT IS TOO DRY. EACH LIFT SHALL BE THOROUGHLY MIXED BEFORE COMPACTION TO ENSURE A UNIFORM DISTRIBUTION OF MOISTURE

EXCESS CUT MATERIAL SHALL NOT BE SPREAD OR STOCKPILED ON THE SITE. DEVELOPER SHALL REMOVE OR TRIM ALL TREES TO PROVIDE AN UNOBSTRUCTED FIFTEEN 3. SURPLUS EARTH FILL MATERIAL SHALL BE PLACED IN A SINGLE (8" MAX) THICK LAYER COMPACTED TO WITHSTAND WEATHERING IN THE AREA(S) DELINEATED ON THE PLAN. 4. NO ORGANIC MATERIAL SHALL BE PLACED IN ANY FILL. NO TREES SHALL BE REMOVED OUTSIDE OF CUT, FILL OR ROADWAY AREAS.

5. THE UPPER 6" OF SUBGRADE BELOW DRIVEWAY ACCESS ROAD OR PARKING AREA SHALL BE COMPACTED TO 95% OF MAXIMUM DENSITY. RESPONSIBILITY TO ENSURE THAT REMOVAL OF ADDITIONAL TREES HAS BEEN PERMITTED. 6. MAXIMUM CUT SLOPE SHALL BE 2 HORIZONTAL TO 1 VERTICAL. MAXIMUM FILL SLOPE SHALL BE a 2 HORIZONTAL TO 1 VERTICAL.

LOCATION	CUT (C.Y.)	FILL (C.Y.)	VERT. DEPTH
ASSY BUILDING	±391	±0	±4.4/±0
DRIVEWAY	±758	±214	±5.4/±5.2
POND	±3	±164	±2.7/±3.9
TOTAL	±1152	±378	

NOTE: FILL VOLUMES INCLUDE 10% SHRINKAGE.

- EXCESS MATERIAL SHALL BE OFF HAULED TO A COUNTY APPROVED DUMP SITE. 7. NOTIFY SOILS ENGINEER TWO (2) DAYS PRIOR TO COMMENCEMENT OF ANY GRADING WORK TO
- 8. ALL MATERIALS FOR FILL SHOULD BE APPROVED BY THE SOILS ENGINEER BEFORE IT IS BROUGHT TO THE SITE.
- 9. THE UPPER 6" OF THE SUBGRADE SOIL SHALL BE SCARIFIED, MOISTURE CONDITIONED AND COMPACTED TO A MINIMUM RELATIVE COMPACTION OF 95%
- 10. ALL AGGREGATE BASE MATERIAL SHALL BE COMPACTED TO A MINIMUM 95% RELATIVE COMPACTION. 11. THE GEOTECHNICAL PLAN REVIEW LETTER MUST BE REVIEWED AND APPROVED BY THE COUNTY
- GEOLOGIST PRIOR TO FINAL APPROVAL BY THE COUNTY ENGINEER FOR BUILDING OCCUPANCY. 12. THE PROJECT GEOTECHNICAL ENGINEER SHALL PERFORM COMPACTION TESTING AND PRESENT THE RESULTS TO THE COUNTY ENGINEERING INSPECTOR PRIOR TO THE CONSTRUCTION OF ANY
- 13. GRADING WORK BETWEEN OCTOBER 15TH AND APRIL 15TH IS AT THE DISCRETION OF THE
- SANTA CLARA COUNTY GRADING OFFICIAL 14. TOTAL DISTURBED AREA FOR THE PROJECT 36,860 SF.

COORDINATE THE WORK IN THE FIELD.

16. THE INSPECTOR MAY VERIFY THAT A VALID NOTICE OF INTENT (NOI) HAS BEEN ISSUED BY THE STATE AND THAT A CURRENT AND UP TO DATE STORM WATER POLLUTION PREVENTION PLAN (SWPPP) IS AVAILABLE ON SITE.

TREE PROTECTION

15. WDID NO.__

- 1. FOR ALL TREES TO BE RETAINED WITH A CANOPY IN THE DEVELOPMENT AREA OR INTERFACES WITH THE LIMITS OF GRADING FOR ALL PROPOSED DEVELOPMENT ON SITE, THE TREES SHALL BE PROTECTED BY THE PLACEMENT OF RIGID TREE PROTECTIVE FENCING, CONSISTENT WITH THE COUNTY INTEGRATED LANDSCAPE GUIDELINES, AND INCLUDE THE FOLLOWING: A. FENCING SHOULD BE PLACED ALONG THE OUTSIDE EDGE OF THE DRIPLINE OF THE TREE OR
- GROVE OF TREES. B. THE FENCING SHALL BE MAINTAINED THROUGHOUT THE SITE CONSTRUCTION PERIOD AND SHALL BE INSPECTED PERIODICALLY FOR DAMAGE AND PROPER FUNCTION.
- C. FENCING SHALL BE REPAIRED, AS NECESSARY, TO PROVIDE A PHYSICAL BARRIER FROM CONSTRUCTION ACTIVITIES.
- D. SIGNAGE STATING, "WARNING- THIS FENCING SHALL NOT BE REMOVED WITHOUT PERMISSION FROM THE SANTA CLARA COUNTY PLANNING OFFICE (408) 299-5770. COUNTY OF SANTA CLARA TREE PROTECTION MEASURES MAY BE FOUND AT http://www.sccplanning.gov." SHALL STORM DRAINAGE AND STORMWATER MANAGEMENT BE PLACED ON THE TREE PROTECTIVE FENCING UNTIL FINAL OCCUPANCY.
- BE SECURELY IN PLACED AND INSPECTED BY THE LAND DEVELOPMENT ENGINEERING INSPECTOR. EXISTING TREES AUTHORIZED FOR REMOVAL, ROOTS, AND FOREIGN MATERIAL IN AREAS 3. SEE EXISTING TREE PROTECTION DETAILS FOR MORE INFORMATION.

ACCESS ROADS AND DRIVEWAYS

- 1. DRIVEWAY LOCATIONS SHALL BE AS SHOWN ON THE IMPROVEMENT PLANS WITH CENTERLINE STATIONING. THE MINIMUM CONCRETE THICKNESS SHALL BE 6 INCHES THROUGHOUT (WITH A MAXIMUM APPROACH SLOPE OF 1 1/4 INCHES PER FOOT).
- 2. ALL DRIVEWAY OR COMMON ACCESS ROAD SECTIONS IN EXCESS OF 15 LONGITUDINAL SLOPE MUST BE PAVED WITH A MINIMUM 2-INCH ASPHALT LIFT OR FULL DEPTH CONCRETE LIFT PRIOR TO ANY COMBUSTIBLE FRAMING.
- 3. THE OWNER AND PRIME CONTRACTOR ARE RESPONSIBLE FOR MAINTAINING PROJECT SITE ACCESS AND NEIGHBORHOOD ACCESS FOR EMERGENCY VEHICLES AND LOCAL RESIDENTS.
- 4. ROADWAYS DESIGNATED AS NOT COUNTY MAINTAINED ROADS AS SHOWN ON THE PLAN WILL NOT BE ELIGIBLE FOR COUNTY MAINTENANCE UNTIL THE ROADWAYS ARE IMPROVED (AT NO COST TO THE COUNTY) TO THE PUBLIC MAINTENANCE ROAD STANDARDS APPROVED BY THE BOARD OF SUPERVISORS AND IN EFFECT AT SUCH TIME THAT THE ROADWAYS ARE CONSIDERED FOR ACCEPTANCE INTO THE COUNTY'S ROAD SYSTEM.
- ALL WORK IN THE COUNTY ROAD RIGHT-OF-WAY REQUIRES AN ENCROACHMENT PERMIT FROM THE ROADS AND AIRPORTS DEPARTMENT. EACH INDIVIDUAL ACTIVITY REQUIRES A SEPARATE PERMIT - I.E. CABLE, ELECTRICAL, GAS, SEWER, WATER, RETAINING WALLS, DRIVEWAY APPROACHES, FENCES, LANDSCAPING, TREE REMOVAL, STORM DRAINAGE IMPROVEMENTS,

STREET LIGHTING

1. PACIFIC GAS & ELECTRIC ELECTROLIER SERVICE FEE SHALL BE PAID BY THE DEVELOPER AND/OR HIS AUTHORIZED REPRESENTATIVE.

SANITARY SEWER

- 1. THE SANITARY SEWER AND WATER UTILITIES SHOWN ON THESE PLANS ARE NOT PART OF THIS GRADING PERMIT AND ARE SHOWN FOR REFERENCE ONLY.
- 2. ALL MATERIALS AND METHODS OF CONSTRUCTION OF SANITARY SEWERS SHALL CONFORM TO THE SPECIFICATIONS OF THE JURISDICTION INVOLVED. INSPECTION OF SANITARY SEWER WORK SHALL BE DONE BY SAID JURISDICTION.

PORTLAND CEMENT CONCRETE

1. CONCRETE USED FOR STRUCTURAL PURPOSES SHALL BE CLASS "A" (6 SACK PER CUBIC YARD) AS SPECIFIED IN THE STATE STANDARD SPECIFICATIONS. CONCRETE PLACED MUST DEVELOP A MINIMUM STRENGTH FACTOR OF 2800 PSI IN A SEVEN-DAY PERIOD. THE CONCRETE MIX DESIGN SHALL BE UNDER THE CONTINUAL CONTROL OF THE COUNTY INSPECTOR.

AIR QUALITY, LANDSCAPING AND EROSION CONTROL

- WATER ALL ACTIVE CONSTRUCTION AREAS AT LEAST TWICE DAILY. COVER ALL TRUCKS HAULING SOIL, SAND, AND OTHER LOOSE MATERIALS OR REQUIRE ALL TRUCKS TO MAINTAIN AT LEAST TWO FEET OF FREEBOARD.
- 3. PAVE, APPLY WATER THREE TIMES DAILY, OR APPLY (NON-TOXIC) SOIL STABILIZERS ON ALL UNPAVED ACCESS ROADS, PARKING AREAS AND STAGING AREAS AT CONSTRUCTION SITES. 4. SWEEP DAILY (WITH WATER SWEEPERS) ALL PAVED ACCESS ROADS, PARKING AREAS AND STAGING AREAS AT CONSTRUCTION SITES. THE USE OF DRY POWDER SWEEPING IS PROHIBITED.
- 5. SWEEP STREETS DAILY (WITH WATER SWEEPERS) IF VISIBLE SOIL MATERIAL IS CARRIED ONTO ADJACENT PUBLIC STREETS. THE USE OF DRY POWDER SWEEPING IS PROHIBITED. 6. ALL CONSTRUCTION VEHICLES, EQUIPMENT AND DELIVERY TRUCKS SHALL HAVE A MAXIMUM **SURVEY MONUMENT PRESERVATION** IDLING TIME OF 5 MINUTES (AS REQUIRED BY THE CALIFORNIA AIRBORNE TOXIC CONTROL MEASURE TITLE 13, SECTION 2485 OF CALIFORNIA CODE OF REGULATIONS (CCR)). ENGINES SHALL BE SHUT OFF IF CONSTRUCTION REQUIRES LONGER IDLING TIME UNLESS NECESSARY FOR PROPER OPERATION OF THE VEHICLE.
- ALL VEHICLE SPEEDS ON UNPAVED ROADS SHALL BE LIMITED TO 15 MILES PER HOUR. ALL CONSTRUCTION EQUIPMENT SHALL BE MAINTAINED AND PROPERLY TUNED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS. ALL EQUIPMENT SHALL BE CHECKED 3 BY A CERTIFIED MECHANIC AND DETERMINED TO BE RUNNING IN PROPER CONDITION PRIOR TO OPERATION.
- POST A SIGN THAT IS AT LEAST 32 SQUARE FEET MINIMUM 2 INCHES LETTER HEIGHT VISIBLE NEAR THE ENTRANCE OF CONSTRUCTION SITE THAT IDENTIFIES THE FOLLOWING REQUIREMENTS. OBTAIN ENCROACHMENT PERMIT FOR SIGN FROM ROADS DEPARTMENT OR OTHER APPLICABLE AGENCY IF REQUIRED.
- A. 15 MILES PER HOUR (MPH) SPEED LIMIT
- B. 5 MINUTES MAXIMUM IDLING TIME OF VEHICLES TELEPHONE NUMBER TO CONTACT THE BAY AREA AIR QUALITY MANAGEMENT DISTRICT REGARDING DUST COMPLAINTS. NOTE PHONE NUMBER OF THE BAY AREA AIR QUALITY MANAGEMENT DISTRICT AIR POLLUTION COMPLAIN HOTLINE OF 1-800-334-6367.
- 10. ALL FILL SLOPES SHALL BE COMPACTED AND LEFT IN A SMOOTH AND FIRM CONDITION CAPABLE OF WITHSTANDING WEATHERING. 11. ALL EXPOSED DISTURBED AREAS SHALL BE SEEDED WITH BROME SEED SPREAD AT THE
- RATE OF 5 LB. PER 1000 SQUARE FEET (OR APPROVED EQUAL). SEEDING AND WATERING SHALL BE MAINTAINED AS REQUIRED TO ENSURE GROWTH.
- 12. ALL DITCHES SHALL BE LINED PER COUNTY STANDARD SD8 13. ALL STORM DRAINAGE STRUCTURES SHALL BE INSTALLED WITH EFFECTIVE ENTRANCE & OUTFALL EROSION CONTROLS E.G. SACKED CONCRETE RIP-RAP. ENERGY DISSIPATERS SHALL BE INSTALLED AT ALL DITCH OUTFALLS. WHERE OUTFALLS ARE NOT INTO AN EXISTING
- CREEK OR WATER COURSE, RUNOFF SHALL BE RELEASED TO SHEET FLOW. 14. PRIOR TO GRADING COMPLETION AND RELEASE OF THE BOND, ALL GRADED AREAS SHALL BE RESEEDED IN CONFORMANCE WITH THE COUNTY GRADING ORDINANCE TO MINIMIZE THE VISUAL IMPACTS OF THE GRADE SLOPES AND REDUCE THE POTENTIAL FOR EROSION OF THE SUBJECT SITE
- 15. PERMANENT LANDSCAPING SHOWN ON THE ATTACHED LANDSCAPE PLAN MUST BE INSTALLED AND FIELD APPROVED BY THE COUNTY PLANNING OFFICE PRIOR TO FINAL APPROVAL BY THE COUNTY ENGINEER, AND FINAL OCCUPANCY RELEASE BY THE BUILDING INSPECTION
- 16. THE OWNER SHALL PREPARE AND PRESENT A WINTERIZATION REPORT TO THE COUNTY
- INSPECTOR FOR REVIEW PRIOR TO OCTOBER 15TH OF EVERY YEAR. 17. THE OWNER, CONTRACTOR, AND ANY PERSON PERFORMING CONSTRUCTION ACTIVITIES SHALL INSTALL AND MAINTAIN CONSTRUCTION BEST MANAGEMENT PRACTICES (BMPS) ON THE PROJECT SITE AND WITHIN THE SANTA CLARA COUNTY ROAD RIGHT-OF-WAY THROUGHOUT THE DURATION OF THE CONSTRUCTION AND UNTIL THE ESTABLISHMENT OF PERMANENT STABILIZATION AND SEDIMENT CONTROL TO PREVENT THE DISCHARGE OF POLLUTANTS INCLUDING SEDIMENT, CONSTRUCTION MATERIALS, EXCAVATED MATERIALS, AND WASTE INTO THE SANTA CLARA COUNTY RIGHT-OF-WAY, STORM SEWER WATERWAYS, ROADWAY INFRASTRUCTURE. BMPS SHALL INCLUDE, BUT NOT BE LIMITED TO THE FOLLOWING:
- A. PREVENTION OF POLLUTANTS IN STORM WATER DISCHARGES FROM THE CONSTRUCTION SITE AND THE CONTRACTOR'S MATERIAL AND EQUIPMENT LAYDOWN / STAGING AREAS. B. PREVENTION OF TRACKING OF MUD, DIRT, AND CONSTRUCTION MATERIALS ONTO THE PUBLIC
- ROAD RIGHT-OF-WAY. C. PREVENTION OF DISCHARGE OF WATER RUN-OFF DURING DRY AND WET WEATHER CONDITIONS ONTO THE PUBLIC ROAD RIGHT-OF-WAY.
- ENSURE THAT ALL TEMPORARY CONSTRUCTION FACILITIES, INCLUDING BUT NOT LIMITED TO CONSTRUCTION MATERIALS, DELIVERIES, HAZARDOUS AND NON-HAZARDOUS MATERIAL STORAGE, EQUIPMENT, TOOLS, PORTABLE TOILETS, CONCRETE WASHOUT, GARBAGE CONTAINERS, LAYDOWN YARDS, SECONDARY CONTAINMENT AREAS, ETC. ARE LOCATED OUTSIDE THE SANTA CLARA COUNTY ROAD RIGHT-OF-WAY.
- 19. EROSION CONTROL PLAN IS A GUIDE AND SHALL BE AMENDED AS NECESSARY TO PREVENT EROSION AND ILLICIT DISCHARGES ON A YEAR AROUND BASIS, DEPENDING ON THE SEASON, WEATHER, AND FIELD CONDITIONS. EROSION CONTROL MEASURES IN ADDITION TO THOSE NOTED IN THE PERMITTED PLANS MAY BE NECESSARY. FAILURE TO INSTALL SITE SITE AND SITUATIONALY APPROPRIATE EROSION CONTROL MEASURES MAY RESULT IN VIOLATIONS, FINES, AND A STOPPAGE OF WORK.

- 2. PRIOR TO COMMENCEMENT OF ANY CONSTRUCTION ACTIVITY, TREE PROTECTIVE FENCING SHALL 1. DEVELOPER IS RESPONSIBLE FOR ALL NECESSARY DRAINAGE FACILITIES WHETHER SHOWN ON THE PLANS OR NOT AND HE OR HIS SUCCESSOR PROPERTY OWNERS ARE RESPONSIBLE FOR THE ADEQUACY AND CONTINUED MAINTENANCE OF THESE FACILITIES IN A MANNER WHICH WILL PRECLUDE ANY HAZARD TO LIFE, HEALTH, OR DAMAGE TO ADJOINING PROPERTY, CONSISTENT WITH NPDES PERMIT CAS612008 / ORDER NO. R2-2009-0047 AND NPDES
 - PERMIT CASO00004/ ORDER NO. 2013-0001-DWQ. 2. DROP INLETS SHALL BE COUNTY STANDARD TYPE 5 UNLESS OTHERWISE NOTED ON THE PLANS. THE DEVELOPER'S ENGINEER SHALL BE RESPONSIBLE FOR THE PROPER LOCATION OF DROP INLETS. WHERE STREET PROFILE GRADE EXCEEDS 6% DROP INLETS SHALL BE SET AT 500 ANGLE CURB LINE TO ACCEPT WATER OR AS SHOWN ON THE PLANS.
 - 3. WHERE CULVERTS ARE INSTALLED THE DEVELOPER SHALL BE RESPONSIBLE FOR GRADING TI OUTLET DITCH TO DRAIN TO AN EXISTING SWALE OR TO AN OPEN AREA FOR SHEET FLOW. 4. UPON INSTALLATION OF DRIVEWAY CONNECTIONS, PROPERTY OWNERS SHALL PROVIDE FOR THE UNINTERRUPTED FLOW OF WATER IN ROADSIDE DITCHES.
 - 5. THE COUNTY SHALL INSPECT UNDERGROUND DRAINAGE IMPROVEMENTS AND STORMWATER MANAGEMENT FEATURES PRIOR TO BACKFILL.

AS-BUILT PLANS STATEMENT


THIS IS A TRUE COPY OF THE AS-BUILT PLANS. THERE (___ WERE) (___ WERE NOT) MINOR FIELD CHANGES - MARKED WITH THE SYMBOL (^). THERE (___WERE) (___ WERE NOT) PLAN REVISIONS INDICATING SIGNIFICANT CHANGES REVIEWED BY THE COUNTY ENGINEER AND MARKED WITH THE SYMBOL△.

SIGNATURE _____ NOTE: THIS STATEMENT IS TO BE SIGNED BY THE PERSON AUTHORIZED BY THE COUNTY ENGINEER TO PFRFORM THE INSPECTION WORK. A REPRODUCIBLE COPYOF THE AS-BUILT PLANS MUST BE


GEOTECHNICAL ENGINEER OBSERVATION

FURNISHED TO THE COUNTY ENGINEER AFTERCONSTRUCTION.

A CONSTRUCTION OBSERVATION LETTER FROM THE RESPONSIBLE GEOTECHNICAL ENGINEER AND ENGINEERING GEOLOGIST DETAILING CONSTRUCTION OBSERVATIONS AND CERTIFYING THAT THE WORK WAS DONE IN ACCORDANCE WITH THE RECOMMENDATIONS IN THE GEOTECHNICAL AND GEOLOGIC REPORTS SHALL BE SUBMITTED PRIOR TO THE GRADING COMPLETION AND RELEASE OF THE BOND.

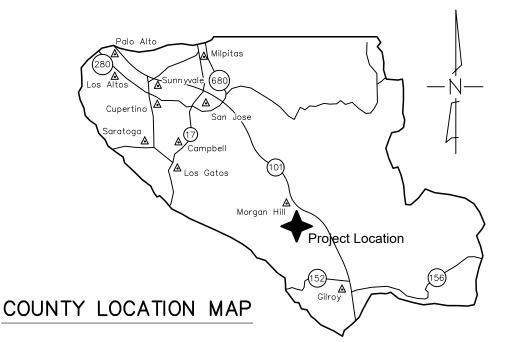

- THE LANDOWNER/CONTRACTOR MUST PROTECT AND ENSURE THE PERPETUATION OF SURVEY MONUMENTS AFFECTED BY CONSTRUCTION ACTIVITIES.
- 2. PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR SHALL LOCATE, STAKE, AND FLAG ALL PERMANENT SURVEY MONUMENTS OF RECORD AND ANY UNRECORDED MONUMENTS THAT ARE DISCOVERED THAT ARE WITHIN 50 FEET OF THE CONSTRUCTION ACTIVITY
- THE LANDOWNER, CONTRACTOR AND/OR ANY PERSON PERFORMING CONSTRUCTION ACTIVITIES THAT WILL OR MAY DISTURB AN EXISTING MONUMENT, CORNER STAKE, OR ANY OTHER PERMANENT SURVEYED MONUMENT SHALL CAUSE TO HAVE A LICENSED LAND SURVEYOR OR CIVIL ENGINEER, AUTHORIZED TO PRACTICE SURVEYING, ENSURE THAT A CORNER RECORD AND/OR RECORD OF SURVEY ARE FILED WITH THE COUNTY SURVEYOR'S OFFICE PRIOR TO DISTURBING SAID MONUMENTS AND RESET PERMANENT MONUMENT(S) TO PERPETUATE THE LOCATION IF ANY PERMANENT MONUMENT COULD BE DESTROYED, DAMAGED, COVERED, DISTURBED, OR OTHERWISE OBLITERATED. THE LICENSED LAND SURVEYOR OR CIVIL ENGINEER SHALL FILE A CORNER RECORD OR RECORD OF SURVEY WITH COUNTY SURVEYOR PRIOR TO FINAL ACCEPTANCE OF THE PROJECT BY THE LAND DEVELOPMENT ENGINEERING INSPECTOR.

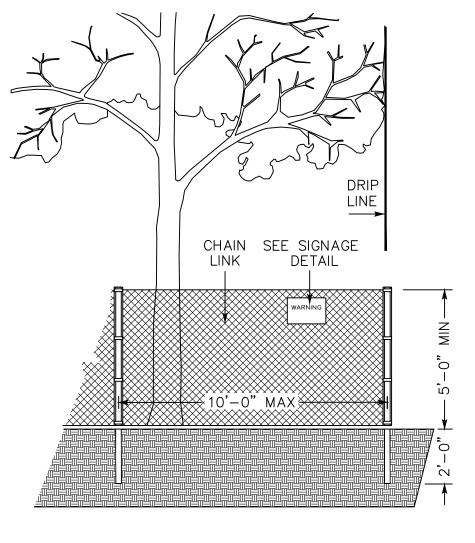

EXISTING TREE PROTECTION DETAILS

- 18. THE OWNER, CONTRACTOR, AND ANY PERSON PERFORMING CONSTRUCTION ACTIVITIES SHALL 1. PRIOR TO THE COMMENCEMENT OF ANY GRADING, TREE PROTECTIVE FENCING SHALL BE IN PLACE IN ACCORDANCE WITH THE TREE PRESERVATION PLAN AND INSPECTED BY A CERTIFIED ARBORIST. THE ARBORIST SHALL MONITOR CONSTRUCTION ACTIVITY TO ENSURE THAT THE TREE PROTECTION MEASURES ARE IMPLEMENTED AND ADHERED TO DURING CONSTRUCTION. THIS CONDITION SHALL BE INCORPORATED INTO THE GRADING PLANS.
 - 2. FENCE SHALL BE MINIMUM 5 FEET TALL CONSTRUCTED OF STURDY MATERIAL (CHAIN-LINK OR EQUIVALENT STRENGTH/ DURABILITY).
 - FENCE SHALL BE SUPPORTED BY VERTICAL POSTS DRIVEN 2 FEET (MIN) INTO THE GROUND AND SPACED NOT MORE THAN 10 FEET APART.
 - TREE FENCING SHALL BE MAINTAINED THROUGHOUT THE SITE DURING THE CONSTRUCTION PERIOD, INSPECTED PERIODICALLY FOR DAMAGE AND PROPER FUNCTION, REPAIRED AS NECESSARY TO PROVIDE A PHYSICAL BARRIER FROM CONSTRUCTION ACTIVITIES, AND REMAIN IN PLACE UNTIL THE FINAL
 - 5. A SIGN THAT INCLUDES THE WORDS, "WARNING: THIS FENCE SHALL NOT BE REMOVED WITHOUT THE EXPRESSED PERMISSION OF THE SANTA CLARA COUNTY PLANNING OFFICE," SHALL BE SECURELY ATTACHED TO THE FENCE IN A VISUALLY PROMINENT LOCATION.

COUNTY OF SANTA CLARA DEPT. OF ROADS AND AIRPORTS	COUNTY OF SANT LAND DEVELOPMENT ENGINEER
ISSUED BY: DATE:	
	GRADING/DRAINAGE PERMIT NO
ENCROACHMENT PERMIT NO	ISSUED BY: DATE:

NO WORK SHALL BE DONE IN THE COUNTY'S RIGHT-OF-WAY WITHOUT AN ENCROACHMENT PERMIT, INCLUDING THE STAGING OF CONSTRUCTION MATERIAL AND THE PLACEMENT OF PORTABLE TOILETS.

ENGINEER'S STATEMENT


I HEARBY STATE THAT THESE PLANS ARE IN COMPLIANCE WITH ADOPTED COUNTY STANDARDS. THE APPROVED TENTATIVE MAR (OR PLAN) AND CONDITIONS OF APPROVAL PERTAINING THERETO DATED FILE(S) NO. OY MUST 7 R.C.E. NO.

COUNTY ENGINEER'S NOTE

COUNTY FILE NO.: PLN21-176

ISSUANCE OF A PERMIT AUTHORIZING CONSTRUCTION DOES NOT RELEASE THE DEVELOPER, PERMITTEE OF ENGINEER FROM RESPONSIBILITY FOR THE CORRECTION OF ERRORS OR OMISSIONS CONTAINED IN THE PLANS. IF, DURING THE COURSE OF CONSTRUCTION, THE PUBLIC INTEREST REQUIRES A MODIFICATION OF (OR DEPARTURE FROM) THE SPECIFICATIONS OF THE PLANS, THE COUNTY SHALL HAVE THE AUTHORITY TO REQUIRE THE SUSPENSION OF WORK, AND THE NECESSARY MODIFICATION OR DEPARTURE AND TO SPECIFY THE MANNER IN WHICH THE SAME IS TO BE MADE.

DATE	
	DARRELL K.H. WONG
	R.C.E. NO. 63958
	EXPIRES 9/30/24

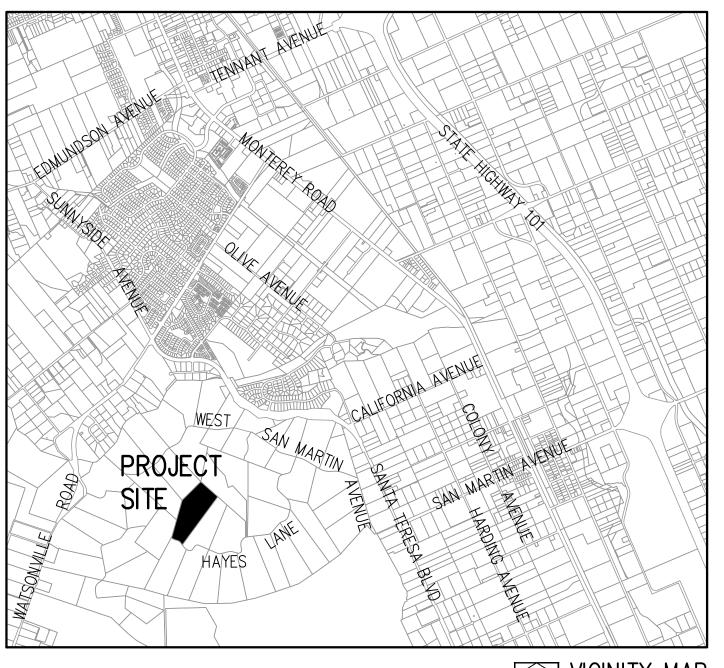

🔁 <u>VICINITY MAP</u>

GRADING PERMIT SCOPE OF WORK

- THE DEVELOPER IS RESPONSIBLE FOR THE INSTALLATION OF THE WORK PROPOSED ON THE EROSION CONTROL PLAN. THE ENGINEER OF RECORD IS RESPONSIBLE FOR THE DESIGN OF THE EROSION CONTROL PLANS AND ANY MODIFICATIONS OF THE EROSION CONTROL PLANS TO PREVENT ILLICIT DISCHARGES FROM THE SITE DURING CONSTRUCTION.
- 2. A CONSTRUCTION OBSERVATION LETTER FROM THE RESPONSIBLE GEOTECHNICAL ENGINEER AND CERTIFIED ENGINEERING GEOLOGIST DETAILING CONSTRUCTION OBSERVATIONS AND CERTIFYING THAT THE WORK WAS DONE IN ACCORDANCE WITH THE RECOMMENDATIONS IN THE GEOTECHNICAL AND GEOLOGICAL REPORTS SHALL BE SUBMITTED PRIOR TO GRADING COMPLETION AND RELEASE OF BOND.
- CLEAR AND GRUB DRIVEWAY.
- DRIVEWAY GRADING.
- 5. CONSTRUCT DRIVEWAY

ADDITIONAL CONTRACT SCOPE OF WORK

- CLEAR AND GRUB BUILDING PAD.
- BUILDING PAD GRADING
- CONSTRUCT DRIVEWAY CONSTRUCT RETAINING WALL

COUNTY OF SANTA CLARA

LAND DEVELOPMENT ENGINEERING & SURVEYING

PRELIMINARY PLANS

NOT FOR CONSTRUCTION

NO. 69278 P. E.

★\EXP. 6-30- /★

ON CIVIL

ISSUED BY: _____ DATE: ____

EXP 6-30-

- FURNISH & INSTALL WHARF FIRE HYDRANT
- 6. INSTALL JOINT TRENCH

SHEET INDEX

1	COVER SHEET	
2	OVERALL SITE PLAN	
3	PRELIMINARY GRADING & DRAINAGE PLAN	
4	DRIVEWAY PROFILE, SECTIONS,	
	DETAILS & NOTES	
5	EROSION CONTROL PLAN	

BMP1&2 BEST MANAGEMENT PRACTICES

ENGINEER'S NAME: <u>Hanna & Brunetti</u>		
	ADDRESS:	7651 EIGLEBERRY STREET, GILROY CA 95020
	_	
	PHONE NO.	408 842-2173
	FAX NO.	408 842-3662

PRELIMINARY IMPROVEMENT PLANS

FOR THE ASSESSORY BUILDING ON THE LANDS OF LESLIE 1975 HAYES LANE, SAN MARTIN

ALL OF PARCEL 17, AS SHOWN UPON THAT CERTAIN MAP ENTITLED AMENDED PARCEL MAP IN BOOK 510 OF MAPS, AT PAGES 49-54 RECORDED ON JULY 30, 1979


> SANTA CLARA COUNTY, CALIFORNIA A.P.N.: 779-46-007


MARCH 2021 NO SCALE Revision Date 779-46-007 Date Revision 2 Revision 3 Date


JOB NO. 15018


APPLICANT: KAIS AND LESLIE

ROAD: 1975 HAYES LANE

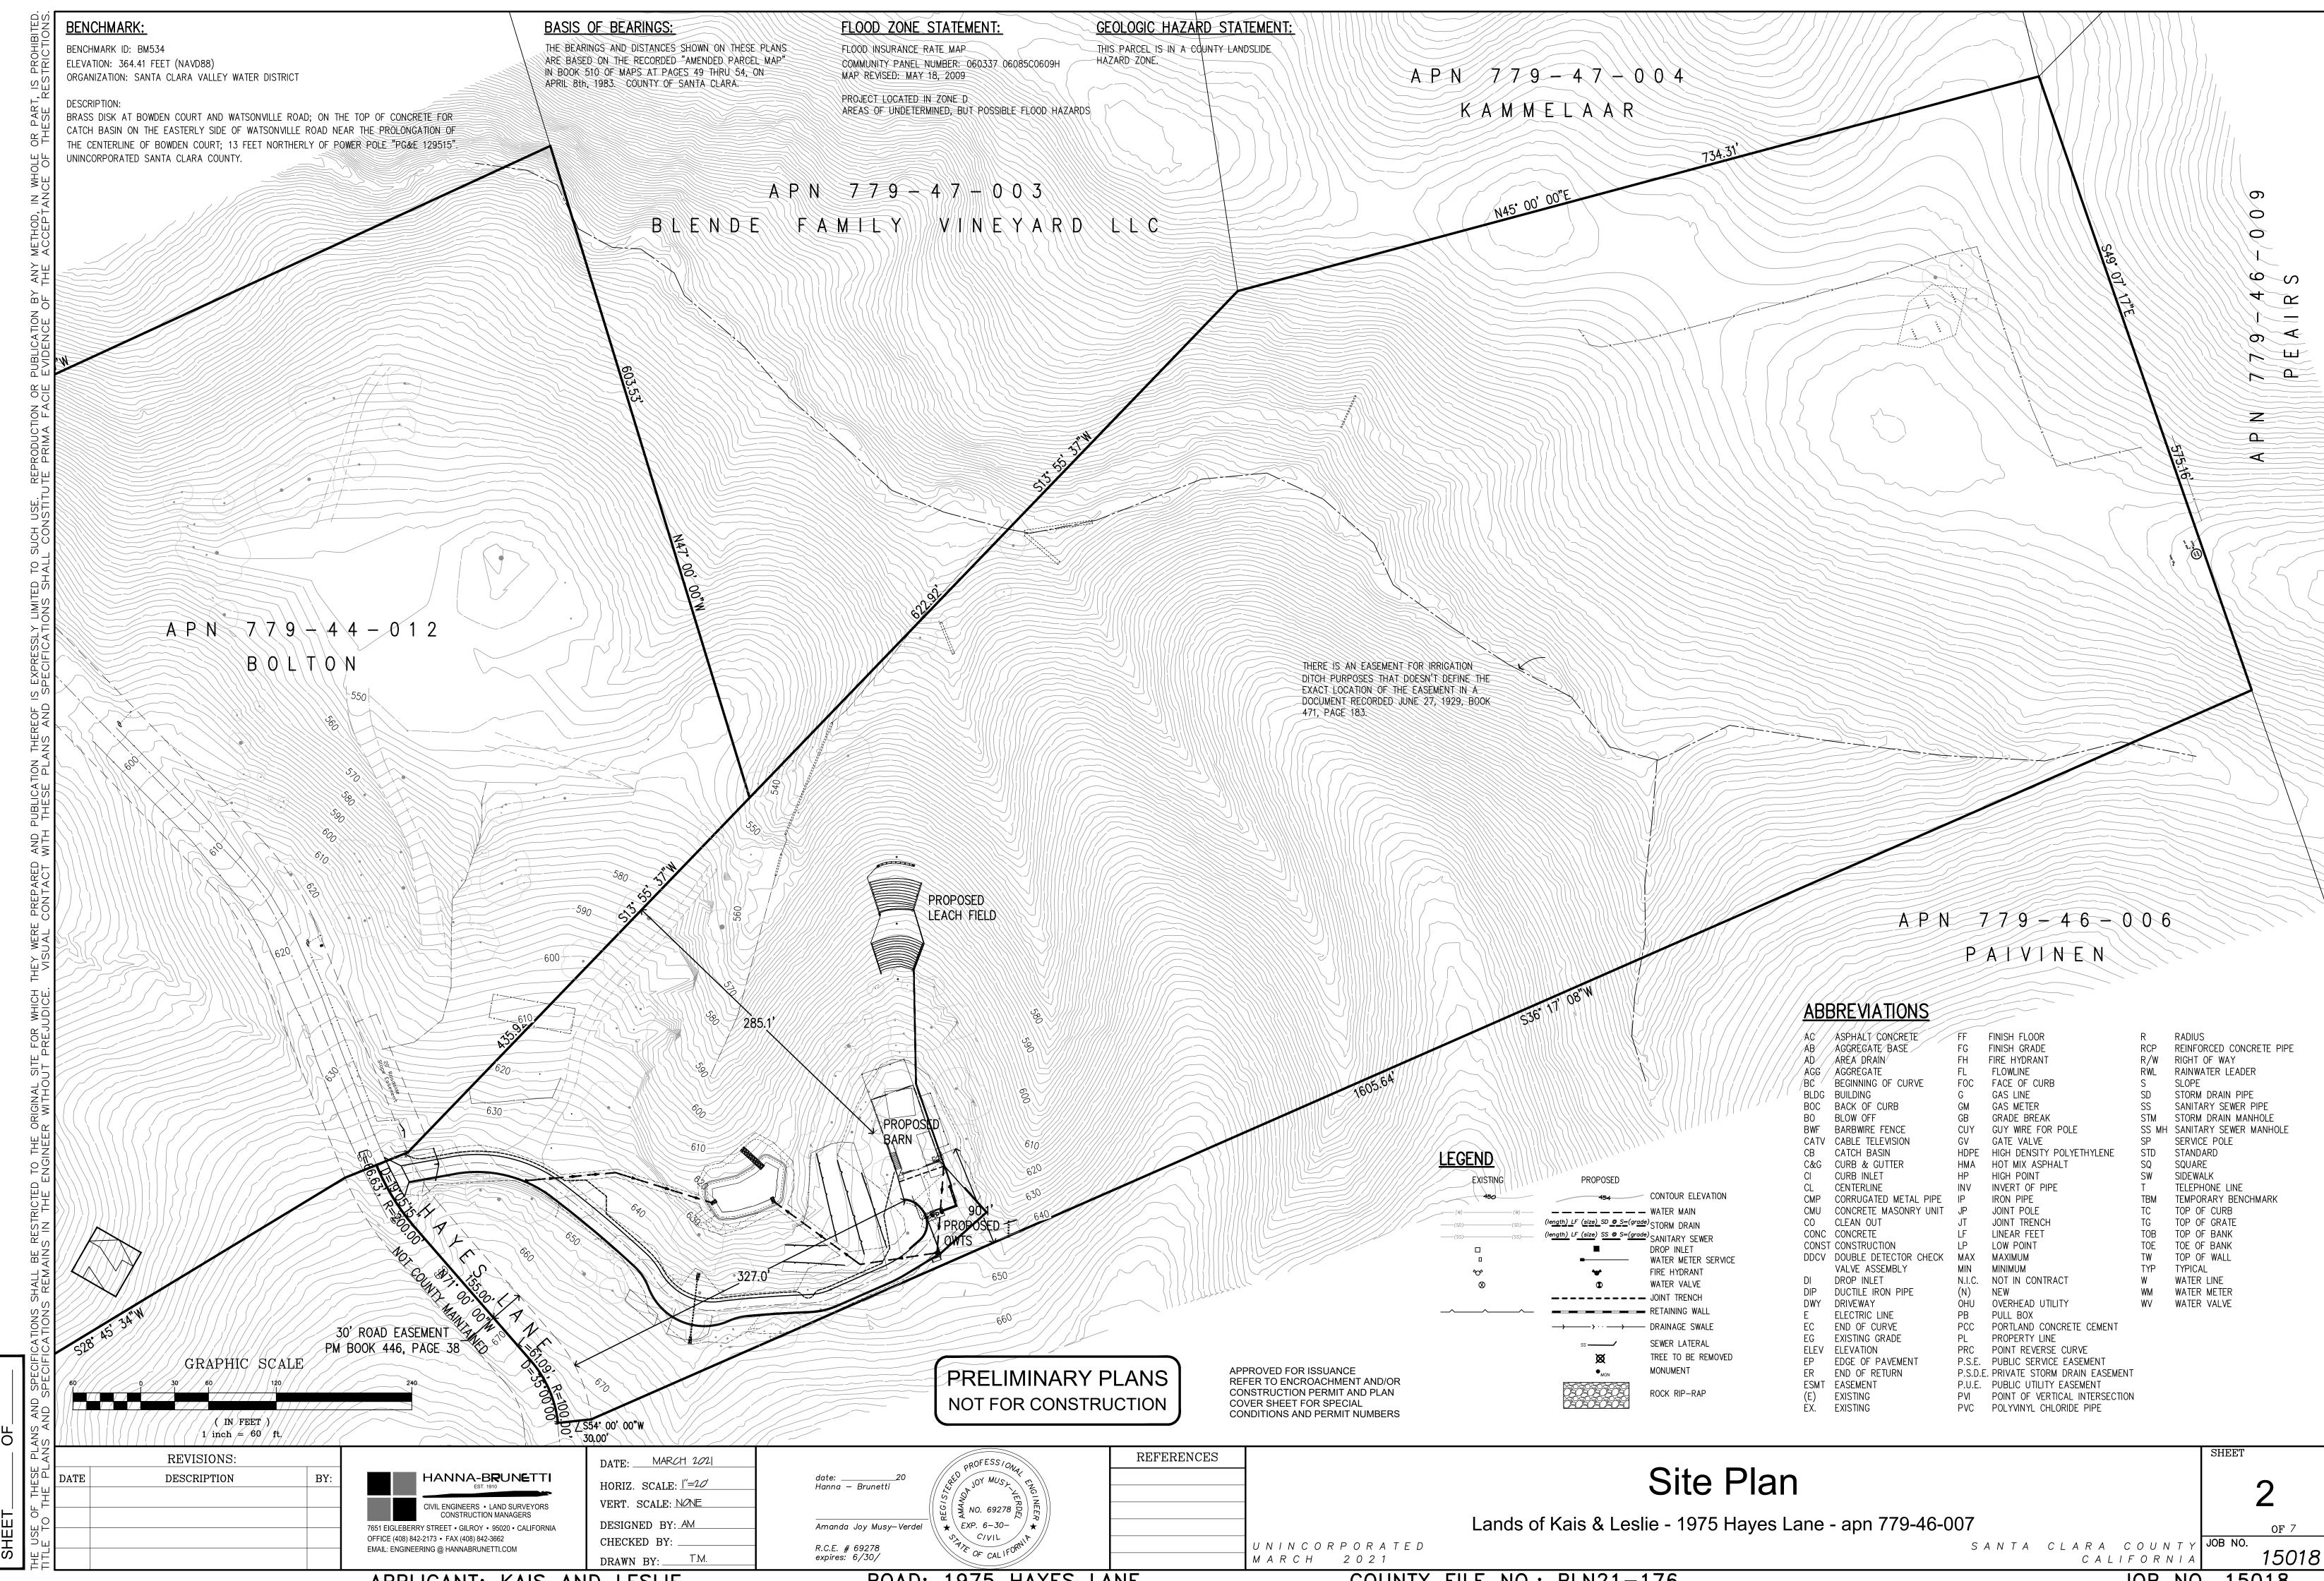

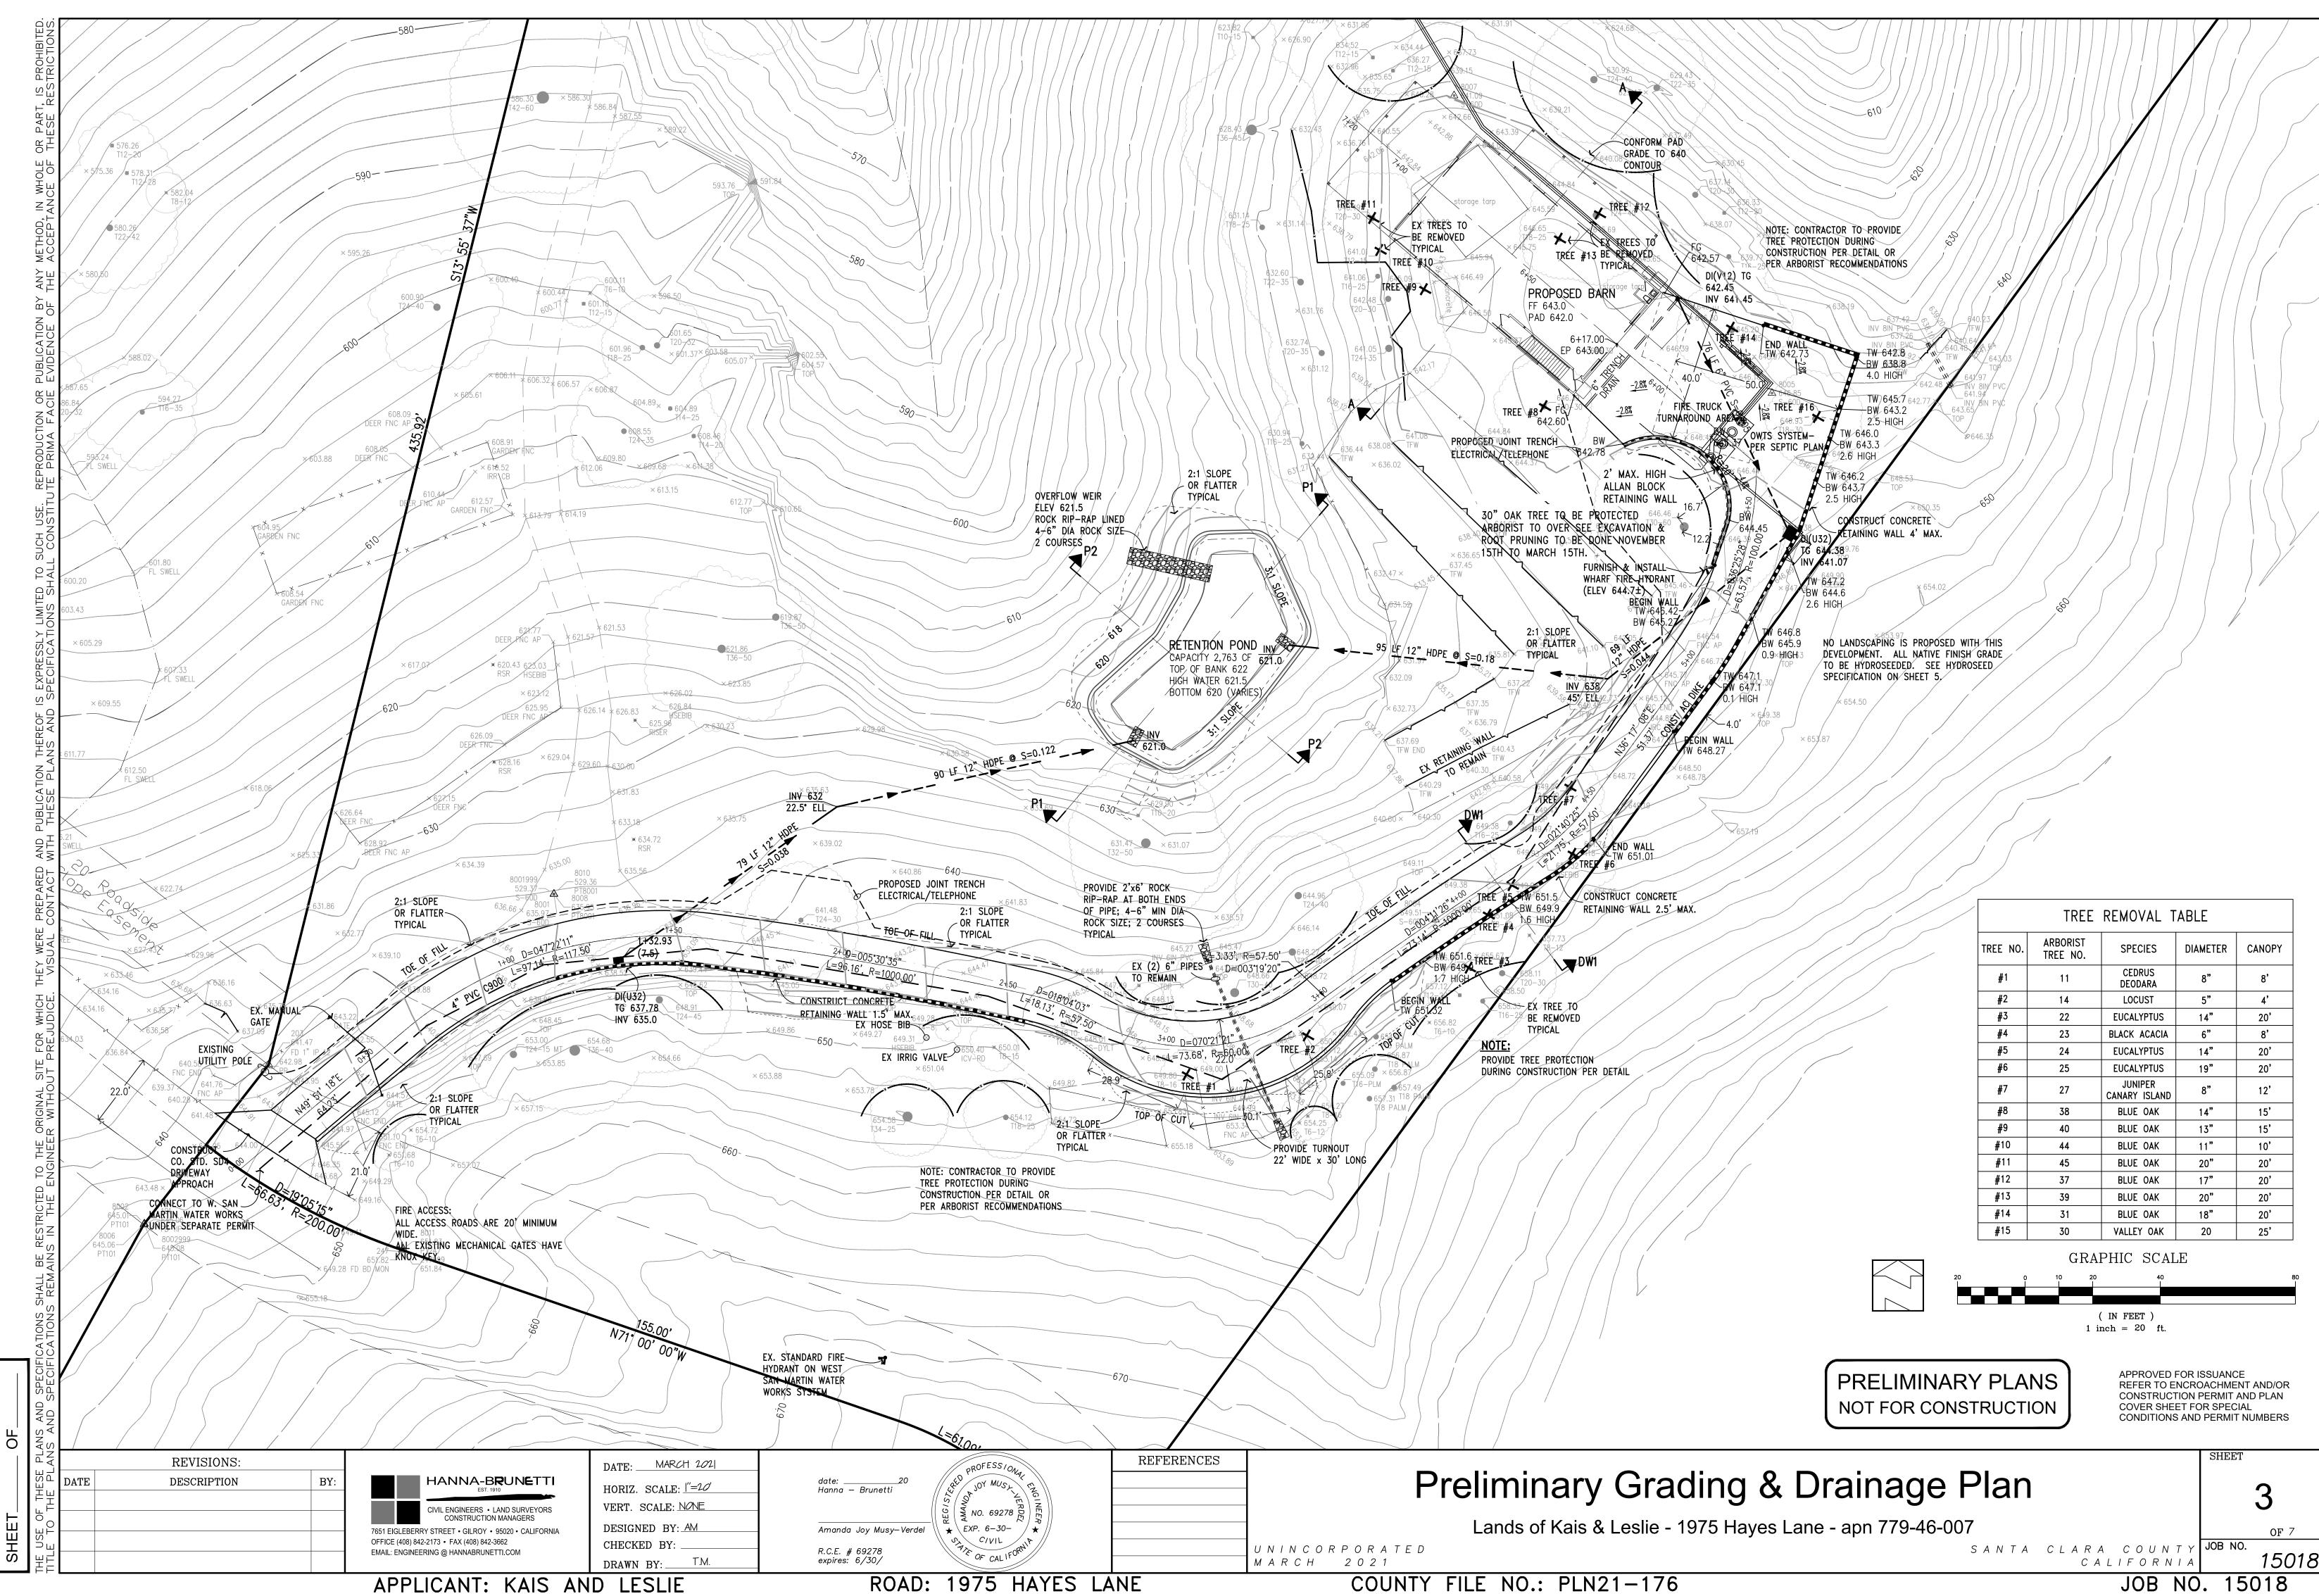


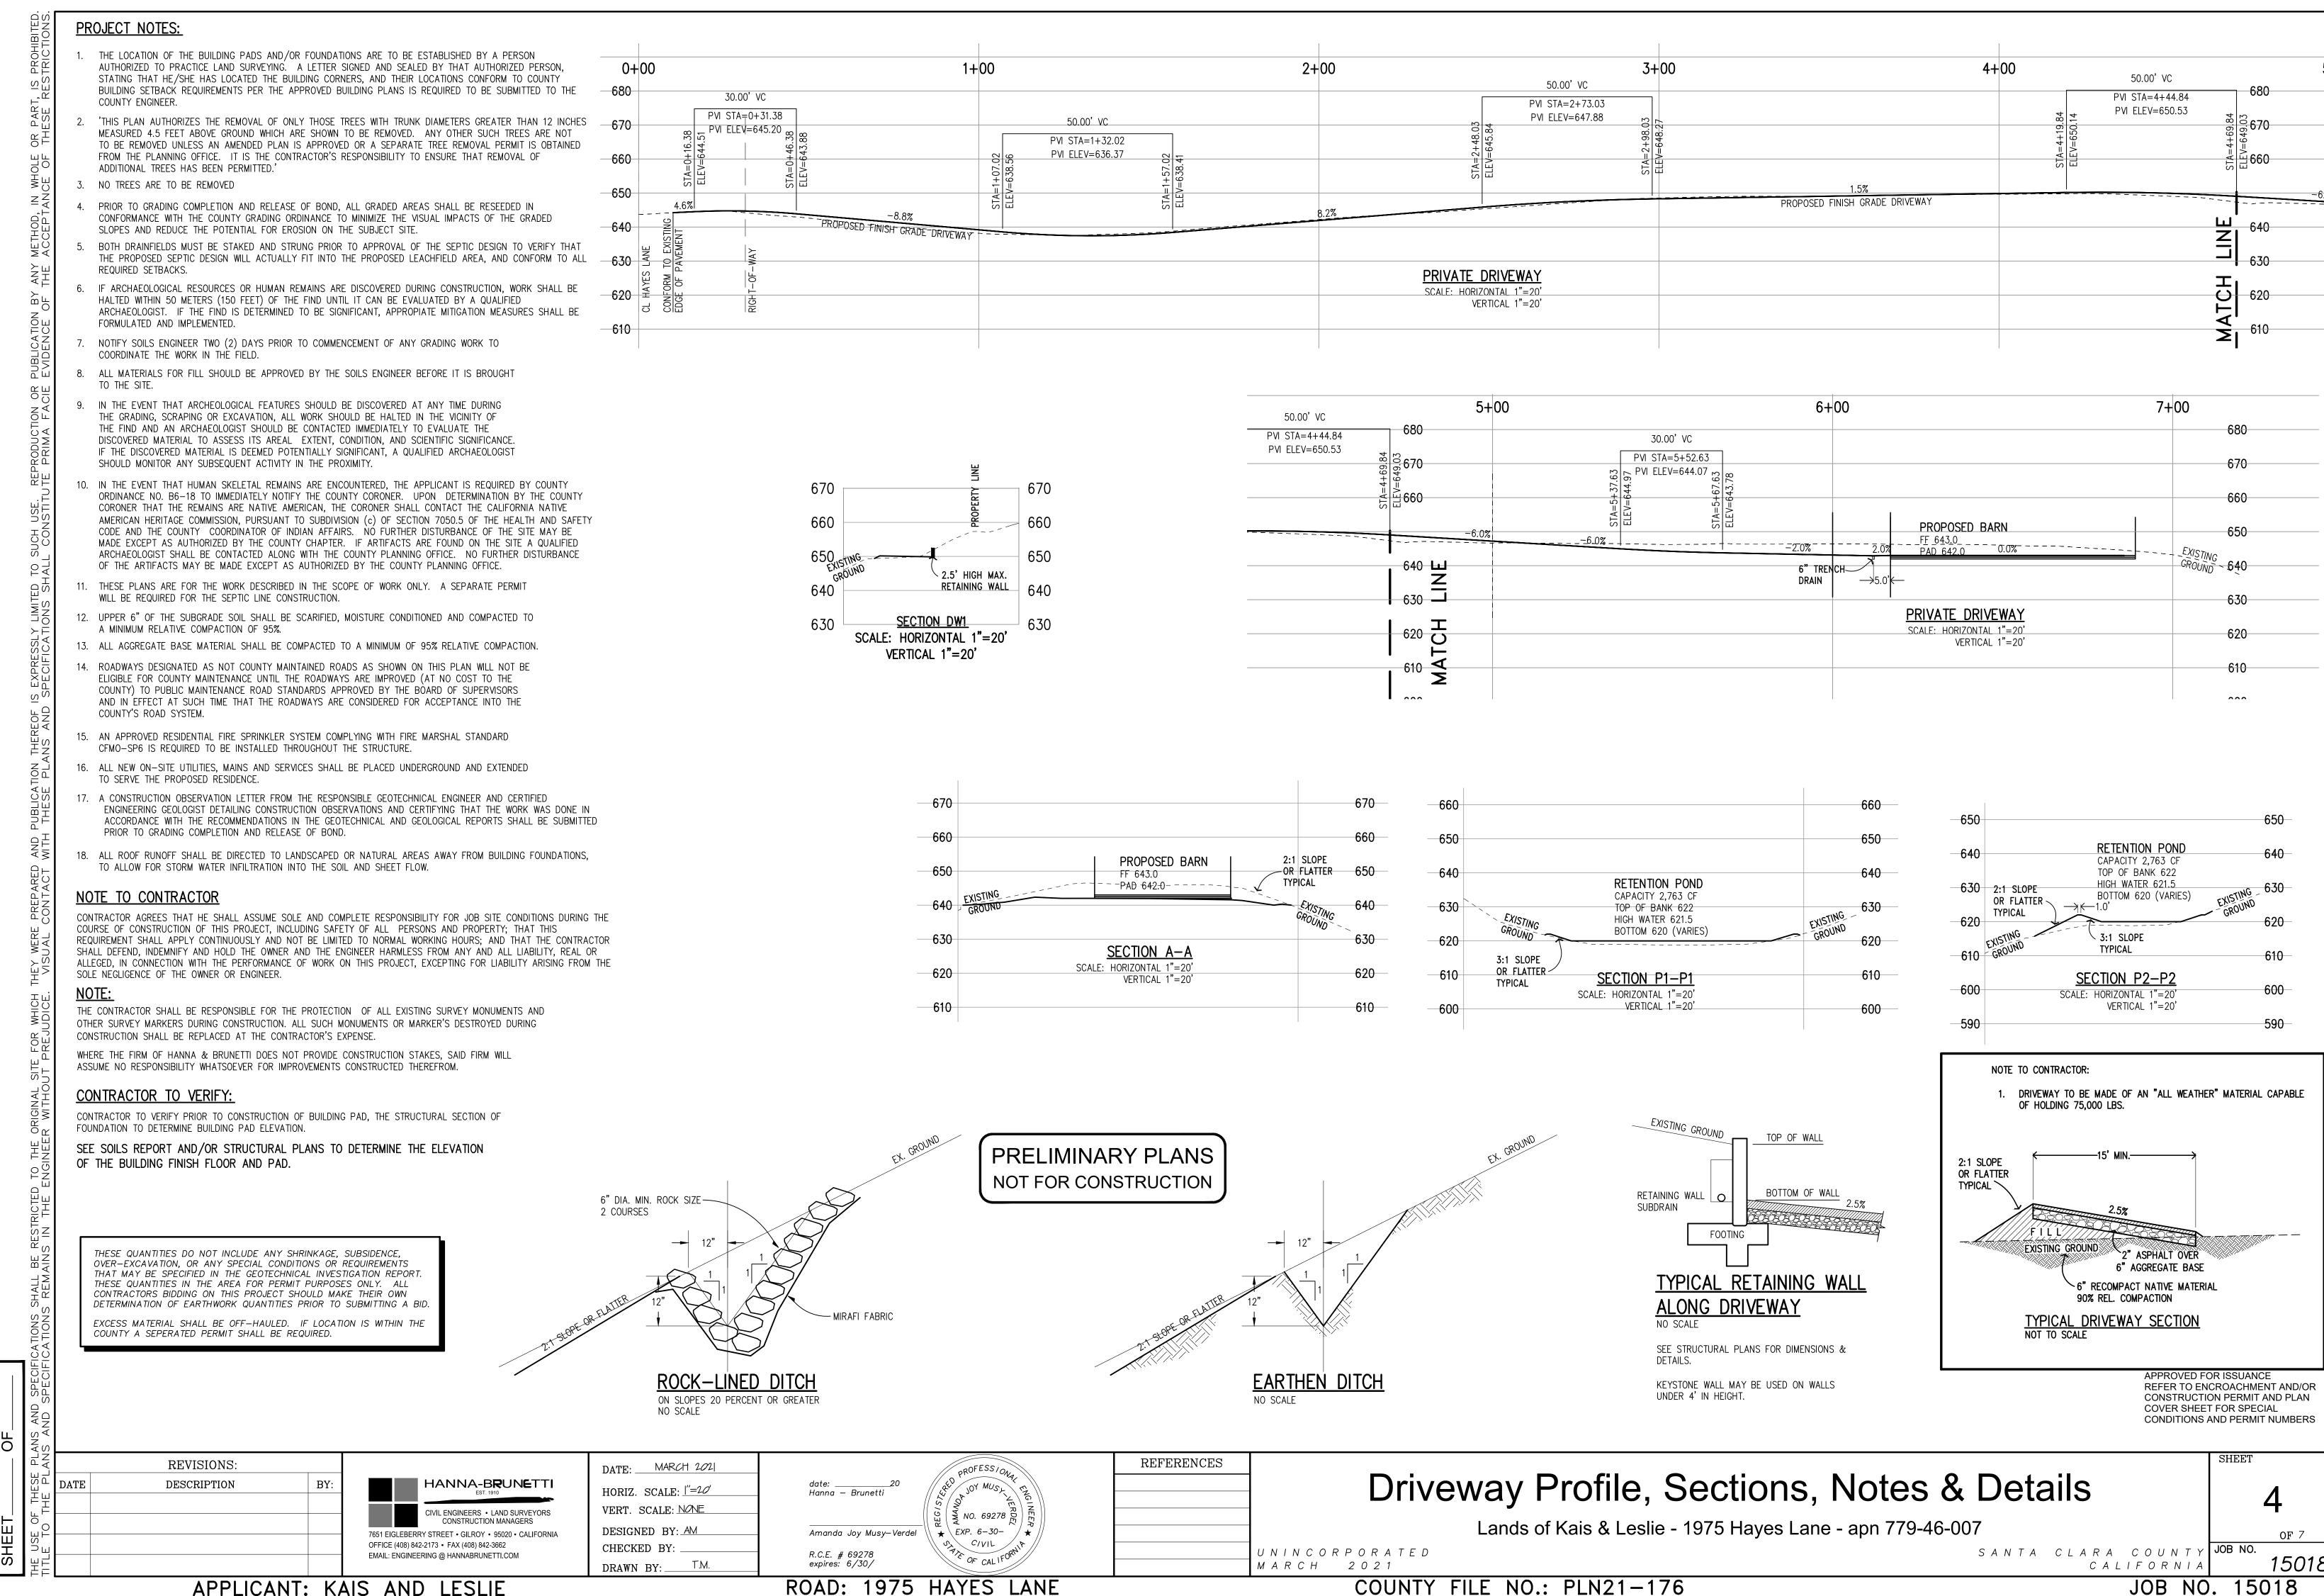

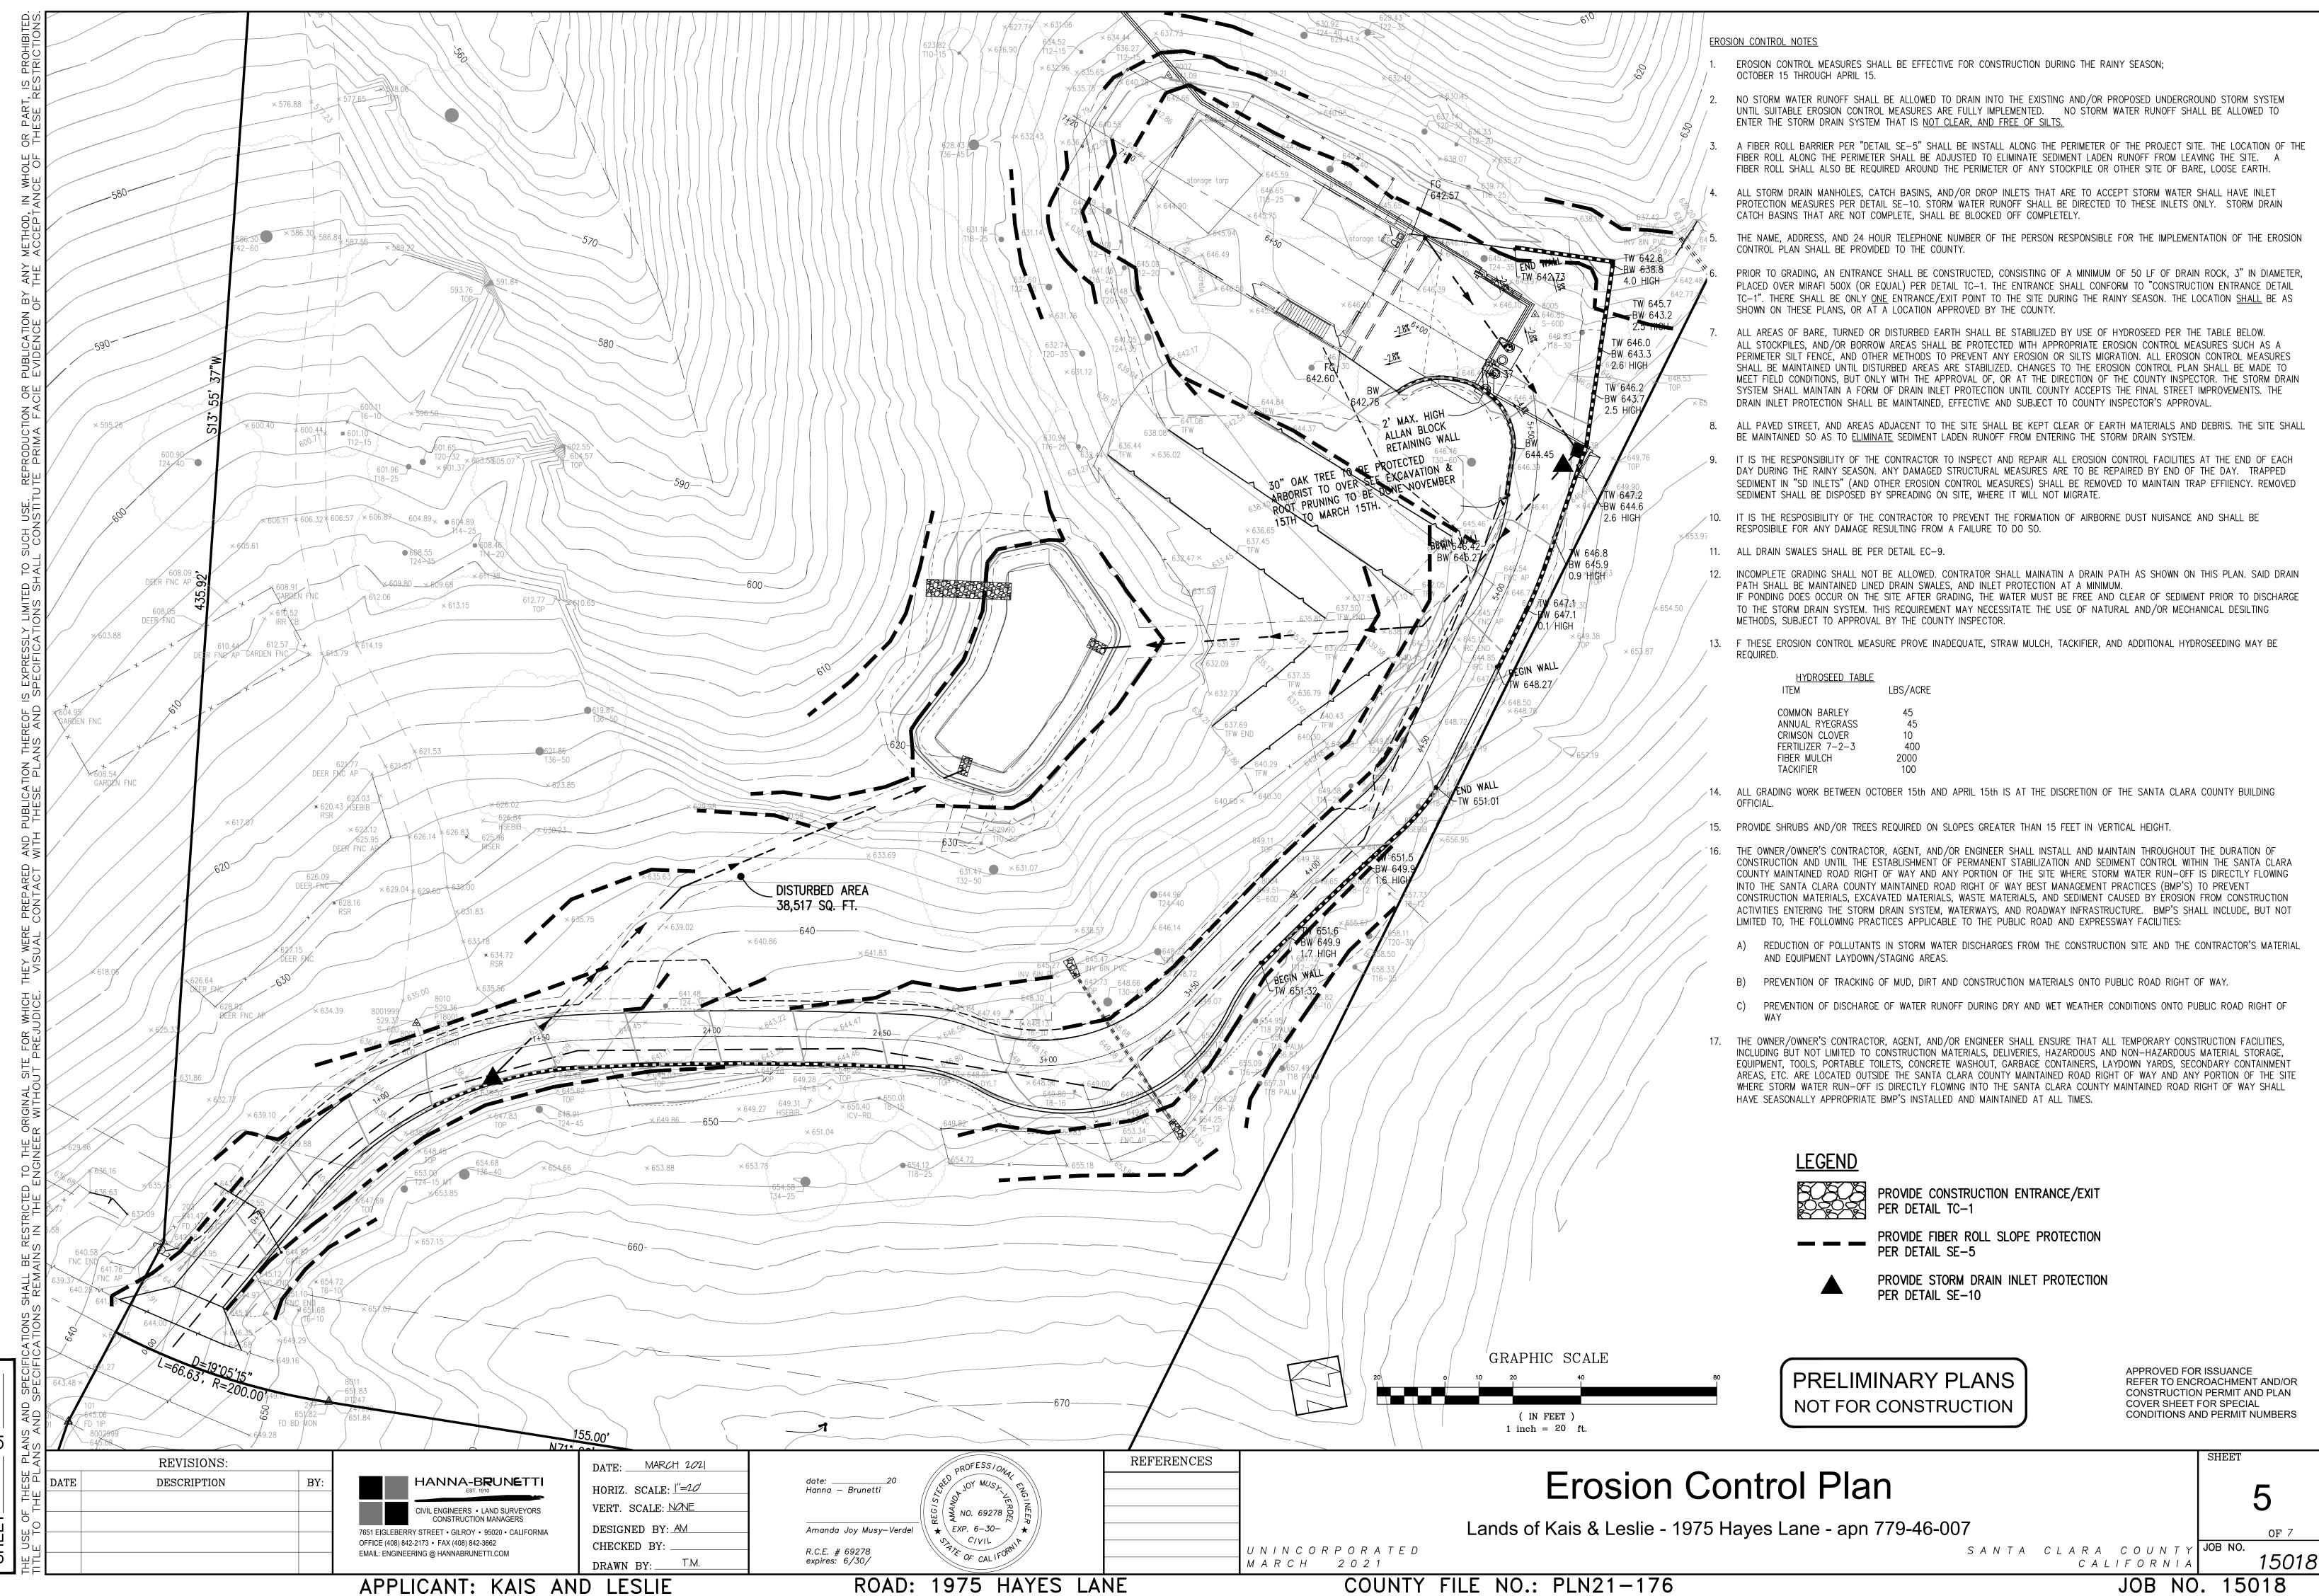

JOB NO. 15018

specified by a soils engineer

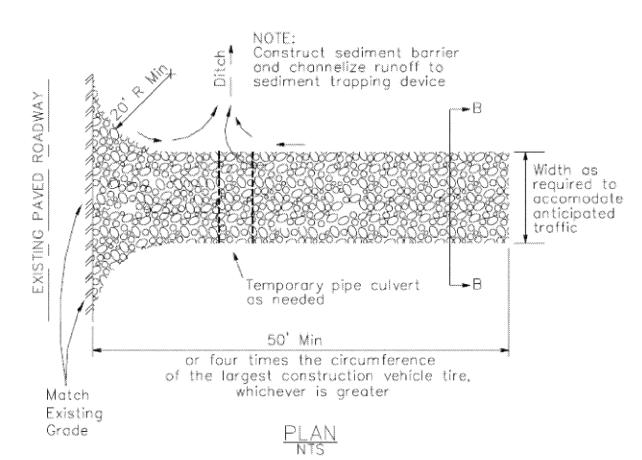

Silt Fence


(FGPND Tomped bookfill <u> Vox reprh = 500 (See note 1)</u> Signe direction Direction of flow - Optional maintanonce opening detail -(Sww natw 10) --松化色色色 Crass barrier PLAN SUTFENCE -- End døtol

CASQA Detail SE-1

NOTES


- 1. Construct the length of each reach so that the change in base elevation along the reach does not exceed 1/3 the height of the linear borrier, in no case shall the reach length exceed 500
- 2. The last B'-D'' of fence shall be turned up slape.
- J. Stake dimensions are naminal
- 4. Dimension may very to fit field condition.
- 5. Stakes shall be spaced at B'-O' maximum and shall be positioned on downstream side of tence.
- 6. Stokes to overlap and tence fabric to fold around each stake one full turn. Secure fathic to stake with 4 stoples.
- 7. Stokes shall be driven tightly together to prevent potential flow-through of sediment at joint. The tops of the stakes
- 8. For end stake, fence tabric shall be folded around two stakes one full turn and secured with 4 staples.
- Minimum 4 staples per stake. Dimensions shown are typical.
- 10. Cross barriers shall be a minimum of 1/3 and a maximum of 1/2 the
- 11. Maintenance openings shall be constructed in a manner to ensure andiment remains behind sit fence.
- 12 Joining sections shall not be placed at sump locations.
- 13. Sandbag rows and layers shall be offset to eliminate gaza.

CROSS BARRIER DETAIL

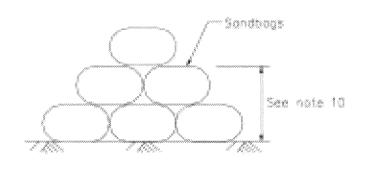


SECTION C-C

Velocity Dissipation Devices

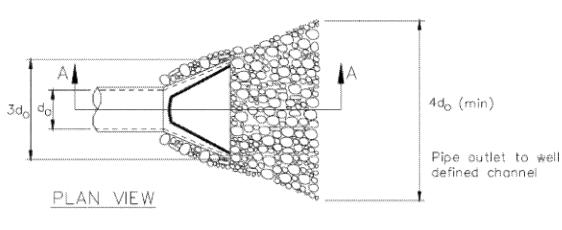


CASQA Detail EC-10

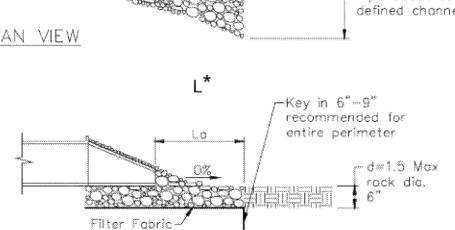

SECTION A-A

* Length per ABAG Design Standards

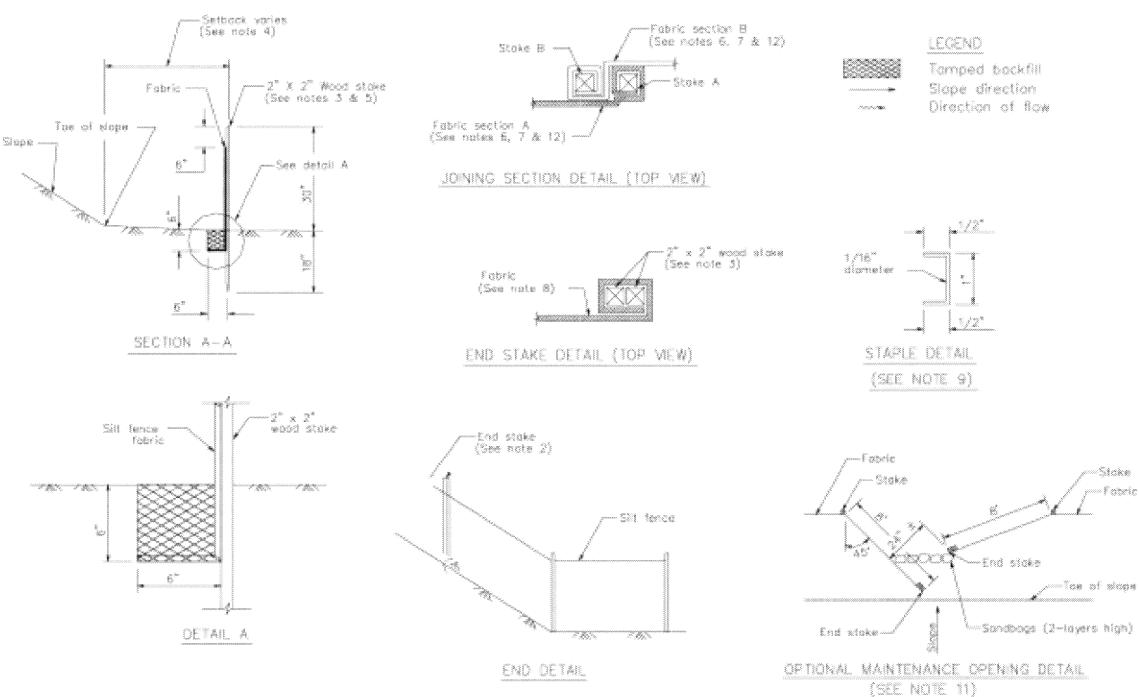

CASQA Detail SE-1

Silt Fence

Source for Graphics: California Stormwater BMP Handbook, California Stormwater Quality Association, January 2003. Available from www.cabmphandbooks.com.

STANDARD BEST MANAGEMENT PRACTICE NOTES

- 1. Solid and Demolition Waste Management: Provide designated waste collection areas and containers on site away from streets, gutters, storm drains, and waterways, and arrange for regular disposal. Waste containers must be watertight and covered at all times except when waste is deposited. Refer to Erosion & Sediment Control Field Manual, 4th Edition (page C3) or
- 2. <u>Hazardous Waste Management</u>: Provide proper handling and disposal of hazardous wastes by a licensed hazardous waste material hauler. Hazardous wastes shall be stored and properly labeled in sealed containers constructed of suitable materials Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-5 to C-6) or latest.
- 3. <u>Spill Prevention and Control</u>: Provide proper storage areas for liquid and solid materials, including chemicals and hazardous substances, away from streets, gutters, storm drains, and waterways. Spill control materials must be kept on site where readily accessible. Spills must be cleaned up immediately and contaminated soil disposed properly. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-7 to C-8, C-13 to C-14) or latest.
- 4. <u>Vehicle and Construction Equipment Service and Storage</u>: An area shall be designated for the maintenance, where onsite maintenance is required, and storage of equipment that is protected from stormwater run-on and runoff. Measures shall be provided to capture any waste oils, lubricants, or other potential pollutants and these wastes shall be properly disposed of off site. Fueling and major maintenance/repair, and washing shall be conducted off-site whenever feasible. Refer to Erosion & Sediment Control Field Manual, 4th Edition (page C9) or latest.
- 5. Material Delivery, Handling and Storage: In general, materials should not be stockpiled on site. Where temporary stockpiles are necessary and approved by the County, they shall be covered with secured plastic sheeting or tarp and located in designated areas near construction entrances and away from drainage paths and waterways. Barriers shall be provided around storage areas where materials are potentially in contact with runoff. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-11 to C-12) or latest.
- 6. Handling and Disposal of Concrete and Cement: When concrete trucks and equipment are washed on-site, concrete wastewater shall be contained in designated containers or in a temporary lined and watertight pit where wasted concrete can harden for later removal. If possible have concrete contractor remove concrete wash water from site. In no case shall fresh concrete be washed into the road right-of-way. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-15 to C-16) or latest.
- . <u>Pavement Construction Management</u>: Prevent or reduce the discharge of pollutants from paving operations, using measures to prevent run-on and runoff pollution and properly disposing of wastes. Avoid paving in the wet season and reschedule paving when rain is in the forecast. Residue from saw-cutting shall be vacuumed for proper disposal. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-17 to C-18) or latest.
- . Contaminated Soil and Water Management: Inspections to identify contaminated soils should occur prior to construction and at regular intervals during construction. Remediating contaminated soil should occur promptly after identification and be specific to the contaminant identified, which may include hazardous waste removal. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-19 to C-20) or
- 2. Sanitary/Septic Water Management: Temporary sanitary facilities should be located away from drainage paths, waterways, and traffic areas. Only licensed sanitary and septic waste haulers should be used. Secondary containment should be provided for all sanitary facilities. Refer to Erosion & Sediment Control Field Manual, 4th Edition (page C-21) or
- 10. Inspection & Maintenance: Areas of material and equipment storage sites and temporary sanitary facilities must be inspected weekly. Problem areas shall be identified and appropriate additional and/or alternative control measures implemented immediately, within 24 hours of the problem being identified.

STANDARD EROSION CONTROL NOTES

1. Sediment Control Management

<u>Tracking Prevention & Clean Up</u>: Activities shall be organized and measures taken as needed to prevent or minimize tracking of soil onto the public street system. A gravel or proprietary device construction entrance/exit is required for all sites. Clean up of tracked material shall be provided by means of a street sweeper prior to an approaching rain event, or at least once at the end of each workday that material is tracked, or, more frequently as determined by the County Inspector. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages B-31 to B-33) or latest.

Storm Drain Inlet and Catch Basin Inlet Protection: All inlets within the vicinity of the project and within the project limits shall be protected with gravel bags placed around inlets or other inlet protection. At locations where exposed soils are present, staked fiber roles or staked silt fences can be used. Inlet filters are not allowed due to clogging and subsequent flooding. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages B-49 to B-51) or latest.

Storm Water Runoff: No storm water runoff shall be allowed to drain in to the existing and/or proposed underground storm drain system or other above ground watercourses until appropriate erosion control measures are fully installed.


<u>Dust Control</u>: The contractor shall provide dust control in graded areas as required by providing wet suppression or chemical stabilization of exposed soils, providing for rapid clean up of sediments deposited on paved roads, furnishing construction road entrances and vehicle wash down areas, and limiting the amount of areas disturbed by clearing and earth moving operations by scheduling these activities in phases.


Stockpiling: Excavated soils shall not be placed in streets or on paved areas. Borrow and temporary stockpiles shall be protected with appropriate erosion control measures(tarps, straw bales, silt fences, ect.) to ensure silt does not leave the site or enter the storm drain system or neighboring watercourse.


- 2. Erosion Control: During the rainy season, all disturbed areas must include an effective combination of erosion and sediment control. It is required that temporary erosion control measures are applied to all disturbed soil areas prior to a rain event. During the non-rainy season, erosion control measures must be applied sufficient to control wind erosion at the site.
- 3. <u>Inspection & Maintenance</u>: Disturbed areas of the Project's site, locations where vehicles enter or exit the site, and all erosion and sediment controls that are identified as part of the Erosion Control Plans must be inspected by the Contractor before, during, and after storm events, and at least weekly during seasonal wet periods. Problem areas shall be identified and appropriate additional and/ or alternative control measures implemented immediately, within 24 hours of the problem being identified.
- 4. Project Completion: Prior to project completion and signoff by the County Inspector, all disturbed areas shall be reseeded, planted, or landscaped to minimize the potential for erosion on the subject site.
- 5. It shall be the Owner's/Contractor's responsibility to maintain control of the entire construction operation and to keep the entire site in compliance with the erosion control plan.
- 6. Erosion and sediment control best management practices shall be operable year round or until vegetation is fully established on landscaped surfaces.


ANS EMEN-IMPROVE


Information Project




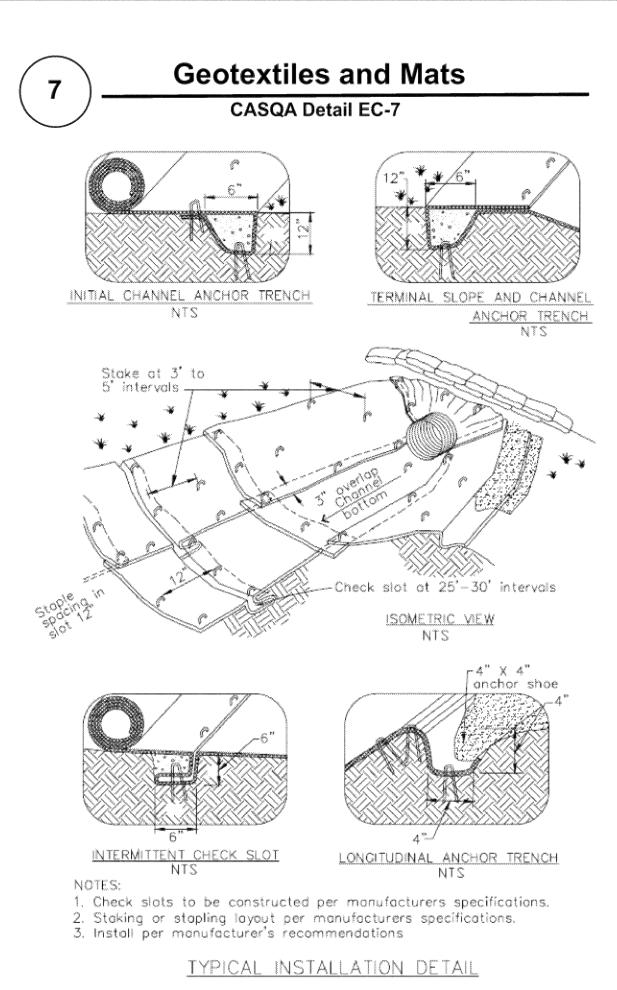


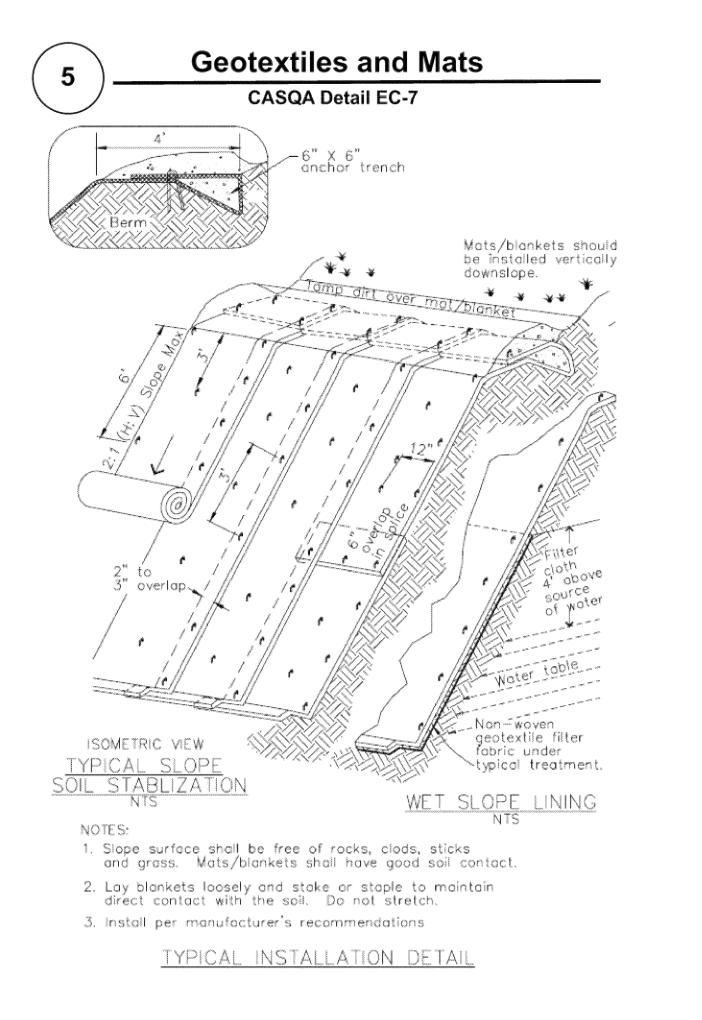

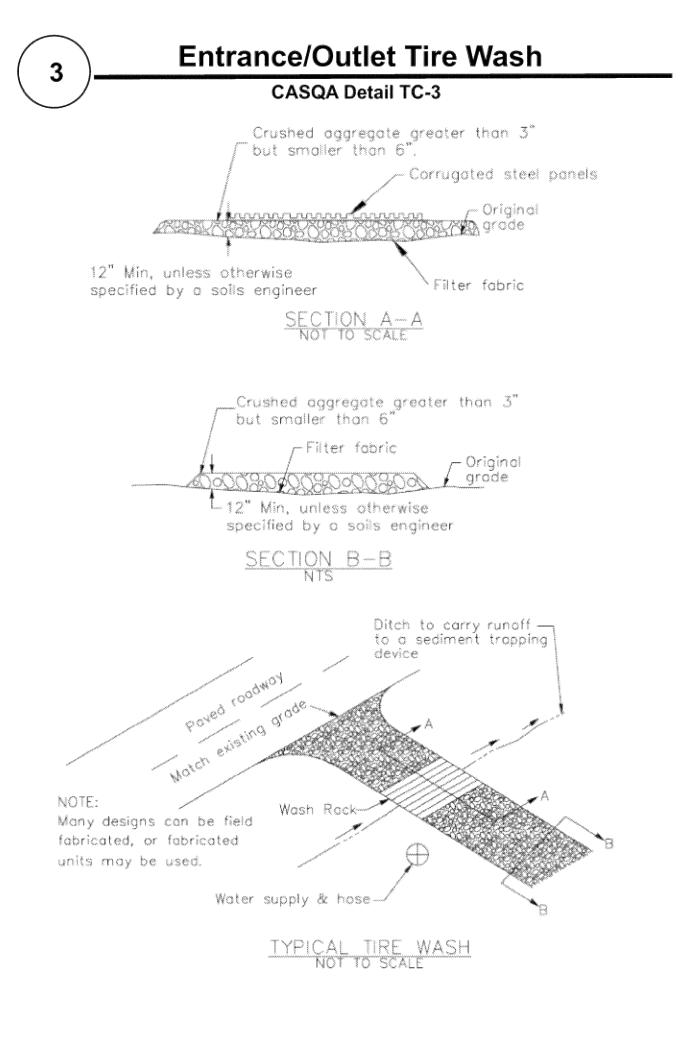

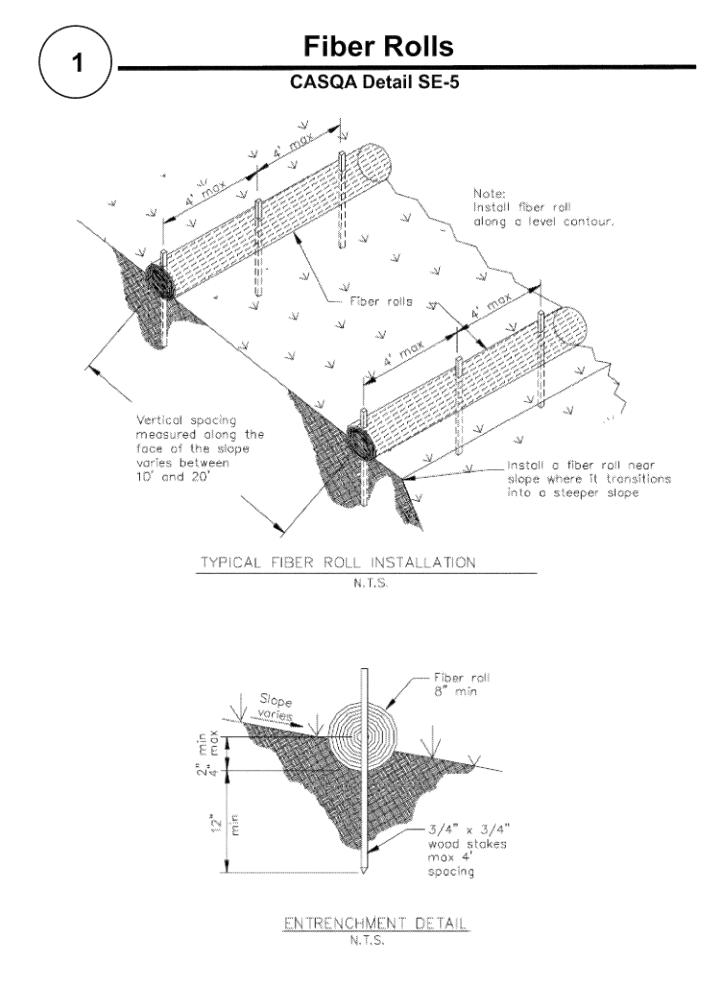

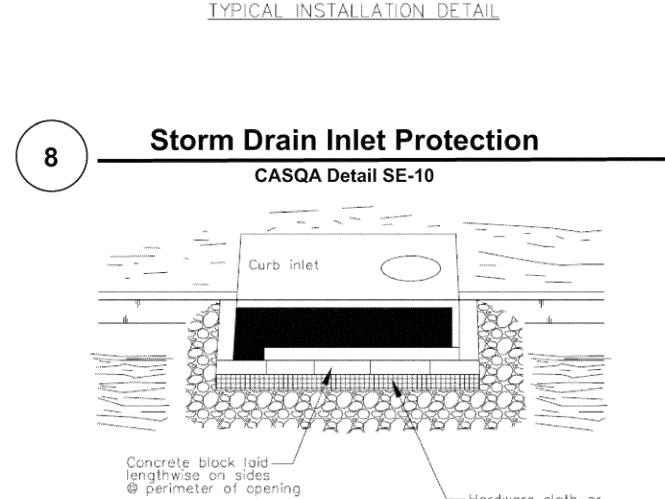

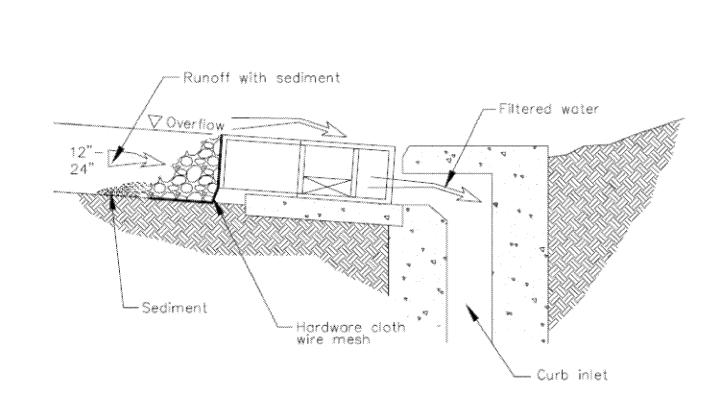


wire mesh

DI PROTECTION - TYPE 4 NOT TO SCALE

Source for Graphics: California Stormwater BMP Handbook, California Stormwater Quality Association, January 2003.


Available from www.cabmphandbooks.com.

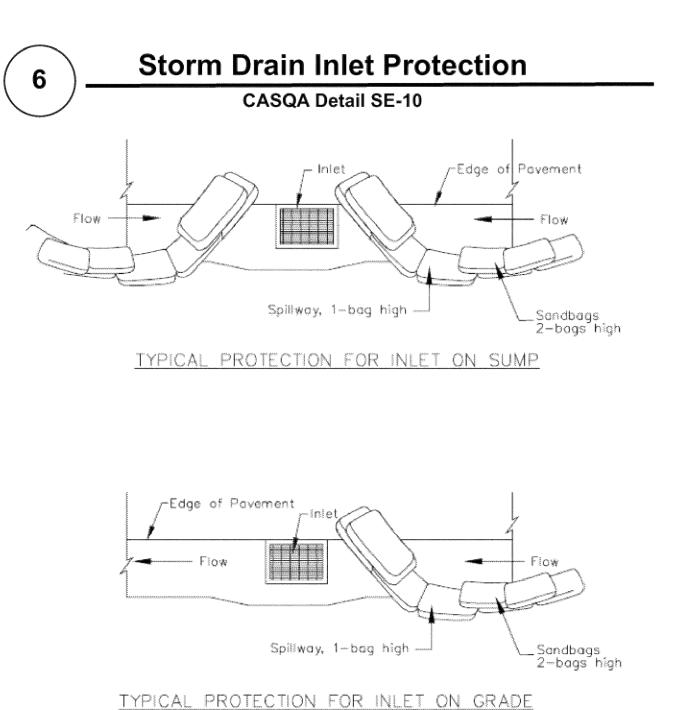


1. Intended for short-term use.

Use to inhibit non-storm water flow.
 Allow for proper maintenance and cleanup.


4. Bags must be removed after adjacent operation is completed5. Not applicable in areas with high silts and clays without filter fabric.

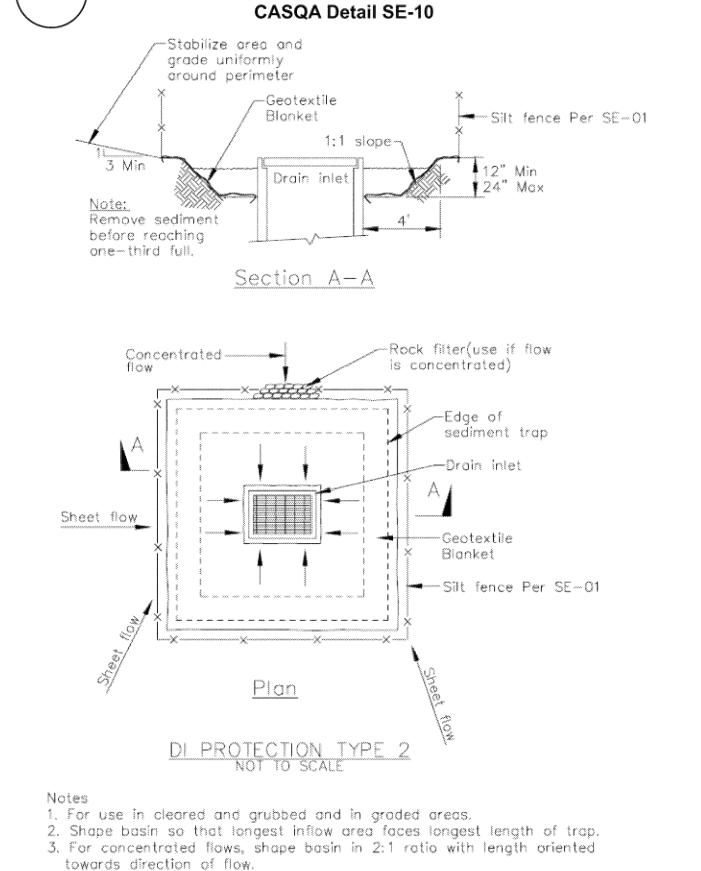

Storm Drain Inlet Protection

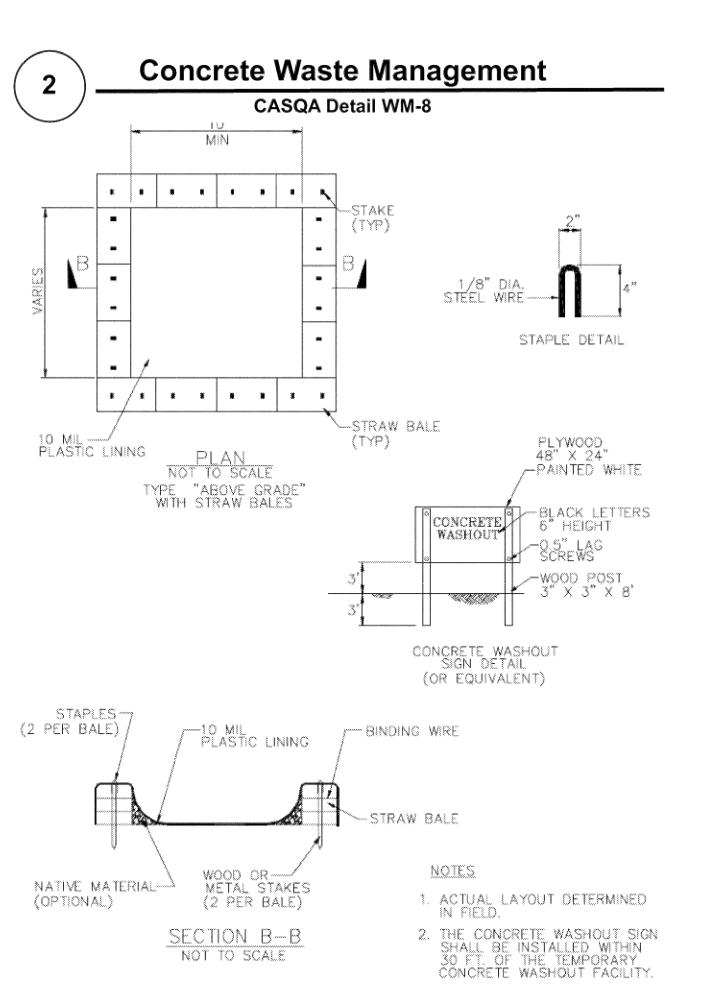

Best Management Practices and Erosion Control Details Sheet 2 County of Santa Clara



Project Information

IMPROVE

