**County of Santa Clara Department of Planning and Development** County Government Center, East Wing, 7th Floor 70 West Hedding Street San Jose, CA 95110 Phone: (408) 299-5700 www.sccplandev.org



STAFF REPORT Zoning Administration February 6, 2025

#### Item No. 2 Staff Contact: Eunice Ban, AICP, Senior Planner (408) 299-5707, eunice.ban@pln.sccgov.org

### File: PLN23-183 Grading Approval and Design Review (Tier 2) - for a new 7,762 sq. ft. single family residence with attached garage, porches, patio, driveway, retaining walls, and associated improvements.

**Summary**: Concurrent land use entitlement includes Design Review (Tier 2) and Grading Approval for a new 7,762 square foot single family residence with attached garage, porches, patios, driveway, retaining walls, and associated improvements. Proposed grading quantities associated with the Grading Approval includes 530 cubic yards of cut and 1,910 cubic yards of fill to accommodate the proposed single-family residence and the associated improvements.

**Owner:** Islam and Samantha Muhammad **Applicant:** Francisco Torres, Camargo & Associates **Address:** 3655 Pleasant Knoll Ct. San Jose **Present Land Use:** Vacant **Supervisorial District:** 1 **GP Designation**: Hillsides **Zoning**: HS-10Ac-d1 **APN**: 654-25-011 **Lot Size**: 10.3 acres **HCP**: Permit Area 2

#### **RECOMMENDED ACTIONS**

- A. Accept Categorical Exemptions, under Section 15303(a) of the CEQA Guidelines, Attachment A; and,
- B. Grant the request for a concurrent land use entitlement for Design Review (Tier 2) and Grading Approval pursuant to the Conditions of Approval outlined in Attachment B.

#### **ATTACHMENTS INCLUDED**

Attachment A – Proposed CEQA Determination Attachment B – Proposed Conditions of Approval Attachment C – Location & Vicinity Map Attachment D – Proposed Plans

#### **PROJECT DESCRIPTION**

The proposed project is for Design Review (Tier 2) and Grading Approval for a new 7,762 square foot single-family residence with attached garage, porches, and patios. Development also includes driveway, retaining walls, and associated improvements. Proposed grading quantities associated with the Grading Approval include 530 cubic yards of cut and 1,910 cubic yards of fill to accommodate the proposed single-family residence and associated improvements. No tree removal is proposed. Additionally, 20,944 square feet of landscaping and planting of various trees are proposed throughout the property to minimize the visibility of the structures (Attachment D – Proposed Plans).

#### **Setting/Location Information**

The subject parcel is 10.3 acres and is located in the northern region of the unincorporated county, east of City of San Jose. The subject property takes access from a private road, Pleasant Knoll Drive, which is part of single-family residential neighborhood. The property is surrounded by single-family residences to the west and south, and vacant parcels to the north and east. (Attachment C – Location & Vicinity Map). The proposed residential development is not subject to Building Site Approval as the subject property was created through a subdivision in 1999 and is therefore a numbered lot on a recorded parcel map (Ordinance Code Section C12-310(a)).

The property is located in Habitat Conservation Plan (HCP) Area 2: Rural Development greater than or equal to 2 acres covered and therefore does not require coverage by the Habitat Plan as the proposed development's disturbed area is 53,474 square feet (1.22 acres) and is under 2 acres in area. Additionally, there are no sensitive landcovers on the site that triggers an HCP coverage. A review of the California Natural Diversity Database identified Northern California legless lizard and Congdon's Tarplant on site, but as noted in the County of Santa Clara GIS database, there are no recent sitings of either species in the project vicinity, and both species are noted as extirpated or possibly extirpated, meaning it is likely that they are no longer present in the area. According to County of Santa Clara GIS mapping, the average slope of the parcel is 29.1%, which goes uphill along Pleasant Knoll Drive.

#### **REASONS FOR RECOMMENDATIONS**

#### A. Environmental Review and Determination (CEQA)

The proposed project qualifies for a Categorical Exemption under Section 15303(a) of the California Environmental Quality Act (CEQA) for a new single-family residence and associated improvements. Additionally, no unusual circumstances exist on the site to constitute significant effects, per subsection 15300.2. As such, an Initial Study and further analysis under the CEQA was not required.

#### B. Project/Proposal

- 1. General Plan: Hillsides
- 2. **Zoning Standards**: The Zoning Ordinance specifies the required development standards for HS-10Ac-d1 Zoning District, as summarized below, followed by a table noting the project's conformance with Section 3.20.040(D) regarding the retaining wall:

*Table A: Compliance with Development Standards for Single-Family Residential in HS-10Ac-d1* 

STANDARDS &	CODE SECTION	Meets Standard
REQUIREMENTS		(Y/N)*

Minimum lot area is 10 acres	§ 3.10.030	Y
Front setback (30 ft.)	§ 3.10.030	Y
Side setback (30 ft.)	§ 3.10.030	Y
Rear setback (30 ft.)	§ 3.10.030	Y

*Table B: Compliance with Retaining Wall Development Standards for HS-10Ac-d1 zoning district.* 

STANDARDS & REQUIREMENTS	CODE SECTION	Meets Standard (Y/N) *
Retaining wall visible from the valley floor shall not exceed ten feet in height as measured from grade at face to top of wall.	§ 3.20.040(D)	Y
Visible walls shall be colored and textured to complement the background land and vegetation, per the adopted design review guidelines.	§ 3.20.040(D)	Y, as conditioned

\*Refer to Discussion in Design Review Findings Section C below and Attachment E.

- C. Design Review (-d1): Per Section §5.50.040 of the County Zoning Ordinance, all Design Review applications are subject to the stated scope of review. The overall purpose of Design Review is to encourage quality design and to mitigate potential adverse visual impacts of development. In the following discussion, the scope of review findings is listed in bold, and an explanation of how the project meets the required standard is in plain text below.
  - 1. Mitigation of any adverse visual impacts from proposed structures, grading, vegetation removal and landscaping;

The County's Geographic Information System (GIS) data shows the proposed development in a high visibility area. As such, the project applicant reduced and modified initial plans to mitigate visual impact to the natural surrounding as much as possible by implementing development standards listed in the County Zoning Code and Grading Ordinance policies as detailed below.

The proposed single-family development is located closest to the private access road, Pleasant Knoll Ct., for minimal grading impact. Architectural accents, door and window frames, exterior walls, and retaining walls all have light reflectivity value (LRV) less than 45. The proposed single-family development conforms to the height and specific limitations on wall dimensions. The height of the single-family residence is at 30 feet. Horizonal length of a continuous wall plane does not exceed 80 feet, and the height of the wall plane does not exceed 24 feet. Lastly, the applicant proposes extensive landscaping surrounding the proposed residential development, and numerous trees will be planted south of the residential development to mitigate visual impact from valley floor. The proposed project includes mitigation efforts to decrease adverse visual impacts; therefore, this finding can be made.

#### 2. Compatibility with the natural environment;

The proposed development is located near the existing driveway and is on the flattest area of the parcel, requiring minimal grading. Project has been modified to create a tiered appearance, by reducing the second story to single story on the western side of the south elevation. One area of minor concern is for the building form to follow the natural contours of the land. Ideally, the single-story garage located on the northern side of the property should be located on the south for the appearance of the building form to follow the natural contours of the land, but this change could also potentially increase grading amount and was not the design preference of the owner.

Overall, the project is designed to be compatible with the natural environment by incorporating standards laid out in the County Zoning Code such as meeting the LRV limitations, building form and massing, and the design review guidelines. As such, this finding can be made.

### **3.** Conformance with the "Design Review Guidelines," adopted by the Board of Supervisors;

The proposed single-family residence and its associated improvements conforms with the County's Board adopted Design Review Guidelines. The siting of the proposed residence is advantageous as it is located close to the existing street and on the flattest area of the parcel. Furthermore, the project applicant has made revisions to reduce its visibility by reducing two stories to single story along the western portion of its south elevation to minimize mass and create a tiered façade. The building form and continuous wall sizes conform with County Zoning Code Section 3.20.040(C), and the LRV of the structure is less than 45 further reducing the visual impact.

As mentioned above, an area of minor concern is the requirement for development to follow the natural contours of the land. The parcel slopes downward towards west. Instead of having the proposed residential tier upward along the slope, the single-story garage is located north, failing to create a tiered structure along the natural contours of the land. However, the applicant proposes extensive landscaping around the proposed residence and retaining walls, which minimizes visual impacts caused by the lack of tiering.

The tallest height of the proposed retaining wall is at nine (9) feet, which is less than the maximum height of 10 feet. Retaining wall will also be covered by surrounding landscaping, and conditions have been added to color and texture the retaining wall to reduce visibility.

With the added landscaping to screen the proposed residential building and retaining walls, the proposed development mostly conforms with the Design Review guidelines. As such this finding can be made.

#### 4. Compatibility with the neighborhood and adjacent development;

Neighboring parcels are approximately 9-12 acres in size and include a single-family residential development or are vacant. The proposed single family residential development with its associated improvements conforms with existing neighboring residences, which are similar in size and scale. Due to the similarities of the proposed development and the neighboring properties, <u>this finding can be made</u>.

#### 5. Compliance with applicable zoning district regulations; and

As summarized in Section B and Tables A and B of this staff report, the proposed single family residential development and retaining wall, less than 10 feet in height, are allowed in the HS-10Ac-d1 zoning district and comply with zoning regulations and development standards. The proposed single-family residence meets the required setbacks and conforms with -d1 LRV requirements. The retaining wall meets the height requirements as specified in Zoning Ordinance Section 3.20.040(D). As such, the single family residential, retaining wall, and its associated improvements comply with the applicable zoning district regulations and this finding can be made.

6. Conformance with the general plan, any applicable specific plan, or any other applicable guidelines adopted by the Board of Supervisors or Planning Commission

The proposed development conforms with the Santa Clara County General Plan Hillside Policy R-LU 18 which allows for low density residential uses. The proposed development also includes associated improvements to the site such as a new driveway, retaining wall, and landscaping. General Plan Policy R-GD 22 also applies to the project which states that grading shall be kept to a minimum to establish the proposed structures and to avoid unnecessary grading. The proposed development conforms with this as it is situated in the area on the parcel that requires the least amount of grading to develop a single-family residence. The single-family residential building is, for the most part, consistent to the County's Board adopted Design Guidelines as they involve minimal grading and will incorporate tree planting to reduce the visual impacts. As such, <u>this finding can be made</u>.

**D. Grading Approval: Pursuant to Section C12-433 of the County Ordinance Code, all** Grading Approvals are subject to specific findings. In the following discussion, the scope of review findings are listed in **bold**, and an explanation of how the project meets the required standard is in plain text below.

# 1. The amount, design, location, and the nature of any proposed grading is necessary to establish or maintain a use presently permitted by law on the property.

The project's grading quantities are 530 cubic yards of cut and 1,910 cubic yards of fill and a maximum vertical depth of 9.4 ft. to establish the driveway. The majority of the cut and fill is to establish the landscaping and driveway area. Additional grading is proposed for the proposed residence, water tank pads, and hardscape. The proposed residential development along with its associated improvements are a use presently permitted by law. The amount, design, location, and the nature of the proposed grading is necessary to establish the use permitted by law on the property. As such, this finding can be made.

# 2. The grading will not endanger public and/or private property, endanger public health and safety, will not result in excessive deposition of debris or soil sediments on any public right-of-way, or impair any spring or existing watercourse.

The proposed grading will not endanger public or private property. The grading is to establish a residential use on the property that is allowed by law. All exported soil

will be deposited at an approved site. The Conditions of Approval require that the final grading plans will ensure that grading around the building pads and driveway will not result in slope instability or erosion. Land Development Engineering has specific erosion control standards to be implemented as part of the driveway and grading design. As such, this finding can be made.

### **3.** Grading will minimize impacts to the natural landscape, scenic, biological and aquatic resources, and minimize erosion impacts.

The proposed residential development would be built on site that is already relatively flat and is on the flattest portion of the subject property. There are no riparian and creeks on site or nearby, and therefore, the project does not impact biological and aquatic resources. Additionally, there are no known recent occurrences of protected species that are impacted by the proposed development. Land Development Engineering has specific erosion control standards to be implemented as part of the grading design which will minimize erosion impacts. As such, this finding can be made.

4. For grading associated with a new building or development site, the subject site shall be one that minimizes grading in comparison with other available development sites, taking into consideration other development constraints and regulations applicable to the project.

The proposed residential development would be built on site that is relatively flat and is the flattest area on the subject property. Therefore, the proposed development is in a location that minimizes grading in comparison to other available sites. As such, <u>this finding can be made</u>.

# 5. Grading and associated improvements will conform with the natural terrain and existing topography of the site as much as possible, and should not create a significant visual scar.

The proposed grading conforms with the natural topography as much as possible. The majority of the proposed grading matches the existing slope and does not create a visual scar as the proposed development would include landscaping to cover the residential and retaining wall. As such, <u>this finding can be made</u>.

#### 6. Grading conforms with any applicable general plan or specific plan; and

The proposed grading is in conformance with specific findings and policies identified in the County General Plan. The project is consistent with the County's General Plan R- GD 22, which encourages only the minimal grading necessary to establish the proposed use. The proposed residential development would be built on a relatively flat area. As such, this finding can be made.

#### 7. Grading substantially conforms with the adopted "Guidelines for Grading and Hillside Development" and other applicable guidelines adopted by the County.

The proposed grading is in conformance with the adopted "Guidelines for Grading and Hillside Development," in particular, the specific guidelines for grading, siting, building form, and design. The overall grading design of the proposed residential and its associated improvements, for the most part, conforms with the natural terrain. There will not be any impact to biological resources and there is no indication of protected species on this parcel. Therefore, this finding can be made.

#### Staff Recommendation

In conclusion, Staff recommends the Zoning Administration Hearing Officer approve the concurrent land use entitlements for Grading Approval and Design Review (Tier 2). As noted throughout the Staff Report, the proposed project meets all development standards for the proposed residence, and retaining wall, as well as uses landscaping to minimize visibility of the residence and associated improvements, thereby meeting and all the findings for Grading Approval and Design Review.

#### BACKGROUND

On October 12, 2023, the applicant applied for Design Review (Tier 2) and Grading Approval to develop a single-family residence with attached garage, porches, patio, driveway, and retaining wall. After several application reviews, the applicant provided additional information and revised their proposed design to reduce the square footage and mass of the residential structure to meet the height requirement and to have a more tiered appearance. The applicant further modified the project and plans to comply with the requirements of Design Review such as meeting the LVR and adding landscaping to reduce visual impact. The applicant also spent a significant amount of time working with San Jose Water Company to address its water issue. The application was deemed complete on September 18, 2024. As such, the Permit Streamlining Act deadline for a decision on this project is February 28, 2025.

A public notice was mailed to all property owners within a 300-foot radius on January 27, 2025, and was also published in the Post Records on January 27,  $2025^{1}$ . As of writing this report, no public comments have been received regarding this application.

#### STAFF REPORT REVIEW

Eunia Ban Prepared by: Prepared by: Eunice Ban, Senior Planner

—DocuSigned by: Joanna Wilk

Reviewed by: Joanna Wilk, Principal Planner

<sup>&</sup>lt;sup>1</sup> San Jose Post Record; <u>https://www.postrecord.news/home.cfm?ref=legalnotices&disp=1</u> – Legal Notices January 27, 2025; <u>https://www.postrecord.news/LegalNotices/SJR-2025-01-27.pdf</u>

## Attachment A

Proposed CEQA Determination

### **County of Santa Clara**

Department of Planning and Development Planning Office

County Government Center, East Wing, 7th Floor 70 West Hedding Street San Jose, California 95110-1705 (408) 299-5770 FAX (408) 288-9198 www.sccplanning.org



## **STATEMENT OF EXEMPTION**

from the California Environmental Quality Act (CEQA)

FILE NUMBER	APN(S) DATE			
PLN23-183	654-25-011	1/30/2025		
PROJECT NAME	APPLICATION TYPE			
New single-family residence with new garage, driveway, retaining wall, and associated improvements	Grading Approval and Design Review (Tier 2)			
OWNER	APPLICANT			
Islam and Samantha Muhammad	Francisco Torres, Camargo & A	Associates		
PROJECT LOCATION				
3655 Pleasant Knoll Ct. San Jose, CA 95148				
PROJECT DESCRIPTION				
Concurrent land use entitlement including Grading Approval for new residence, water tank pads, landscape, and driveway, Design Review (Tier 2) for a new two story 7,762 square feet single-family home. Proposed grading quantities associated with the Grading Approval include 530 cubic yards of cut and 1,910 cubic yards of fill to accommodate the proposed residential and associated improvements.				
All discretionary development permits processed by the County Planning Office must be evaluated for compliance with the California Environmental Quality Act (CEQA) of 1970 (as amended). Projects which meet criteria listed under CEQA may be deemed exempt from environmental review. The project described above has been evaluated by Planning Staff under the provisions of CEQA and has been deemed to be exempt from further environmental review per the provision(s) listed below.				
CEQA (GUIDELINES) EXEMPTION SECTION				
Section 15303(a) - Class 3: New Construction or Conversion of Small Structures				

COMMENTS

The proposed single-family residential development requires Design Review and Grading Approval land use entitlements and meets Zoning Ordinance development standards. The grading associated with the proposed single-family residential and associated improvements is the minimum necessary to construct the residential which is allowed by law. New landscaping is proposed to shield development from neighboring properties and the valley floor. No unusual circumstances exist so as to constitute significant effects, per subsection 15300.2(c).

APPROVED	OBY:
----------	------

Eunice Ban, Senior Planner

Curiu Ban

Signature Date: 1/30/2025

## Attachment B

Preliminary Conditions of Approval

### **Preliminary Conditions of Approval**

<b>Owner/Applicant:</b>	Islam and Samantha Muhammad
Location:	3655 Pleasant Knoll Ct. (APN: 654-25-011)
File Number:	PLN23-183
Project Description:	Concurrent land use entitlement includes Design Review (Tier 2) and Grading Approval for a new 7,762 square foot single family residence with attached garage, porches, patios, driveway, retaining walls, and associated improvements. Proposed grading quantities associated with the Grading Approval includes 530 cubic yards of cut and 1,910 cubic yards of fill to accommodate the proposed single-family residence and the associated improvements.

Agency	NamePhone		E-mail
Planning	Eunice Ban (408) 299-570		eunice.ban@pln.sccgov.org
Land Development Engineering	Darrell Wong	(408) 299-5735	darrell.wong@pln.sccgov.org
Environmental Health	Darrin Lee	(408) 918-3435	darrin.lee@cep.sccgov.org
Fire Marshal's Office	Alex Goff	(408) 299-5760	alex.goff@sccfd.org
Geology	David Seymour	(408) 573-6711	david.seymour@pln.sccgov.org

#### STANDARD CONDITIONS OF APPROVAL

#### **Building Inspection**

1. For detailed information about the requirements for a Building Permit, obtain a Building Permit Application Instruction handout form the Building Inspection Office or visit the website at <u>www.sccbuilding.org</u>.

#### Planning

- 2. Development must take place according to approved grading plans prepared by Lea & Braze Engineering, Inc, submitted on November 26, 2024, and architect plans prepared by Camargo & Associates Architects submitted on November 26, 2024, and these Conditions of Approval.
- 3. Changes to the design of the single-family residential and its associated improvements or the grading design and quantities, may require a modification to this land use entitlement and/or additional environmental review under the California Environmental Quality Act, which may require a public hearing. All changes are to be submitted to the Planning Division for review and approval.

- 4. Provide height calculation as detailed on the <u>County height calculation handout</u> on submitted site plan.
- 5. Retaining walls shall adhere to Zoning Ordinance Section 3.20.040(D). Specifically, the proposed retaining walls shall be colored and textured to complement the background land and vegetation.
- 6. Roof and trim shall have a light reflectivity value (LRV) less than 45.
- 7. Please note that pursuant to the approved subdivision that created this site (County File 5912), a burrowing owl survey will be required prior to the issuance of any development permits.
- 8. If archaeological resources or human skeletal remains are discovered during construction, work shall immediately stop, and the County Coroner's Office notified. Upon determination that the remains are Native American, no further disturbance of the site may be made except as authorized by the County Coordinator of Indian Affairs, in accordance with state law and Chapter B6-18 of the County Ordinance Code.

#### Land Development Engineering

9. Property owner is responsible for the adequacy of any drainage facilities and for the continued maintenance thereof in a manner that will preclude any hazard to life, health, or damage to adjoining property.

#### Department of Environmental Health

10. All construction activities shall be in conformance with the Santa Clara County Noise Ordinance Section B11-154 and prohibited between the hours of 7:00 p.m. and 7:00 a.m. on weekdays and Saturdays, or at any time on Sundays for the duration of construction.

#### <u>CONDITIONS OF APPROVAL TO BE COMPLETED PRIOR TO DEVELOPMENT</u> <u>PERMIT ISSUANCE</u>

#### Planning

- 11. **Prior to the issuance of any permits,** the applicant shall pay all reasonable costs associated with the work by the Department of Planning and Development.
- 12. **Prior to the issuance of any permit,** and pursuant to ZO Section 5.20.125, record a "Notice of Permit and Conditions" with the County Office of Clerk-Recorder, to ensure that successor property owners are made aware that certain conditions of approval shall have enduring obligation. Evidence of such recordation shall be provided **prior to building permit application**.
- 13. If landscaping of over 500 square feet is proposed, submit a landscape plan (including irrigation systems), prepared and stamped by a licensed landscape architect **prior to** issuance of any permit. The landscape plan shall emphasize native plant species and shall

be designed to meet the County's Model Water Efficient Landscape Ordinance (MWELO) requirements.

The requirements of Division B33 of the County Ordinance Code (Water Conservation in Landscaping) shall apply. In particular:

- i. Landscape water efficiency must be demonstrated by utilizing any one of the three options provided in Section B33-5: Demonstration of Landscape Water Efficiency.
- Landscape design must comply with all applicable standards and criteria of Section B33-6: Water-Efficient Design Elements.
- iii. Landscape and irrigation plans must comply with all applicable standards and criteria of Section B33-8: Landscape and Irrigation Design Plans. The landscape ordinance and supporting information can be found on the Planning Office web site:
   www.sccplanning.org > Plans and Ordinances > Landscape Ordinance
- 14. **Prior to issuance of any permit**, provide a color and materials sheet demonstrating that exterior colors of all structures (walls, roof, window trim / accent, retaining walls, fences) shall use natural dark earth tones such as hues of brown, green, and shades of gray, and not exceed a light reflective value of 45.

#### Land Development Engineering

15. Obtain a Grading Permit from Land Development Engineering (LDE) prior to beginning any construction activities. Issuance of the grading permit is required prior to LDE clearance of the building permit (building and grading permits shall be applied for concurrently). The process for obtaining a grading permit and the forms that are required can be found at the following web page: https://plandev.sccgov.org/home > How to > Apply for a Development Permit or Planning Application > Grading Permit

If the County Roads and Airports Department provides a condition of approval to obtain an encroachment permit, for your convenience, the grading and encroachment permits will be processed concurrently under one set of improvements (grading) plans.

- 16. Final plans shall include a single sheet which contains the County standard notes and certificates as shown on County Standard Cover Sheet. Plans shall be neatly and accurately drawn, at an appropriate scale that will enable ready identification and recognition of submitted information.
- 17. Final improvement plans shall be prepared by a licensed civil engineer for review and approval by LDE and the scope of work shall be in substantial conformance with the conditionally approved preliminary plans on file with the Planning Office. Include plan, profile, typical sections, contour grading for all driveway, structures, and other improvements as appropriate for construction. The final design shall be in conformance with all currently adopted standards and ordinances. The following standards are available on-line:
  - Standard Details Manual, September 1997, County of Santa Clara, Roads and Airports Department

https://countyroads.sccgov.org/home > Do Business with Us > County Standard Details, Specifications and Documents

- March 1981 Standards and Policies Manual, Volume 1 (Land Development): https://plandev.sccgov.org/home > Ordinances & Codes > Land Development Standards and Policies
- 2007 Santa Clara County Drainage Manual: https://plandev.sccgov.org/home > Ordinances & Codes > Grading and Drainage Ordinance
- 18. Survey monuments shall be shown on the improvement plan to provide sufficient information to locate the proposed improvements and the property lines. Existing monuments must be exposed, verified, and noted on the grading plans. Where existing monuments are below grade, they shall be field verified by the surveyor and the grade shall be restored and a temporary stake shall be placed identifying the location of the found monument. If existing survey monuments are not found, temporary staking delineating the property line may be placed prior to construction and new monuments shall be set prior to final acceptance of the improvements. The permanent survey monuments shall be set pursuant to the State Land Surveyor's Act. The Land Surveyor / Engineer in charge of the boundary survey shall file appropriate records pursuant to Business and Professions Code Section 8762 or 8771 of the Land Surveyors Act with the County Surveyor.
- 19. The improvement plans shall include an Erosion and Sediment Control Plan that outlines seasonally appropriate erosion and sediment controls during the construction period). Include the County's Standard Best Management Practice Plan Sheets BMP-1 and BMP-2 with the Plan Set.
- 20. All applicable easements affecting the parcel(s) with benefactors and recording information shall be shown on the improvement plans.
- 21. All proposed fencing and gates are to be located outside of the right of way.
- 22. Provide landscaping and disturbed area quantities on the final plans along with water efficiency calculations to demonstrate compliance with water usage requirements.
- 23. Plans shall indicate the construction of the driveway access is required prior to combustibles being placed on the site.

#### Drainage

24. Provide a drainage analysis prepared by a licensed civil engineer in accordance with criteria as designated in the 2007 County Drainage Manual (see Section 6.3.3 and Appendix L for design requirements). The on-site drainage will be controlled in such a manner as to not increase the downstream peak flow for the 10-year and 100-year storm event or cause a hazard or public nuisance. The mean annual precipitation is available on the on-line property profile.

#### Utilities

25. All new on-site utilities, mains and services shall be placed underground and extended to

DR (Tier 2), GA File #PLN23-183 February 6, 2024

serve the proposed development. All extensions shall be included in the improvement plans. Off-site work should be coordinated with any other undergrounding to serve other properties in the immediate area.

#### Stormwater Treatment – San Francisco Bay

- 26. Fill out and submit the forms in the Post Construction Requirements (PCR) Applicant's Packet.
- 27. Include one of the following site design measures per the Municipal Regional Permit in the project design: (a) direct hardscape and/or roof runoff onto vegetated areas, (b) collect roof runoff in cisterns or rain barrels for reuse, or (c) construct hardscape (driveway, walkways, patios, etc.) with permeable surfaces. Though only one site design measure is required, it is encouraged to include multiple site design measures in the project design. For additional information, please refer to the C.3 Stormwater Handbook available at the following website:

 $\underline{www.scvurppp.org} > Elements > New Development and Redevelopment > C.3 Stormwater Handbook$ 

28. Provide a Storm Water Management Plan. The Storm Water Management Plan shall incorporate site design measures, source control measures, and show drainage management areas, treatment measures, and hydromodification management (HM) features. Sizing calculations for the treatment measures and hydraulic analysis of the HM measures will be required. Please see the C.3 Stormwater Handbook published by the Santa Clara Valley Urban Runoff Pollution Prevention Program (SCVURPPP) available at the following website:

§ <u>www.scvurppp.org</u> > Resources > reports and work products > New Development and Redevelopment >C.3 Stormwater Handbook

29. Any pervious paving and pavers shall be designed and constructed with the appropriate storage volume and subdrain system to allow for proper infiltration into the native surface.

#### Soils and Geology

- 30. Submit one copy of the signed and stamped geotechnical report for the project.
- 31. Submit a plan review letter by the Project Geotechnical Engineer certifying that the geotechnical recommendation in the above geotechnical report have been incorporated into the improvement plan.

#### Notice of Intent

32. Indicate on the improvement plans the land area that will be disturbed. If one acre or more of land area will be disturbed, file a Notice of Intent (NOI) with the State Water Resources Control Board (SWRCB) for coverage under the State General Construction Permit. The SWRCB will issue a Waste Discharge Identification number (WDID). The WDID number shall be shown on the on the final improvement plans. The SWRCB web site is at:

DR (Tier 2), GA File #PLN23-183 February 6, 2024

www.waterboards.ca.gov > Water Issues > Programs > Stormwater

#### Agreements

33. Enter into an Operations and Maintenance Agreement for Stormwater Quality Improvements with the County per Section C11.5-23 of the County Ordinance Code.

#### Department of Environmental Health

- 34. Sewage disposal conditions have been determined at 194 plus 194 lineal feet of subsurface dispersal field. The two drainline systems must be connected through a positive diversion valve. A 1,500 gallon septic tank shall be required. This septic system is adequate to serve a four-bedroom house.
- 35. Submit a complete set of floor plans to the Department of Environmental Health (Raymond Chung) for review prior to septic system sign-off.
- 36. At the time of application for a building permit, submit a revised plot plans to scale (1" = 20') on a grading and drainage plan showing the house, driveway, accessory structures, septic tank and required drainlines to contour, in order to obtain a septic system permit. Maintain all setbacks as outlined within County of Santa Clara Onsite Systems Manual. The original plans must be submitted to the Department of Environmental Health prior to the issuance of the septic system permit and submitted as the final grading plan to Land Development Engineering when a grading permit is required. Contact Raymond Chung at 408-918-3445 for septic system sign-off.
- 37. At the time of development, a septic system conforming to the prevailing Onsite Wastewater Treatment System (OWTS) Ordinance shall be designed based upon percolation test rates and the dispersal field shall be located within the percolation and soil profile testing areas. Percolation test results = 17 minutes per inch (MPI) and Percolation test depth = 3-4.5' for a conventional wastewater treatment system.

Note: Percolation depths may dictate the type of OWTS designed and permitted for use. Changes to the proposed scope of work or OWTS design may require additional onsite soil testing).

38. Domestic water to be provided by San Jose Water per submitted will serve letter.

#### Fire Marshal's Office

- 39. Provide a Response Letter addressing comments below. Provide sheet that comments were addressed. More comments may be made when more information is supplied.
- 40. The location of the wharf hydrant is to match on all sheets. An example is sheet 17 of 38 (C2.0) differs from sheets 31 and 33.
- 41. Wharf hydrants are to be located per CMFO-W4. This includes but isn't limited to being located at a fire department turnaround, turnout or 20 ft. drivable width. Sheet 17 of 38 (C2.0) doesn't appear show a driveway with a 20 ft. drivable width (only a portion looks to possibly be 20 ft.). The entire driveway will need to be a 20 ft. width or a proposed turnout or turnaround is needed at the hydrant location.

#### Geology

DR (Tier 2), GA File #PLN23-183 February 6, 2024

- 42. The property is located in a County Fault Rupture Hazard Zone and State of California Earthquake-Induced Landslide Hazard Zone, which is also a County Landslide Hazard Zone. The geologic hazards evaluation report by Quantum Geotechnical, Inc., dated March 31, 2023, and the geotechnical investigation report by Haro, Kasunich and Associates, dated April 13, 2023, address the potential for these and other geologic and seismic hazards to impact the proposed residential development. Based on the results of their studies, they conclude that the potential for ground rupture due to faulting and landslides to impact the building envelope is low. Based on the results of these reports, the subject planning application is approved for Geology.
- 43. Prior to issuance of building and grading permits, submittal of a Plan Review Letter and a Response to Comment Letter will be required. The plan review letter needs to be prepared by the geotechnical consultant confirming that the plans conform with the recommendations presented in the approved reports. The response letter will need to address the following comment:

The Site Overview Image in the Quantum Geotechnical report depicts the Quimby fault zone a few hundred feet southwest of the location as mapped by Cleary (1990). We overlaid the Cleary map in GIS and found that the fault zone transects the southwestern boundary of the subject parcel. Provide an updated version of the figure showing the fault zone location as mapped by Cleary and a brief written description of the updated location. Contact the County Geologist for a copy of the overlay map. (Please note that the fault zone does not impact the location of the proposed development).

#### <u>CONDITIONS OF APPROVAL TO BE COMPLETED PRIOR TO FINAL INSPECTION</u> <u>Planning</u>

44. **Prior to final inspection**, contact Eunice Ban in the Planning Division, **at least two (2) weeks in advance** to schedule a site visit to verify the colors, and material finishes have been installed as approved per condition of approval 14.


Land Development Engineering

- 45. Existing and set permanent survey monuments shall be verified by inspectors prior to final acceptance of the improvements by the County. Any permanent survey monuments damaged or missing shall be reset by a licensed land surveyor or registered civil engineer authorized to practice land surveying and they shall file appropriate records pursuant to Business and Professions Code Section 8762 or 8771 of the Land Surveyors Act with the County Surveyor.
- 46. Construct the improvements. Construction staking is required and shall be the responsibility of the developer.
- 47. Provide a Construction Observation Letter by the Project Geotechnical Engineer certifying that the construction was completed per the geotechnical recommendations in the above geotechnical report.

#### Department of Environmental Health

48. Provide proof of garbage service at the time of final occupancy sign-off. Garbage service in the unincorporated areas of Santa Clara County is mandatory.


## Attachment C Location and Vicinity Map

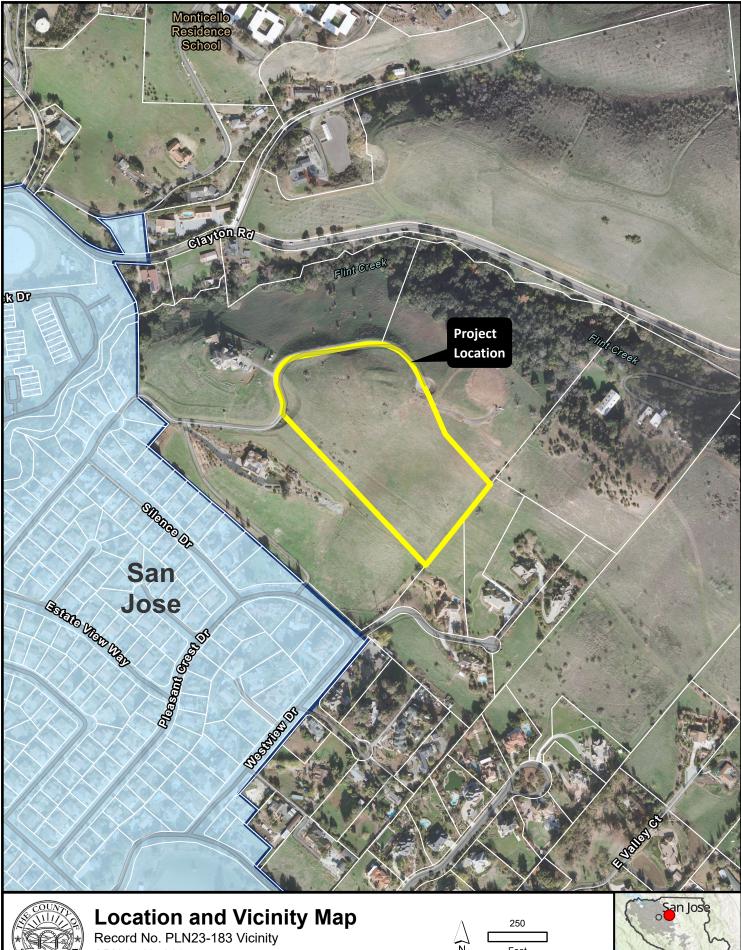

APN 65425011 3655 PLEASANT KNOLL CT SAN JOSE



# Attachment D

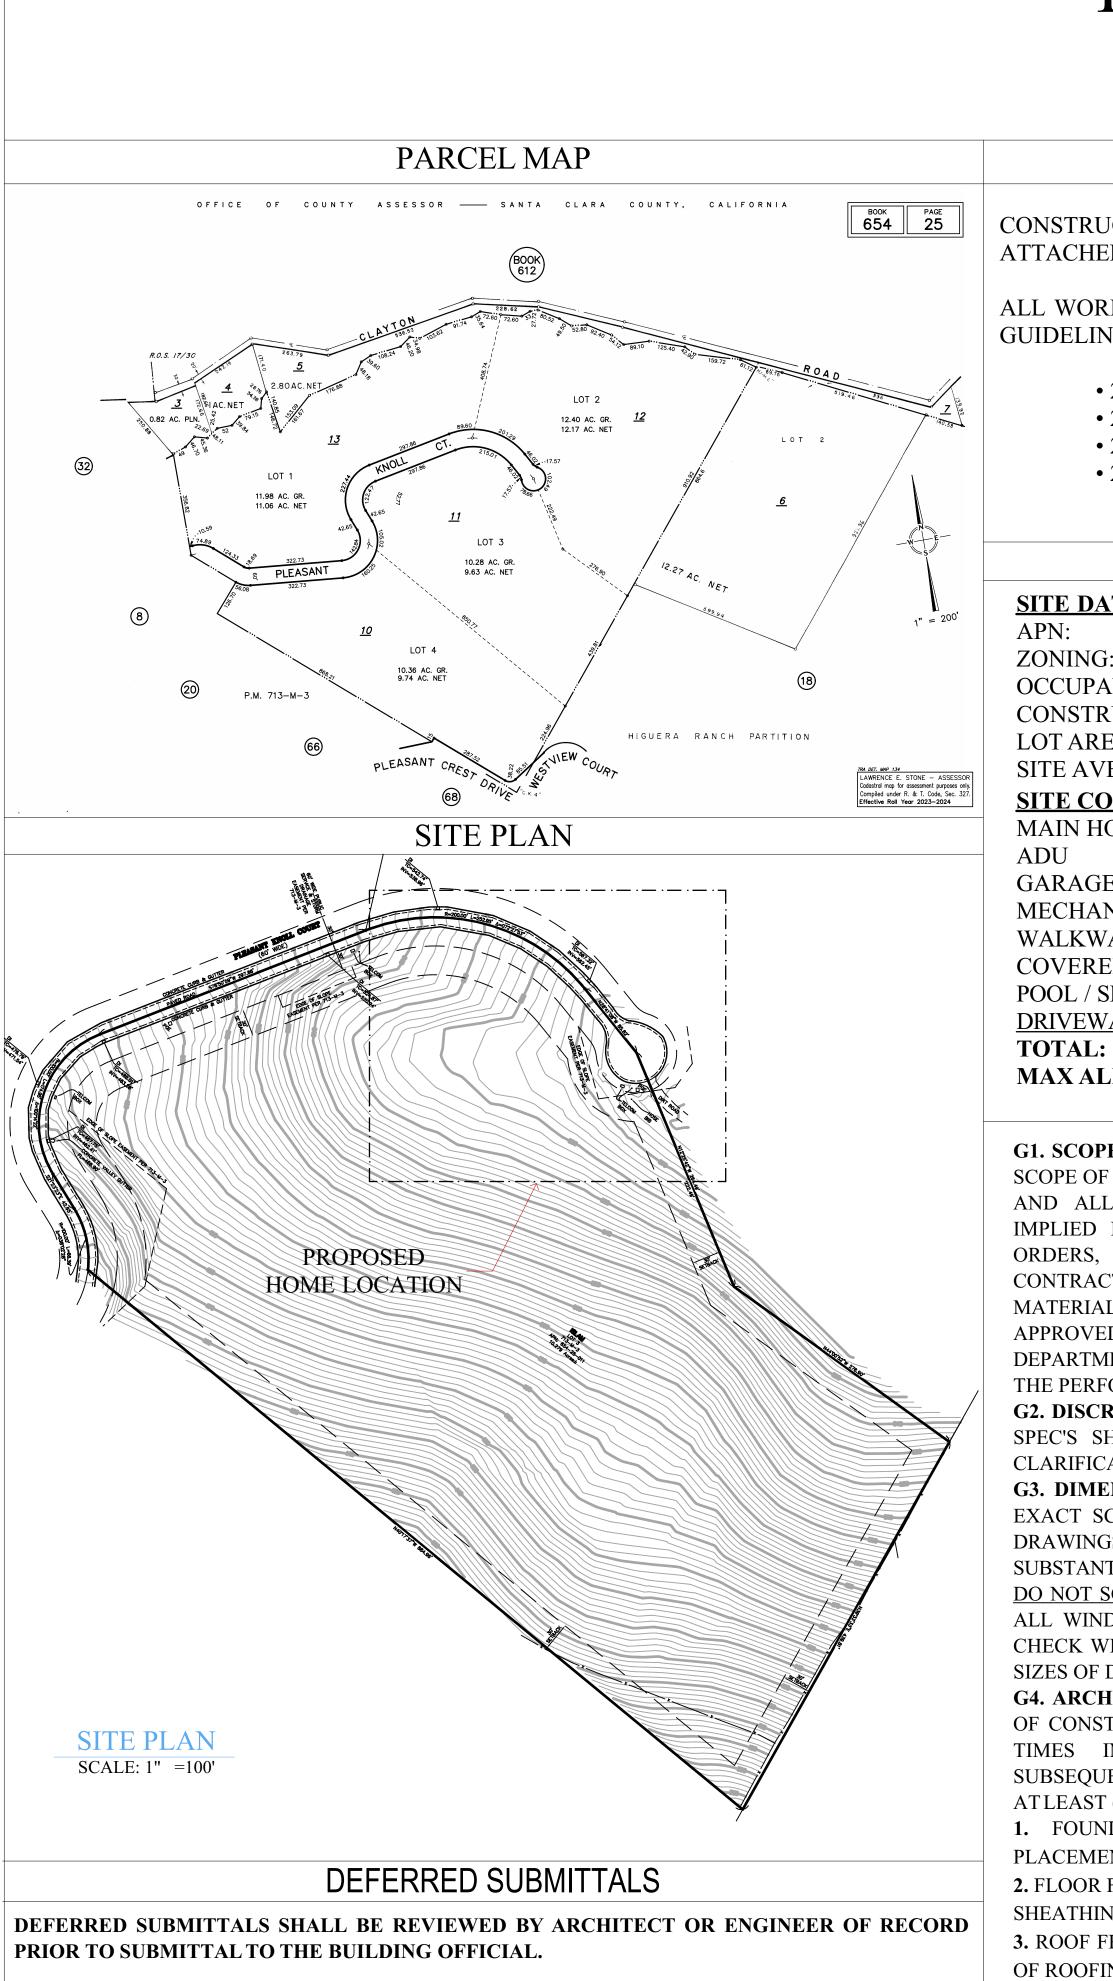

**1. FIRE SPRINKLER SYSTEM.** 

4. FLOOR INSPECTIO G5. TITLE OR INSTA

# ISLAM RESIDENCE 3655 PLEASANT KNOLL CT.

SAN JOSE, CA. 95148

### PROJECT SCOPE / APPLICABLE CODES


CONSTRUCTION OF A NEW TWO STORY 7,762 SQFT HOME WITH 4 BEDROOMS 4.5 BATHS, FULL KITCHEN, LAUN ATTACHED GARAGE WITH RECREATIONAL SPACE.

ALL WORK DESCRIBED IN THESE DOCUMENTS SHALL COMPLY WITH THE LATEST BUILDING CONSTRUCTION CONSTRUCTUA CONSTRUCTUA CONSTRUCTION CONSTRUCTUA CONSTRUCT GUIDELINES, AND THOSE AMENDED AND ADOPTED BY THE COUNTY OF SANTA CLARA, CA.

- 2022 CALIFORNIA BUILDING CODE • 2023 CALIFORNIA ENERGY CODE • 2022 CALIFORNIA MECHANICAL CODE • 2022 CALIFORNIA RESIDENTIAL CODE
- 2022 CALIFORNIA ELECTRICAL CODE
- 2022 CALIFORNIA FIRE CODE
- 2022 CALIFORNIA PLUMBING CODE
- 2022 CAL-GREEN BUILDING STANDARDS

SITE DATA		DIRECTORY			
ATA: G: 654-25-011 ANCY GROUP: AR-RURAL ZONING DI	ADDRESS:	<ul> <li>ADDNAN ISLAM</li> <li>3655 PLEASANT KNOLL CT.</li> <li>SAN JOSE, CA</li> <li>05148</li> </ul>			
ANCY GROUP: AR-RURAL ZONING DI RUCTUION TYPE: VA EA: 447,796.8 SQFT / 10.28 A VERAGE SLOPE: 19.69% OVERAGE: IOUSE 3,689.50 SQFT		95148 MAURICE CAMARGO A.I.A. CAMARGO & ASSOC. ARCHITE MAURICE@CAMARGO.COM (408)489-1077			
N/AE917.51NICAL STORAGE62.80SQFT/AYS / PATIOS /1,320.75SQFTED PORCHES918.00SPA / FOUNTAINN/A	CIVIL ENGINEER:	E LEA & BRAZE ENGINEERING, I ZENAB ALI; E.I.T ZALI@LEABRAZE.COM (510)887 - 4068			
AY / PARKING     3,452.75     SQFT       :     10,361.30 SQFT       LLOWED	GEOTECHNICAL ENGINEER:	HARO, KASUNICH & ASSOCIA CHRISTOPHER A. GEORGE, P.E CGEORGE@HAROKASUNICH.( (831)247-7320			
<b>PE OF PLANS:</b> THESE PLANS ILLUSTRATE THE NA F WORK TO BE PERFORMED BY THE GENERAL CON L SUBCONTRACTORS. ALL WORK SPECIFIEI IN THESE PLANS, ALL ADDENDA, CHANGE A SHOP DRAWINGS, ETC. SHALL BE A PART CTOR'S AGREEMENT. SUBSTITUTIONS PROPOSED LS AND METHODS ILLUSTRATED IN THESE PLANS ED BY THE PROJECT ARCHITECT AND THE MENT PRIOR TO THE INSTALLATION OF SUCH MAT FORMANCE OF SUCH WORK. <b>REPANCIES:</b> DISCREPANCIES BETWEEN DRAWING HALL BE REFERRED TO THE PROJECT ARCHI CATION BEFORE STARTING THE AFFECTED WORK. ENSIONS: PORTIONS OF THE PLANS ARE NOT D CALE AND PRINTS ARE NOT EXACT REPRODUC GS. DIMENSIONS MARKED "N.T.S." (NOT TO SO ITIALLY DIFFERENT FROM THE SCALE OF THE <u>SCALE OFF OF THE DRAWINGS.</u> USE DIMENSION DOW, DOOR AND CABINET SIZES SHOWN ARE WITH MANUF'R FOR EXACT GLAZING AND ROUGH DOORS AND WINDOWS. HITECT OBSERVATIONS: SITE VISITS AND OBSE TRUCTION SHALL BE CONDUCTED BY THE ARCCI INDICATED BELOW PRIOR TO PROCEEDIN JENT CONSTRUCTION. THE ARCHITECT SHALL BE C(2) WORKING DAYS PRIOR TO EACH INSPECTION. ND. EXCAVATION, FORMS & REINF'G. JUST ENT OF CONC. FRAMING AT ALL LEVELS BEFORE INSTALLATION NG. FRAMING AND SHEATHING NAILING BEFORE INST ING. & WALL FRAMING & SHEATHING BEFORE FINAL ON BY COUNTY. <b>E 24 INSTALLATION CERTIFICATES:</b> CONTRAC LLER OF HVAC SYSTEMS, WATERHEATER	NTRACTORINSULATION SHALL PD AND/OR24 CF-6R (PAGES 1-7 AD ND FIELDSIGNED BY THE INSTAD OF THEDEPARTMENT AT THED FOR THEG7. GEOTECHNICALD FOR THEFOR CONFORMANCED ELTTER DOCUMENTIPRIOR TO OBTAININGGS AND/ORG8. GEOTECHNICALGS AND/ORG8. GEOTECHNICALD FORFORD FORFORD FORFORSHALL BEFOR CONFORMANCEBUILDINGLETTER DOCUMENTIPRIOR TO OBTAININGGS AND/ORG8. GEOTECHNICALGS AND/ORG8. GEOTECHNICALD FORDCONSTRUCTION ID RAWN TOAS DETERMINED BYD RAWN TOAS DETERMINED BYD RAWING.AN INSPECTION FINAL.OF CONSTRUCTION FINAL.G9. PROPOSED SITTHESE PLANS ARE IPROPOSED COTTAGEON THESE PLANS ARE IPROPOSED COTTAGEON THESE PLANS ARE IPROPOSED COTTAGEON THESE PLANS ARE IFOR BIDDING OR APPG WITHCERTAIN PORTIONS OFAN APPROVED SPECIALINSPECTIONSD EPARTMENT DURINGCONSTRUCTIONSD EPARTMENT DURINGCONSTRUCTION, SPOF FLOORSPECIAL INSPECTORTO EACH INSPECTCONDUCTED PRIOCONSTRUCTION, SPNOTIFICATIONS, REITHEIR WORK TO THEINSPECTION SCHEDU	CONSTRUCTION OBSERVATIONS: 7 GINEER SHALL PROVIDE OBSERV DURING THE GRADING AND FOUNDAT PER RECOMMENDATIONS IN THE REP THE ENGINEER DURING CONSTRUCT NOTIFIED AT LEAST (2) WORKING DA SUCH OPERATIONS AND SHALL SUBMI PORT TO THE BUILDING DEPARTMEN <b>TE PLAN:</b> THE PROPOSED SITE PLAN FOR THE PURPOSE OF COUNSTRUCT ONLY. ANY LANDSCAPE MODIFICATION FOR THE PURPOSE OF COUNSTRUCT ONLY. ANY LANDSCAPE MODIFICATION FOR THE PURPOSE OF COUNSTRUCT ONLY. ANY LANDSCAPE MODIFICATION FOR THE CONSTRUCTION SHALL NOT BE OF ROVAL. <b>ECTIONS:</b> SITE VISITS AND INSP OF THE CONSTRUCTION SHALL BE COM IAL INSPECTION AND TESTING AGEN R THE CONDITIONS OF THE "STRUCT SCHEDULE" SUBMITTED TO THE G THE BUILDING PERMIT APPROVAL P SHALL BE NOTIFIED AT LEAST (24) H TION AND SPECIAL INSPECTIONS OR TO PROCEEDING WITH S ECIAL INSPECTOR SHALL SUBMIT A PORTS, STATEMENTS AND FORMS BUILDING DEPARTMENT PER THE SIGN			

					DARCHI JE CAMAS 14140 1/31/25 HENEWAL DATE CALIFO	ARCT & PINE
		VICINITY MAP	ID	DATE TRAN	EVISIONS NSMITAL SET NAME	
	ton Rd Clayton Rd Clayton Rd Mornis House Clea		01	3/8/2024 DESIN	SN REVIEW INITIAL SUBMITT	IEW
INDRY AND	"Heating Lancesta Touch Massage Therapy	Clayton Rd Clayton Rd Clayton Rd Clayton Rd Clayton Rd Clayton Rd	03 04		NG REVIEW - 2ND PLAN REVI	
CODES AND	Terrace Hills Terrace Hills Te	Poly de la construction de la co				
		AWING SHEET INDEX				
	G. GENERAL G0.0	COVER SHEET	_			<u>)</u>
	G0.0	SITE PLAN SURVEY	-			
	PCM-S1	PARCEL MAP SHEET 1	-			
	PCM-S2	PARCELMAP SHEET 2		6		ン 
TECTS	PCM-S3	PARCEL MAP SHEET 3	_			
	A. ARCHITECTUR		_			<b>5</b>
	AS1.0 AS1.1	ARCHITECTURAL SITE PLAN BUILDING SITE AREA PLAN		Ŭ		
, INC .	A31.1	MAIN FLOOR PLAN	_	F		2
,	A1.0	SECOND FLOOR PLAN	_			1
	A1.1	ROOF PLAN	_			5
	A2.0	EXTERIOR ELEVATIONS				
ATES	A2.1	EXTERIOR ELEVATIONS	_			
E.	A3.0	BUILDING SECTIONS	_			
.COM	A3.1	BUILDING SECTIONS	_			5
	C. CIVIL PLANS					
ID	C-1.0	TITLE SHEET				
ES PER TITLE ED OUT,	C-1.1	OVERALL SITE PLAN			D V	
LD OO I, LDING	C-2.0	GRADING & DRAINAGE PLAN	_			<b>5</b>
AL ENGINEER	C-2.1	SITE SECTIONS SITE SECTIONS	_		~	
ATION DESIGN	C-2.2 C-3.0	UTILITY PLAN	_			
ALL SUBMIT A	C-3.1	UTILITY PLAN	_			
DEPARTMENT	C-4.0	DETAILS	_			
THE PROJECT	C-4.1	DETAILS				
VATION AND	C-4.2	DETAILS		A <b>h</b> #		
ATION PHASES EPORT AND/OR	C-5.0	GRADING SPECIFICATIONS		AM		UL
UCTION. THE	ER-1	EROSION CONTROL PLAN				
AYS PRIOR TO MIT A TESTING	BPM-1	EROSION CONTROL DETAILS	-	<b>│`</b> ∎	ΠĽ	
ENT PRIOR TO	BPM-2 EX-1	EROSION CONTROL DETAILS AVERAGE LOT SLOPE	-	╷╶┻		
N SHOWN ON	OTWS SS-1					-
CTION OF THE		SEPTIC SYSTEM ENGINEERED PLAN				
TIONS SHOWN E CONSIDERED		CONVENTIONAL OTWS DETAILS		E		
	HYD - 1	IMPERVIOUS SURFACE EXHIBIT	-		<b>C</b> IA	
SPECTIONS OF ONDUCTED BY	HYD - 2	DRAINING MANAGEMENT AREAS	<u>A</u> ]	RCH	ΙΤΕΟ	<u>' T S</u>
NCY PER CBC		FIRETRUCK ANALYSIS: 3-PT TURN	c		Yolo Driv e, CA. 95	
CTURAL TESTS	L - LANDSCAPING	PLANS PLANTING & LIGHTING PLAN		(408)	266-344	2
HE BUILDING PROCESS. THE	L-1 L-2	IRRIGATION PLAN	-	w w w . c a	amargo.c	om
HOURS PRIOR	L-2	IRRIGATION & PLANNING DETAILS	Date	Printed:	11/2	2/2024
S SHALL BE						
SUBSEQUENT				ect №:		2022-10 NCISCO
ALL WRITTEN REGARDING			Drav	wn by:		ORRES
GNED SPECIAL				S	Sheet	
		COVER SHEET				
				Ψ	$\mathbf{v}.\mathbf{v}$	
	<u>.</u>		<u> </u>	<u> </u>		<u> </u>

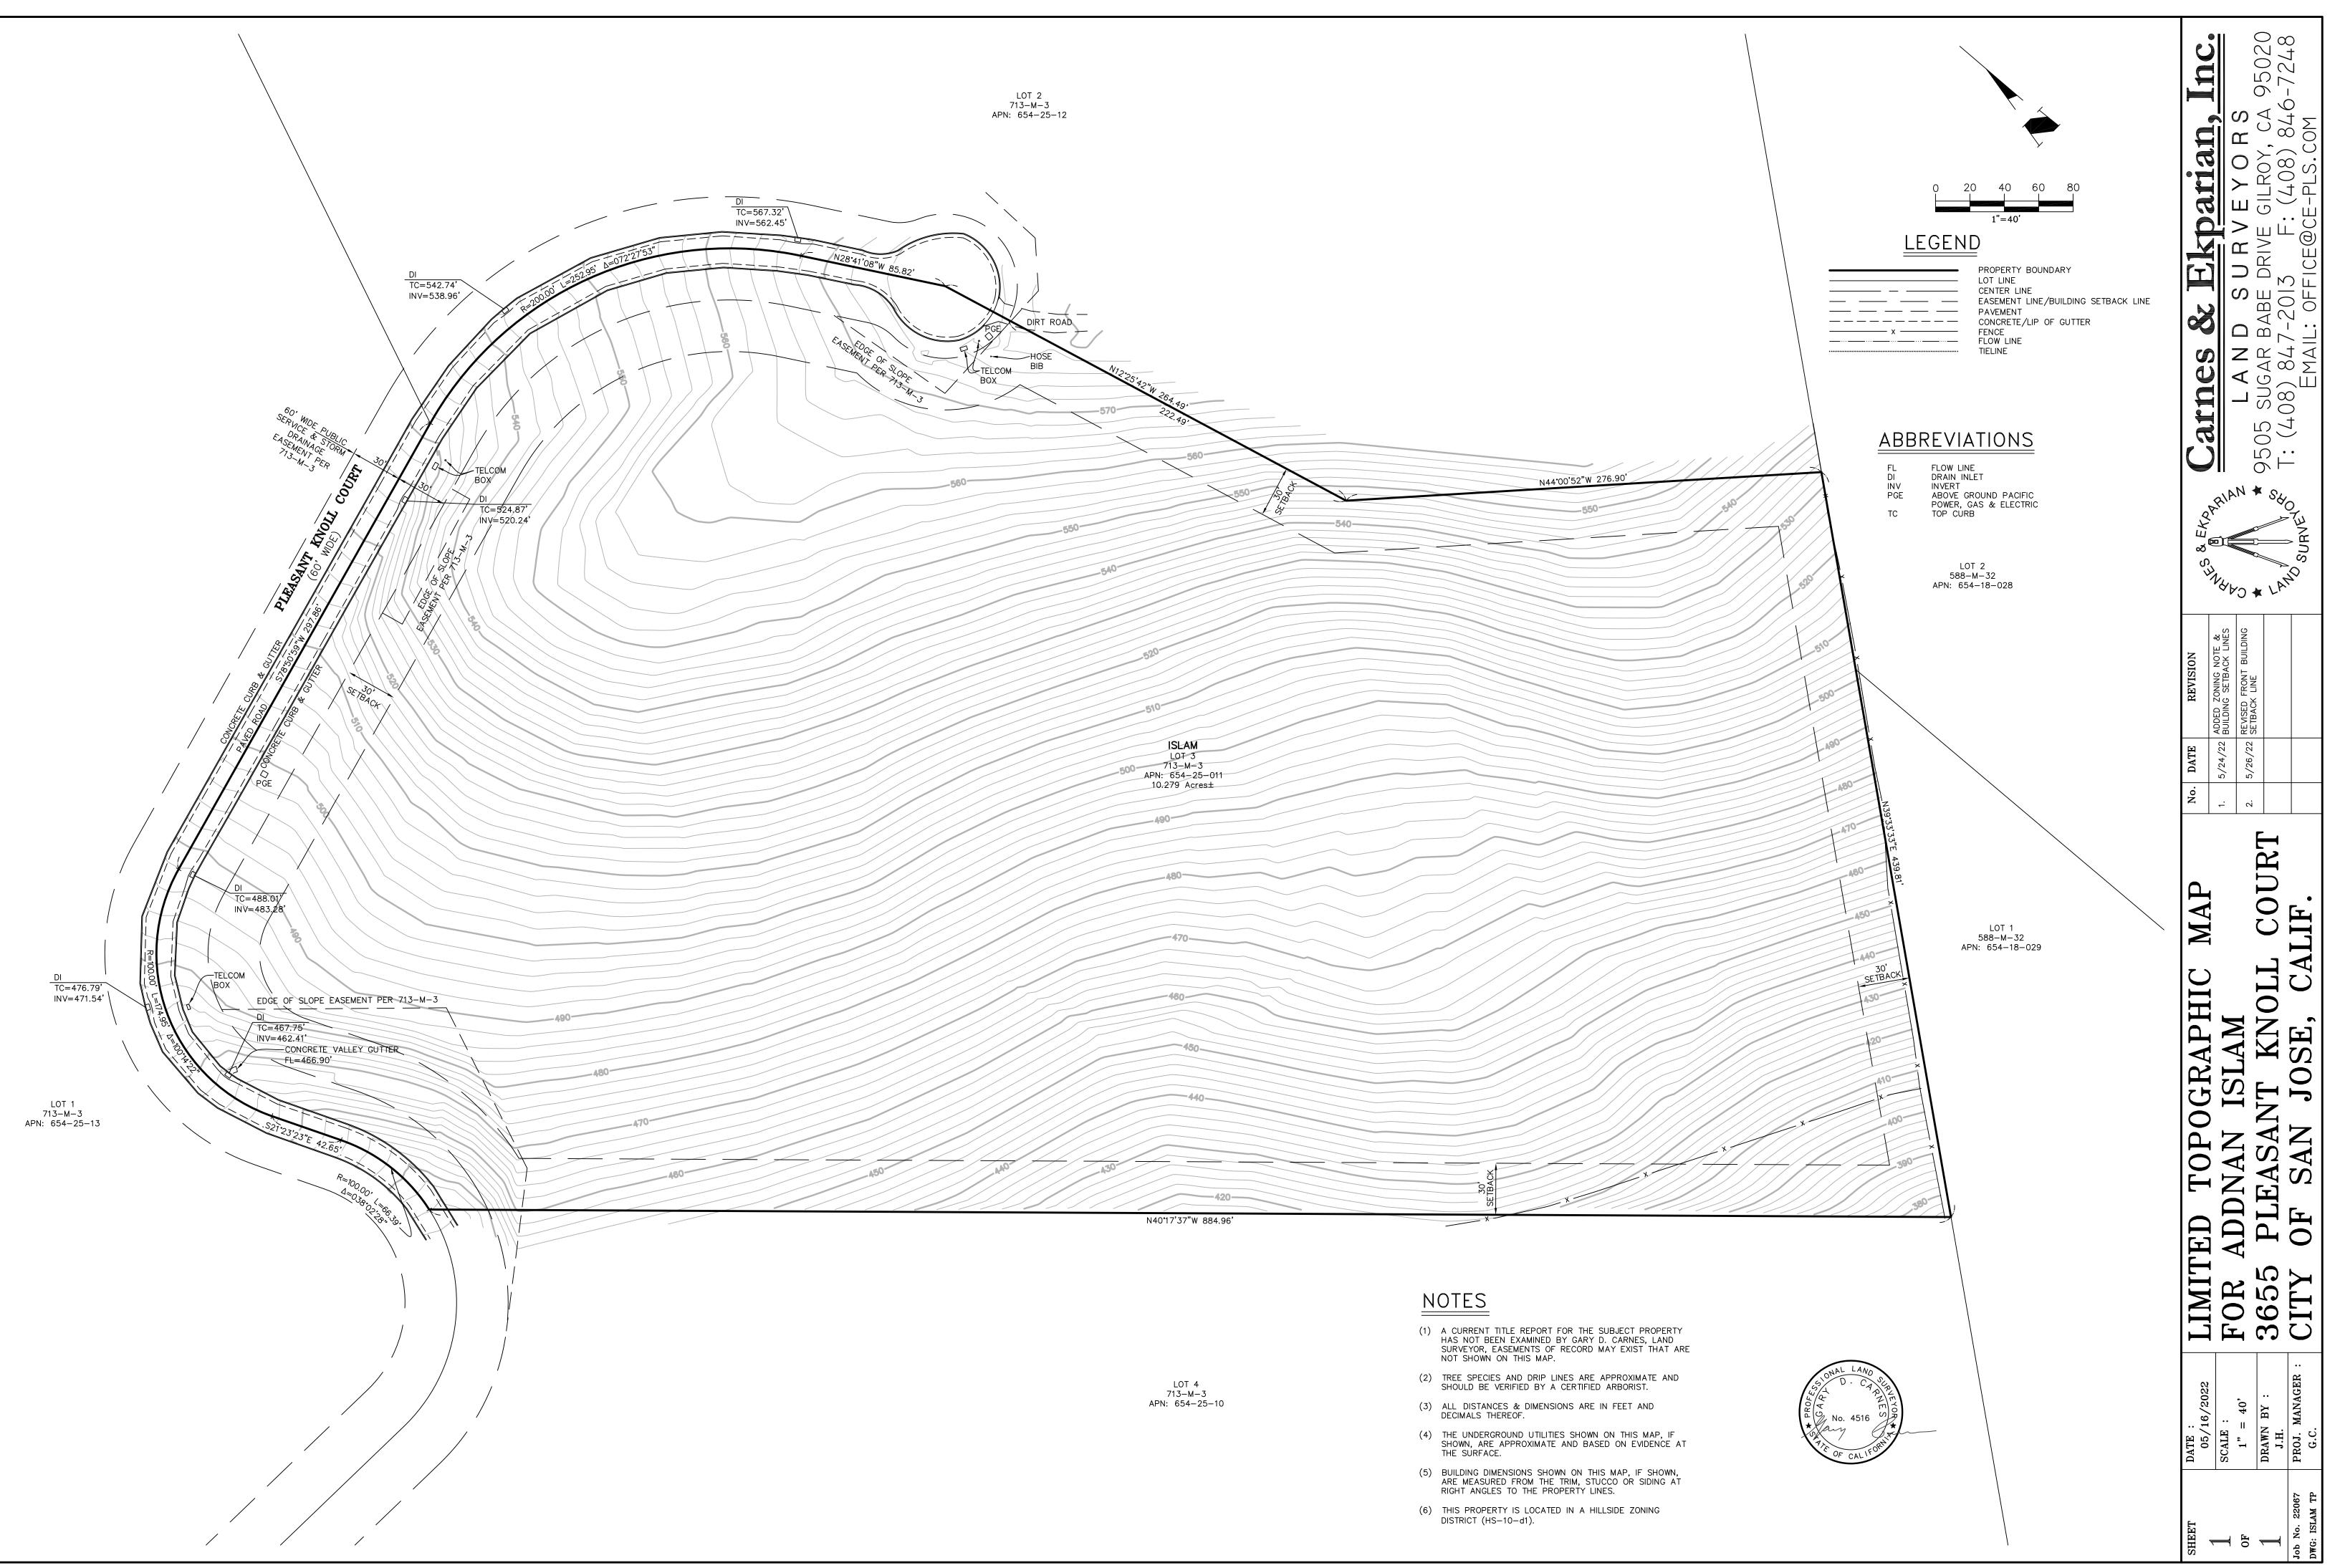

## **OWNER'S STATEMENT**

WE HEREBY STATE THAT WE ARE THE OWNERS OF, OR HAVE SOME RIGHT, TITLE, OR INTEREST IN AND TO THE REAL PROPERTY INCLUDED WITHIN THE SUBDIVISION SHOWN UPON THE HEREIN MAP; THAT WE ARE THE ONLY PERSONS WHOSE CONSENTS ARE NECESSARY TO PASS A CLEAR TITLE TO SAID REAL PROPERTY; THAT WE HEREBY CONSENT TO THE PREPARATION AND FILING OF SAID MAP AND SUBDIVISION AS SHOWN WITHIN THE DISTINCTIVE BORDER LINE.

WE HEREBY DEDICATE TO PUBLIC USE A STRIP OF LAND DELINEATED AND DESIGNATED AS EAE "EMERGENCY ACCESS EASEMENT" FOR EMERGENCY ACCESS PURPOSES ONLY.

WE HEREBY DEDICATE TO PUBLIC USE AND OFFER TO DEDICATE TO THE COUNTY OF SANTA CLARA ALL STREETS AND PORTIONS OF STREETS NOT HERETOFORE EXISTING AND DESIGNATED AS PLEASANT KNOLL COURT AS SHOWN UPON THIS MAP; SAID DEDICATIONS AND OFFERS OF DEDICATION ARE FOR ANY AND ALL PUBLIC USES UNDER. UPON AND OVER SAID STREETS AND PORTIONS THEREOF.

ALL OF THE HEREIN DESCRIBED EASEMENTS SHALL BE KEPT FREE OF BUILDINGS EXCEPT LAWFUL UNSUPPORTED ROOF OVERHANGS AND OBSTRUCTIONS THAT IMPAIR THE USE OF OR ARE INCONSISTENT WTH THE PURPOSES OF THE EASEMENT.

WE HEREBY DEDICATE TO PUBLIC USE AND OFFER TO DEDICATE TO THE COUNTY OF SANTA CLARA ALL STREETS AND PORTIONS OF STREETS NOT HERETOFORE EXISTING AND DESIGNATED AS PLEASANT CREST DR. AND WEST VIEW CT. AS SHOWN UPON THIS MAP; SAID DEDICATIONS AND OFFERS OF DEDICATION ARE FOR ANY AND ALL PUBLIC USES UNDER, UPON, AND OVER SAID STREETS AND PORTIONS THEREOF.

WE HEREBY DEDICATE TO PUBLIC USE AND OFFER TO DEDICATE TO THE COUNTY OF SANTA CLARA FOR THE PURPOSE OF CONSTRUCTING SLOPE EASEMENTS DESIGNATED AS SLOPE CASEMENT. AND MAINTAINING CUT OR FILL SLOPES OR RETAINING WALLS.

WE HEREBY DEDICATE TO PUBLIC USE AND OFFER TO DEDICATE TO THE COUNTY OF SANTA CLARA EASEMENTS FOR ANY AND ALL PUBLIC SERVICE FACILITIES INCLUDING BUT NOT LIMITED TO POLES, WIRES AND CONDUITS FOR ELECTRICAL, TELEPHONE, TELEVISION, GAS, STORM, SANITARY AND WATER SERVICES, AND ALL APPURTENANCES THERETO UNDER, UPON, OR OVER THE LAND DESIGNATED AS "P.S.E." (PUBLIC SERVICE EASEMENT).

THE HEREIN DESCRIBED OFFERS OF DEDICATION TO THE COUNTY OF SANTA CLARA ARE TO BE ACCEPTED ONLY WHEN THE BOARD OF SUPERVISORS OR ITS SUCCESSOR AGENY ADOPTS AND RECORDS IN THE OFFICE OF THE RECORDER OF SANTA CLARA COUNTY A RESOLUTION ACCEPTING SAID STREETS OR EASEMENTS. UNTIL SAID RESOLUTIONS ARE RECORDED, ALL STREETS AND EASEMENTS ENCOMPASED WITHIN SUCH OFFERS OF DEDICATION SHALL BE MAINTAINED BY THE DEVELOPER DURING ANY REQUIRED WARRANTY PERIOD AND THEREAFTER BY THE OWNERS OF THE LOTS OR PARCELS IN THE SUBDIVISION. THE COUNTY OF SANTA CLARA SHALL NOT BE RESPONSIBLE FOR MAINTENANCE THEREON SHALL INCUR NO LIABILITY WITH RESPECT TO SUCH OFFERED STREETS AND EASEMENTS OR ANY IMPROVEMENT ALL DEDICATED RIGHTS OF WAY AND EASEMENTS NOT ACCEPTED FOR MAINTENANCE BY THE COUNTY OF SANTA CLARA OR OTHER PUBLIC AGENCY SHALL BE MAINTAINED BY THE OWNERS OF THE LOTS OR PARCELS IN THE SUBDIVISION.

AS OWNERS:

Mabet fleth THE NELLIS CORPORATION, ROBERT C. NELLIS, PRESIDENT

KATHA E. NELLIS, SECRETARY

## ACKNOWLEDGEMENT

STATE OF CALIFORNIA COUNTY OF <u>Canta Dara</u>:ss

Robert C. Nellin and Kathing C. Nellins) BEFORE ME PERSONALLY APPEARED ON \_\_\_\_ PERSONALLY KNOWN TO ME (OR PROVED TO ME ON THE BASIS OF SATISFACTORY EVIDENCE) TO BE THE PERSON(S) WHOSE NAME(S) IS ARE SUBSCRIBED TO THE WITHIN INSTRUMENT AND ACKNOWLEDGED TO ME THAT HE SHE THEY EXECUTED THE SAME IN HIS HER THEIR AUTHORIZED CAPACITY(IES), AND THAT BY HIS/HER/THEIR SIGNATURE(S) ON THE INSTRUMENT THE PERSON(S), OR THE ENTITY UPON BEHALF OF WHICH THE PERSON(S) ACTED, EXECUTED THE INSTRUMENT.

WITNESS MY HAND AND OFFICIAL SEAL Misson Juchannow SIGNATURE:

PRINT NAME \_\_\_\_ALISON J. SCHARNOW

NOTARY PUBLIC IN AND FOR SAID COUNTY AND STATE Julia 4 2001 MY COMMISSION EXPIRES: \_\_\_\_

GRID NO: 69-51-69, 69-51-70 AND 69-50-70

FILE NO: 5912-51-70-94S

## ENGINEER'S STATEMENT

THIS MAP WAS PREPARED BY ME OR UNDER MY DIRECTION AND IS BASED UPON A FIELD SURVEY IN CONFORMANCE WITH THE REQUIREMENTS OF THE SUBDIVISION MAP ACT AND LOCAL ORDINANCE AT THE REQUEST OF MR. ROBERT C. NELLIS ON FEBRUARY, 1994. I HEREBY STATE THAT THIS PARCEL MAP SUBSTANTIALLY CONFORMS TO THE APPROVED OR CONDITIONALLY APPROVED TENTATIVE MAP, IF ANY.

I HEREBY STATE THAT ALL THE MONUMENTS ARE OF THE CHARACTER AND OCCUPY THE POSITIONS INDICATED OR WILL BE SET ON OR BEFORE DECEMBER 1, 1999 AND THAT SUCH MONUMENTS ARE SUFFICIENT TO ENABLE THE SURVEY TO BE RETRACED.

1-18-99 DATE:

No. 2059

MARIUS E. NELSEN R.C.E. NO. 20597 EXPIRES: 9-30-2001

COUNTY SURVEYOR'S STATEMENT

I HEREBY STATE THAT I HAVE EXAMINED THE WITHIN PARCEL MAP; THAT THE MAP AS SHOWN IS SUBSTANTIALLY THE SAME AS IT APPEARED ON THE TENTATIVE MAP AND ANY APPROVED ALTERATIONS THEREOF: THAT ALL PROVISIONS OF THE CALIFORNIA SUBDIVISION MAP ACT AND ANY LOCAL ORDINANCES APPLICABLE AT THE TIME OF THE APPROVAL OF THE TENTATIVE MAP HAVE BEEN COMPILED WITH AND I AM SATISFIED THAT SAID MAP IS TECHNICALLY CORRECT. PURSUANT TO THE PROVISIONS OF SECTION C12-133 OF THE COUNTY ORDINANCE CODE, IT IS HEREBY ORDERED THAT ALL STREETS, PORTIONS OF STREETS AND EASEMENTS OFFERED FOR DEDICATION TO THE COUNTY OF SANTA CLARA ARE HEREBY NOT ACCEPTED AND ALL DEDICATIONS TO PUBLIC USE ARE HEREBY ACCEPTED IN BEHALF OF THE PUBLIC FOR THE PURPOSES SET FORTH IN THE OWNER'S STATEMENT.

DATE: 2-23-99



MARTIN D. MARCOTT, COUNTY SURVEYOR Martin D. Marcott L.L.S. NO. 4304 EXPIRATION DATE: 6-30-00

ACKNOWLEDGEMENT

STATE OF CALIFORNIA

COUNTY OF \_\_\_\_\_

BEFORE ME PERSONALLY APPEARED

PERSONALLY KNOWN TO ME (OR PROVED TO ME ON THE BASIS OF SATISFACTORY EVIDENCE) TO BE THE PERSON(S) WHOSE NAME(S) IS/ARE SUBSCRIBED TO THE WITHIN INSTRUMENT AND ACKNOWLEDGED TO ME THAT HE/SHE/THEY EXECUTED THE SAME IN HIS/HER/THEIR AUTHORIZED CAPACITY(IES), AND THAT BY HIS/HER/THEIR SIGNATURE(S) ON THE INSTRUMENT THE PERSON(S), OR THE ENTITY UPON BEHALF OF WHICH THE PERSON(S) ACTED, EXECUTED THE INSTRUMENT.

: : SS

WITNESS MY HAND AND OFFICIAL SEAL SIGNATURE:

PRINT NAME

NOTARY PUBLIC IN AND FOR SAID COUNTY AND STATE MY COMMISSION EXPIRES: \_\_\_\_\_ SANTA CLARA COUNTY RECORDS.


FILE NO. 14684224


01000


## **BASIS OF BEARINGS**


## SOILS REPORT

KOHLER ROAD

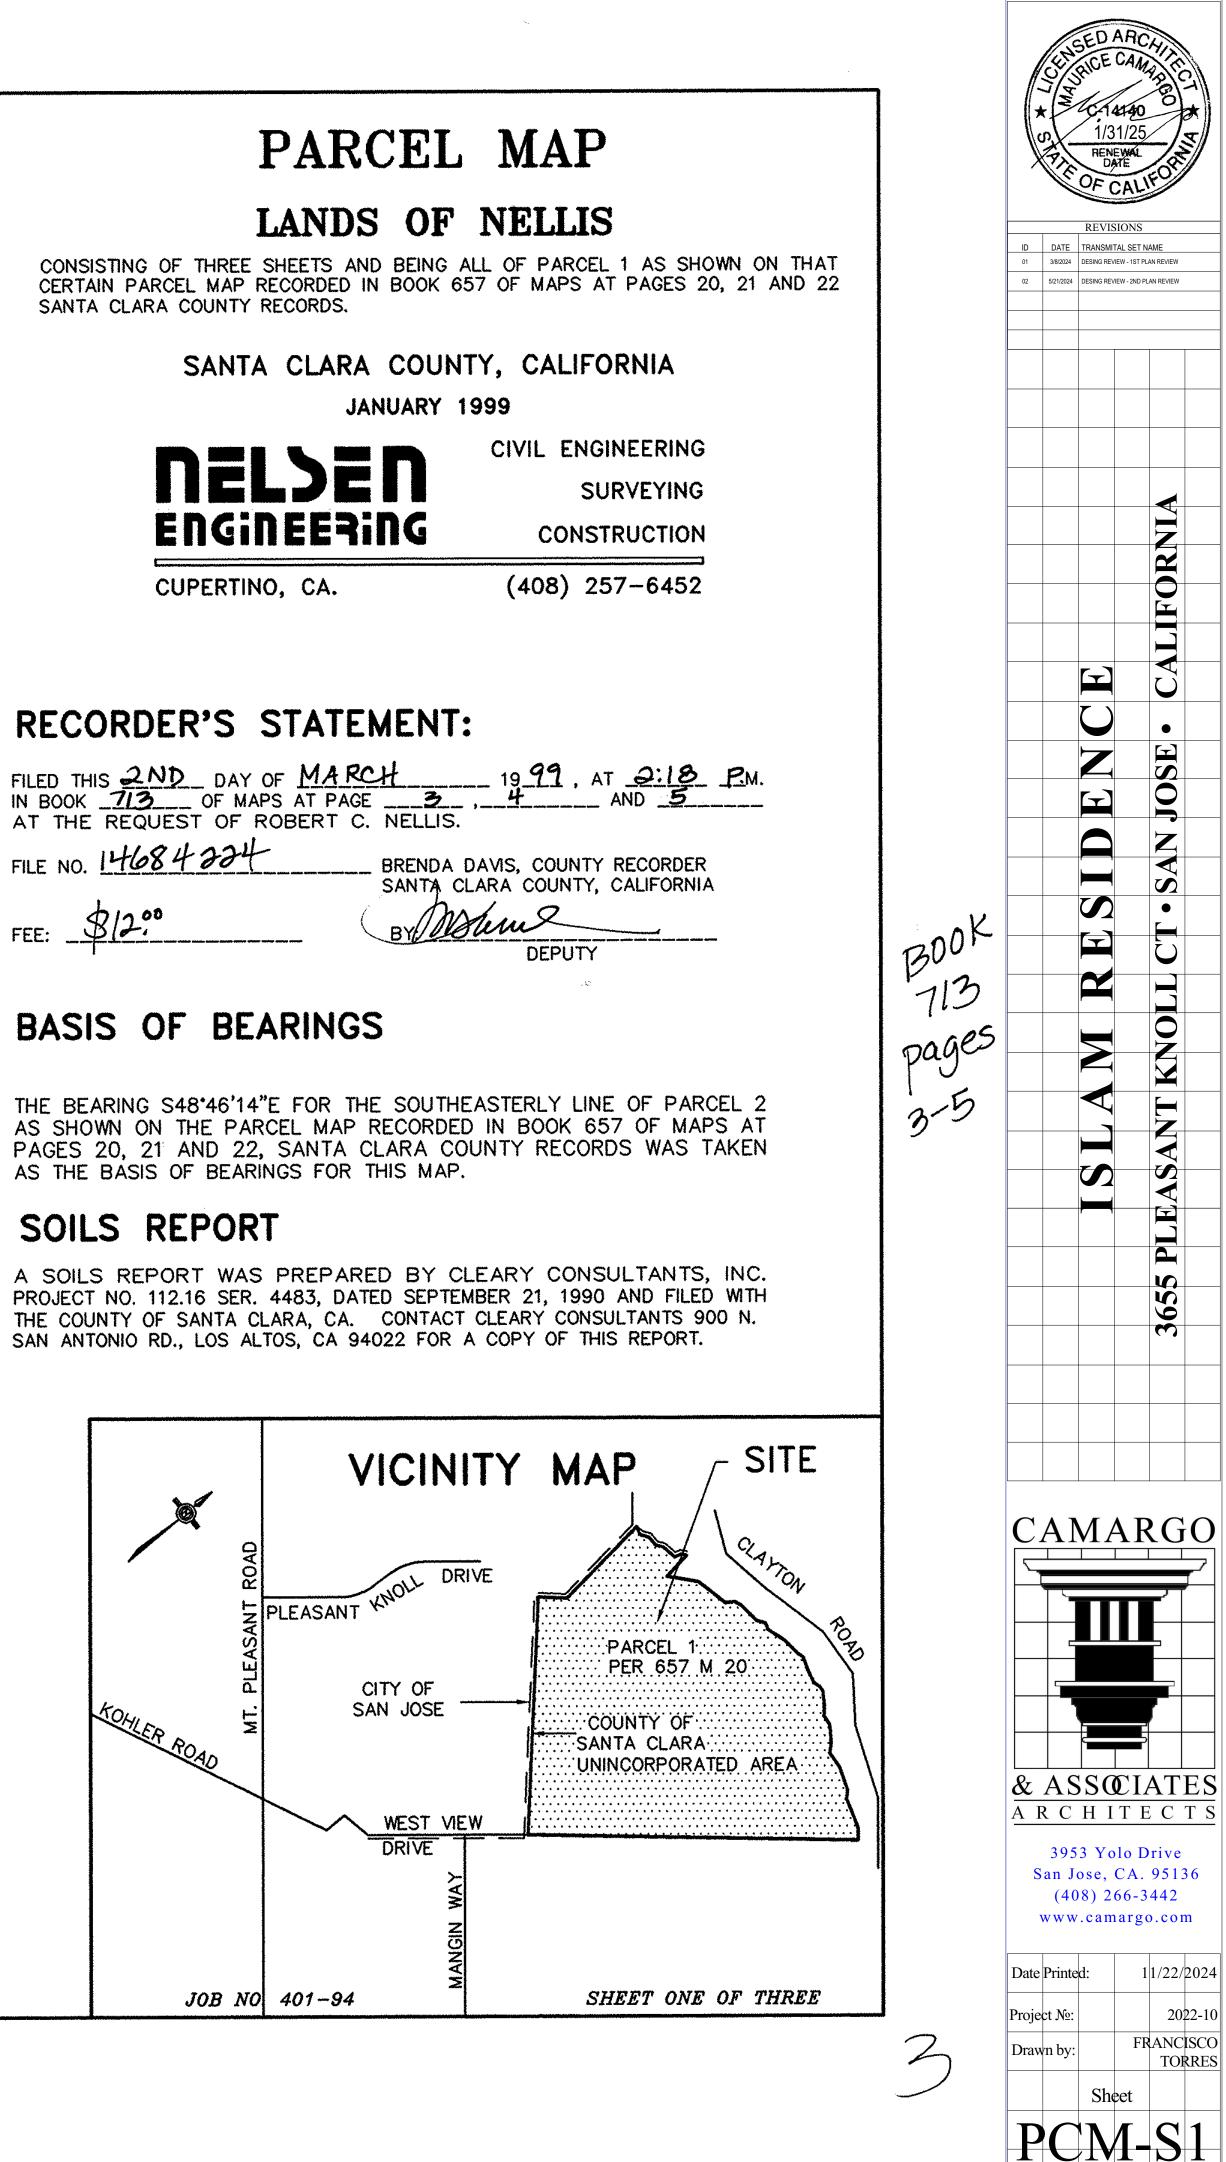

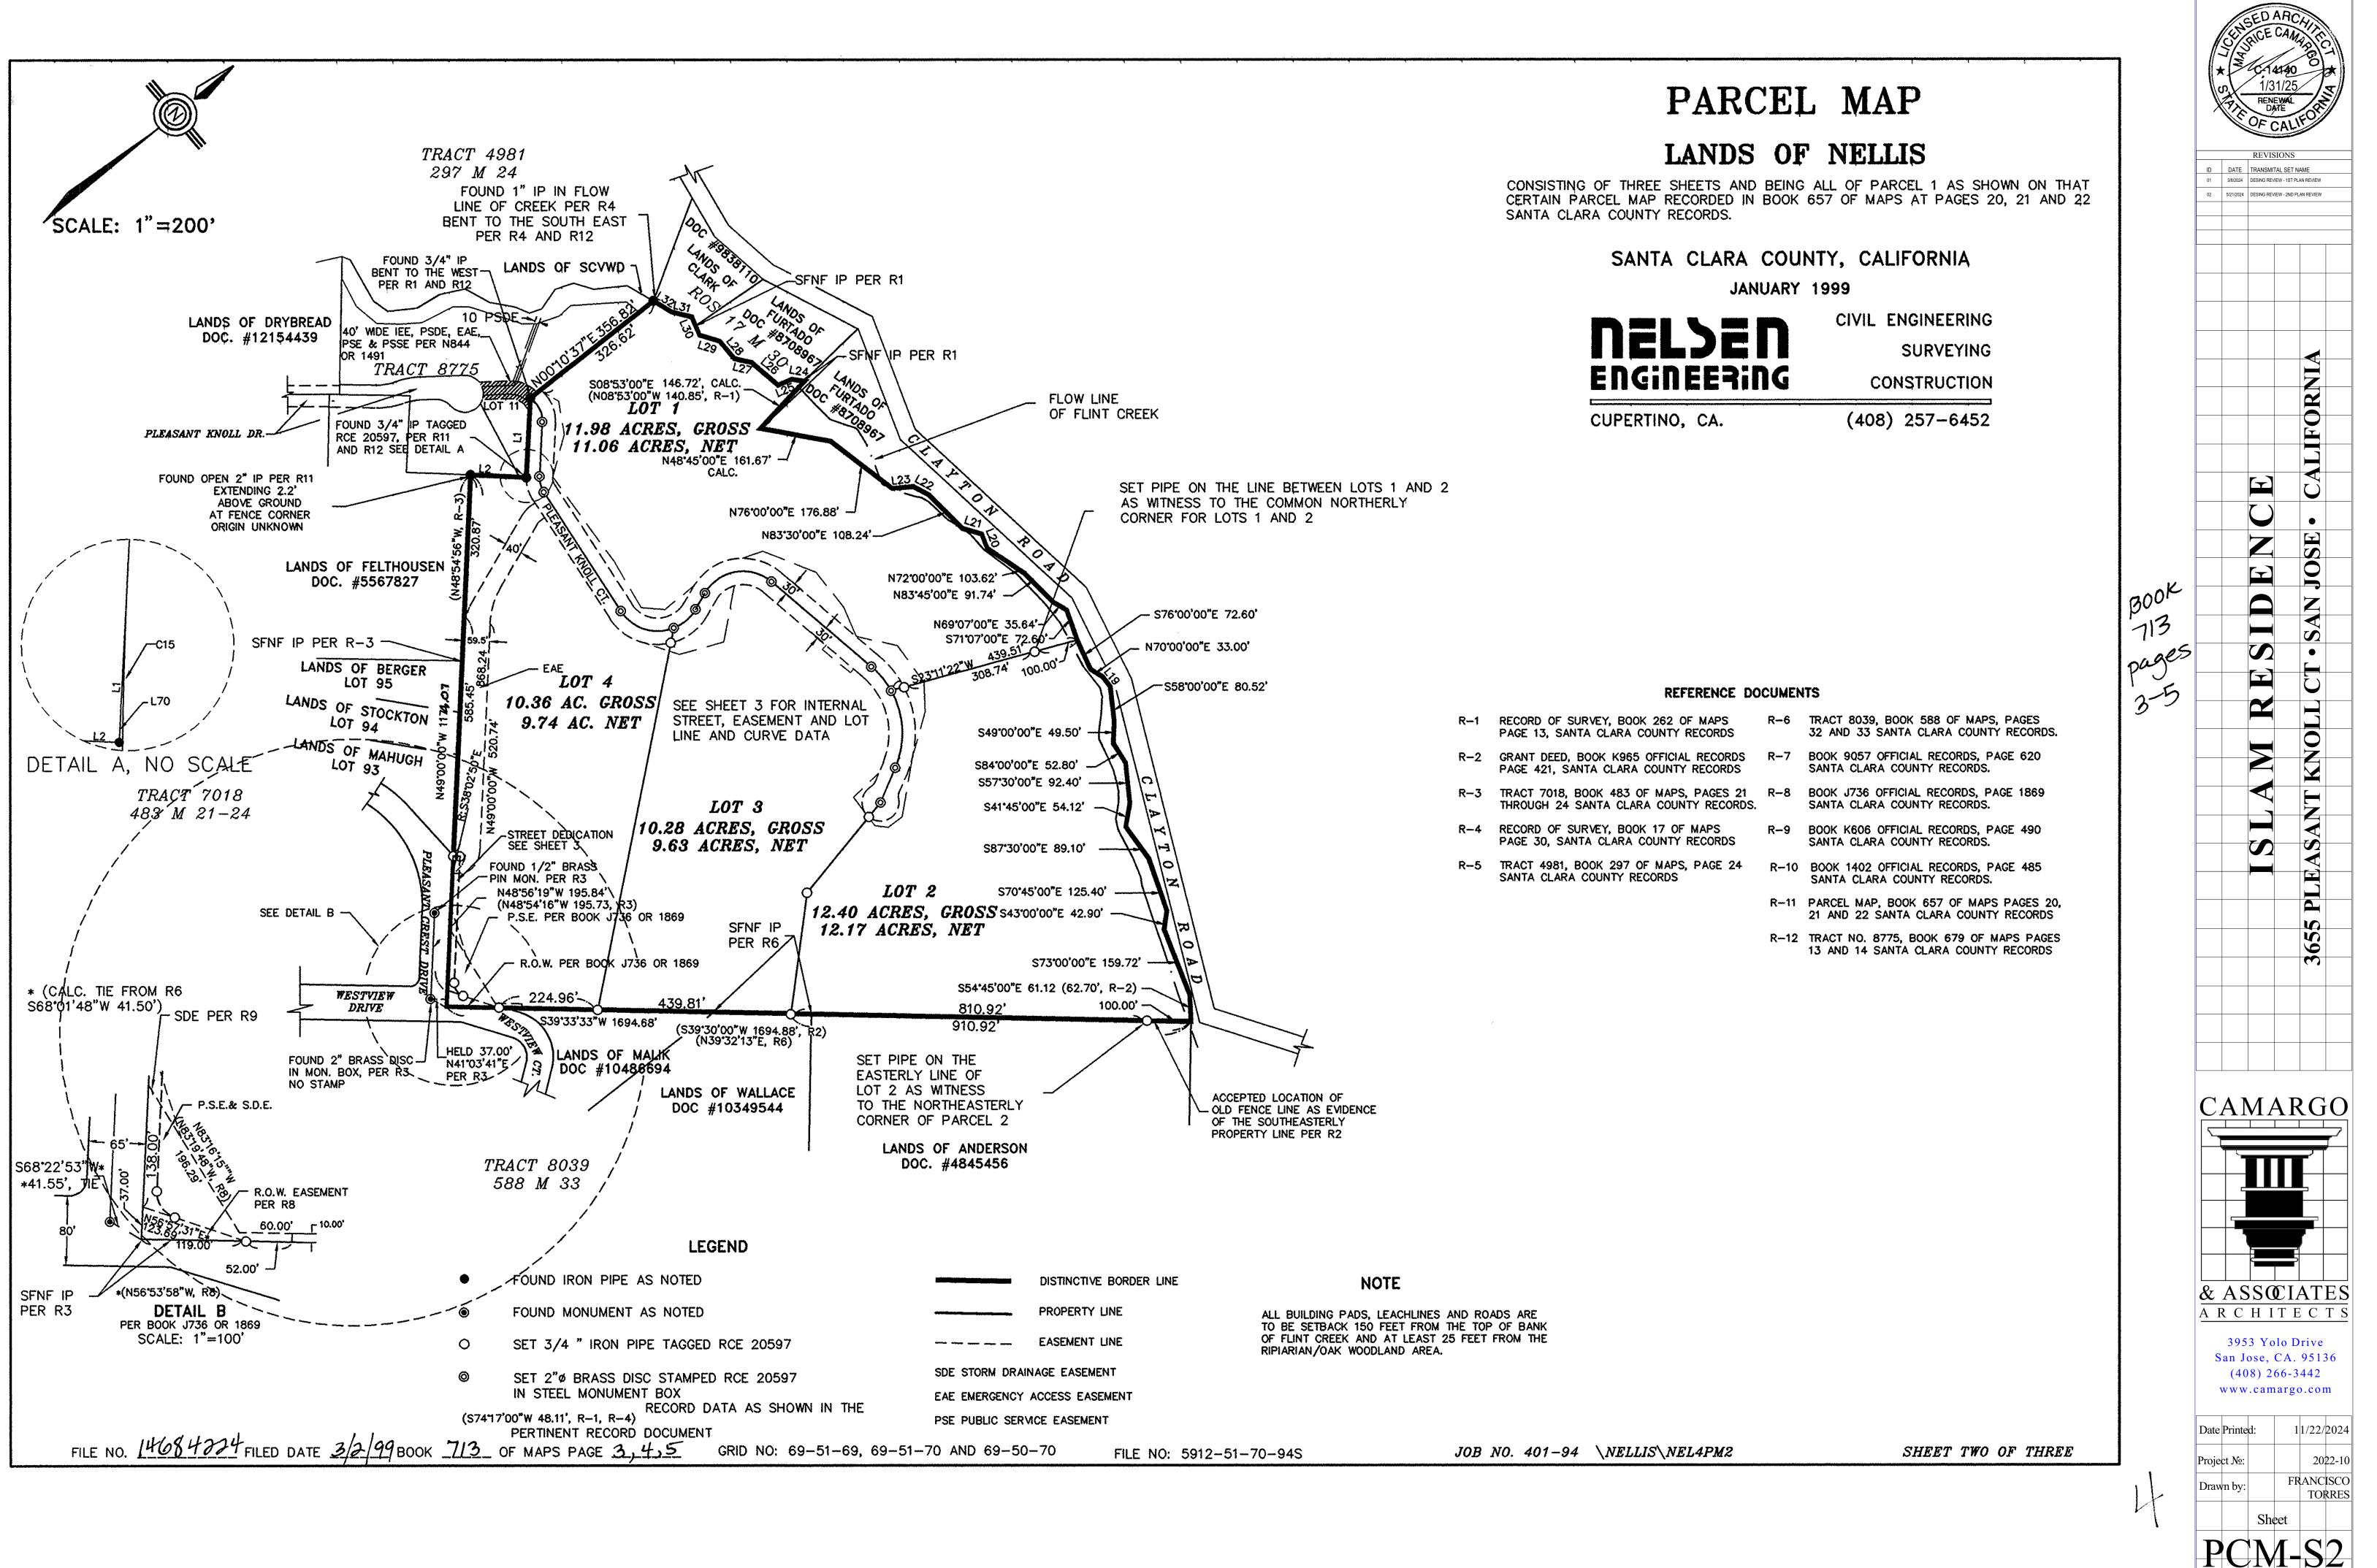

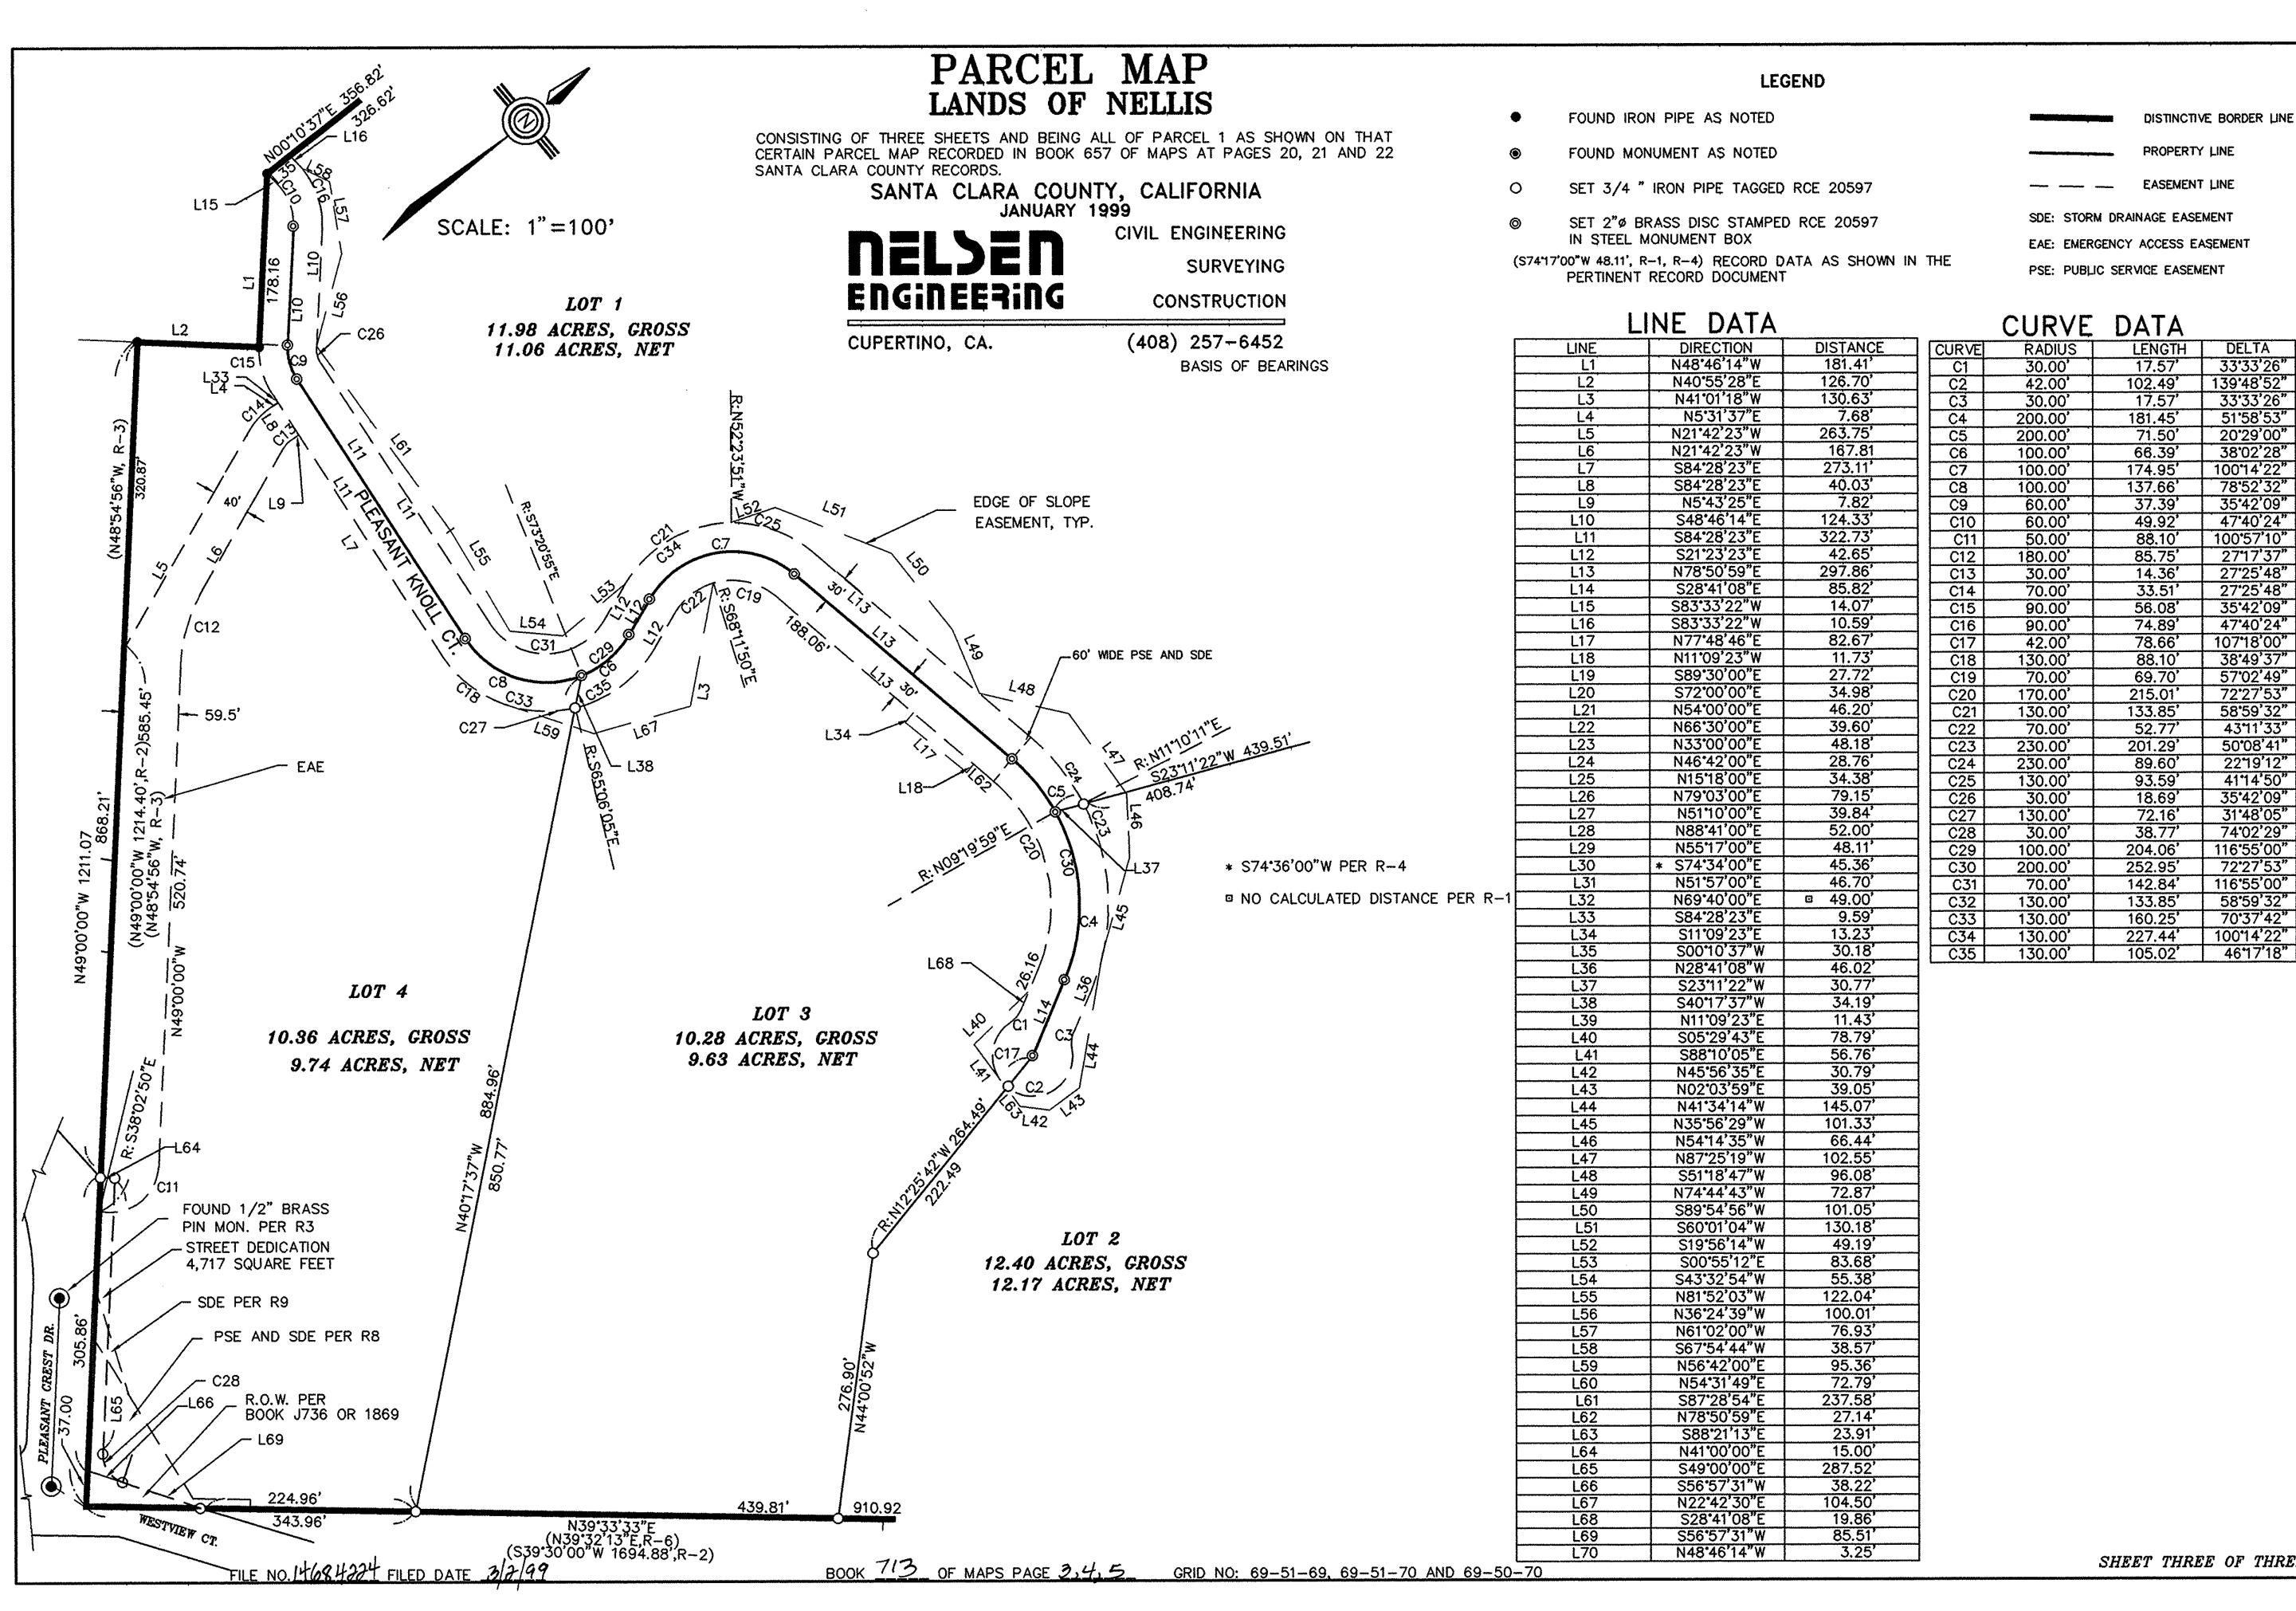

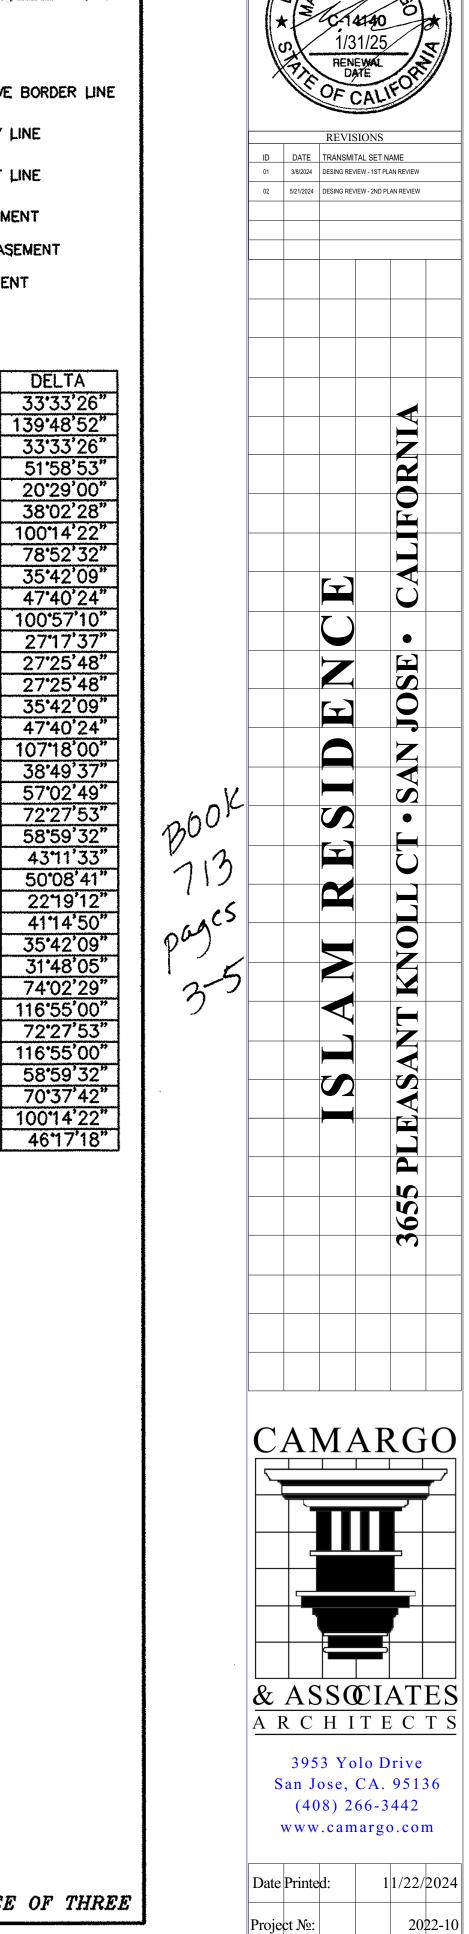

FRANCISCO

Sheet

PCM-S3

TORRES

Drawn by:

 $\mathbf{L}$ 

33'33'26

51'58'53"

38'02'28

10014'22

78\*52'32'

35\*42'09

100'57'10

27'17'37

27'25'48

27'25'48

35'42'09'

38'49'37'

58'59'32'

43'11'33'

50'08'41'

22'19'12'

41'14'50'

35'42'09'

31'48'05'

74'02'29


72\*27'53'


116'55'00

PARCEL MAP SHEET 3


SHEET	THREE	OF	THREE	

1

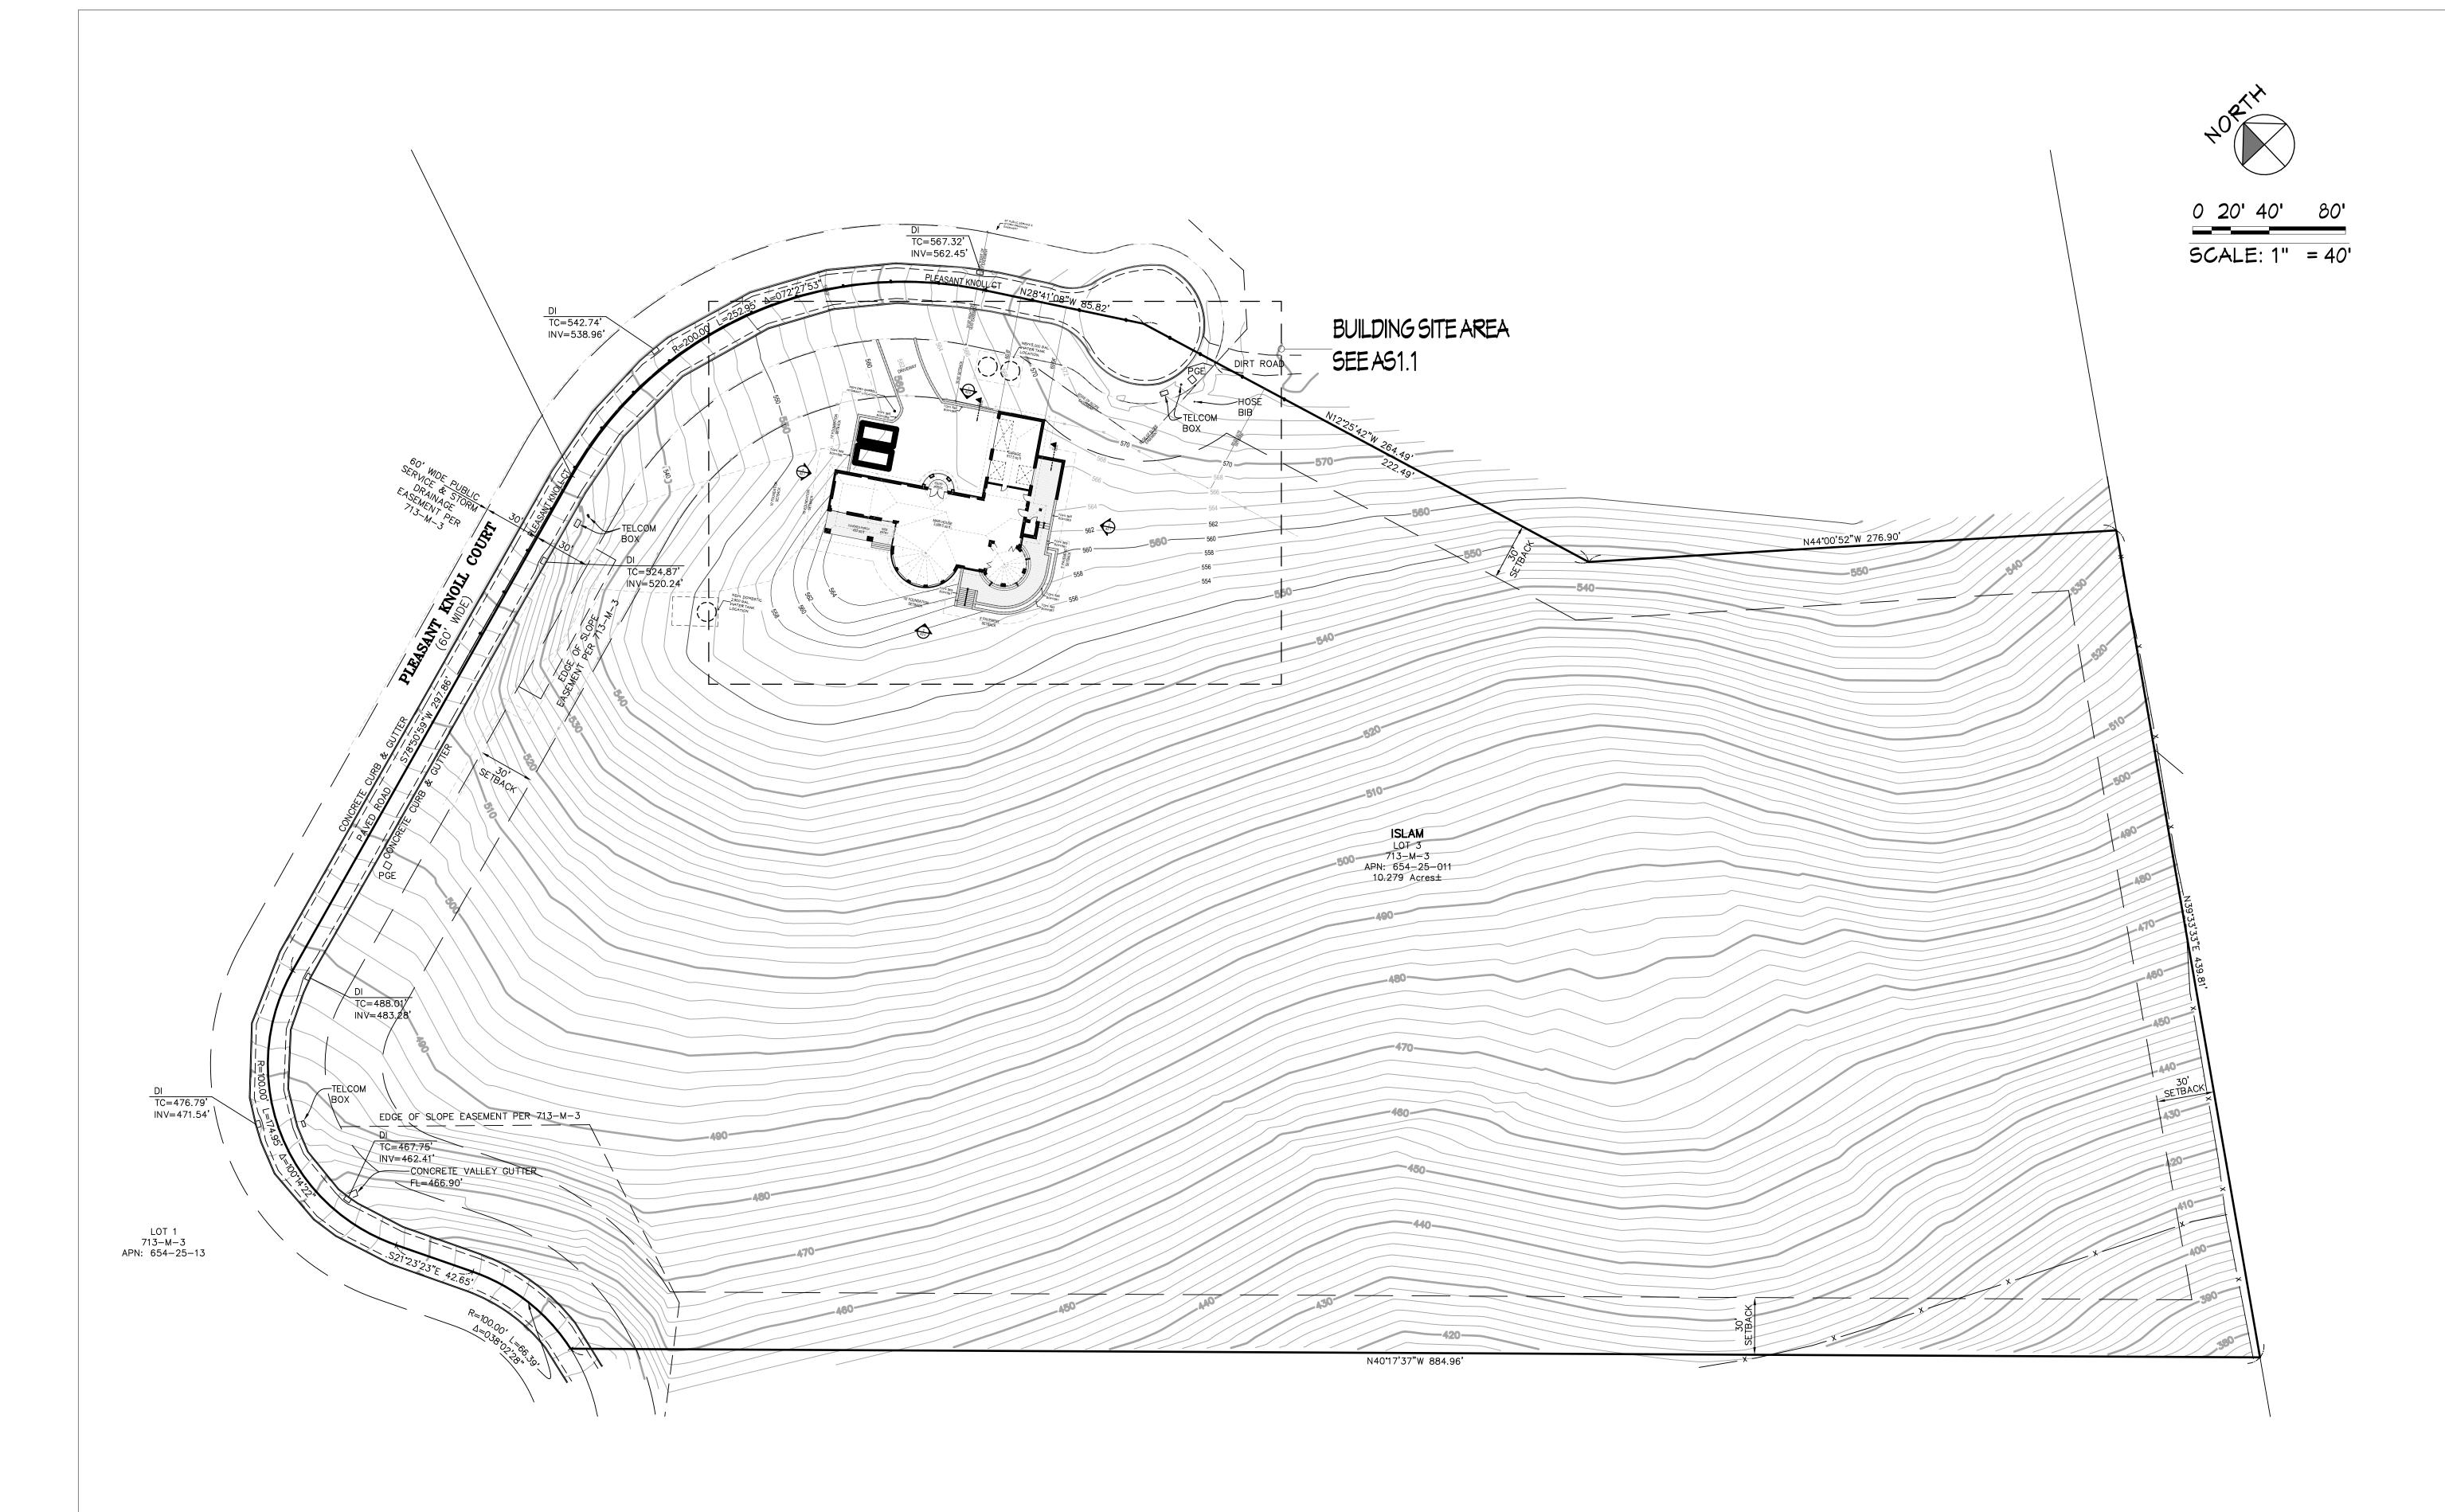

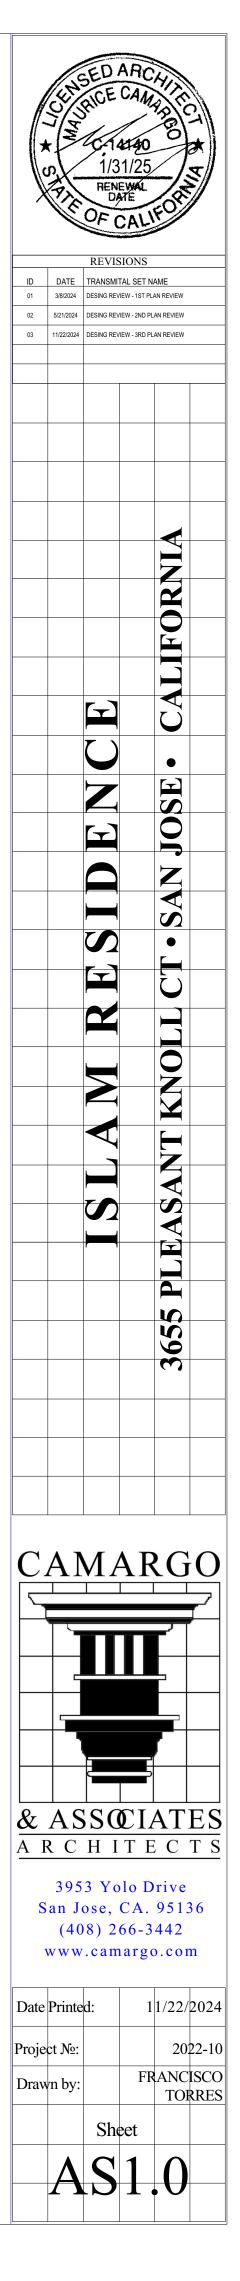


ARCHITECTURAL SITE PLAN

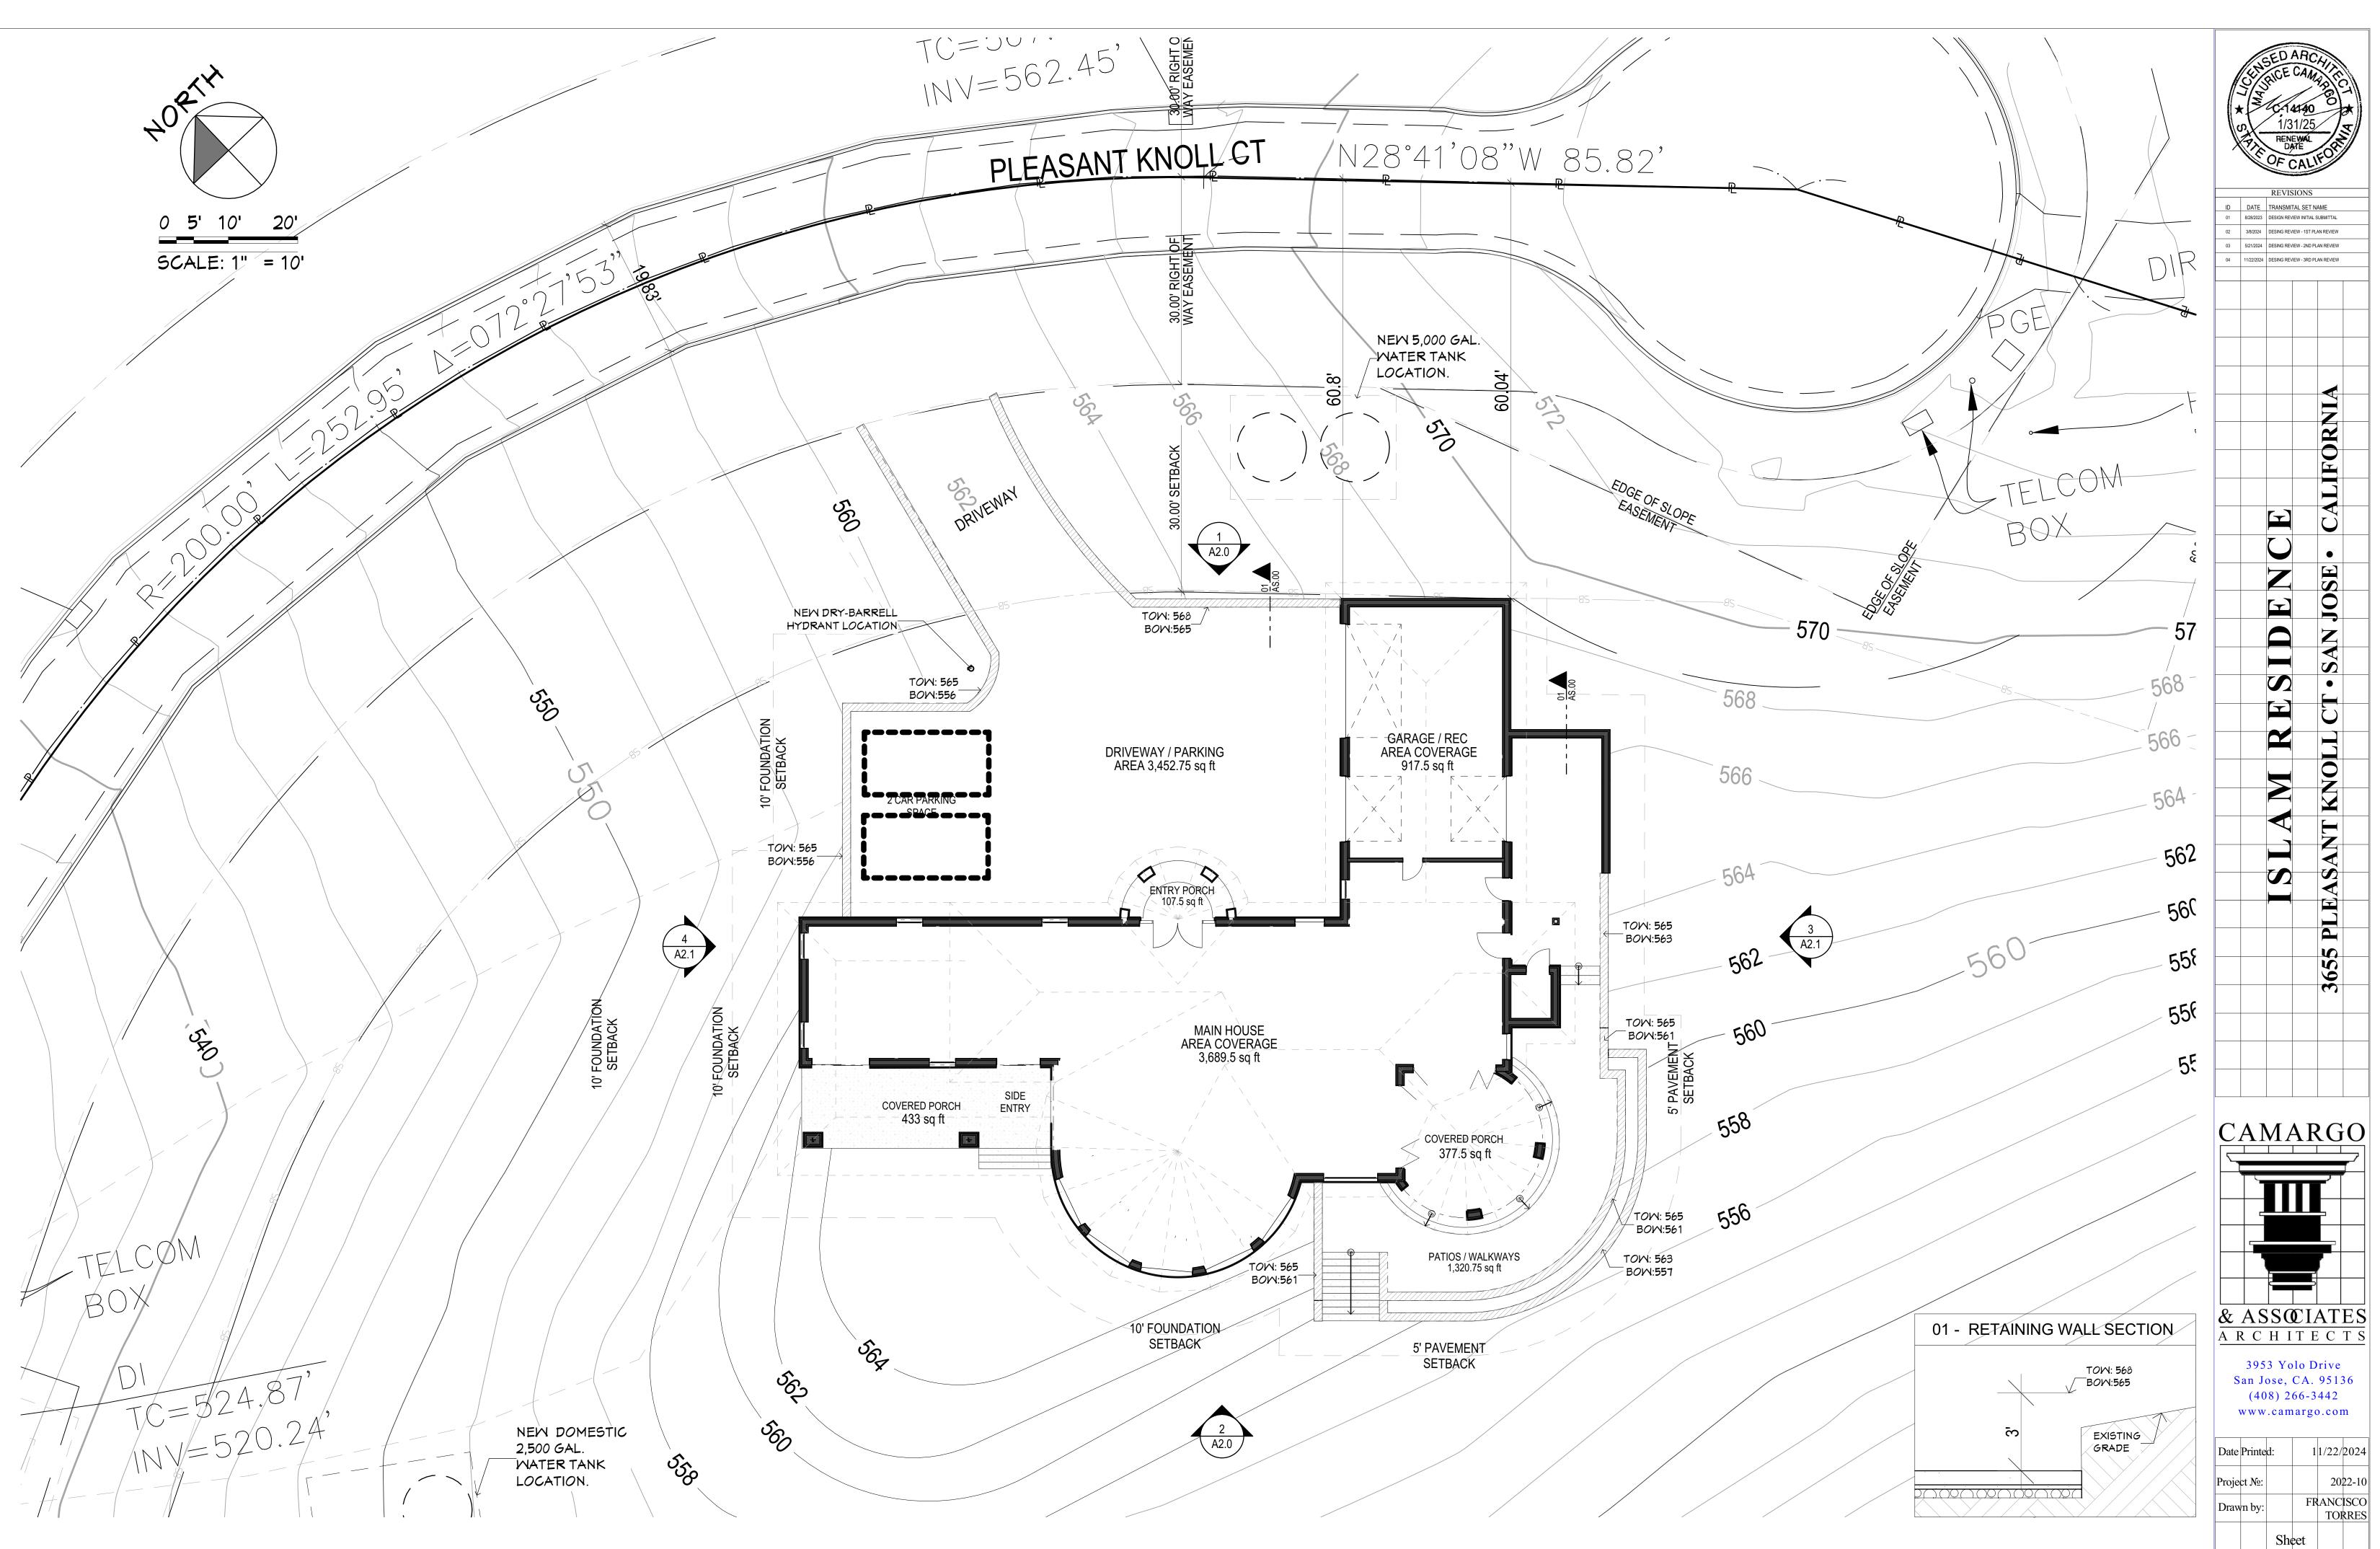





AS1.1

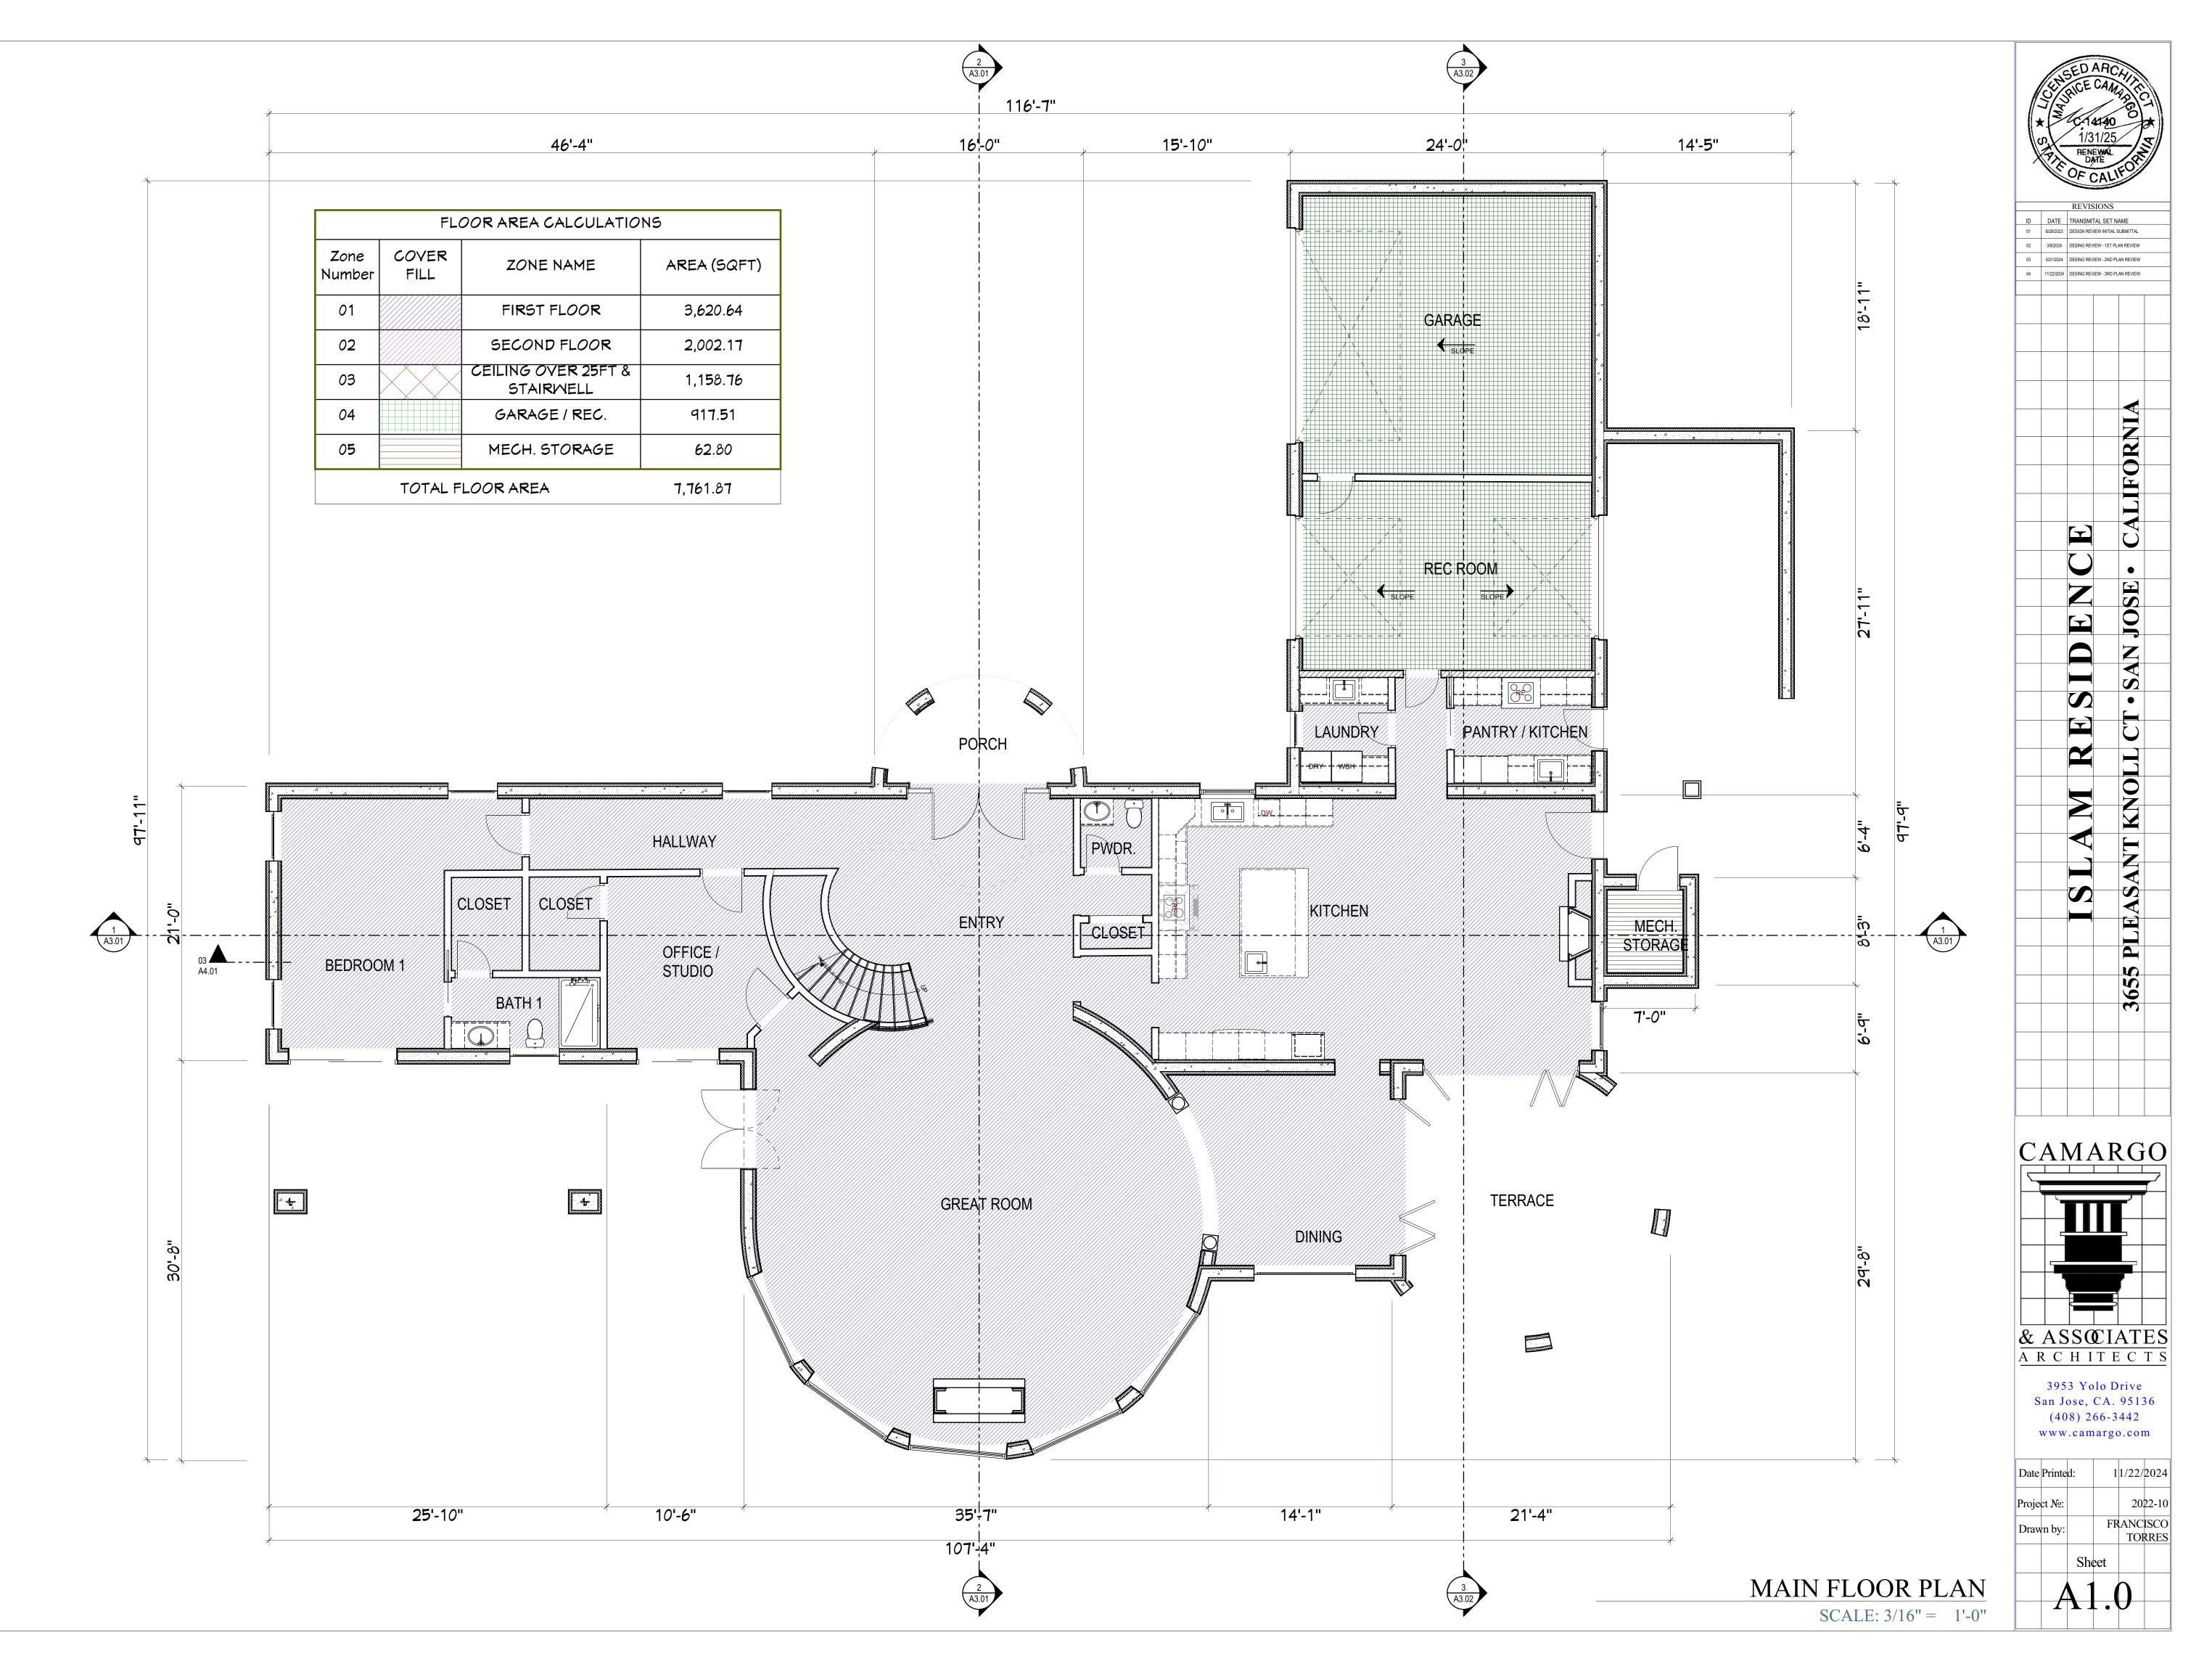


	FLOOR AREA CALCULATIONS			
Zone Number	COVER FILL	ZONE NAME	AREA (SQFT)	
01		FIRST FLOOR	3,620.64	
02		SECOND FLOOR	2,002.17	
03		CEILING OVER 25FT & STAIRWELL	1,158.76	
04		GARAGE / REC.	917.51	
05		MECH. STORAGE	62.80	
TOTAL FLOOR AREA 7,761.87			7,761.87	


43.01

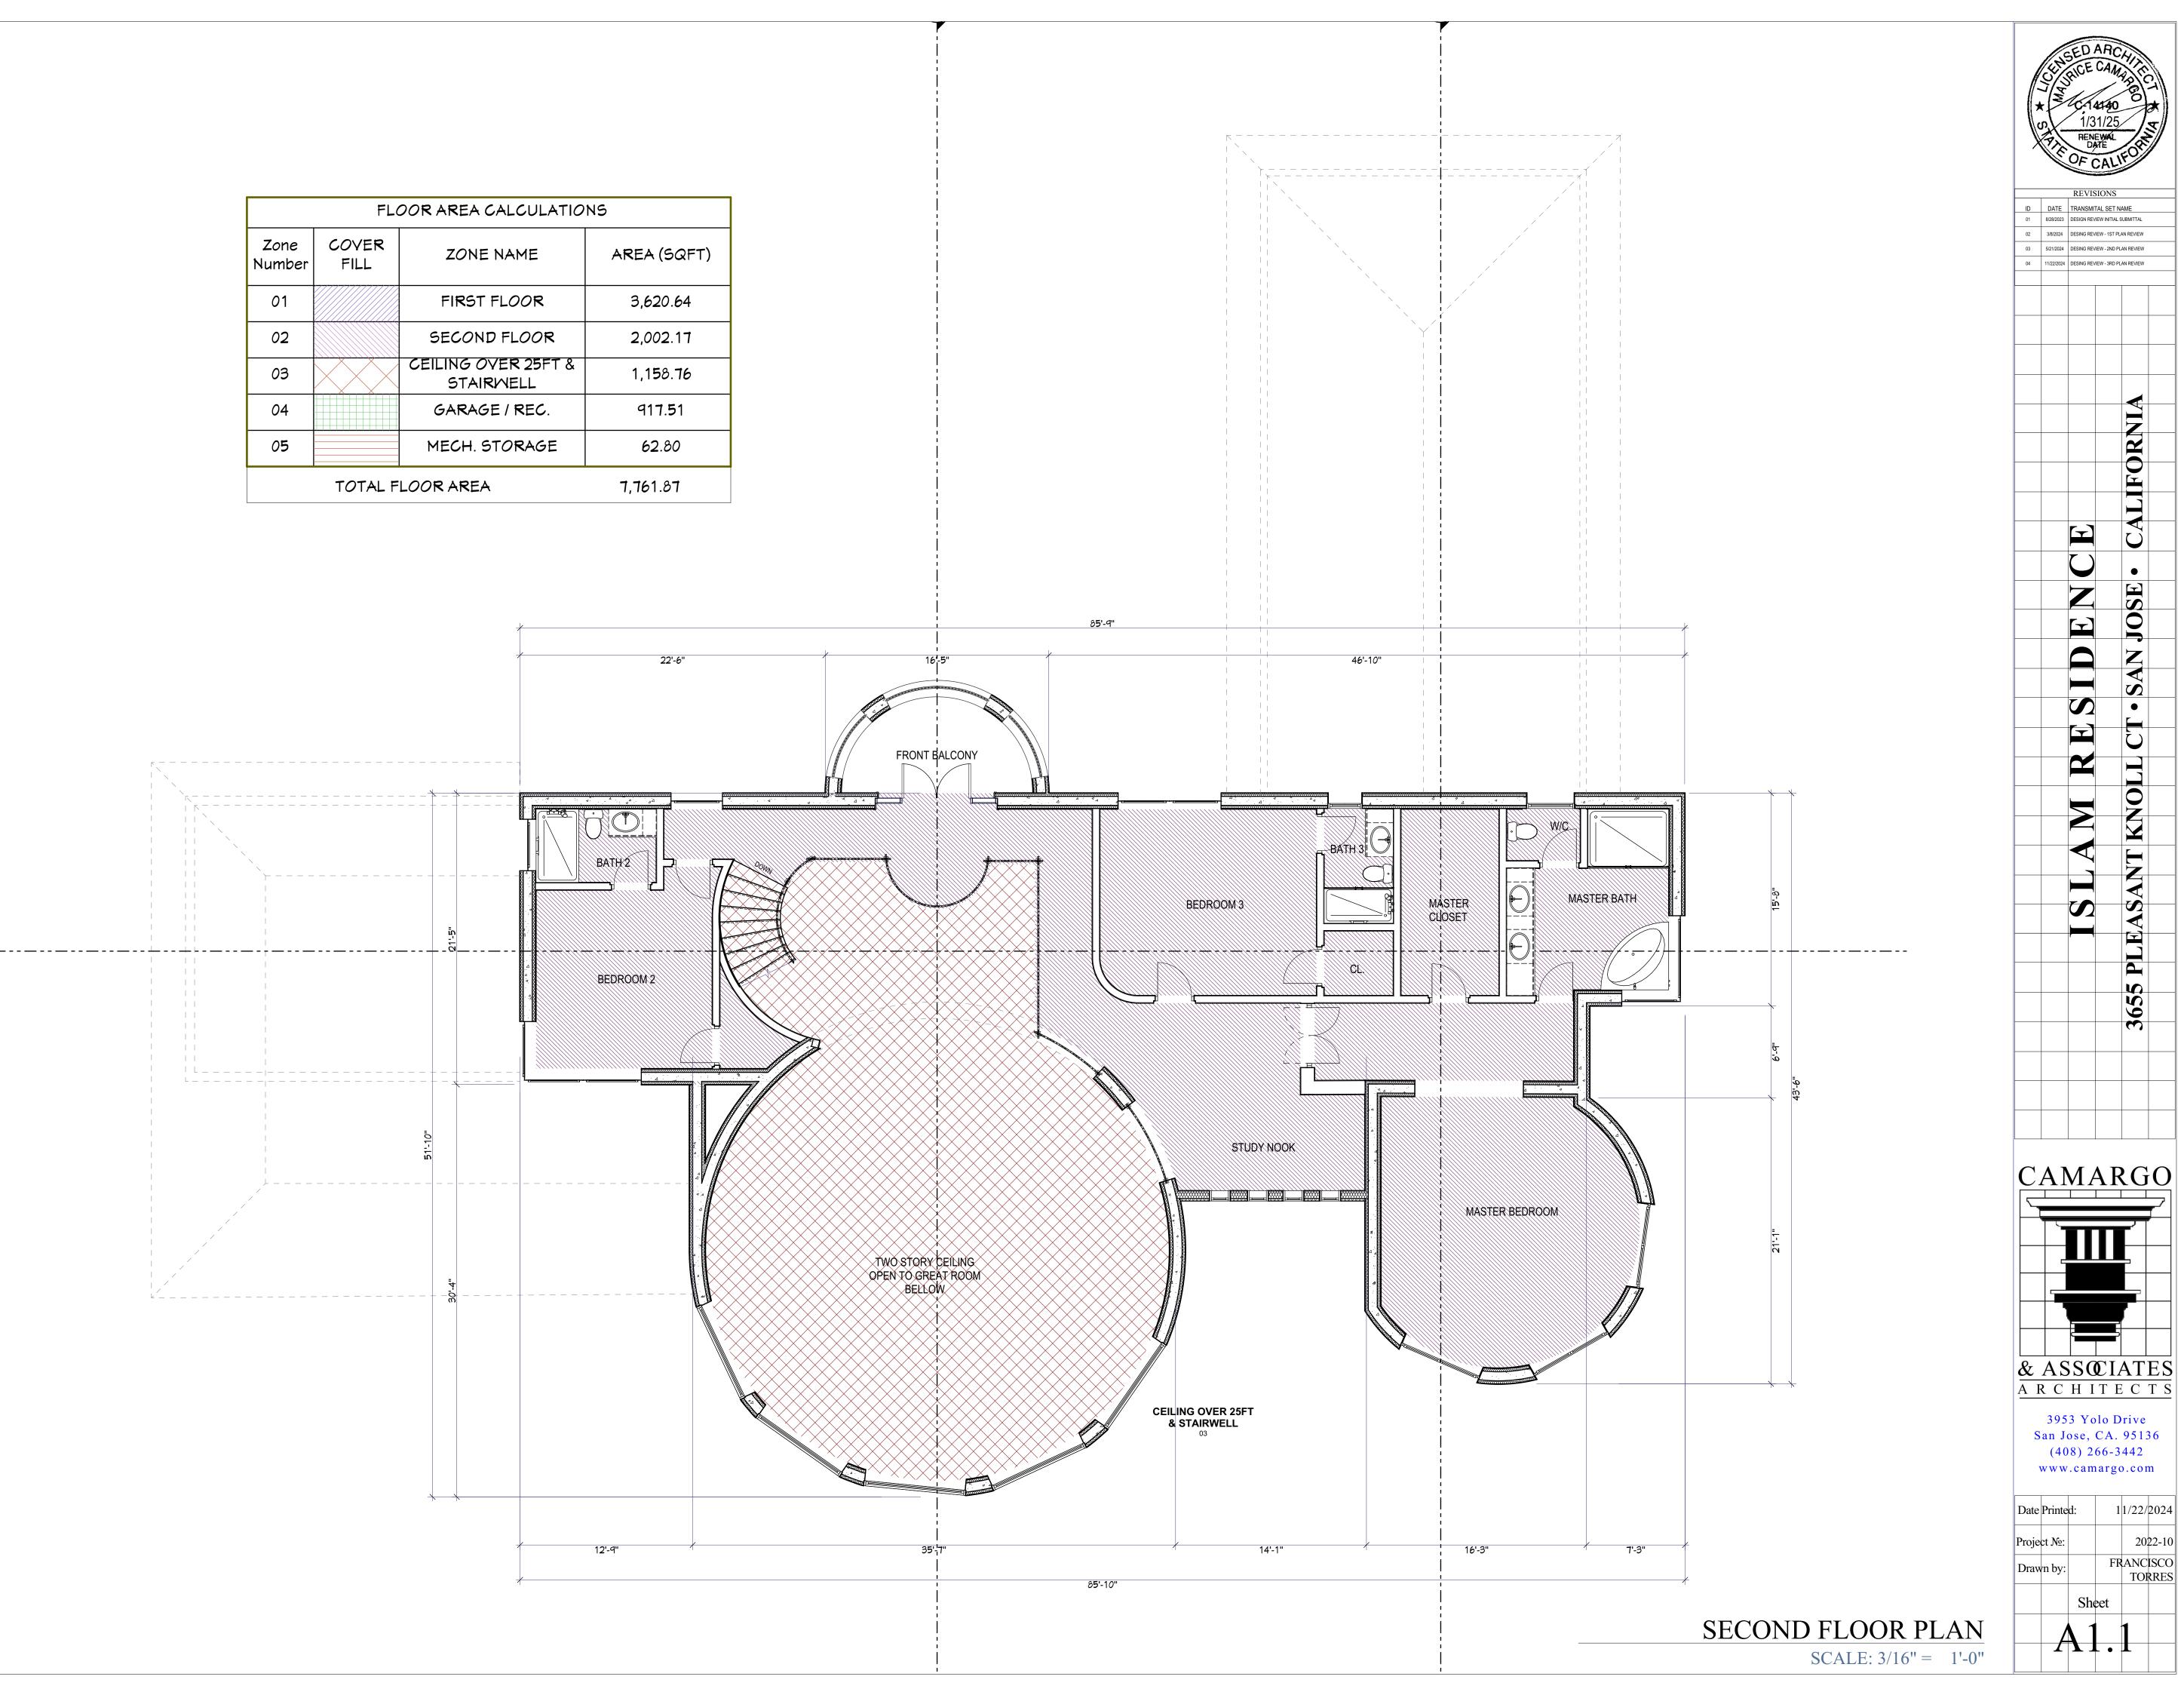


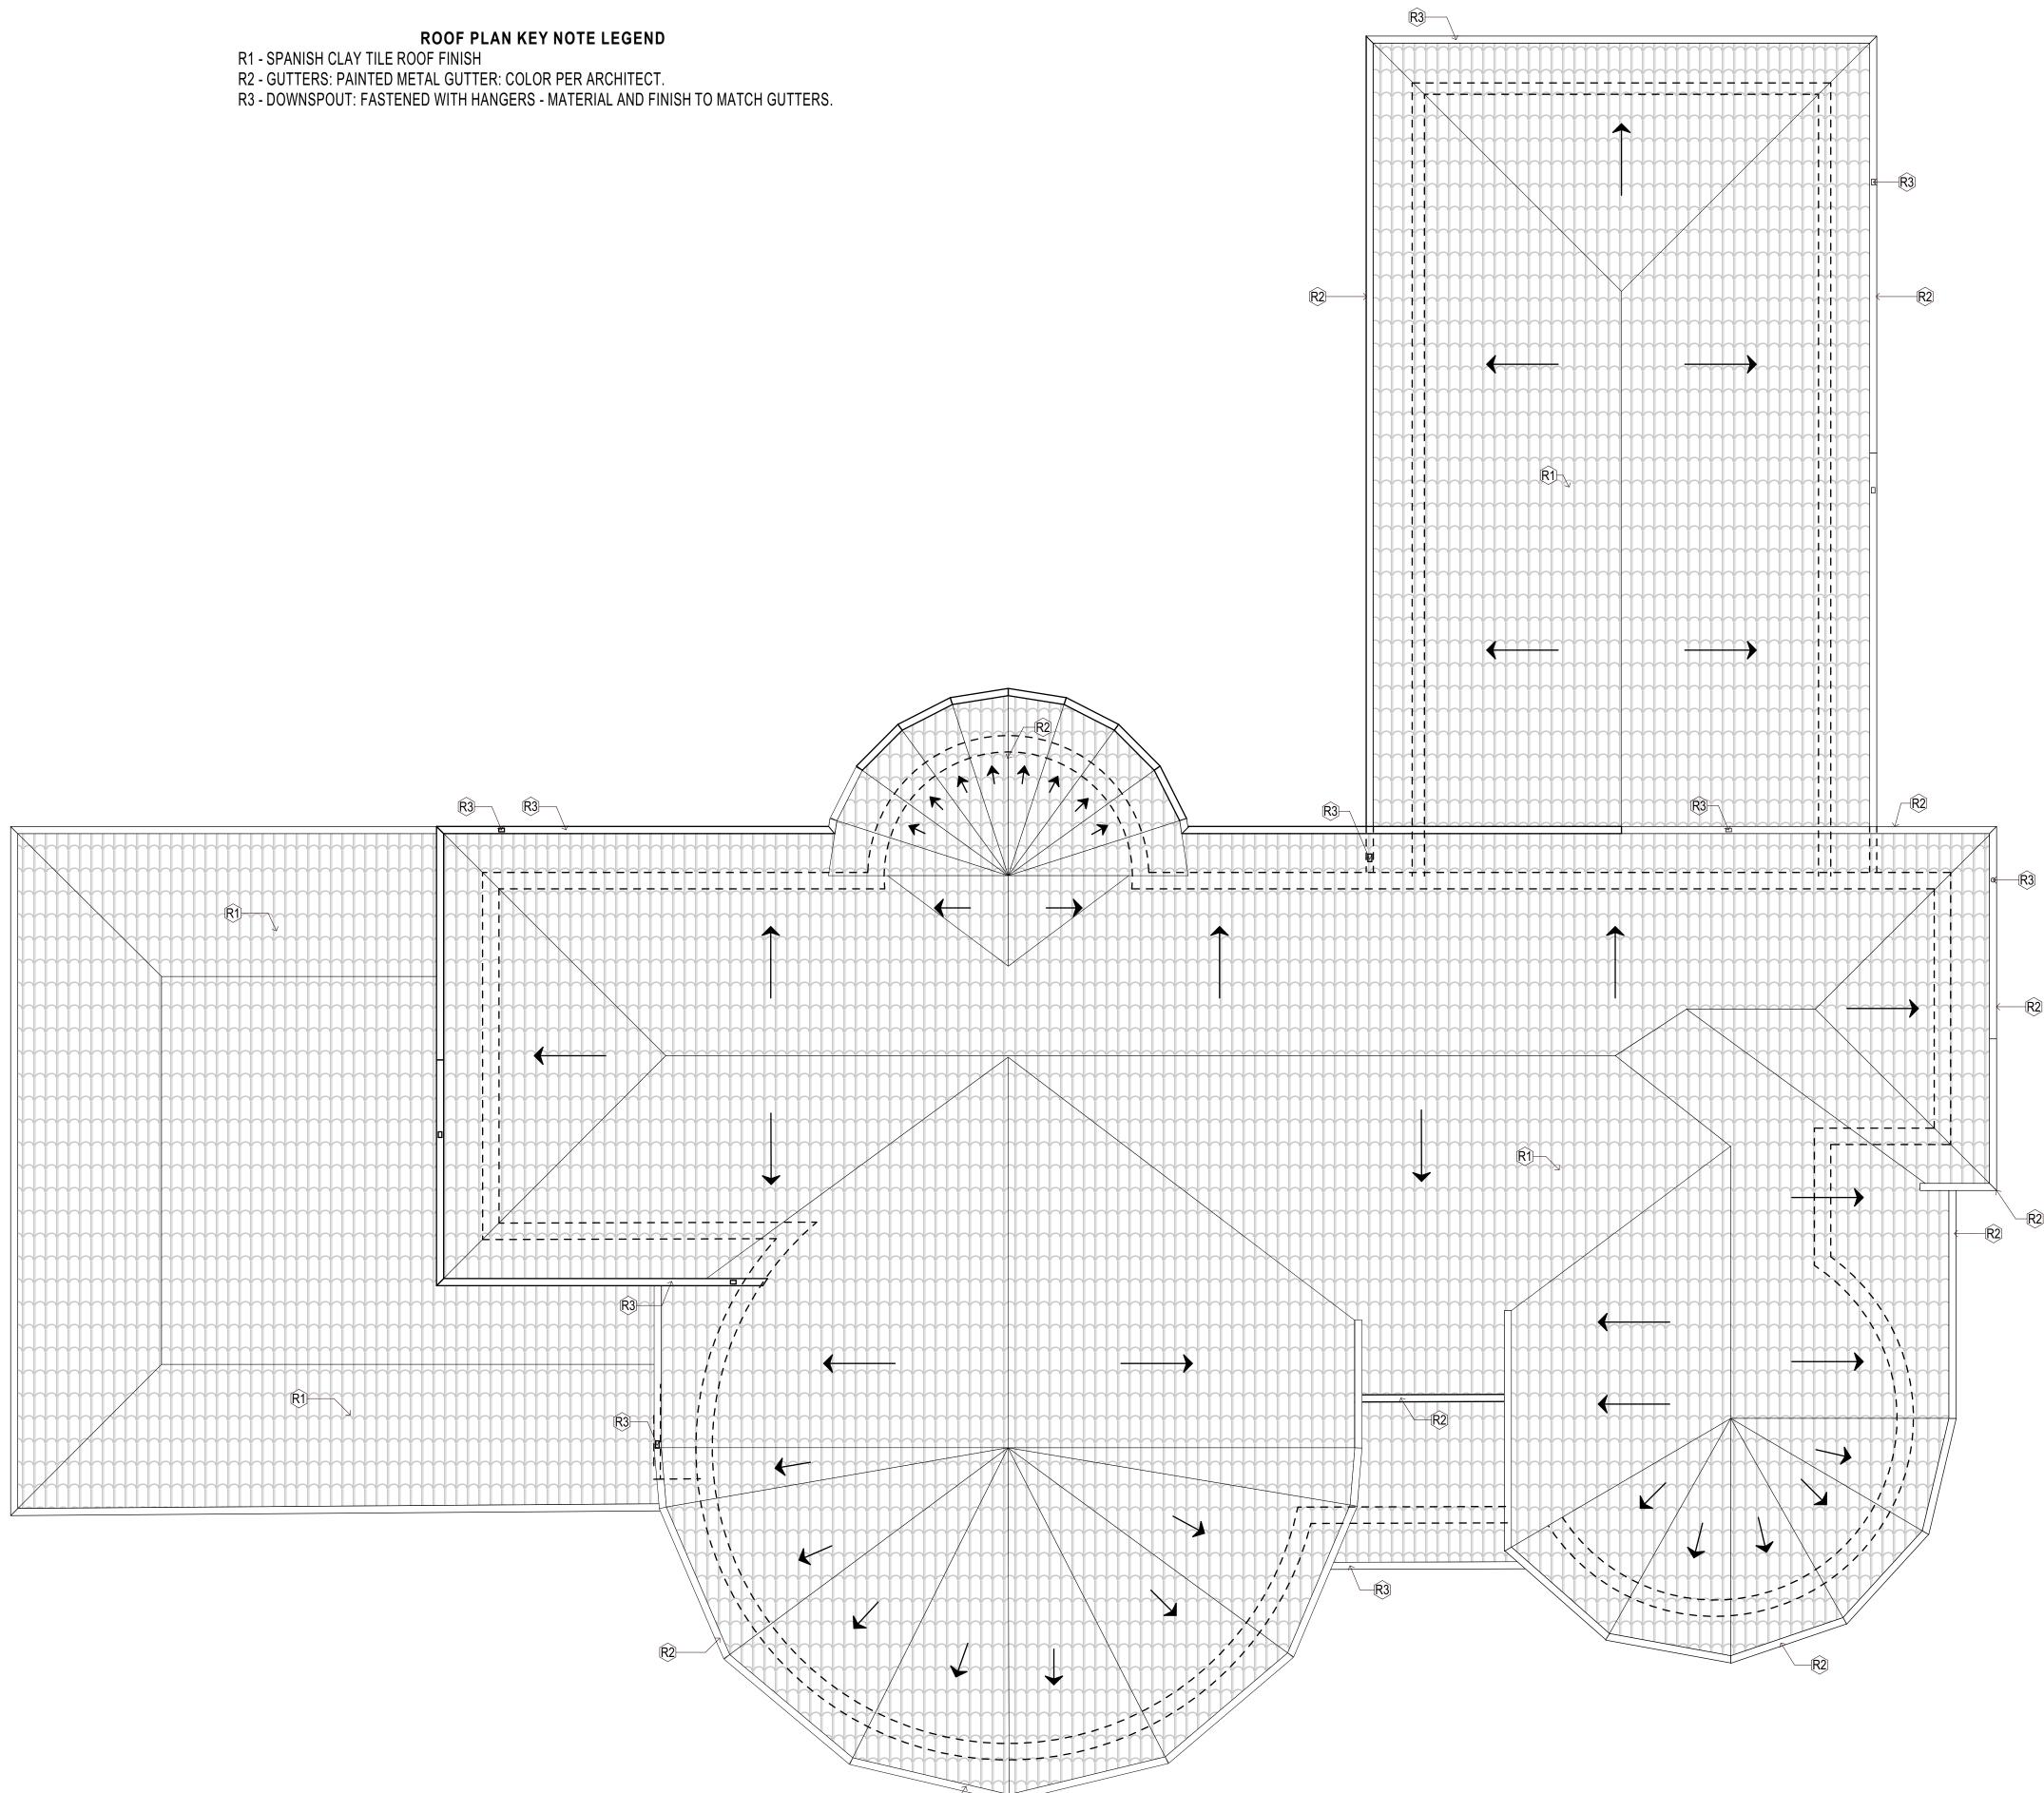


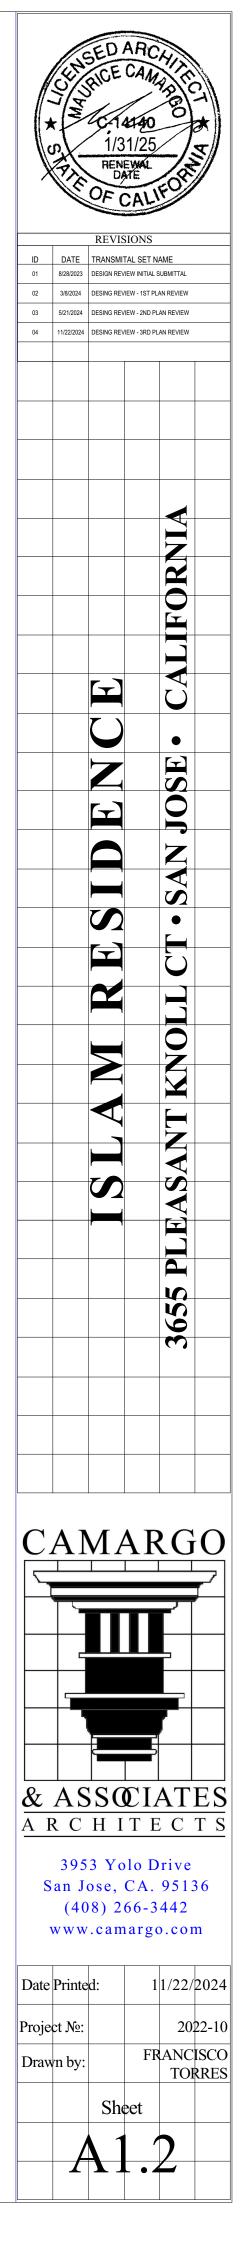


ROOF PLAN SCALE: 3/16" = 1'-0"

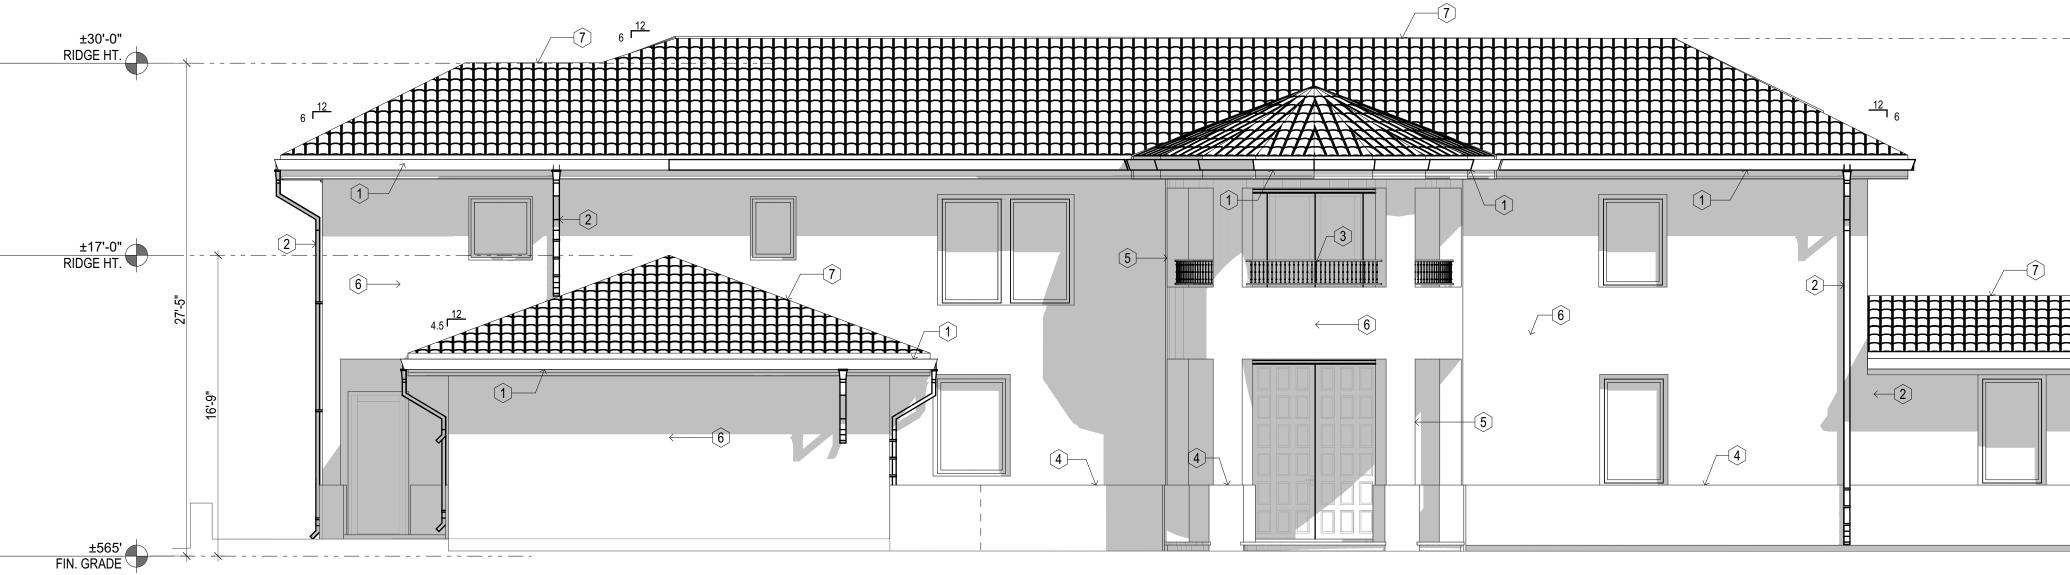



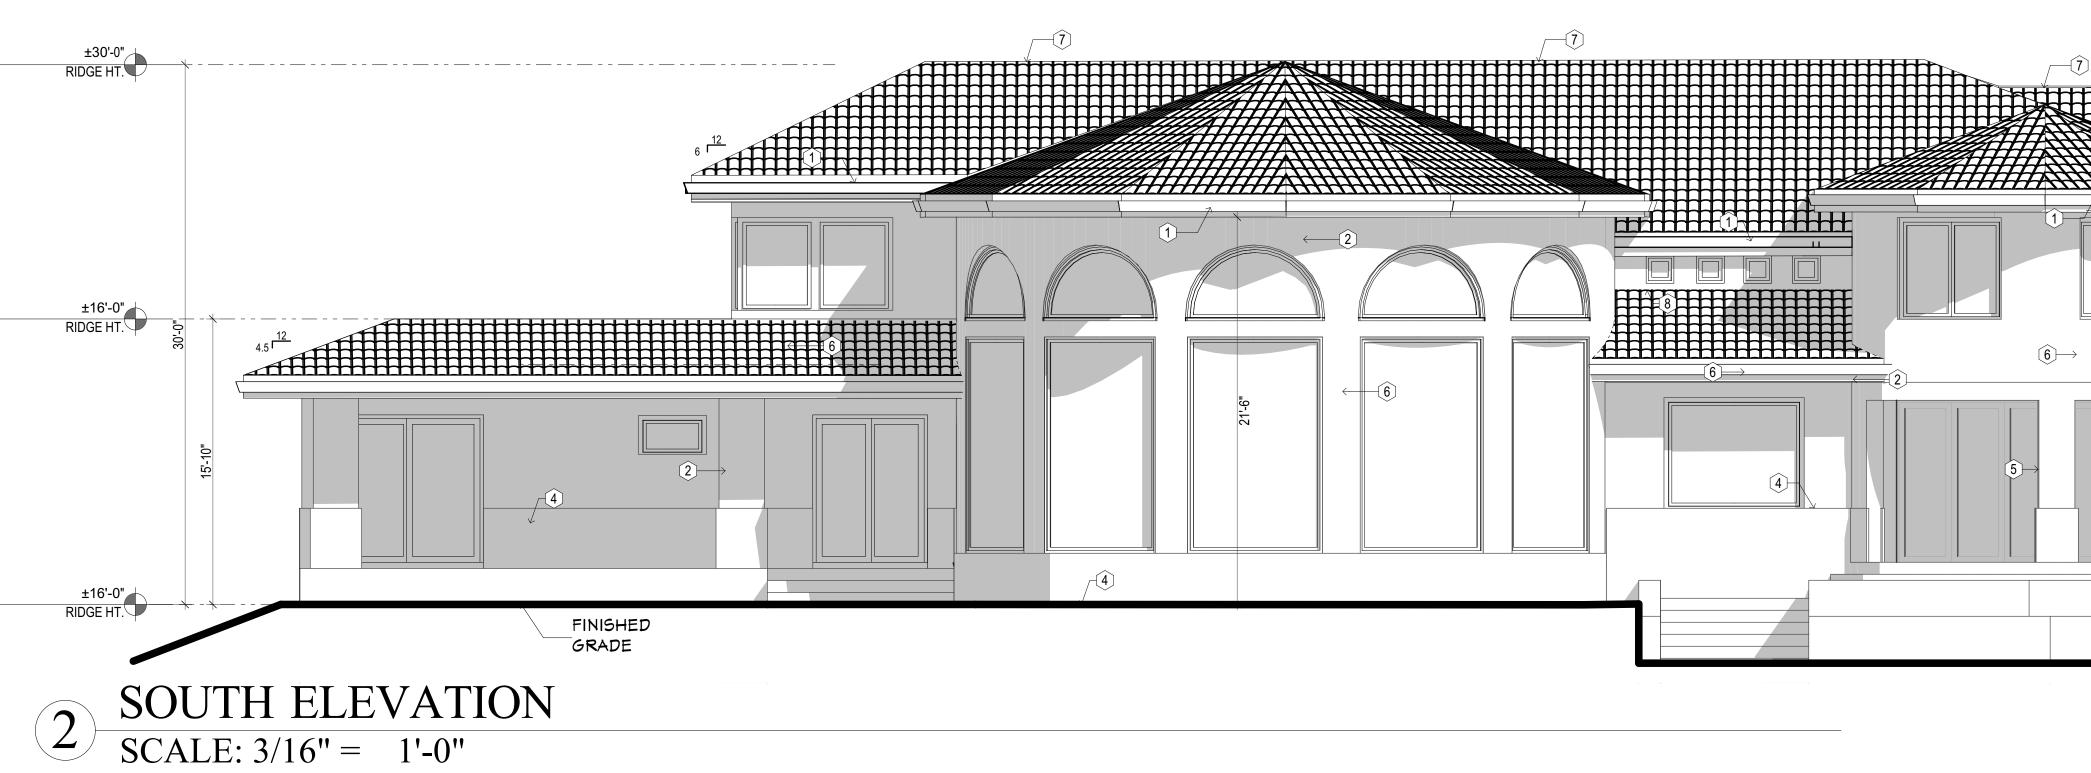


	ELEVATION KEY NOTE LEGEND		
ID	ELEMENT	DESCRIPTION	
1	GUTTER	PAINTED METAL: COLOR PER ARCHITECT.	
2	DOWNSPOUT	PAINTED METAL: FASTENED WITH HANGERS, MATERIAL AND FINISH TO MATCH GUTTERS.	
3	GUARDRAIL	18" BLACK WROUGHT-RAIL COLUMN MOUNTED ABOVE PARTIAL PARAPET WALL - FINISH PER ARCHITECT.	
4	WAINSCOT	LIQUID ACRYLIC INTAGRATED PLASTER WITH SMOOTH TROWELLED FINISH, COLOR & TEXTURE PER ARCHITECT.	
5	COLUMN	LIQUID ACRYLIC WITH SMOOTH THOWELLED FINISH WRAPPED AROUND OPENING. COLOR AND TEXTURE TO BE APPROVED BY ARCHITECT.	
6	WALL	LIQUID ACRYLIC INTAGRATED PLASTER WITH SMOOTH TROWELLED FINISH, COLOR & TEXTURE PER ARCHITECT.	
7	ROOF	CLAY TILE 3 PIECE WITH YELLOW, BROWN, GRAY, AND GOLD BLENDS . INSTALL PER MANUFACTURERS RECOMMENDATIONS	
8	GUARDRAIL	42" BLACK WRHOUGHT-RAIL COLUMN MOUNTED - FINISH PER ARCHITECT.	

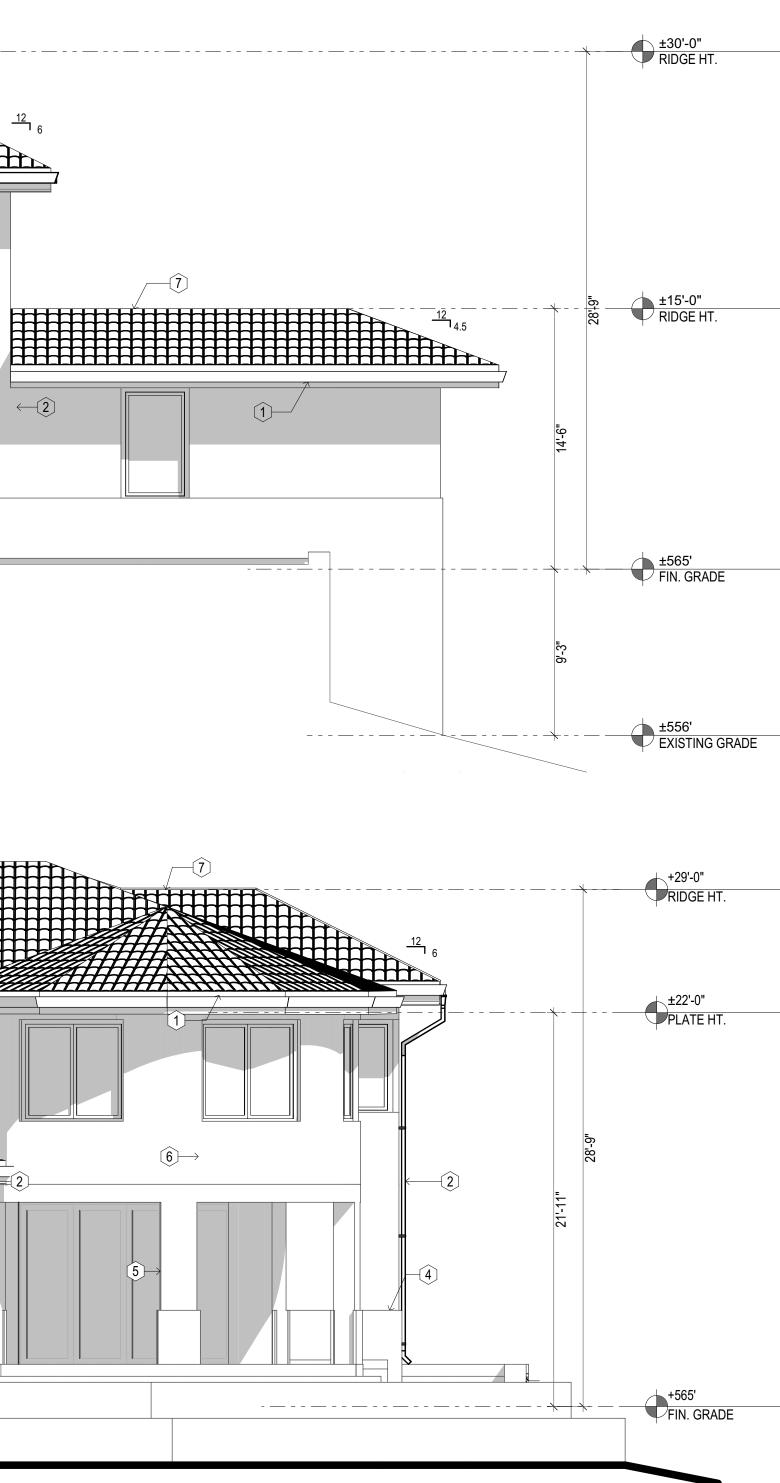


### COLOR/MATERIALS BOARD:


ARCHITECTURAL ACCENTS: (Ex. Stone Veneer) Sherwin Williams SW7027 - Hickory Smoke, LRV: 7 DOOR & WINDOW FRAMES: Marvin - SW7020 Black Fox Num: 244-C7, LRV: 7 EXTERIOR WALLS: Sherwin Williams SW7501 - Threshold Taupe, LRV:34 RETAINING WALLS: SHERWIN WILLIAMS SW7501 - THRESHOLD TAUPE, LRV:34 ROOF: TBD - CLASSIC "S" MISSION CLAY TILE TRIM: N/A

EXTERIOR ELEVATIONS

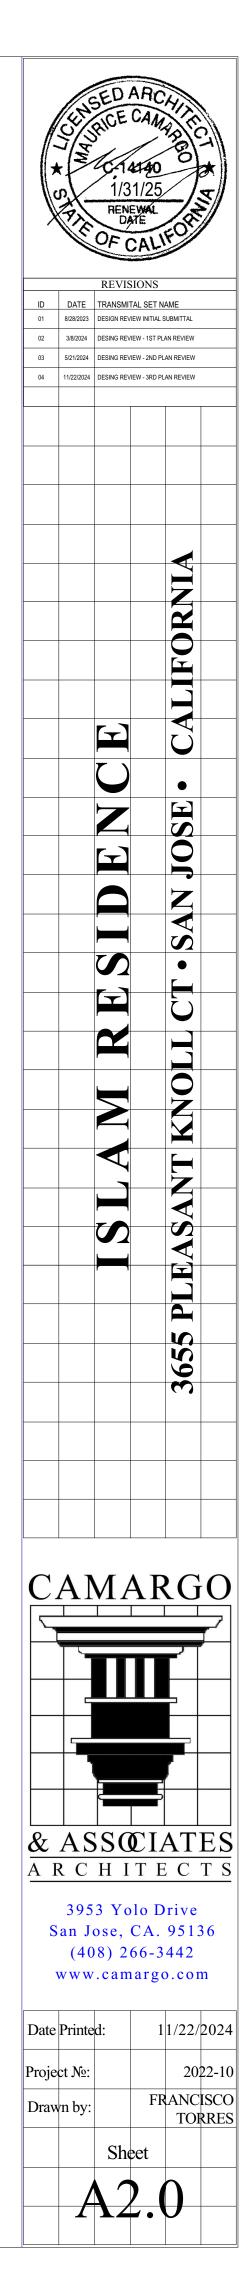

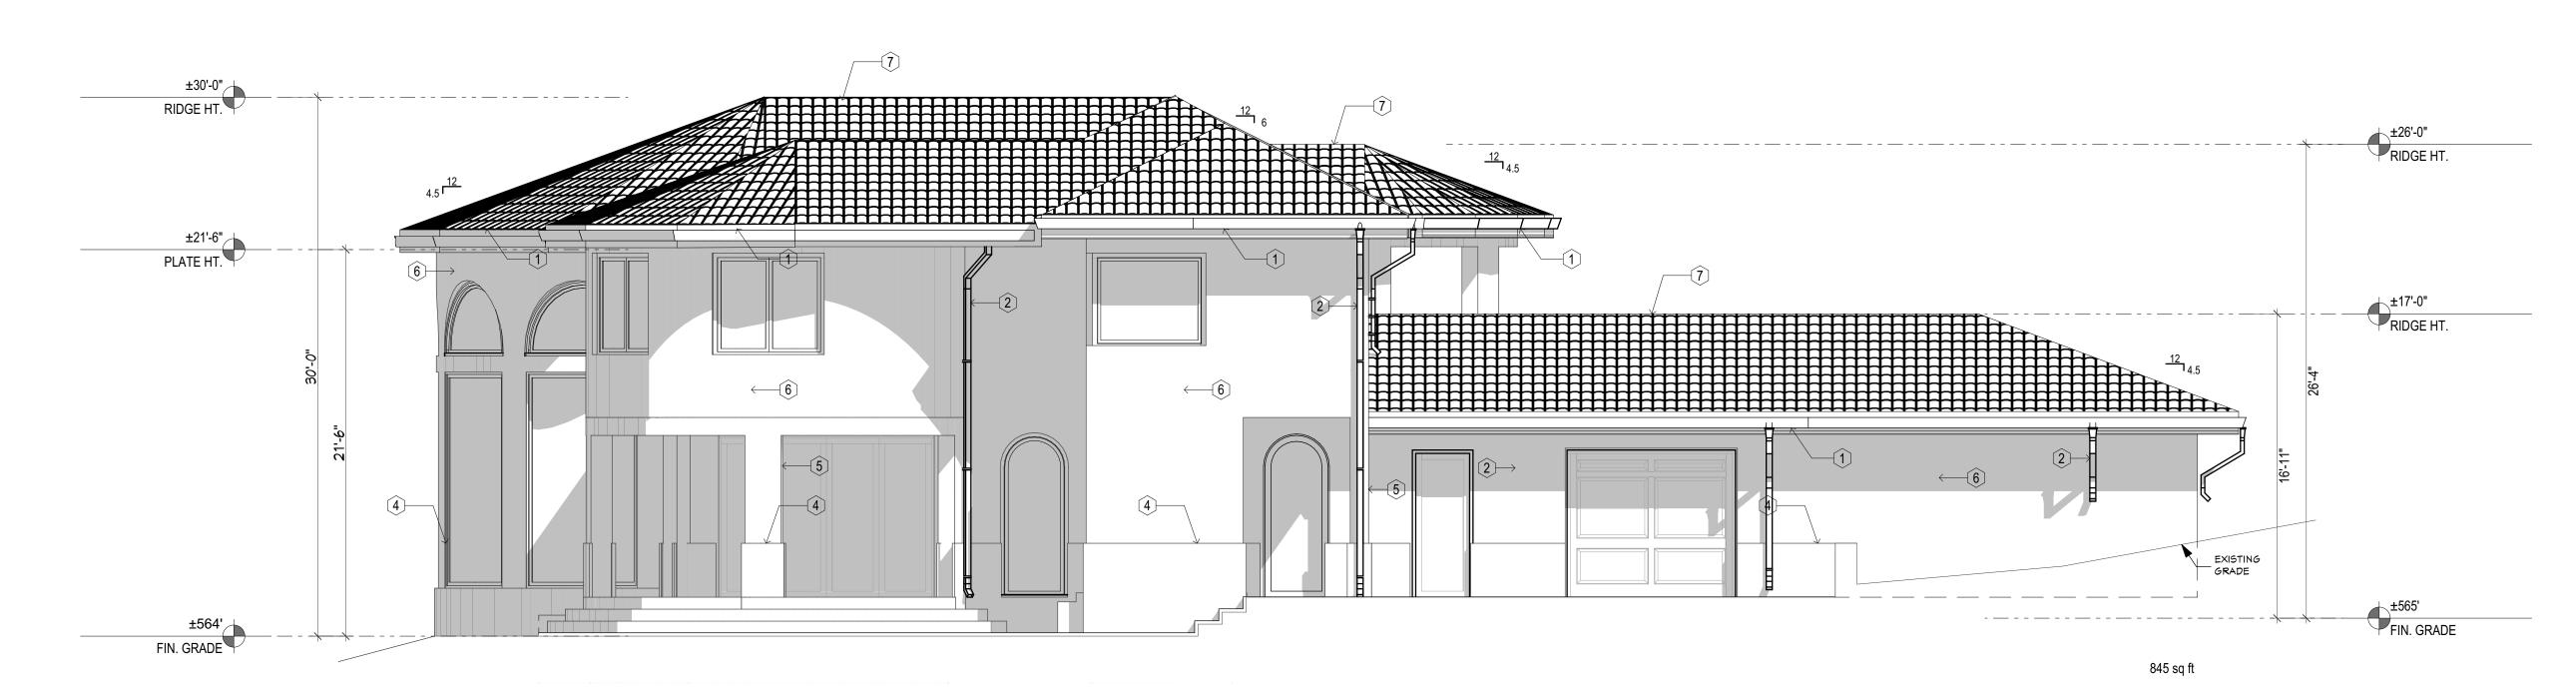

3 EAST ELEVATION SCALE: 3/16'' = 1'-0''

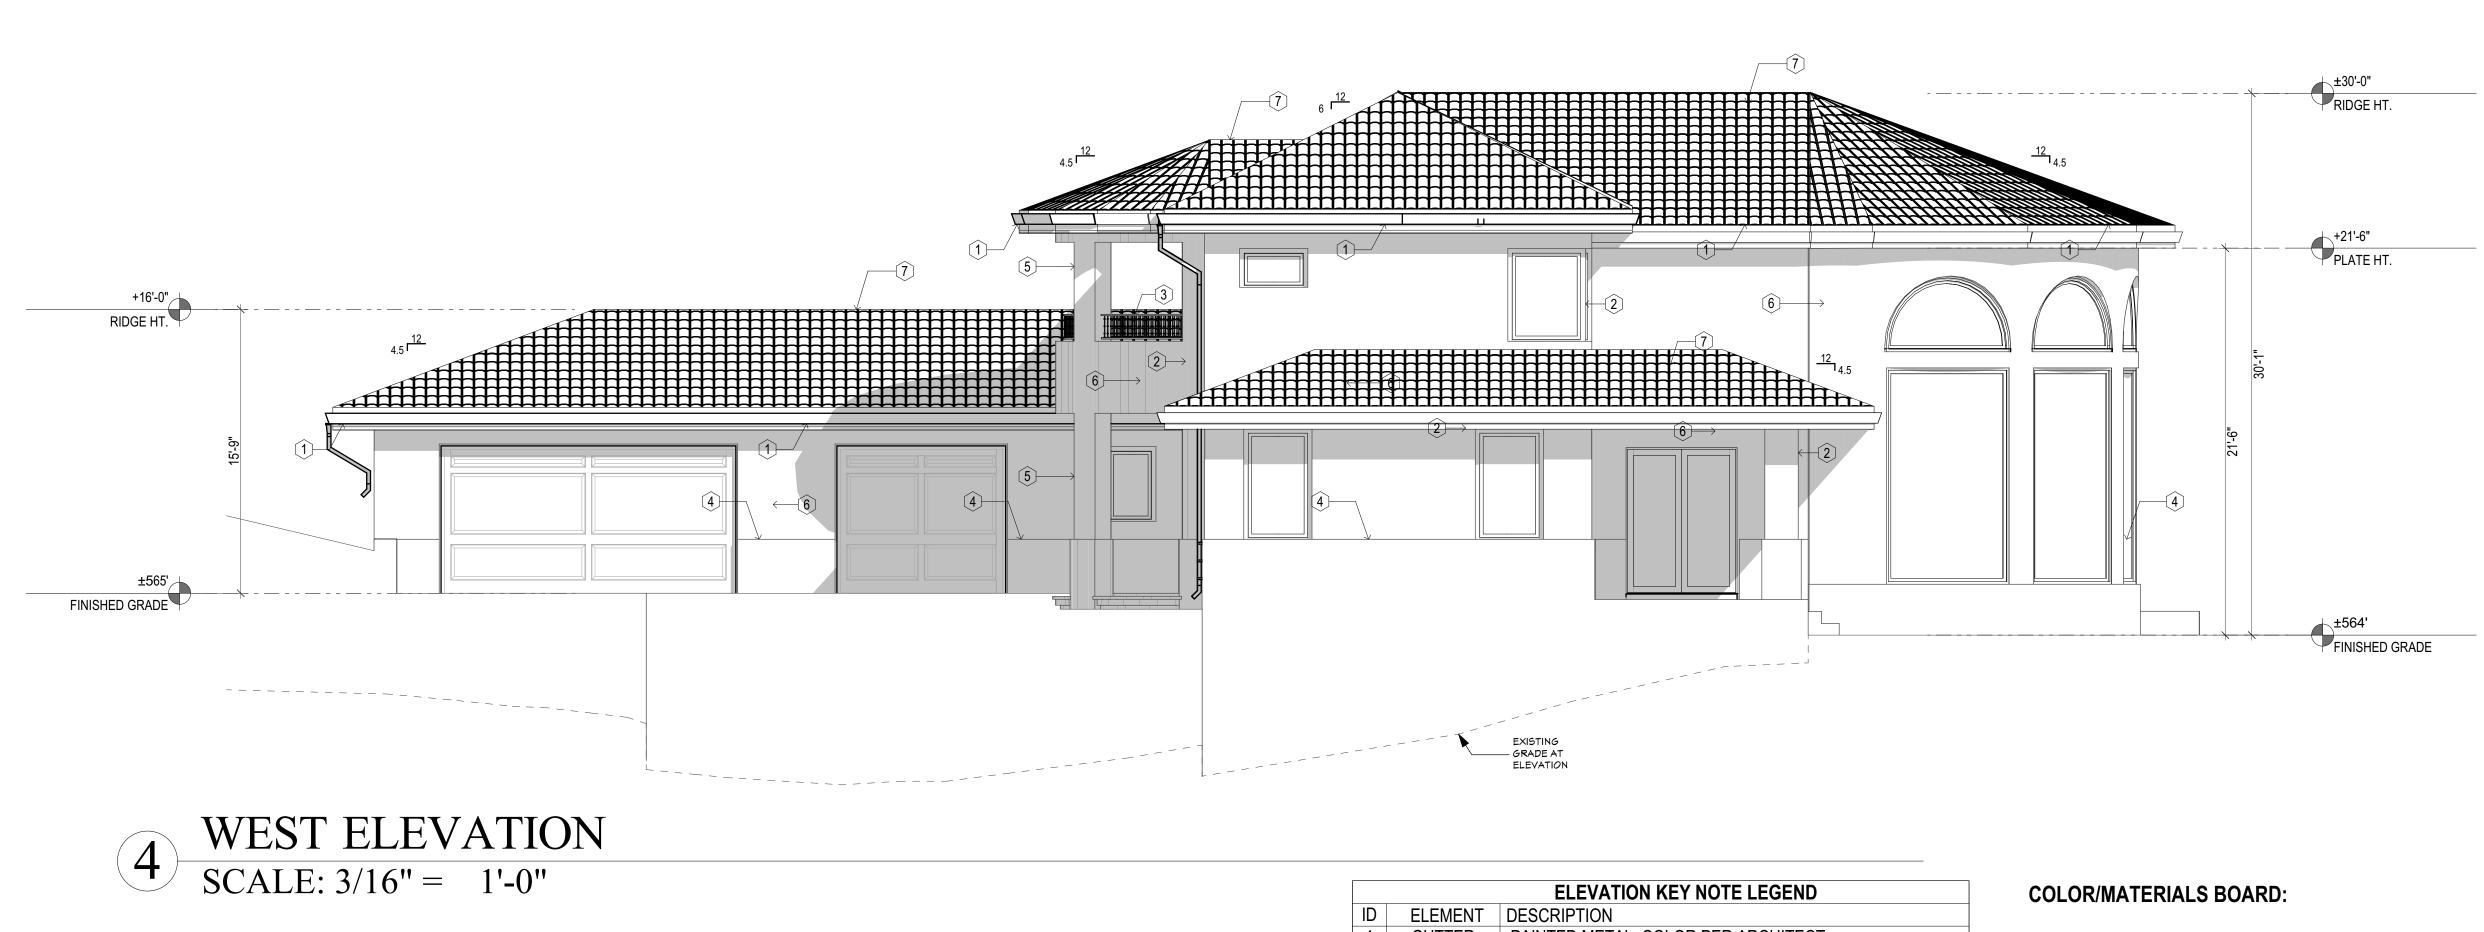



	ELEVATION KEY NOTE LEGEND		
ID	ELEMENT	DESCRIPTION	
1	GUTTER	PAINTED METAL: COLOR PER ARCHITECT.	
2	DOWNSPOUT	PAINTED METAL: FASTENED WITH HANGERS, MATERIAL AND FINISH TO MATCH GUTTERS.	
3	GUARDRAIL	18" BLACK WROUGHT-RAIL COLUMN MOUNTED ABOVE PARTIAL PARAPET WALL - FINISH PER ARCHITECT.	
4	WAINSCOT	LIQUID ACRYLIC INTAGRATED PLASTER WITH SMOOTH TROWELLED FINISH, COLOR & TEXTURE PER ARCHITECT.	
5	COLUMN	LIQUID ACRYLIC WITH SMOOTH THOWELLED FINISH WRAPPED AROUND OPENING. COLOR AND TEXTURE TO BE APPROVED BY ARCHITECT.	
6	WALL	LIQUID ACRYLIC INTAGRATED PLASTER WITH SMOOTH TROWELLED FINISH, COLOR & TEXTURE PER ARCHITECT.	
7	ROOF	CLAY TILE 3 PIECE WITH YELLOW, BROWN, GRAY, AND GOLD BLENDS . INSTALL PER MANUFACTURERS RECOMMENDATIONS	
8	GUARDRAIL	42" BLACK WRHOUGHT-RAIL COLUMN MOUNTED - FINISH PER ARCHITECT.	




ARCHITECTURAL ACCENTS: (Ex. Stone Veneer) Sherwin Williams SW7027 - Hickory Smoke, LRV: 7 DOOR & WINDOW FRAMES: Marvin - SW7020 Black Fox Num: 244-C7, LRV: 7 EXTERIOR WALLS: Sherwin Williams SW7501 - Threshold Taupe, LRV:34 **RETAINING WALLS:** SHERWIN WILLIAMS SW7501 - THRESHOLD TAUPE, LRV:34 ROOF: TBD - CLASSIC "S" MISSION CLAY TILE TRIM: N/A

EXTERIOR ELEVATIONS

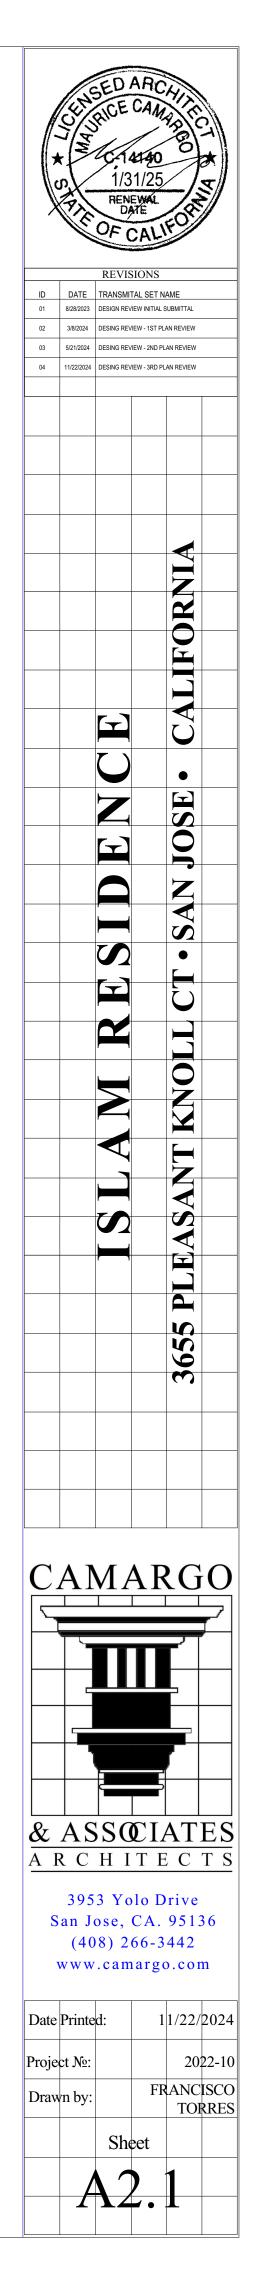

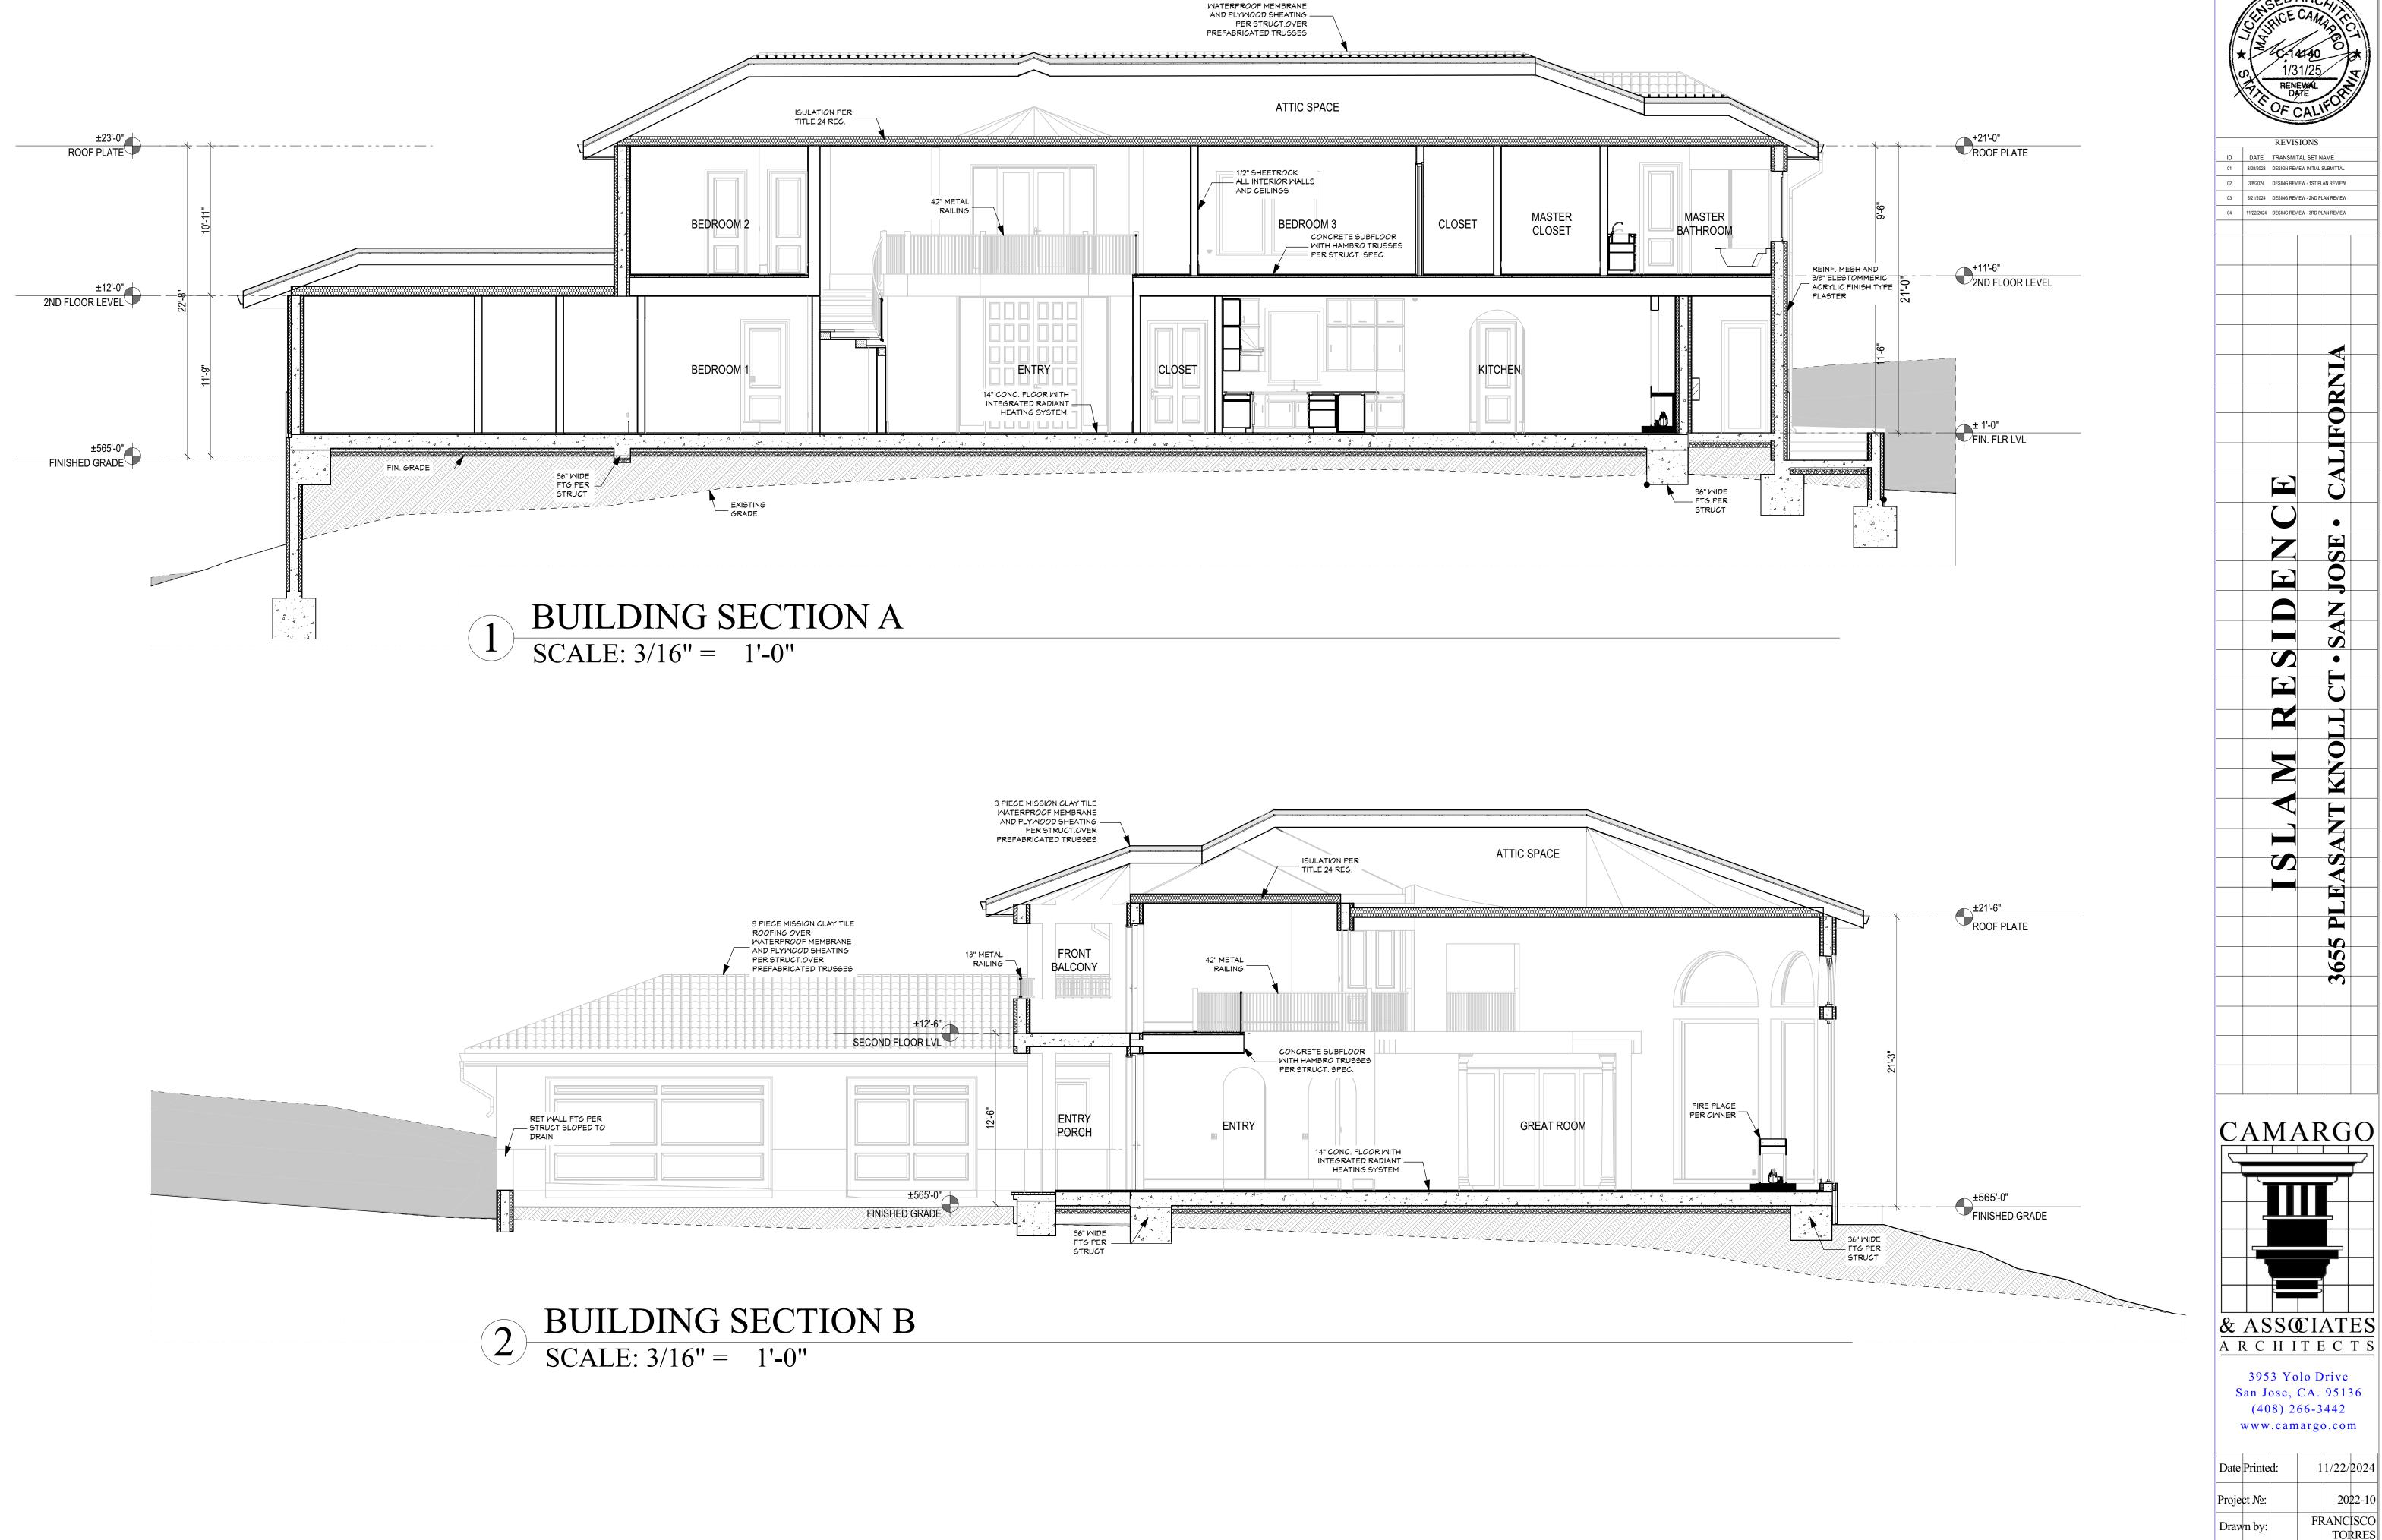


METAL SEAM ROOFING OVER

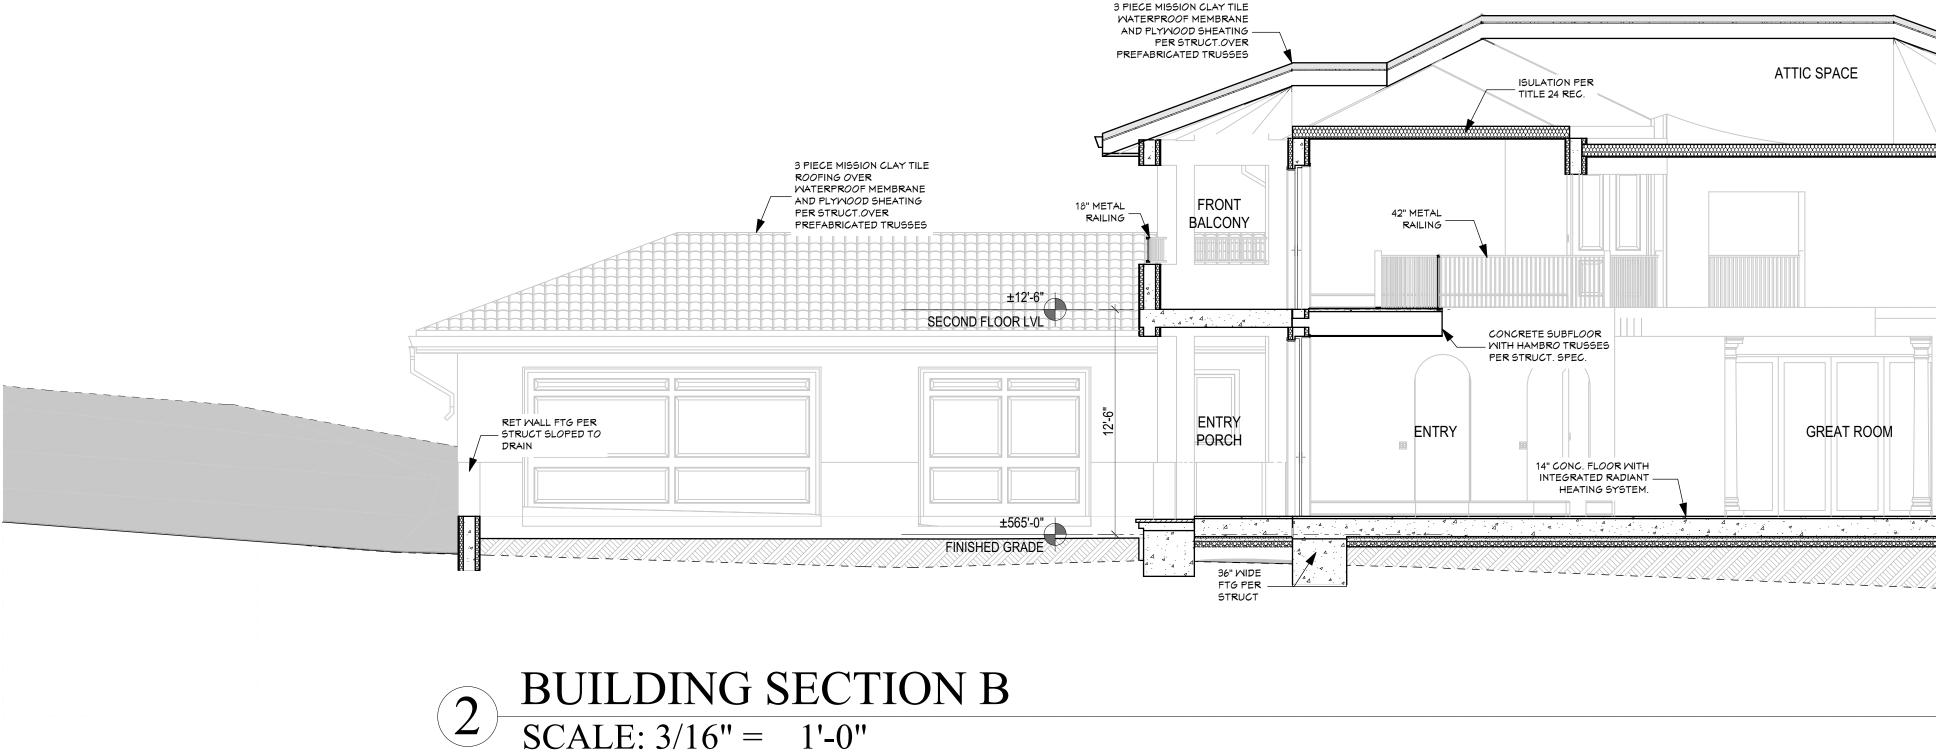



## **BUILDING SECTIONS**

Sheet

A3.0

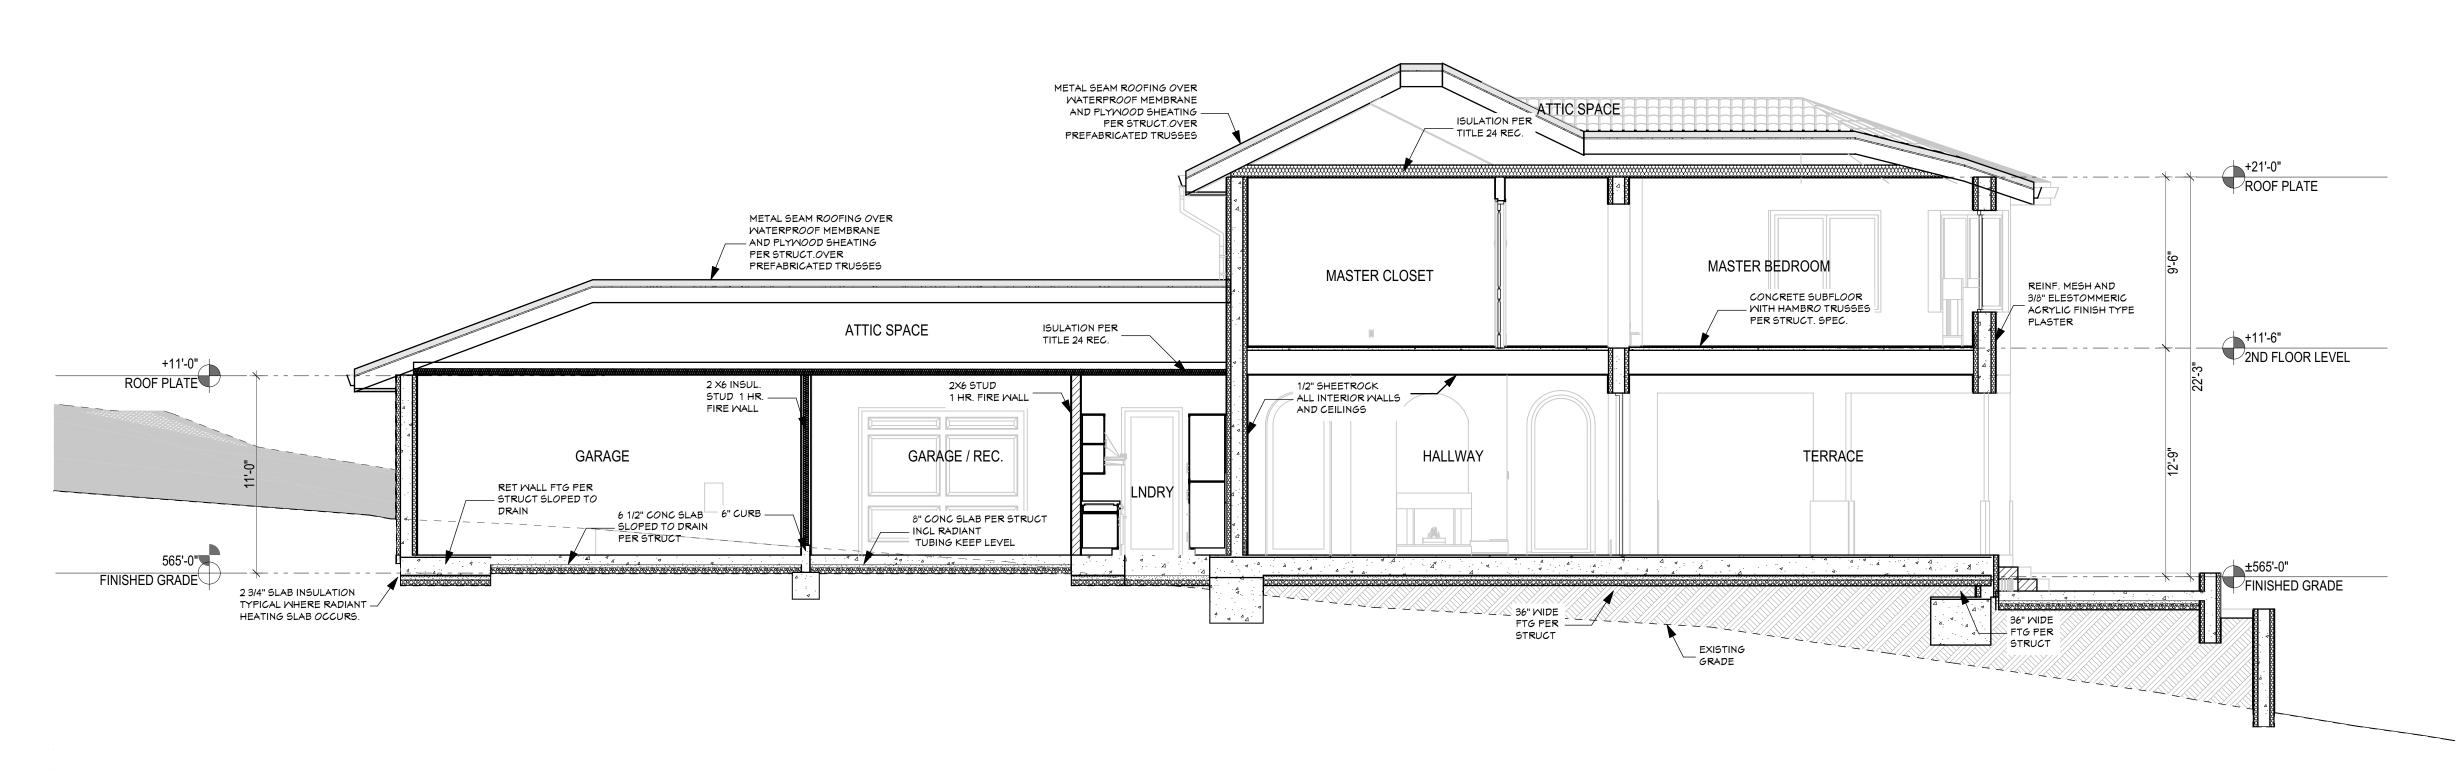



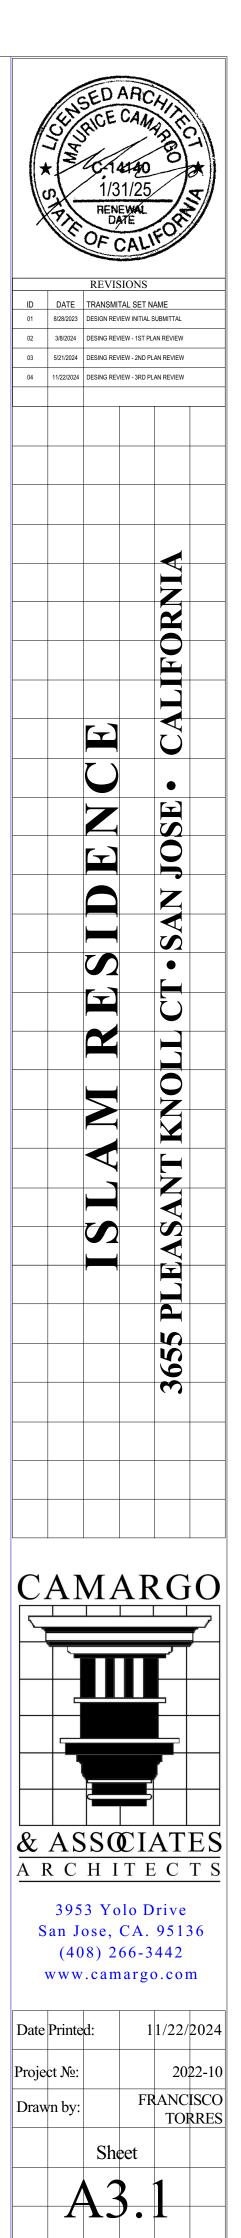

**BUILDING SECTIONS** 

# COUNTY OF SANTA CLARA <u>General Construction</u> Specifications

# GENERAL CONDITIONS

- ALL CONSTRUCTION WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE SOILS AND/OR GEOTECHNICAL REPORT ONCE RECEIVED. THIS REPORT IS SUPPLEMENTED BY: 1) THESE PLANS AND SPECIFICATIONS, 2) THE COUNTY OF SANTA CLARA STANDARD DETAILS. 3) THE COUNTY OF SANTA CLARA STANDARD SPECS, 4) STATE OF CALIFORNIA STANDARD DETAILS, 5) STATE OF CALIFORNIA STANDARD SPECIFICATIONS. IN THE EVENT OF CONFLICT THE FORMER SHALL TAKE PRECEDENCE OVER THE LATTER. THE PERFORMANCE AND COMPLETION OF ALL WORK MUST BE TO THE SATISFACTION OF THE COUNTY. DEVELOPER IS RESPONSIBLE FOR INSTALLATION OF THE IMPROVEMENTS SHOWN
- ON THESE PLANS AND HE OR HIS SUCCESSOR PROPERTY OWNERS ARE RESPONSIBLE FOR THEIR CONTINUED MAINTENANCE.
- DEVELOPER SHALL BE RESPONSIBLE FOR CORRECTION OF ANY ERRORS OR OMISSIONS IN THESE PLANS. THE COUNTY SHALL BE AUTHORIZED TO REQUIRE DISCONTINUANCE OF ANY WORK AND SUCH CORRECTION AND MODIFICATION OF PLANS AS MAY BE NECESSARY TO COMPLY WITH COUNTY STANDARDS OR CONDITIONS OF DEVELOPMENT APPROVAL.
- DEVELOPER SHALL OBTAIN ENCROACHMENT PERMITS FROM THE SANTA CLARA VALLEY WATER DISTRICT AND CALIFORNIA DEPARTMENT OF TRANSPORTATION WHERE NEEDED. COPIES OF THESE PERMITS SHALL BE KEPT AT THE JOB SITE 3. SURPLUS EARTH FILL MATERIAL SHALL BE PLACED IN A SINGLE (8" MAX) FOR REVIEW BY THE COUNTY'S INSPECTOR.
- DEVELOPER SHALL REMOVE OR TRIM ALL TREES TO PROVIDE AN
- THIS PLAN AUTHORIZES THE REMOVAL OF ONLY THOSE TREES WITH TRUNK DIAMETERS GREATER THAN 12 INCHES MEASURED 4.5 FEET ABOVE THE GROUND THAT ARE SHOWN TO BE REMOVED UNLESS AN AMENDED PLAN IS APPROVED OR A SEPARATE TREE REMOVAL PERMIT IS OBTAINED FROM THE PLANNING OFFICE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT
- REMOVAL OF ADDITIONAL TREES HAS BEEN PERMITTED. DEVELOPER SHALL PROVIDE ADEQUATE DUST CONTROL AS REQUIRED BY THE COUNTY INSPECTOR. ALL PERSONS MUST COMPLY WITH SECTION 4442 OF THE PUBLIC RESOURCES
- CODE AND SECTION 13005 OF THE HEALTH AND SAFETY CODE RELATING TO THE USE OF SPARK ARRESTERS.
- UPON DISCOVERING OR UNEARTHING ANY BURIAL SITE AS EVIDENCED BY HUMAN SKELETAL REMAINS OR ARTIFACTS, THE PERSON MAKING SUCH DISCOVERY SHALL IMMEDIATELY NOTIFY THE COUNTY CORONER AT (4008) 454-2520 AND LAND DEVELOPMENT ENGINEERING OFFICE AT (408) 299-5730. NO FURTHER DISTURBANCE OF THE SITE MAY BE MADE EXCEPT AS AUTHORIZED BY THE LAND DEVELOPMENT OFFICE IN ACCORD WITH PROVISIONS OF THIS ORDINANCE (COUNTY ORDINANCE CODE SECTION B6-18).
- 0. THESE PLANS ARE FÒR THE WORK DESCRIBED IN THE SCOPE OF WORK ONLY. A SEPARATE PERMIT WILL BE REQUIRED FOR THE SEPTIC LINE CONSTRUCTION. 1. ANY DEVIATION FROM THESE APPROVED PLANS SHALL BE RE-APPROVED IN WRITING BY THE COUNTY ENGINEER PRIOR TO CONSTRUCTION.

# CONSTRUCTION STAKING

- THE DEVELOPER'S ENGINEER IS RESPONSIBLE FOR THE INITIAL PLACEMENT AND REPLACEMENT OF CONSTRUCTION GRADE STAKES. THE STAKES ARE TO BE ADEQUATELY IDENTIFIED, LOCATED, STABILIZED, ETC. FOR THE CONVENIENCE OF CONTRACTORS. LATERAL OFFSET OF STAKES SET FOR CURBS AND GUTTERS SHALL NOT EXCEED 2 1/2 FEET FROM BACK OF CURB.
- ANY PROPERTY LINE STAKES OR ROAD MONUMENTS DISTURBED DURING CONSTRUCTION SHALL BE REPLACED BY DEVELOPER'S ENGINEER AND LICENSED LAND SURVEYOR.
- PROPERTY LINE STAKING MUST BE PERFORMED BY THE PROJECT ENGINEER OR LAND SURVEYOR TO ESTABLISH OR RE-ESTABLISH THE PROJECT BOUNDARY AND SHALL BE INSPECTED BY THE COUNTY INSPECTOR PRIOR TO THE BEGINNING OF THE WORK.
- PROPER CONSTRUCTION STAKES SHALL BE SET IN THE FIELD BY THE PROJECT ENGINEER OR LAND SURVEYOR AND VERIFIED BY THE COUNTY INSPECTOR PRIOR TO THE COMMENCEMENT OF GRADING.

# CONSTRUCTION INSPECTION

BUILDING FOUNDATION.

- CONTRACTOR SHALL NOTIFY PERMIT INSPECTION UNIT, SANTA CLARA COUNTY PRIOR TO COMMENCING WORK AND FOR FINAL INSPECTION OF WORK AND SITE.
- THE COUNTY REQUIRES A MINIMUM OF 24 HOURS ADVANCE NOTICE FO
- GENERAL INSPECTION, 48 HOURS FOR ASPHALT CONCRETE INSPECTION. INSPECTION BY SANTA CLARA COUNTY SHALL BE LIMITED TO INSPECTION OF MATERIALS AND PROCESSES OF CONSTRUCTION TO OBSERVE THEIR COMPLIANCE WITH PLANS & SPECIFICATIONS BUT DOES NOT INCLUDE RESPONSIBILITY FOR THE SUPERINTENDENT OF CONSTRUCTION, SITE CONDITIONS, EQUIPMENT OR PERSONNEL. CONTRACTOR SHALL NOTIFY THE COUNTY LAND DEVELOPMENT INSPECTOR AT PHONE (408) 299-6868 AT LEAST 24 HOURS PRIOR TO COMMENCING WORK AND FOR FINAL INSPECTION OF WORK AND SITE.
- DEVELOPER AND/OR HIS AUTHORIZED REPRESENTATIVE MUST SUBMIT WRITTEN REQUEST FOR FINAL INSPECTION AND ACCEPTANCE. SAID REQUEST SHALL BE DIRECTED TO THE INSPECTION OFFICE NOTED ON THE PERMIT FORM. THE CONTRACTOR SHALL PROVIDE TO THE COUNTY CONSTRUCTION INSPECTOR WITH PAD ELEVATION AND LOCATION CERTIFICATES. PREPARED BY THE PROJECT ENGINEER OR LAND SURVEYOR, PRIOR TO COMMENCEMENT OF THE

SITE PREPARATION (CLEARING AND GRUBBING)

- EXISTING TREES AUTHORIZED FOR REMOVAL, ROOTS, AND FOREIGN MATERIAL IN AREAS TO BE IMPROVED WILL BE REMOVED TO AN AUTHORIZED DISPOSAL SITE <u>ACCESS ROADS AND DRIVEWAYS</u> AS FOLLOWS
  - PROPOSED ROADWAYS (EITHER PRIVATE OR TO BE DEDICATED TO
  - PUBLIC USE) B) FROM AREAS AFFECTED BY THE PROPOSED GRADING EXCEPT WHERE NOTED ON THE PLANS.
- 2. IT SHALL BE THE RESPONSIBILITY OF THE DEVELOPER TO MOVE OR RELOCATE UTILITY POLES AND OTHER OBSTRUCTIONS IN THE WAY OF CONSTRUCTION.

# UTILITY LOCATION. TRENCHING & BACKFILL

- CONTRACTOR SHALL NOTIFY USA (UNDERGROUND SERVICE ALERT) AT 1-800-277-2600 A MINIMUM OF 24 HOURS BEFORE BEGINNING UNDERGROUND WORK FOR VERIFICATION OF THE LOCATION OF UNDERGROUND UTILITIES.
- ACCURATE VERIFICATION AS TO SIZE, LOCATION, AND DEPTH OF EXISTING UNDERGROUND CONDUITS OR FACILITIES SHALL BE THE INDIVIDUAL CONTRACTORS RESPONSIBILITY. PLAN LOCATIONS ARE APPROXIMATE AND FOR GENERAL INFORMATION ONLY.
- ALL UNDERGROUND INSTALLATIONS SHALL BE IN PLACE AND THE TRENCH BACKFILLED AND COMPACTED BEFORE PLACING AGGREGATE BASE MATERIAL OR SURFACE STRUCTURES. SURFACING MAY BE DONE IF THE UTILITY COMPANY CONCERNED INDICATES BY LETTER THAT IT WILL BORE. UNLESS SPECIFICALLY AUTHORIZED BY THE COUNTY, GAS AND WATER MAINS SHALL BE INSTALLED OUTSIDE THE PAVED AREAS.
- TRENCH BACKFILL IN EXISTING PAVEMENT AREAS SHALL BE SAND MATERIAL IN ACCORDANCE WITH THE APPLICABLE PROVISIONS OF THE STATE SPECIFICATIONS. THE STRUCTURAL SECTION FOR TRENCH REPLACEMENT SHALL CONSIST OF NOT LESS THAN 12 INCHES OF APPROVED AGGREGATE BASE MATERIAL COMPACTED TO A RELATIVE COMPACTION OF AT LEAST 95% AND 4 INCHES OF HOT ASPHALT CONCRETE PLACED IN TWO LIFTS. TRENCH RESTORATION FOR HIGHER TYPE PAVEMENTS SHALL BE MADE IN KIND OR AS
- DIRECTED BY THE COUNTY. TRENCH BACKFILL IN NEW CONSTRUCTION AREAS SHALL BE SAND MATERIAL COMPACTED TO A RELATIVE COMPACTION OF AT LEAST 90%. THE REQUIREMENT FOR SELECT MATERIAL MAY BE WAIVED BY COUNTY IF THE NATIVE SOIL IS SUITABLE FOR USE AS TRENCH BACKFILL BUT THE COMPACTION REQUIREMENTS WILL NOT BE THEREBY WAIVED.
- BACKFILL AND TRENCH RESTORATION REQUIREMENTS SHALL APPLY AS MINIMUM STANDARDS TO ALL UNDERGROUND FACILITIES INSTALLED BY OTHER FIRMS OR PUBLIC AGENCIES.

# RETAINING WALLS

- REINFORCED CONCRETE AND CONCRETE MASONRY UNIT RETAINING WALLS SHALL HAVE FOUNDATION AND REINFORCEMENT INSPECTED BY THE COUNTY ENGINEERING CONTINUAL CONTROL OF THE COUNTY INSPECTOR. INSPECTOR AND ENGINEER OF RECORD PRIOR TO POURING THE FOUNDATION AND FORMING THE WALL
- SEGMENTAL BLOCK RETAINING WALLS SHALL HAVE FOUNDATION AND REINFORCEMENT INSPECTED BY THE COUNTY ENGINEERING INSPECTOR.

# GRADING

- 1. EXCAVATED MATERIAL SHALL BE PLACED IN THE FILL AREAS DESIGNATED OR SHALL BE HAULED AWAY FROM THE SITE TO A COUNTY APPROVED DISPOSAL SITE. WHERE FILL MATERIAL IS TO BE PLACED ON NATURAL GROUND, IS SHALL BE STRIPPED OF ALL VEGETATION. TO ACHIEVE A PROPER BOND WITH THE FILL MATERIAL, THE SURFACE OF THE GROUND SHALL BE SCARIFIED TO DEPTH OF 6" BEFORE FILL IS PLACED. WHERE NATURAL GROUND IS STEEPER THAN 5:1, IT SHALL BE BENCHED AND THE FILL KEYED IN TO ACHIEVE STABILITY. WHERE NEW FILL IS TO BE PLACED ON EXISTING FILL THE EXISTING FILL SHALL BE REMOVED UNTIL MATERIAL COMPACTED TO 90% RELATIVE COMPACTION IS EXPOSED. THEN THE NEW FILL MATERIAL SHALL BE PLACED AS PER THESE CONSTRUCTION NOTES. FILL MATERIAL SHALL BE PLACED IN UNIFORM LIFTS NOT EXCEEDING 6" IN UNCOMPACTED THICKNESS. BEFORE COMPACTION BEGINS, THE FILL SHALL BE BROUGHT TO A WATER CONTENT THAT WILL PERMIT PROPER COMPACTION BY EITHER 1) AERATING THE FILL IF IT IS TOO WET OR 2) MOISTENING THE FILL WITH WATER IF IT IS TOO DRY. EACH LIFT SHALL BE THOROUGHLY MIXED BEFORE COMPACTION TO ENSURE A UNIFORM DISTRIBUTION OF MOISTURE.
- 2. EXCESS CUT MATERIAL SHALL NOT BE SPREAD OR STOCKPILED ON THE SITE. THICK LAYER COMPACTED TO WITHSTAND WEATHERING IN THE AREA(S) DELINEATED ON THE PLAN.
- UNOBSTRUCTED FIFTEEN (15) FOOT VERTICAL CLEARANCE FOR ROADWAY AREA. 4. NO ORGANIC MATERIAL SHALL BE PLACED IN ANY FILL. NO TREES SHALL BE REMOVED OUTSIDE OF CUT, FILL OR ROADWAY AREAS. THE UPPER 6" OF SUBGRADE BELOW DRIVEWAY ACCESS ROAD OR PARKING
  - AREA SHALL BE COMPACTED TO 95% OF MAXIMUM DENSITY. 6. MAXIMUM CUT SLOPE SHALL BE 2 HORIZONTAL TO 1 VERTICAL. MAXIMUM FILL SLOPE SHALL BE 2 HORIZONTAL TO 1 VERTICAL.

LOCATION	CUT (C.Y.)	FILL (C.Y.)	VERT. DEPTH
RESIDENCE	90	360	4
WATER TANK PADS	5	370	6
POOL/HARDSCAPE	0	115	2.8
LANDSCAPE	230	690	4
DRIVEWAY	205	375	9.4
OFF SITE	0	0	0
TOTAL	530	1910	

NOTE: FILL VOLUMES INCLUDE 10% SHRINKAGE.

- EXCESS MATERIAL SHALL BE OFF HAULED TO A COUNTY APPROVED DUMP
- 7. NOTIFY SOILS ENGINEER TWO (2) DAYS PRIOR TO COMMENCEMENT OF ANY GRADING WORK TO COORDINATE THE WORK IN THE FIELD.
- 8. ALL MATERIALS FOR FILL SHOULD BE APPROVED BY THE SOILS ENGINEER BEFORE IT IS BROUGHT TO THE SITE.
- 9. THE UPPER 6" OF THE SUBGRADE SOIL SHALL BE SCARIFIED, MOISTURE CONDITIONED AND COMPACTED TO A MINIMUM RELATIVE COMPACTION OF 95% 10. ALL AGGREGATE BASE MATERIAL SHALL BE COMPACTED TO A MINIMUM 95%
- RELATIVE COMPACTION 11. THE GEOTECHNICAL PLAN REVIEW LETTER MUST BE REVIEWED AND APPROVED BY THE COUNTY GEOLOGIST PRIOR TO FINAL APPROVAL BY THE COUNTY ENGINEER FOR BUILDING OCCUPANCY.
- 12. THE PROJECT GEOTECHNICAL ENGINEER SHALL PERFORM COMPACTION TESTING AND PRESENT THE RESULTS TO THE COUNTY ENGINEERING INSPECTOR PRIOR TO THE CONSTRUCTION OF ANY PAVED AREA.
- 13. GRADING WORK BETWEEN OCTOBER 15TH AND APRIL 15TH IS AT THE
- DISCRETION OF THE SANTA CLARA COUNTY GRADING OFFICIAL. 14. TOTAL DISTURBED AREA FOR THE PROJECT <u>31,270</u>\_\_\_\_\_SF. 15. WDID NO.<u>N/A\_</u>
- 16. THE INSPECTOR MAY VERIFY THAT A VALID NOTICE OF INTENT (NOI) HAS BEEN ISSUED BY THE STATE AND THAT A CURRENT AND UP TO DATE STORM WATER POLLUTION PREVENTION PLAN (SWPPP) IS AVAILABLE ON SITE.

# TREE PROTECTION

- 1. FOR ALL TREES TO BE RETAINED WITH A CANOPY IN THE DEVELOPMENT AREA OR INTERFACES WITH THE LIMITS OF GRADING FOR ALL PROPOSED OF RIGID TREE PROTECTIVE FENCING, CONSISTENT WITH THE COUNTY
- INTEGRATED LANDSCAPE GUIDELINES, AND INCLUDE THE FOLLOWING: FENCING SHOULD BE PLACED ALONG THE OUTSIDE EDGE OF THE DRIPLINE OF THE TREE OR GROVE OF TREES. THE FENCING SHALL BE MAINTAINED THROUGHOUT THE SITE
- CONSTRUCTION PERIOD AND SHALL BE INSPECTED PERIODICALLY FOR DAMAGE AND PROPER FUNCTION FENCING SHALL BE REPAIRED. AS NECESSARY. TO PROVIDE A PHYSICAL
- BARRIER FROM CONSTRUCTION ACTIVITIES. SIGNAGE STATING. "WARNING- THIS FENCING SHALL NOT BE REMOVED WITHOUT PERMISSION FROM THE SANTA CLARA COUNTY PLANNING OFFICE (408) 299-5770. COUNTY OF SANTA CLARA TREE
- PROTECTION MEASURES MAY BE FOUND AT
- http://www.sccplanning.gov." SHALL BE PLACED ON THE TREE PROTECTIVE FENCING UNTIL FINAL OCCUPANCY. PRIOR TO COMMENCEMENT OF ANY CONSTRUCTION ACTIVITY. TREE PROTECTIVE FENCING SHALL BE SECURELY IN PLACED AND INSPECTED BY THE LAND
- DEVELOPMENT ENGINEERING INSPECTOR. 3. SEE EXISTING TREE PROTECTION DETAILS FOR MORE INFORMATION.

- A) TO A MINIMUM DEPTH OF TWO FEET BELOW THE FINISHED GRADE OF 1. DRIVEWAY LOCATIONS SHALL BE AS SHOWN ON THE IMPROVEMENT PLANS WITH CENTERLINE STATIONING. THE MINIMUM CONCRETE THICKNESS SHALL BE 6 INCHES THROUGHOUT (WITH A MAXIMUM APPROACH SLOPE OF 1 1/4 INCHES PER FOOT)
  - 2. ALL DRIVEWAY OR COMMON ACCESS ROAD SECTIONS IN EXCESS OF 15 LONGITUDINAL SLOPE MUST BE PAVED WITH A MINIMUM 2-INCH ASPHALT LIFT OR FULL DEPTH CONCRETE LIFT PRIOR TO ANY COMBUSTIBLE FRAMING.
  - 3. THE OWNER AND PRIME CONTRACTOR ARE RESPONSIBLE FOR MAINTAINING PROJECT SITE ACCESS AND NEIGHBORHOOD ACCESS FOR EMERGENCY VEHICLES AND LOCAL RESIDENTS 4. ROADWAYS DESIGNATED AS NOT COUNTY MAINTAINED ROADS AS SHOWN ON
  - THE PLAN WILL NOT BE ELIGIBLE FOR COUNTY MAINTENANCE UNTIL THE ROADWAYS ARE IMPROVED (AT NO COST TO THE COUNTY) TO THE PUBLIC MAINTENANCE ROAD STANDARDS APPROVED BY THE BOARD OF SUPERVISORS AND IN EFFECT AT SUCH TIME THAT THE ROADWAYS ARE CONSIDERED FOR ACCEPTANCE INTO THE COUNTY'S ROAD SYSTEM.
  - ALL WORK IN THE COUNTY ROAD RIGHT-OF-WAY REQUIRES AN ENCROACHMENT PERMIT FROM THE ROADS AND AIRPORTS DEPARTMENT. EACH INDIVIDUAL ACTIVITY REQUIRES A SEPARATE PERMIT - I.E. CABLE, ELECTRICAL, GAS. SEWER. WATER. RETAINING WALLS, DRIVEWAY APPROACHES, FENCES, LANDSCAPING, TREE REMOVAL, STORM DRAINAGE IMPROVEMENTS, ETC ...

# STREET LIGHTING

- 1. PACIFIC GAS & ELECTRIC ELECTROLIER SERVICE FEE SHALL BE PAID BY THE DEVELOPER AND/OR HIS AUTHORIZED REPRESENTATIVE. SANITARY SEWER
- THE SANITARY SEWER AND WATER UTILITIES SHOWN ON THESE PLANS ARE NOT PART OF THIS GRADING PERMIT AND ARE SHOWN FOR REFERENCE ONLY.
- 2. ALL MATERIALS AND METHODS OF CONSTRUCTION OF SANITARY SEWERS SHALL CONFORM TO THE SPECIFICATIONS OF THE JURISDICTION INVOLVED. INSPECTION AFTERCONSTRUCTION. OF SANITARY SEWER WORK SHALL BE DONE BY SAID JURISDICTION.

# PORTLAND CEMENT CONCRETE

. CONCRETE USED FOR STRUCTURAL PURPOSES SHALL BE CLASS "A" (6 SACK PER CUBIC YARD) AS SPECIFIED IN THE STATE STANDARD SPECIFICATIONS. CONCRETE PLACED MUST DEVELOP A MINIMUM STRENGTH FACTOR OF 2800 PSI IN A SEVEN-DAY PERIOD. THE CONCRETE MIX DESIGN SHALL BE UNDER THE

# AIR QUALITY, LANDSCAPING AND EROSION CONTROL

- WATER ALL ACTIVE CONSTRUCTION AREAS AT LEAST TWICE DAILY. COVER ALL TRUCKS HAULING SOIL, SAND, AND OTHER LOOSE MATERIALS OR
- REQUIRE ALL TRUCKS TO MAINTAIN AT LEAST TWO FEET OF FREEBOARD. 3. PAVE, APPLY WATER THREE TIMES DAILY, OR APPLY (NON-TOXIC) SOIL
- STABILIZERS ON ALL UNPAVED ACCESS ROADS. PARKING AREAS AND STAGING AREAS AT CONSTRUCTION SITES. SWEEP DAILY (WITH WATER SWEEPERS) ALL PAVED ACCESS ROADS, PARKING
- AREAS AND STAGING AREAS AT CONSTRUCTION SITES. THE USE OF DRY POWDER SWEEPING IS PROHIBITED. SWEEP STREETS DAILY (WITH WATER SWEEPERS) IF VISIBLE SOIL MATERIAL IS
- CARRIED ONTO ADJACENT PUBLIC STREETS. THE USE OF DRY POWDER SWEEPING IS PROHIBITED. ALL CONSTRUCTION VEHICLES, EQUIPMENT AND DELIVERY TRUCKS SHALL HAVE A MAXIMUM IDLING TIME OF 5 MINUTES (AS REQUIRED BY THE CALIFORNIA AIRBORNE TOXIC CONTROL MEASURE TITLE 13, SECTION 2485 OF CALIFORNIA CODE OF REGULATIONS (CCR)). ENGINES SHALL BE SHUT OFF IF CONSTRUCTION REQUIRES LONGER IDLING TIME UNLESS NECESSARY FOR PROPER OPERATION OF THE VEHICLE.
- ALL VEHICLE SPEEDS ON UNPAVED ROADS SHALL BE LIMITED TO 15 MILES PFR HOUR. 8. ALL CONSTRUCTION EQUIPMENT SHALL BE MAINTAINED AND PROPERLY TUNED
- IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS. ALL EQUIPMENT SHALL BE CHECKED BY A CERTIFIED MECHANIC AND DETERMINED TO BE RUNNING IN PROPER CONDITION PRIOR TO OPERATION.
- 9. POST A SIGN THAT IS AT LEAST 32 SQUARE FEET MINIMUM 2 INCHES LETTER HEIGHT VISIBLE NEAR THE ENTRANCE OF CONSTRUCTION SITE THAT IDENTIFIES THE FOLLOWING REQUIREMENTS. OBTAIN ENCROACHMENT PERMIT FOR SIGN FROM ROADS DEPARTMENT OR OTHER APPLICABLE AGENCY IF REQUIRED. A. 15 MILES PER HOUR (MPH) SPEED LIMIT
  - 5 MINUTES MAXIMUM IDLING TIME OF VEHICLES
  - TELEPHONE NUMBER TO CONTACT THE BAY AREA AIR QUALITY MANAGEMENT DISTRICT REGARDING DUST COMPLAINTS. NOTE PHONE NUMBER OF THE BAY AREA AIR QUALITY MANAGEMENT DISTRICT AIR POLLUTION COMPLAIN HOTLINE OF 1-800-334-6367.
- 10. ALL FILL SLOPES SHALL BE COMPACTED AND LEFT IN A SMOOTH AND FIRM CONDITION CAPABLE OF WITHSTANDING WEATHERING 11. ALL EXPOSED DISTURBED AREAS SHALL BE SEEDED WITH BROME SEED SPREAD AT THE RATE OF 5 LB. PER 1000 SQUARE FEET (OR APPROVED EQUAL). SEEDING AND WATERING SHALL BE MAINTAINED AS REQUIRED TO ENSURE
- GROWTH 12. ALL DITCHES SHALL BE LINED PER COUNTY STANDARD SD8. 13. ALL STORM DRAINAGE STRUCTURES SHALL BE INSTALLED WITH EFFECTIVE ENTRANCE & OUTFALL EROSION CONTROLS E.G. SACKED CONCRETE RIP-RAP. ENERGY DISSIPATERS SHALL BE INSTALLED AT ALL DITCH OUTFALLS. WHERE OUTFALLS ARE NOT INTO AN EXISTING CREEK OR WATER COURSE, RUNOFF SHALL BE RELEASED TO SHEET FLOW.
- 14. PRIOR TO GRADING COMPLETION AND RELEASE OF THE BOND, ALL GRADED AREAS SHALL BE RESEEDED IN CONFORMANCE WITH THE COUNTY GRADING ORDINANCE TO MINIMIZE THE VISUAL IMPACTS OF THE GRADE SLOPES AND
- REDUCE THE POTENTIAL FOR EROSION OF THE SUBJECT SITE. 15. PERMANENT LANDSCAPING SHOWN ON THE ATTACHED LANDSCAPE PLAN MUST BE INSTALLED AND FIELD APPROVED BY THE COUNTY PLANNING OFFICE PRIOR TO FINAL APPROVAL BY THE COUNTY ENGINEER, AND FINAL OCCUPANCY RELEASE BY THE BUILDING INSPECTION OFFICE.
- 16. THE OWNER SHALL PREPARE AND PRESENT A WINTERIZATION REPORT TO THE COUNTY INSPECTOR FOR REVIEW PRIOR TO OCTOBER 15TH OF EVERY YEAR. 17. THE OWNER, CONTRACTOR, AND ANY PERSON PERFORMING CONSTRUCTION ACTIVITIES SHALL INSTALL AND MAINTAIN CONSTRUCTION BEST MANAGEMENT PRACTICES (BMPS) ON THE PROJECT SITE AND WITHIN THE SANTA CLARA COUNTY ROAD RIGHT-OF-WAY THROUGHOUT THE DURATION OF THE CONSTRUCTION AND UNTIL THE ESTABLISHMENT OF PERMANENT STABILIZATION AND SEDIMENT CONTROL TO PREVENT THE DISCHARGE OF POLLUTANTS INCLUDING SEDIMENT, CONSTRUCTION MATERIALS, EXCAVATED MATERIALS, AND WASTE INTO THE SANTA CLARA COUNTY RIGHT-OF-WAY, STORM SEWER WATERWAYS, ROADWAY INFRASTRUCTURE. BMPS SHALL INCLUDE, BUT NOT BE LIMITED TO THE FOLLOWING: A. PREVENTION OF POLLUTANTS IN STORM WATER DISCHARGES FROM THE
  - CONSTRUCTION SITE AND THE CONTRACTOR'S MATERIAL AND EQUIPMENT LAYDOWN / STAGING AREAS.
  - B. PREVENTION OF TRACKING OF MUD. DIRT. AND CONSTRUCTION MATERIALS ONTO THE PUBLIC ROAD RIGHT-OF-WAY.
- PREVENTION OF DISCHARGE OF WATER RUN-OFF DURING DRY AND WET WEATHER CONDITIONS ONTO THE PUBLIC ROAD RIGHT-OF-WAY. 18. THE OWNER, CONTRACTOR, AND ANY PERSON PERFORMING CONSTRUCTION
- ACTIVITIES SHALL ENSURE THAT ALL TEMPORARY CONSTRUCTION FACILITIES. INCLUDING BUT NOT LIMITED TO CONSTRUCTION MATERIALS, DELIVERIES, HAZARDOUS AND NON-HAZARDOUS MATERIAL STORAGE, EQUIPMENT, TOOLS. PORTABLE TOILETS, CONCRETE WASHOUT, GARBAGE CONTAINERS, LAYDOWN YARDS, SECONDARY CONTAINMENT AREAS, ETC. ARE LOCATED OUTSIDE THE SANTA CLARA COUNTY ROAD RIGHT-OF-WAY.
- 19. EROSION CONTROL PLAN IS A GUIDE AND SHALL BE AMENDED AS NECESSARY TO PREVENT EROSION AND ILLICIT DISCHARGES ON A YEAR AROUND BASIS, DEPENDING ON THE SEASON, WEATHER, AND FIELD CONDITIONS. EROSION CONTROL MEASURES IN ADDITION TO THOSE NOTED IN THE PERMITTED PLANS MAY BE NECESSARY. FAILURE TO INSTALL SITE SITE AND SITUATIONALY APPROPRIATE EROSION CONTROL MEASURES MAY RESULT IN VIOLATIONS, FINES, AND A STOPPAGE OF WORK.

# STORM DRAINAGE AND STORMWATER MANAGEMENT

- 1. DEVELOPER IS RESPONSIBLE FOR ALL NECESSARY DRAINAGE FACILITIES WHETHER SHOWN ON THE PLANS OR NOT AND HE OR HIS SUCCESSOR PROPERTY OWNERS ARE RESPONSIBLE FOR THE ADEQUACY AND CONTINUED MAINTENANCE OF THESE FACILITIES IN A MANNER WHICH WILL PRECLUDE ANY HAZARD TO LIFE, HEALTH, OR DAMAGE TO ADJOINING PROPERTY, CONSISTENT
- WITH NPDES PERMIT CAS612008 / ORDER NO. R2-2009-0047 AND NPDES PERMIT CAS000004/ ORDER NO. 2013-0001-DWQ. 2. DROP INLETS SHALL BE COUNTY STANDARD TYPE 5 UNLESS OTHERWISE NOTED
- ON THE PLANS. THE DEVELOPER'S ENGINEER SHALL BE RESPONSIBLE FOR THE PROPER LOCATION OF DROP INLETS. WHERE STREET PROFILE GRADE EXCEEDS 6% DROP INLETS SHALL BE SET AT 500 ANGLE CURB LINE TO ACCEPT WATER OR AS SHOWN ON THE PLANS.
- WHERE CULVERTS ARE INSTALLED THE DEVELOPER SHALL BE RESPONSIBLE FOR GRADING THE OUTLET DITCH TO DRAIN TO AN EXISTING SWALE OR TO AN OPEN AREA FOR SHEET FLOW UPON INSTALLATION OF DRIVEWAY CONNECTIONS, PROPERTY OWNERS SHALL
- PROVIDE FOR THE UNINTERRUPTED FLOW OF WATER IN ROADSIDE DITCHES. 5. THE COUNTY SHALL INSPECT UNDERGROUND DRAINAGE IMPROVEMENTS AND STORMWATER MANAGEMENT FEATURES PRIOR TO BACKFILL.

# AS-BUILT PLANS STATEMENT


THIS IS A TRUE COPY OF THE AS-BUILT PLANS. THERE (\_\_\_\_ WERE) (\_\_ NOT) MINOR FIELD CHANGES - MARKED WITH THE SYMBOL (^). THERE (\_\_\_WERE) WERE NOT) PLAN REVISIONS INDICATING SIGNIFICANT CHANGES REVIEWED BY THE COUNTY ENGINEER AND MARKED WITH THE SYMBOL  $\triangle$ .

NOTE: THIS STATEMENT IS TO BE SIGNED BY THE PERSON AUTHORIZED BY THE COUNTY ENGINEER TO PERFORM THE INSPECTION WORK. A REPRODUCIBLE COPYOF THE AS-BUILT PLANS MUST BE FURNISHED TO THE COUNTY ENGINEER

SIGNATURE

GEOTECHNICAL ENGINEER OBSERVATION

1. A CONSTRUCTION OBSERVATION LETTER FROM THE RESPONSIBLE GEOTECHNICAL ENGINEER AND ENGINEERING GEOLOGIST DETAILING CONSTRUCTION OBSERVATIONS AND CERTIFYING THAT THE WORK WAS DONE IN ACCORDANCE WITH THE RECOMMENDATIONS IN THE GEOTECHNICAL AND GEOLOGIC REPORTS SHALL BE SUBMITTED PRIOR TO THE GRADING COMPLETION AND RELEASE OF THE BOND.

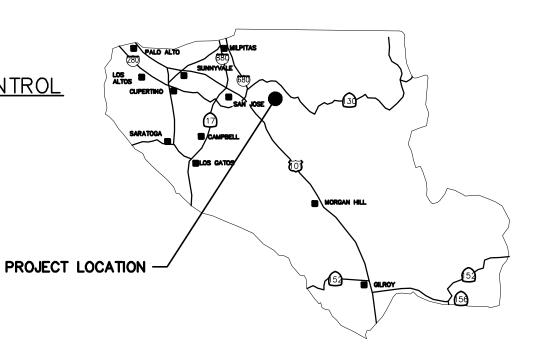

# COUNTY LOCATION MAP

# SURVEY MONUMENT PRESERVATION

- 1. THE LANDOWNER / CONTRACTOR MUST PROTECT AND ENSURE THE PERPETUATION OF SURVEY MONUMENTS AFFECTED BY CONSTRUCTION
- ACTIVITIES. 2. PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR SHALL LOCATE. STAKE, AND FLAG OR OTHERWISE IDENTIFY WITH PAINT OR OTHER MARKINGS ALL PERMANENT SURVEY MONUMENTS OF RECORD AND ANY UNRECORDED MONUMENTS THAT ARE DISCOVERED THAT ARE WITHIN 50 FEET OF THE CONSTRUCTION ACTIVITY.
- 3. THE LANDOWNER, CONTRACTOR AND/OR ANY PERSON PERFORMING CONSTRUCTION ACTIVITIES THAT WILL OR MAY DISTURB AN EXISTING MONUMENT, CORNER STAKE, OR ANY OTHER PERMANENT SURVEYED MONUMENT SHALL CAUSE TO HAVE A LICENSED LAND SURVEYOR OR CIVIL ENGINEER, AUTHORIZED TO PRACTICE SURVEYING, ENSURE THAT A CORNER RECORD AND/OR RECORD OF SURVEY ARE FILED WITH THE COUNTY SURVEYOR'S OFFICE PRIOR TO DISTURBING SAID MONUMENTS AND RESET PERMANENT MONUMENT(S) IN THE SURFACE OF THE NEW CONSTRUCTION OR SET A WITNESS MONUMENT(S) TO PERPETUATE THE LOCATION IF ANY PERMANENT MONUMENT COULD BE DESTROYED, DAMAGED, COVERED, DISTURBED, OR OTHERWISE OBLITERATED. THE LICENSED LAND SURVEYOR OR CIVIL ENGINEER SHALL FILE A CORNER RECORD OR RECORD OF SURVEY WITH COUNTY SURVEYOR PRIOR TO FINAL ACCEPTANCE OF THE PROJECT BY THE LAND DEVELOPMENT ENGINEERING INSPECTOR.

INSPECTION.

COUNTY OF SANTA CLARA DEPT. OF ROADS AND AIRPORTS
ISSUED BY: DATE:
ENCROACHMENT PERMIT NO.

NO WORK SHALL BE DONE IN THE COUNTY'S RIGHT-OF-WAY WITHUOT AN ENCROACHEMENT PERMIT, INCLUDING THE STAGING OF CONSTRUCTION MATERIAL AND THE PLACEMENT OF PORTABLE TOILETS.

# ENGINEER'S STATEMENT

\_\_\_\_\_

I HEREBY STATE THAT THESE PLANS ARE IN COMPLIANCE WITH ADOPTED COUNTY STANDARDS, THE APPROVED TENTATIVE MAP (OR PLAN) AND CONDITIONS PERTAINING THERETO FILE(S) NO. PLN21-218

DATE





# COUNTY ENGINEER'S NOTE

ISSUANCE OF A PERMIT AUTHORIZING CONSTRUCTION DOES NOT RELEASE THE DEVELOPER, PERMITTEE OF ENGINEER FROM RESPONSIBILITY FOR THE CORRECTION OF ERRORS OR OMISSIONS CONTAINED IN THE PLANS. IF, DURING THE COURSE OF CONSTRUCTION, THE PUBLIC INTEREST REQUIRES A MODIFICATION OF (OR DEPARTURE FROM) THE SPECIFICATIONS OF THE PLANS, THE COUNTY SHALL HAVE THE AUTHORITY TO REQUIRE THE SUSPENSION OF WORK, AND THE NECESSARY MODIFICATION OR DEPARTURE AND TO SPECIFY THE MANNER IN WHICH THE SAME IS TO BE MADE.

# DATE

R.C.E. NO.

# IMPROVEMENT PLANS 3655 PLEASANT KNOLL COURT SAN JOSE, CA

# ISLAM PROPERTY


# PROJECT DESCRIPTION:

# ON-SITE IMPROVEMENTS

THE SCOPE OF WORK TO BE PERFORMED UNDER THIS GRADING PERMIT IS TO CONSTRUCT A NEW SINGLE FAMILY RESIDENCE, GARAGE BUILDING, DRIVEWAY, WALKWAYS/PATIOS. AND APPURTENANT SITE IMPROVEMENTS. JOINT TRENCH CONNECTION TO EXISTING ELECTRIC AND GAS LINE ON-SITE. NEW STORM DRAIN SYSTEM AND RETENTION, WATER SERVICE, AND O.W.T.S. SYSTEM FOR THE PROJECT SITE.

OFF-SITE IMPROVEMENTS

ONE COUNTY STANDARD DRIVEWAY APPROACHES. DOES NOT OBSTRUCT VEHICULAR ACCESS. ASPHALT AND SAWCUT TO CONFORM DRIVEWAY APPROACH. CONNECTION TO SAN JOSE WATER SUPPLY IN RIGHT OF WAY.

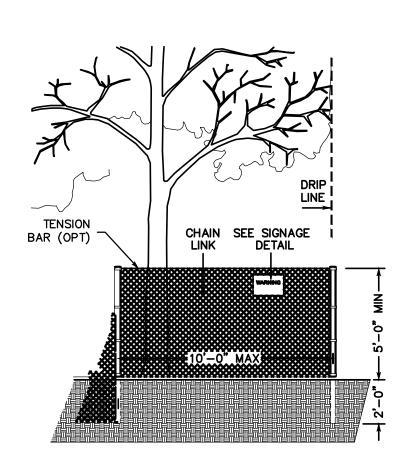

# EXISTING TREE PROTECTION DETAILS

PRIOR TO THE COMMENCEMENT OF ANY GRADING. TREE PROTECTIVE FENCING SHALL BE IN PLACE IN ACCORDANCE WITH THE TREE PRESERVATION PLAN AND INSPECTED BY A CERTIFIED ARBORIST. THE ARBORIST SHALL MONITOR CONSTRUCTION ACTIVITY TO ENSURE THAT THE TREE PROTECTION MEASURES ARE IMPLEMENTED AND ADHERED TO DURING CONSTRUCTION. THIS CONDITION SHALL BE INCORPORATED INTO THE GRADING PLANS. 2. FENCE SHALL BE MINIMUM 5 FEET TALL CONSTRUCTED OF STURDY MATERIAL (CHAIN-LINK OR EQUIVALENT STRENGTH / DURABILITY).

3. FENCE SHALL BE SUPPORTED BY VERTICAL POSTS DRIVEN 2 FEET (MIN) INTO THE GROUND AND SPACED NOT MORE THAN 10 FEET APART. 4. TREE FENCING SHALL BE MAINTAINED THROUGHOUT THE SITE DURING THE CONSTRUCTION PERIOD, INSPECTED PERIODICALLY FOR DAMAGE AND PROPER FUNCTION, REPAIRED AS NECESSARY TO PROVIDE A PHYSICAL BARRIER FROM CONSTRUCTION ACTIVITIES, AND REMAIN IN PLACE UNTIL THE FINAL

5. A SIGN THAT INCLUDES THE WORDS, "WARNING: THIS FENCE SHALL NOT BE REMOVED WITHOUT THE EXPRESSED PERMISSION OF THE SANTA CLARA COUNTY PLANNING OFFICE." SHALL BE SECURELY ATTACHED TO THE FENCE IN A VISUALLY PROMINENT LOCATION.

COUNTY OF SANTA LAND DEVELOPMENT ENGINEERI	
RADING / DRAINAGE PERMIT NO.	
SSUED BY:	DATE:



EXPIRATION DATE

	SHEET INDEX	
C-1.0	TITLE SHEET	
C-1.1	OVERALL SITE PLAN	
C-2.0	GRADING AND DRAINAGE PLAN	
C-2.1	SITE SECTIONS	
C-2.2	SITE SECTIONS	
C-3.0	UTILITY PLAN	
C-3.1	UTILITY PLAN	
C-4.0	DETAILS	
C-4.1	DETAILS	
C-5.0	GRADING SPECIFICATIONS	
ER-1	EROSION CONTROL PLAN	
BMP-1	EROSION CONTROL DETAILS	
BMP-2	EROSION CONTROL DETAILS	
2495 IN HAYWAR (P) (51	LEA & BRAZE ENGINEERING, INC. CIVIL ENGINEERS • LAND SURVEYORS ACRAMENTO REGION DUSTRIAL PKWY WEST D, CALIFORNIA 94545 0) 887–4086 0) 887–3019 WWW.LEABRAZE.COM LB#: 2221253 DATE: 08/07	5
Revisior		/2023 Sheet 1

08-26-24

11-06-24

Co. File

Revision 2

Revision 3

# EXISTING

# LEGEND

PROPOSED

<u>EXIS IING</u>	PROPOSED
· · · ·	RW RW
	SUB
· · · ·	TL
SD	SD
SS	SS
G	G
Р	
P	
JT	JT
	$\cdot  \checkmark \land \land$
CB JB AD	Ш СВ Ш ЈВ Ар
SDMH	O <sub>sdmh</sub> ₩
SSMH 222.57 × INV	○ SSMH   222.57  NV
<b>~</b>	
$\bullet$	$\overleftarrow{ullet}$
200-200-	200 XX" TREE
	TP

# DESCRIPTION

BOUNDARY PROPERTY LINE **RETAINING WALL** LANDSCAPE RETAINING WALL RAINWATER TIGHTLINE SUBDRAIN LINE TIGHTLINE STORM DRAIN LINE SANITARY SEWER LINE WATER LINE GAS LINE STORM DRAIN PRESSURE LINE SANITARY SEWER PRESSURE LINE JOINT TRENCH SET BACK LINE CONCRETE VALLEY GUTTER EARTHEN SWALE CATCH BASIN JUNCTION BOX AREA DRAIN CURB INLET STORM DRAIN MANHOLE FIRE HYDRANT SANITARY SEWER MANHOLE STREET SIGN SPOT ELEVATION FLOW DIRECTION DEMOLISH/REMOVE BENCHMARK CONTOURS

TREE TO BE REMOVED

TREE PROTECTION FENCING

# ABBREVIATIONS

LF MAX

MH

MIN

MON.

MRO

(N) NO.

NTS **O.C.** 

0/

(PA) PED

PIV

PSS

PUE PVC

RCP

RIM

RW

R/W

S.A.D.

SAN

SDMH

SHT

S.L.D. SPEC

SS SSCO SSMH

ST.

STA

STD STRUCT

TC

TP

TOW

TEMP

TW/FG

TYŻ

VC

VCP

VERT

W, WL

W/

WM

WWF

SD

AB	AGGREGATE BASE
AC	ASPHALT CONCRETE
	ACCESSIBLE
	AREA DRAIN
	BEGINNING OF CURVE
	BEARING & DISTANCE
	BENCHMARK
	BUBBLER BOX
	BOTTOM OF WALL/FINISH
	GRADE
CB	CATCH BASIN
C & G	CURB AND GUTTER
СĘ.	CENTER LINE
<b>ČPP</b>	CORRUGATED PLASTIC PIPE
	(SMOOTH INTERIOR)
CO	CLEANOUT
COTG	ČLEANOUT CLEANOUT TO GRADE
CONC	CONCRETE
CONST	CONSTRUCT or TION
	CONSTRUCT or -TION CONCRETE CORNER
CY	
D	DIAMETER
DI	DROP INLET
DIP	DUCTILE IRON PIPE
EA	EACH
EC	END OF CURVE
EG	EXISTING GRADE
EL	ELEVATIONS
EP	EDGE OF PAVEMENT
EQ	EQUIPMENT
EW	EACH WAY
(E)	EXISTING
	FACE OF CURB
FF	FINISHED FLOOR
FG	FINISHED GRADE
FH	FIRE HYDRANT
FL	FLOW LINE
FS	FINISHED SURFACE
G	GAS
ĞA	GAGE OR GAUGE
GB	GRADE BREAK
HDPE	HIGH DENSITY CORRUGATED
NUFL	POLYETHYLENE PIPE
	HORIZONTAL
HORIZ	
HI PT	HIGH POINT
H&T	HUB & TACK
ID	INSIDE DIAMETER
INV	INVERT ELEVATION
JB	JUNCTION BOX
JT	JOINT TRENCH
JP	JOINT UTILITY POLE
L	LENGTH
LNDG	LANDING

LINEAR FEET MAXIMUM MANHOLE MINIMUM MONUMENT METERED RELEASE OUTLET NEW NUMBER NOT TO SCALE ON CENTER OVER PLANTING AREA PEDESTRIAN POST INDICATOR VALVE PUBLIC SERVICES EASEMENT PROPERTY LINE POWER POLE PUBLIC UTILITY EASEMENT POLYVINYL CHLORIDE RADIUS REINFORCED CONCRETE PIPE **RIM ELEVATION** RAINWATER RIGHT OF WAY SLOPE SEE ARCHITECTURAL DRAWINGS SANITARY STORM DRAIN STORM DRAIN MANHOLE SHEET SEE LANDSCAPE DRAWNGS SPECIFICATION SANITARY SEWER SANITARY SEWER CLEANOUT SANITARY SEWER MANHOLE STREET STATION STANDARD STRUCTURAL TELEPHONE TOP OF CURB TOP OF WALL TEMPORARY TOP OF PAVEMENT TOP OF WALL/FINISH GRADE TYPICAL VERTICAL CURVE VITRIFIED CLAY PIPE VERTICAL WITH WATER LINE WATER METER WELDED WIRE FABRIC


# DEVELOPED AREA SLOPE:

S=(I\*L/A)100

INTERVAL (I) = 5TOTAL CONTOUR LENGTH (L) = 2,005.9 FT PROPOSED DEVELOPED AERA (A) = 1.169 ACRE


# **RETAINING WALL NOTES**

- FOOTING, FREEBOARD, ETC.
- TO CONSTRUCTION REQUIREMENTS.
- FREEBOARD, AND EMBEDMENT.
- INTO THE WALL).
- PRESSURE.
- 6. SEE DETAIL SHEET FOR SPECIFIC INFORMATION.
- HORIZONTALLY FROM FACE OF WALL, PER CBC.

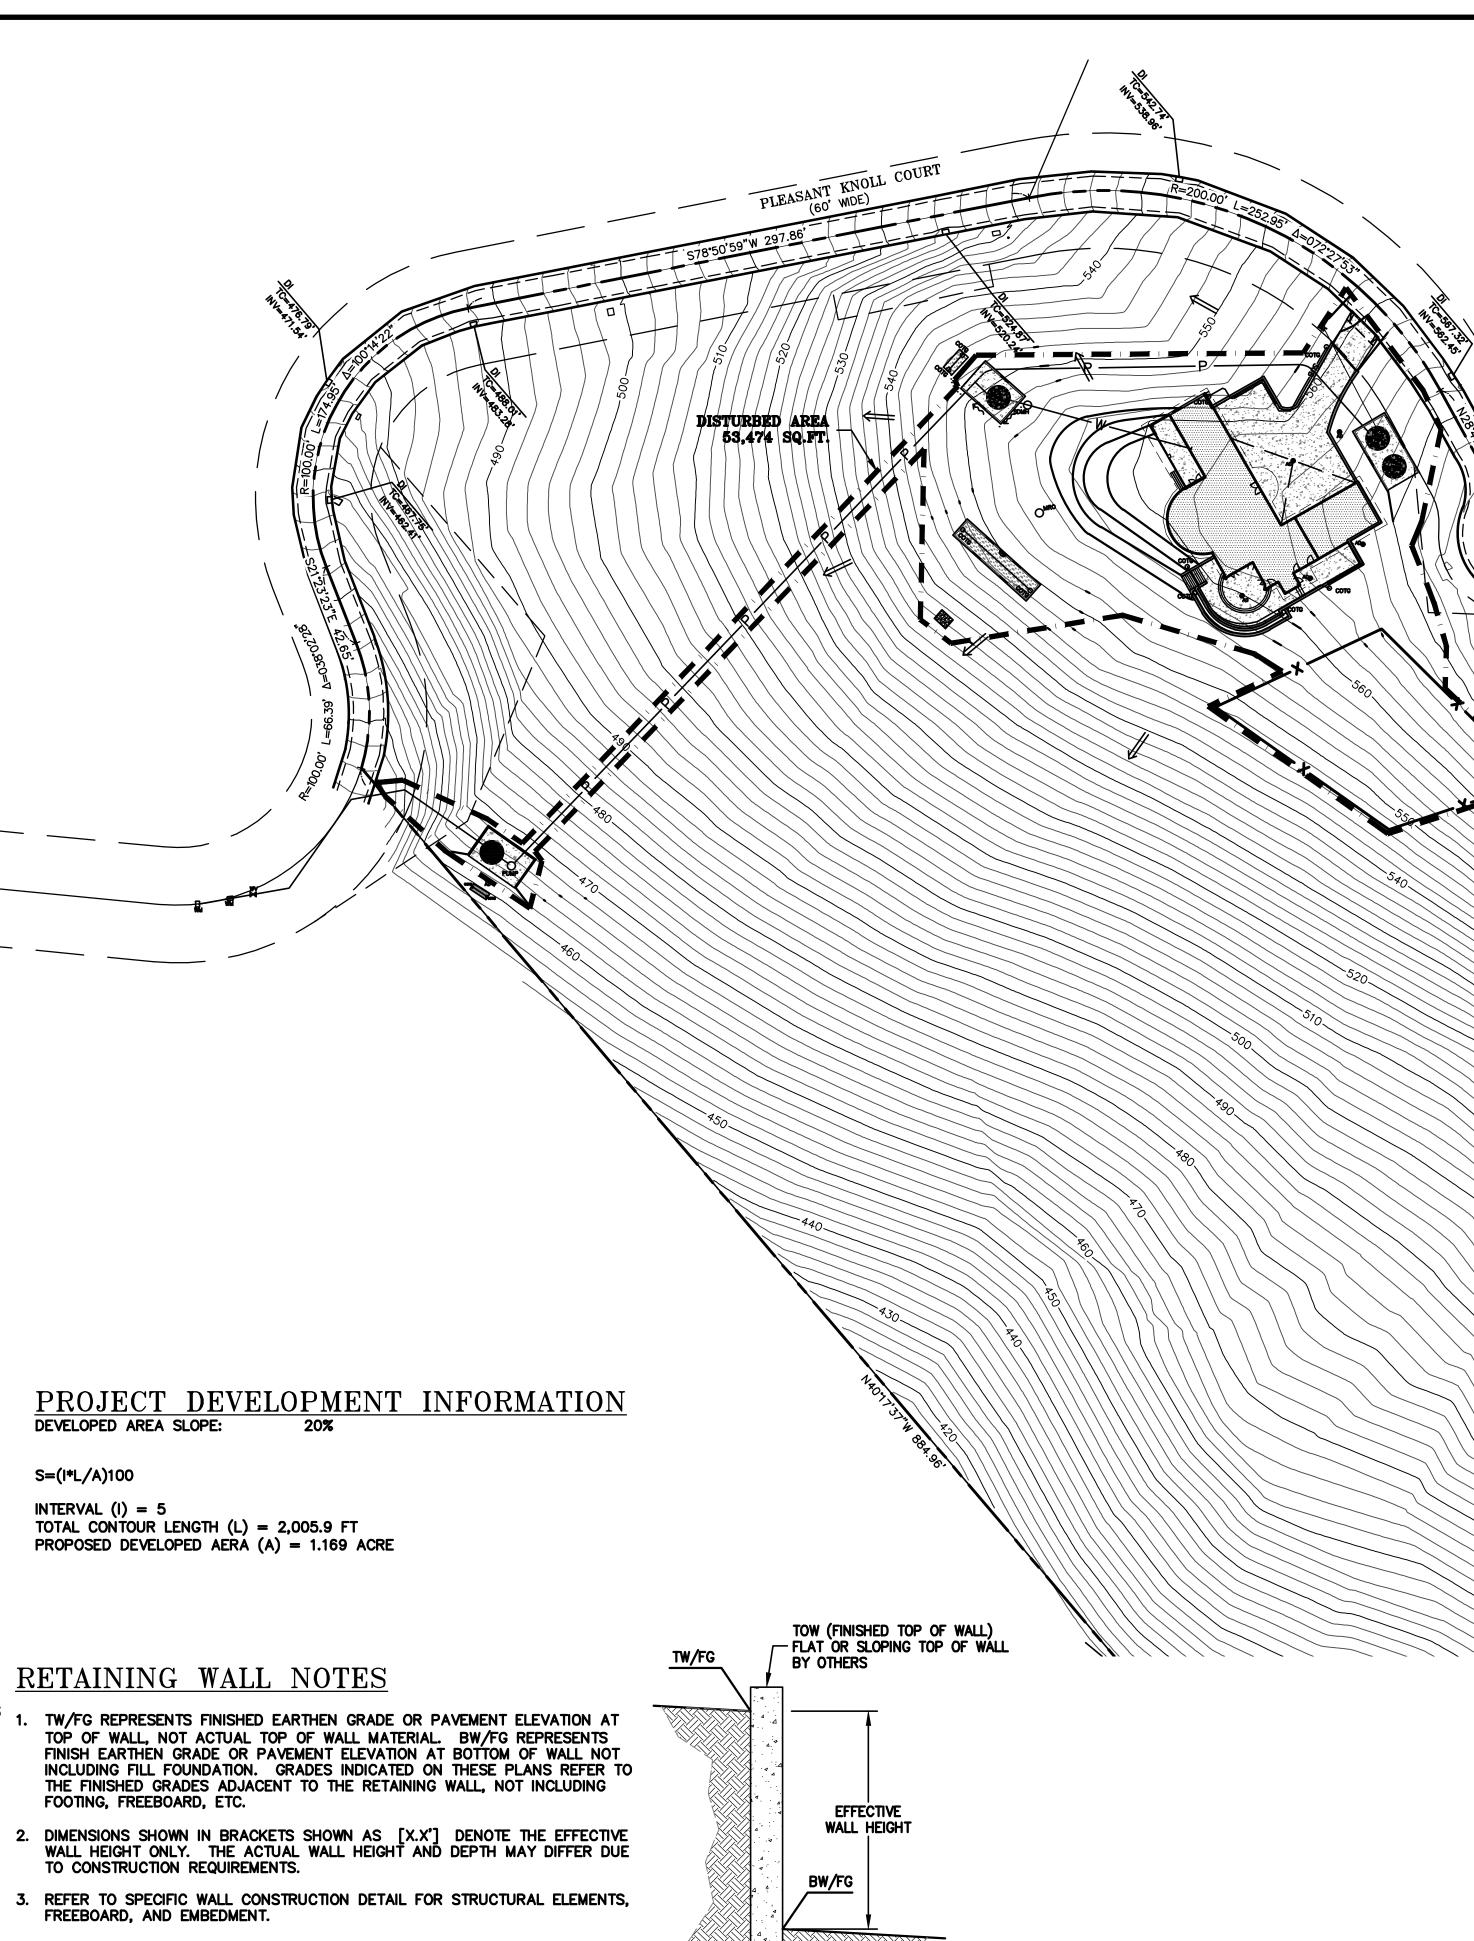

4. REFER TO ARCHITECTURAL, LANDSCAPE ARCHITECTURE, AND/OR STRUCTURAL PLANS FOR DETAILS, WALL ELEVATIONS, SUBDRAINAGE, WATERPROOFING, FINISHES, COLORS, STEEL REINFORCING, MATERIALS, ETC. PROVIDE CLIPS OR OTHER MEANS OF SECURING FINISH MATERIALS AS NECESSARY (WET SET

5. ALL RETAINING WALLS SHOULD HAVE A BACK-OF-WALL SUB-SURFACE DRAINAGE SYSTEM INCLUDING WEEPHOLES TO PREVENT HYDROSTATIC

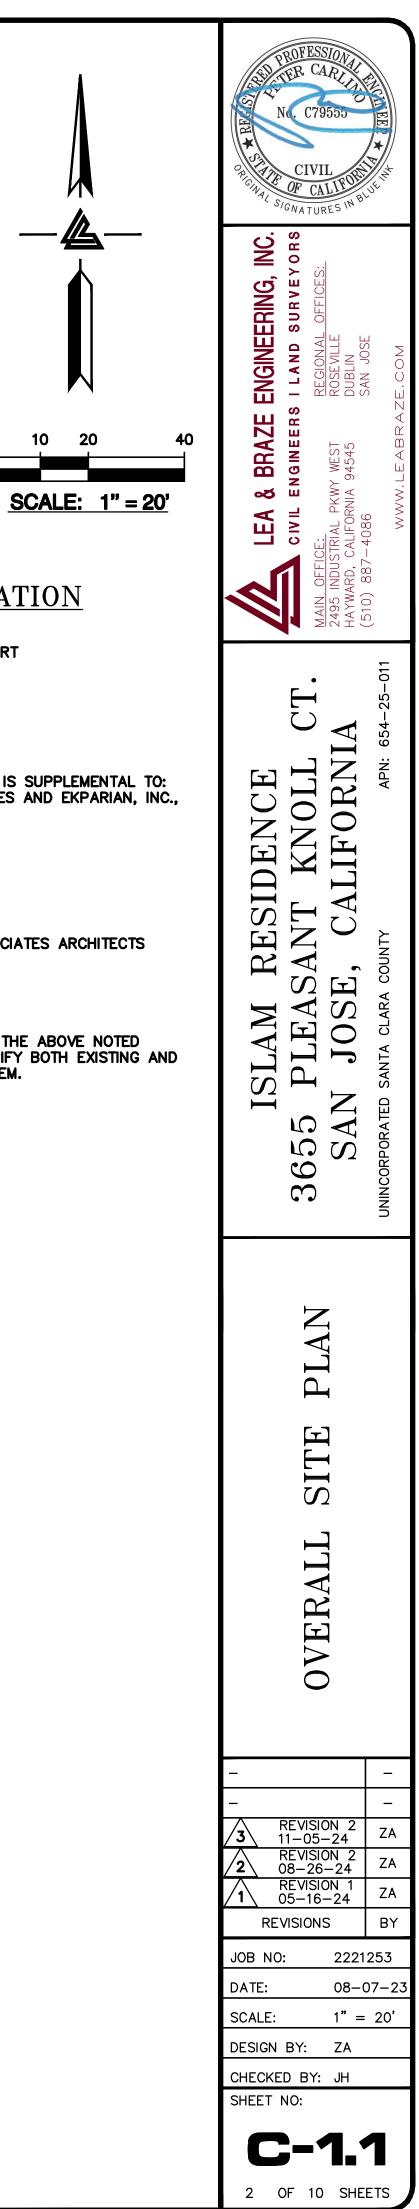7. PROVIDE GUARDRAIL (WHERE APPLICABLE AND DESIGNED BY OTHERS) AS REQUIRED FOR GRADE SEPARATION OF 30 INCHES OR MORE MEASURED 5' 

OWNER'S INFORMATION **OWNER:** 

> ADDNAN ISLAM 3655 PLEASANT KNOLL COURT SAN JOSE, CA 95148

APN: 654-25-011

# REFERENCES


THIS GRADING AND DRAINAGE PLAN IS SUPPLEMENTAL TO: 1. TOPOGRAPHIC SURVEY BY CARNES AND EKPARIAN, INC., ENTITLED; "TOPOGRAPHIC SURVEY"

3655 PLEASANT KNOLL COURT SAN JOSE, CA 95148 DATED: 5-16-22 JOB 22067

2. SITE PLAN BY CAMARGO & ASSOCIATES ARCHITECTS ENTITLED: "SITE PLAN" 3655 PLEASANT KNOLL COURT SAN JOSE, CA 95148

THE CONTRACTOR SHALL REFER TO THE ABOVE NOTED SURVEY AND PLAN, AND SHALL VERIFY BOTH EXISTING AND PROPOSED ITEMS ACCORDING TO THEM.


KEY MAP 1" = 50'

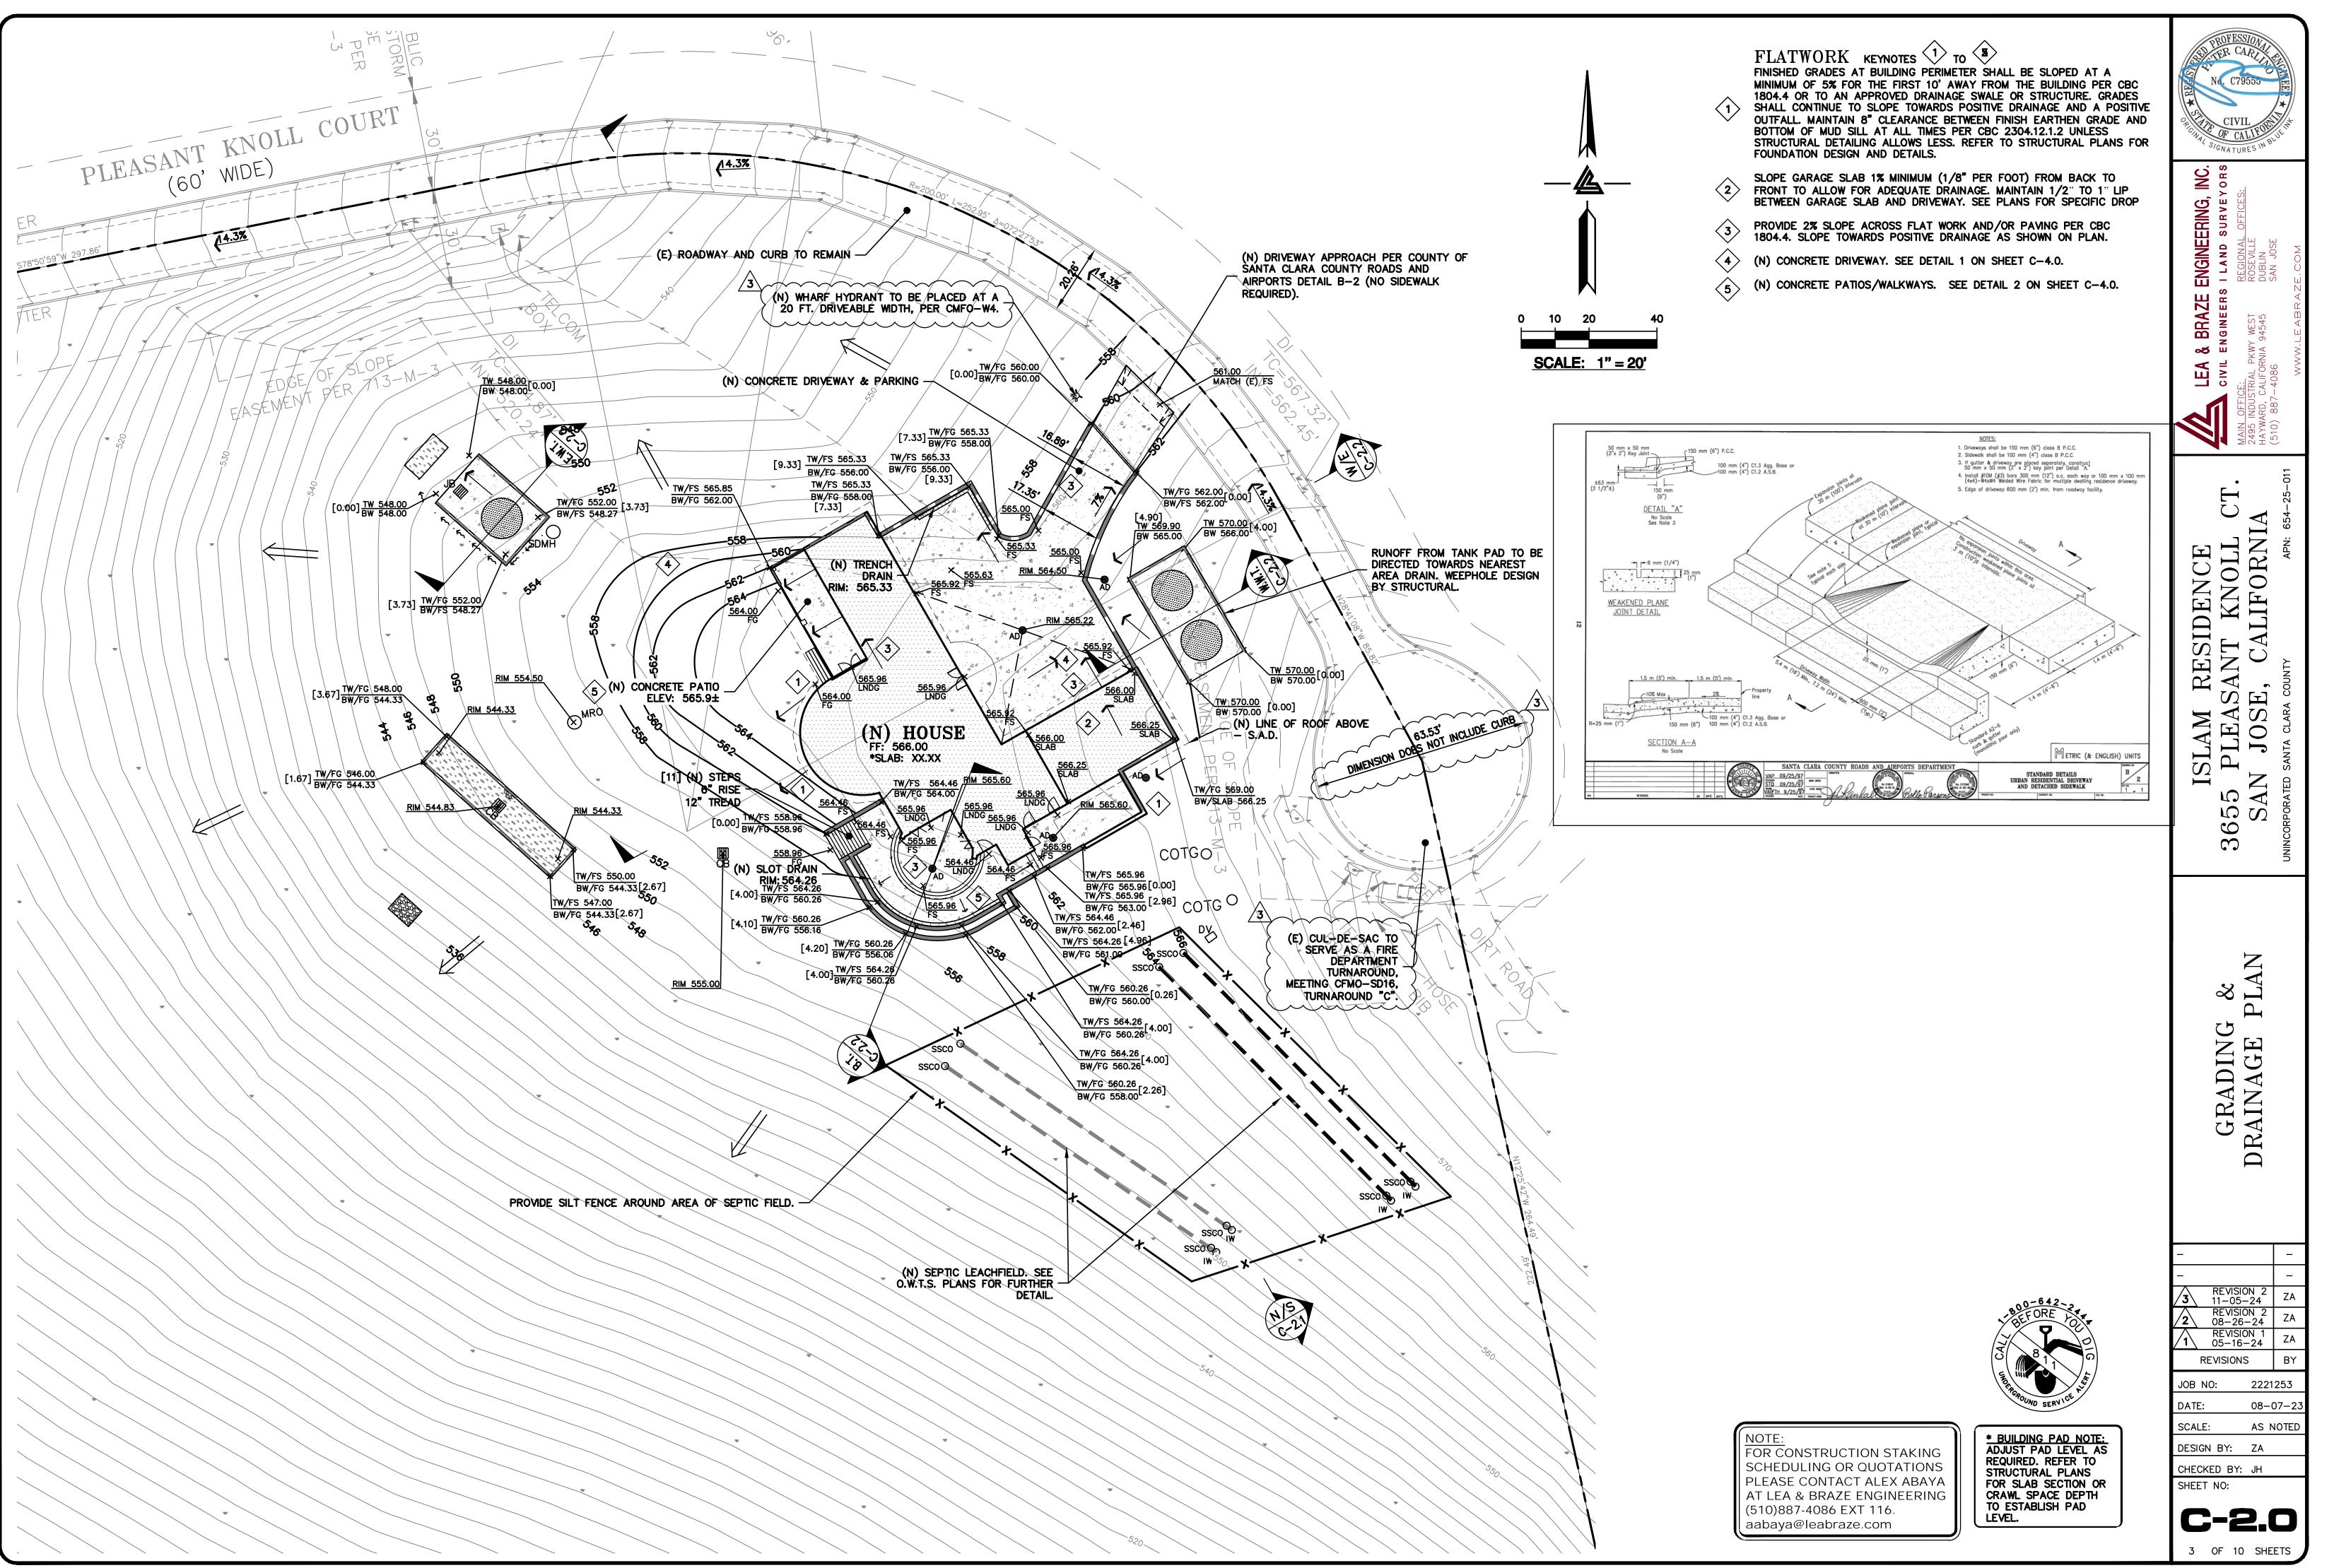

APPLICANT: ADDNAN ISLAM


ROAD: PLEASANT KNOLL


COUNTY FILE NO.: PLN23-183

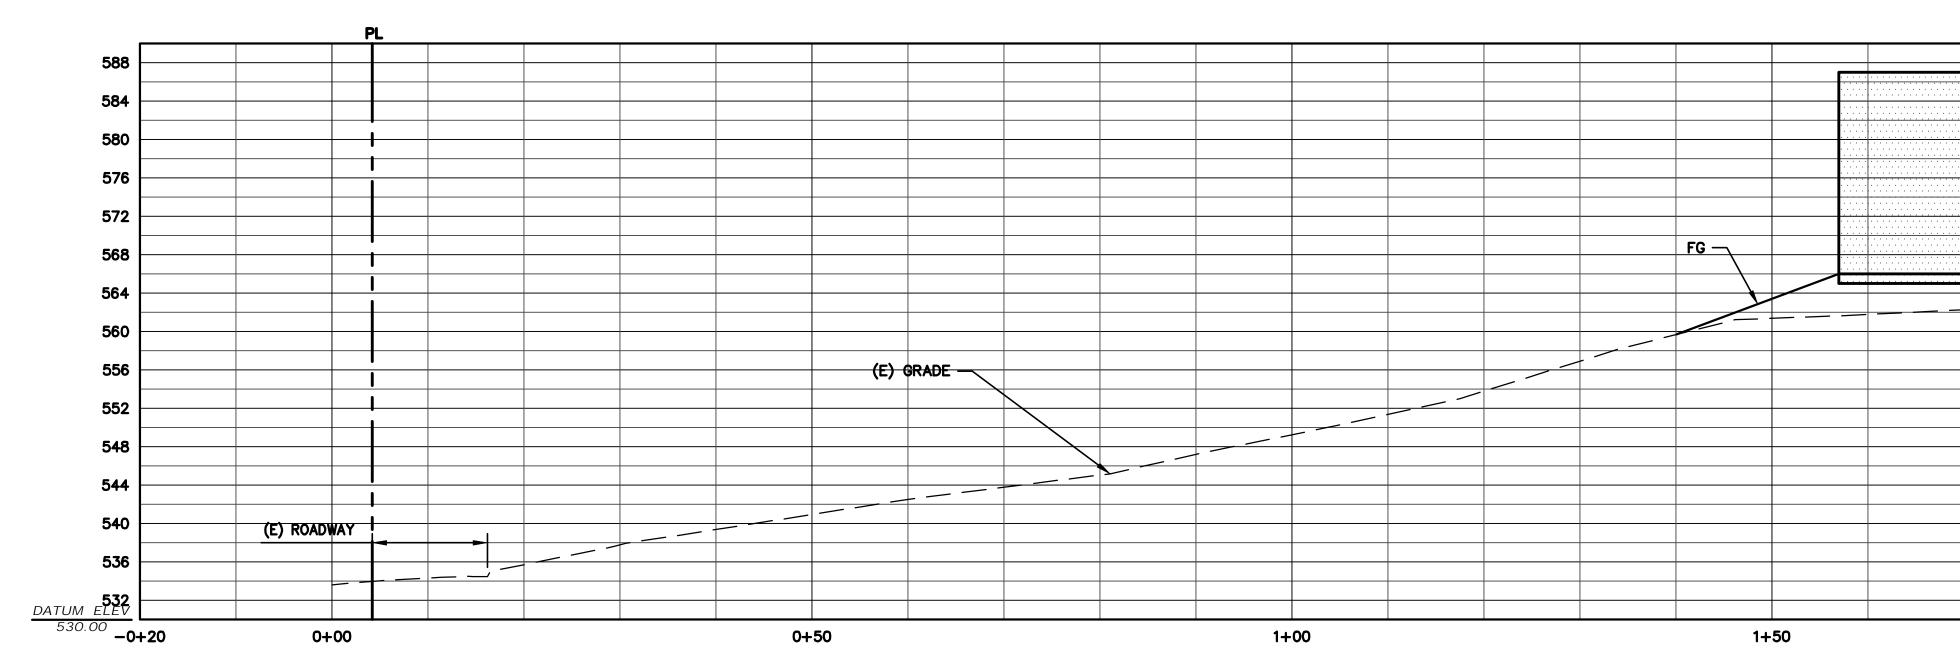

	· · · · · · · · · · · · · · · · · · ·		 			
	TOTT	<b>CD</b>	 			
	HOU		 			
FF: 566 *SLAB:	0.00		 			
*CI ^D.			 			
JLAD.	$\wedge \wedge \cdot \wedge \wedge$		 		· · · · · · · · · · · · · · · · · · ·	(N
· · · · · · · · · · · · · · · · · · ·	· · · · · · · · · · · · · · · · · · ·		 			Т
· · · · · · · · · · · · · · · · · · ·			 			
		· ·	 	F		
· · · ·	2+					2+50

# CROSS-SECTION: NORTH-SOUTH SCALE: 1" = 10' HORIZ & VERT

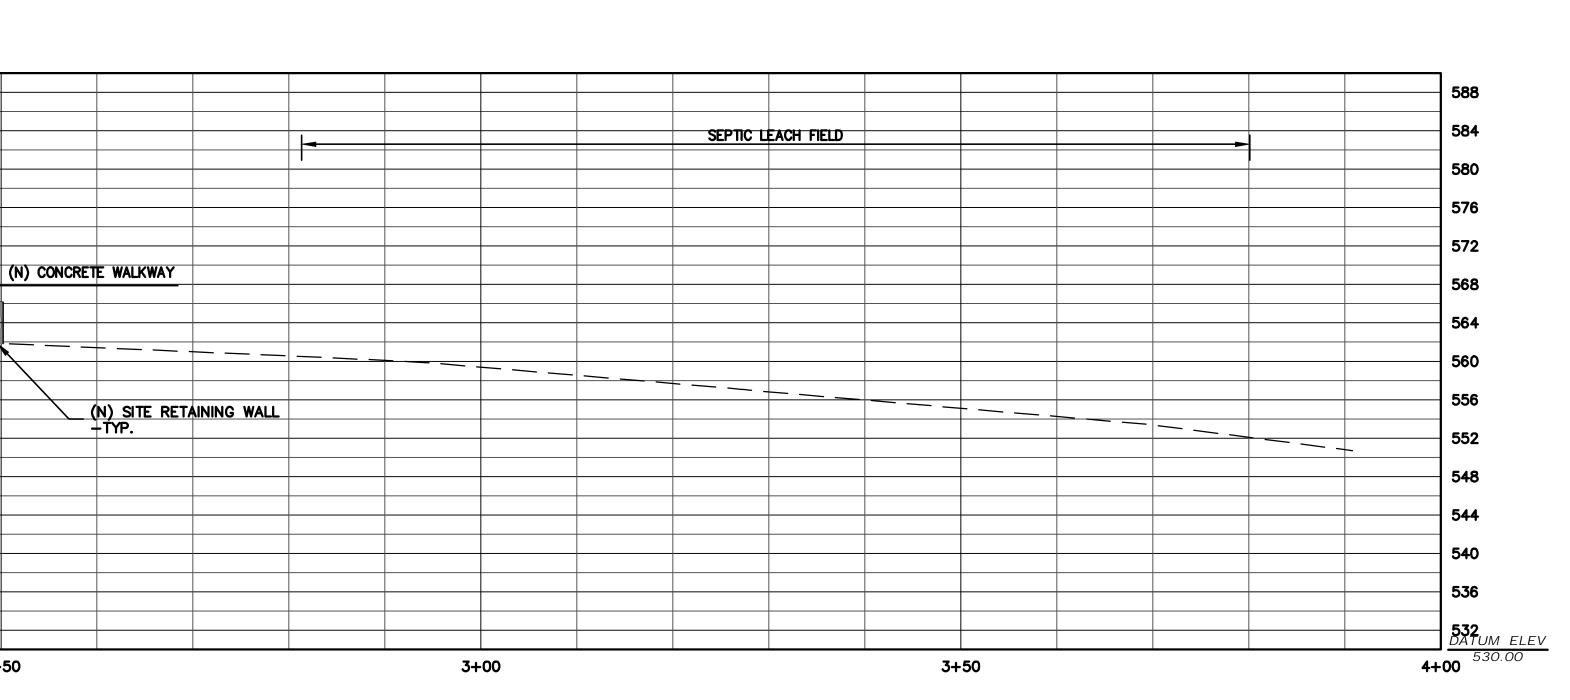



· · · · · · · · · · · · · · · · · · ·	· · · · · · · · · · · · · · · · · · ·		• • • • • • • • • • • • • • • • • • • •	· · · · · · · · · · · · · · · · · · ·
· · · · · · · · · · · · · · · · · · ·	· · · · · · · · · · · · · · · · · · ·			· · · · · · · · · · · · · · · · · · ·
	N) I F: 560	INI	CL	· · · · · · · · · · · · · · · · · · ·
	N) ]		<b>NĽ</b>	
F	F. 566	5 00		
<u></u> 7	SLAB:	XX.XX		· · · · · · · · · · · · · · · · · · ·

2+00

NOTE: FOR CONSTRUCTION STAKING


SCHEDULING OR QUOTATIONS PLEASE CONTACT ALEX ABAYA AT LEA & BRAZE ENGINEERING


(510)887-4086 EXT 116. aabaya@leabraze.com




\* BUILDING PAD NOTE: ADJUST PAD LEVEL AS REQUIRED. REFER TO STRUCTURAL PLANS FOR SLAB SECTION OR CRAWL SPACE DEPTH TO ESTABLISH PAD LEVEL.

XX OF 10 SHEETS

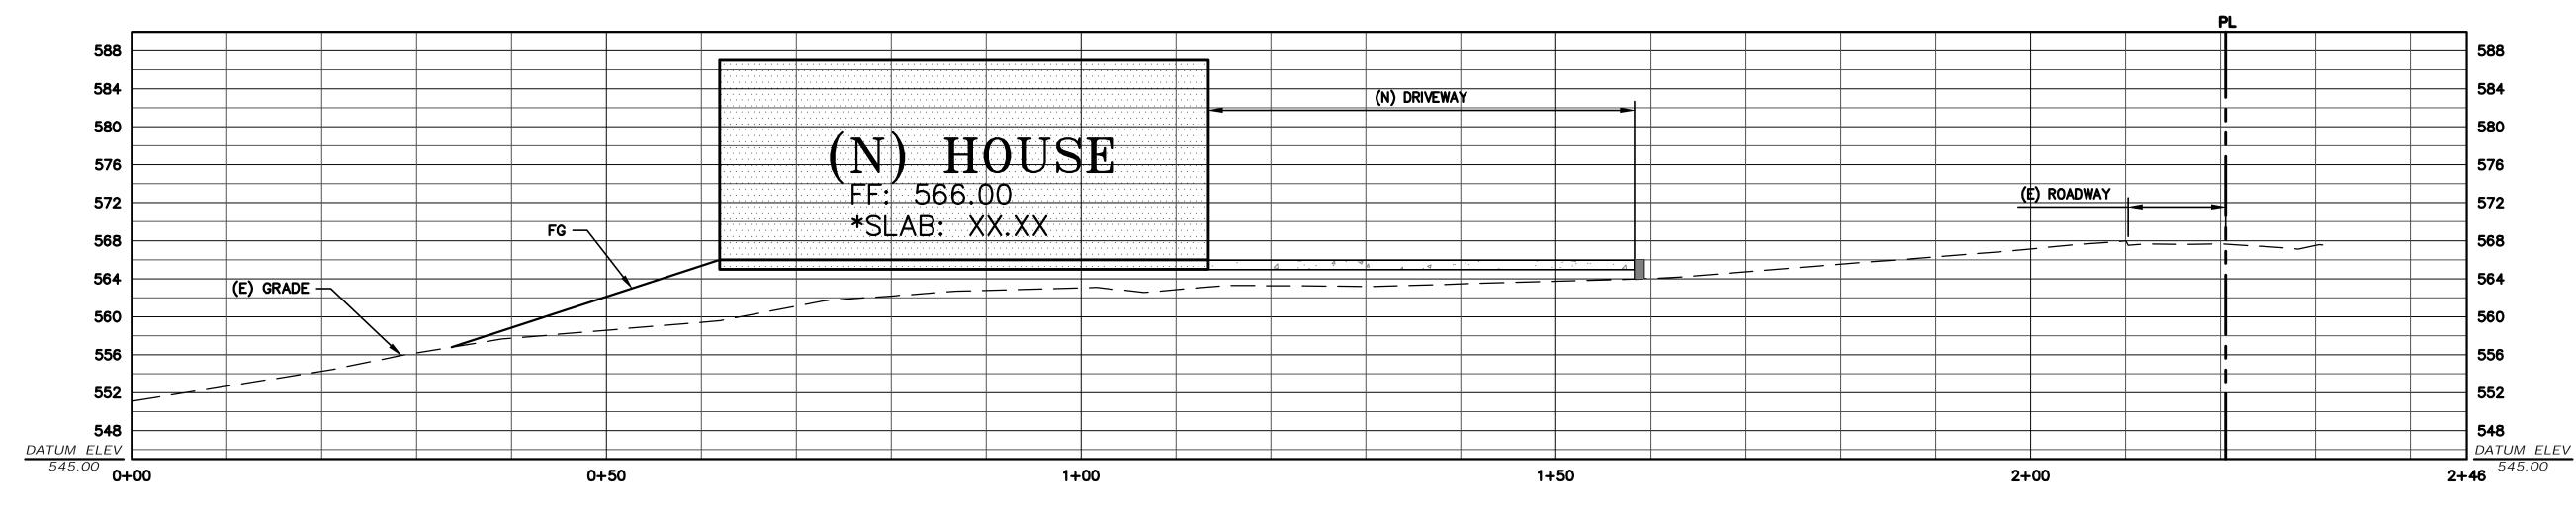

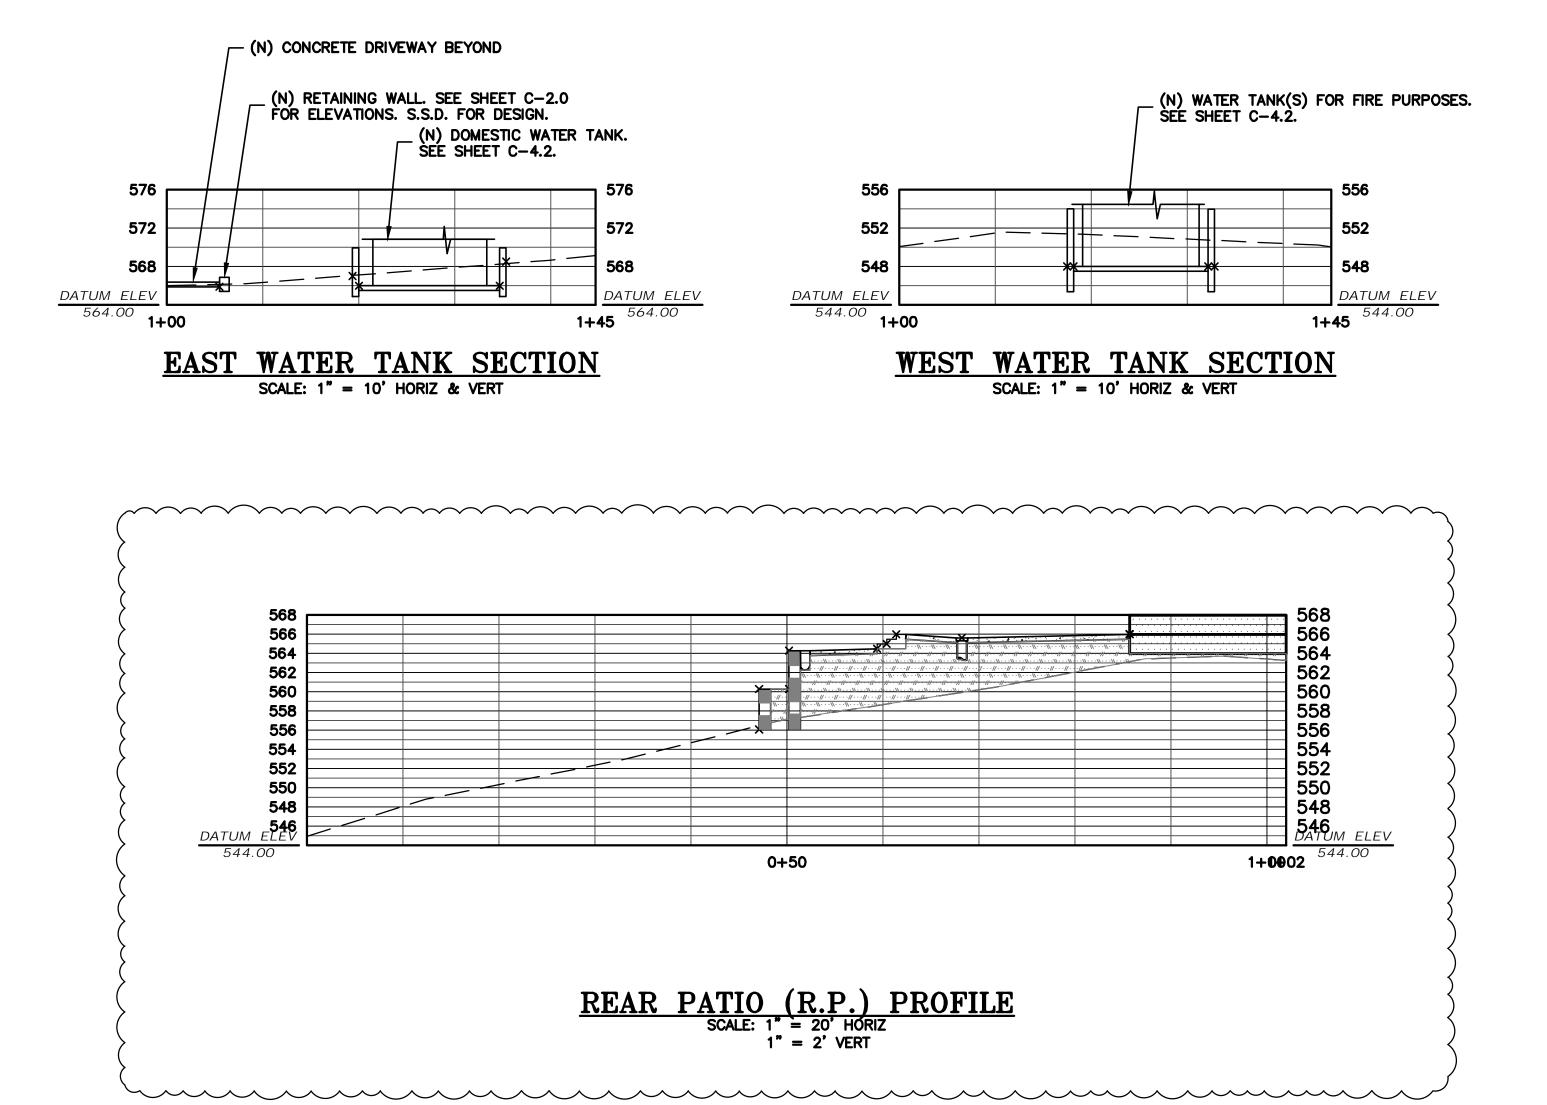



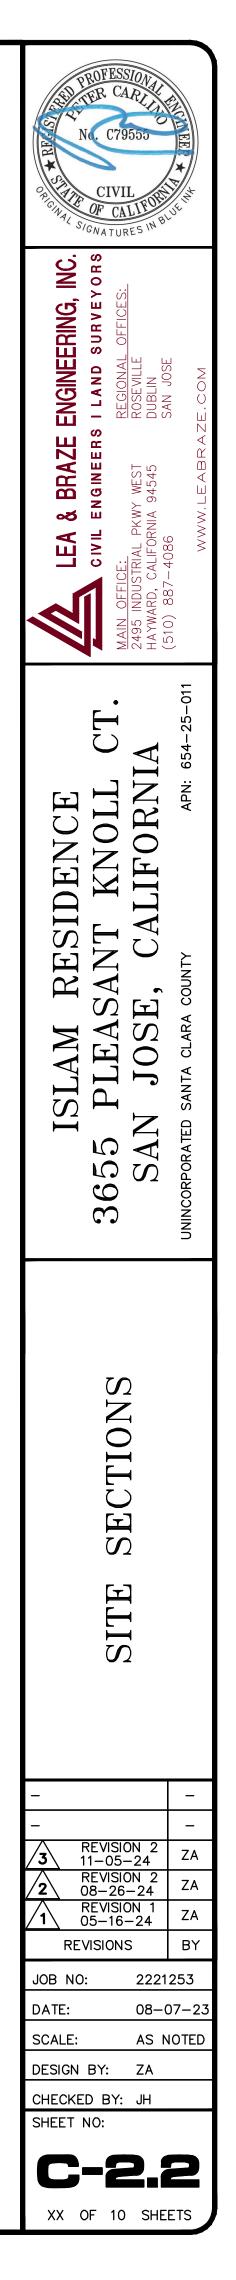



\* BUILDING PAD NOTE: ADJUST PAD LEVEL AS REQUIRED. REFER TO STRUCTURAL PLANS FOR SLAB SECTION OR CRAWL SPACE DEPTH TO ESTABLISH PAD LEVEL.


NOTE:

FOR CONSTRUCTION STAKING

SCHEDULING OR QUOTATIONS PLEASE CONTACT ALEX ABAYA


AT LEA & BRAZE ENGINEERING

(510)887-4086 EXT 116. aabaya@leabraze.com

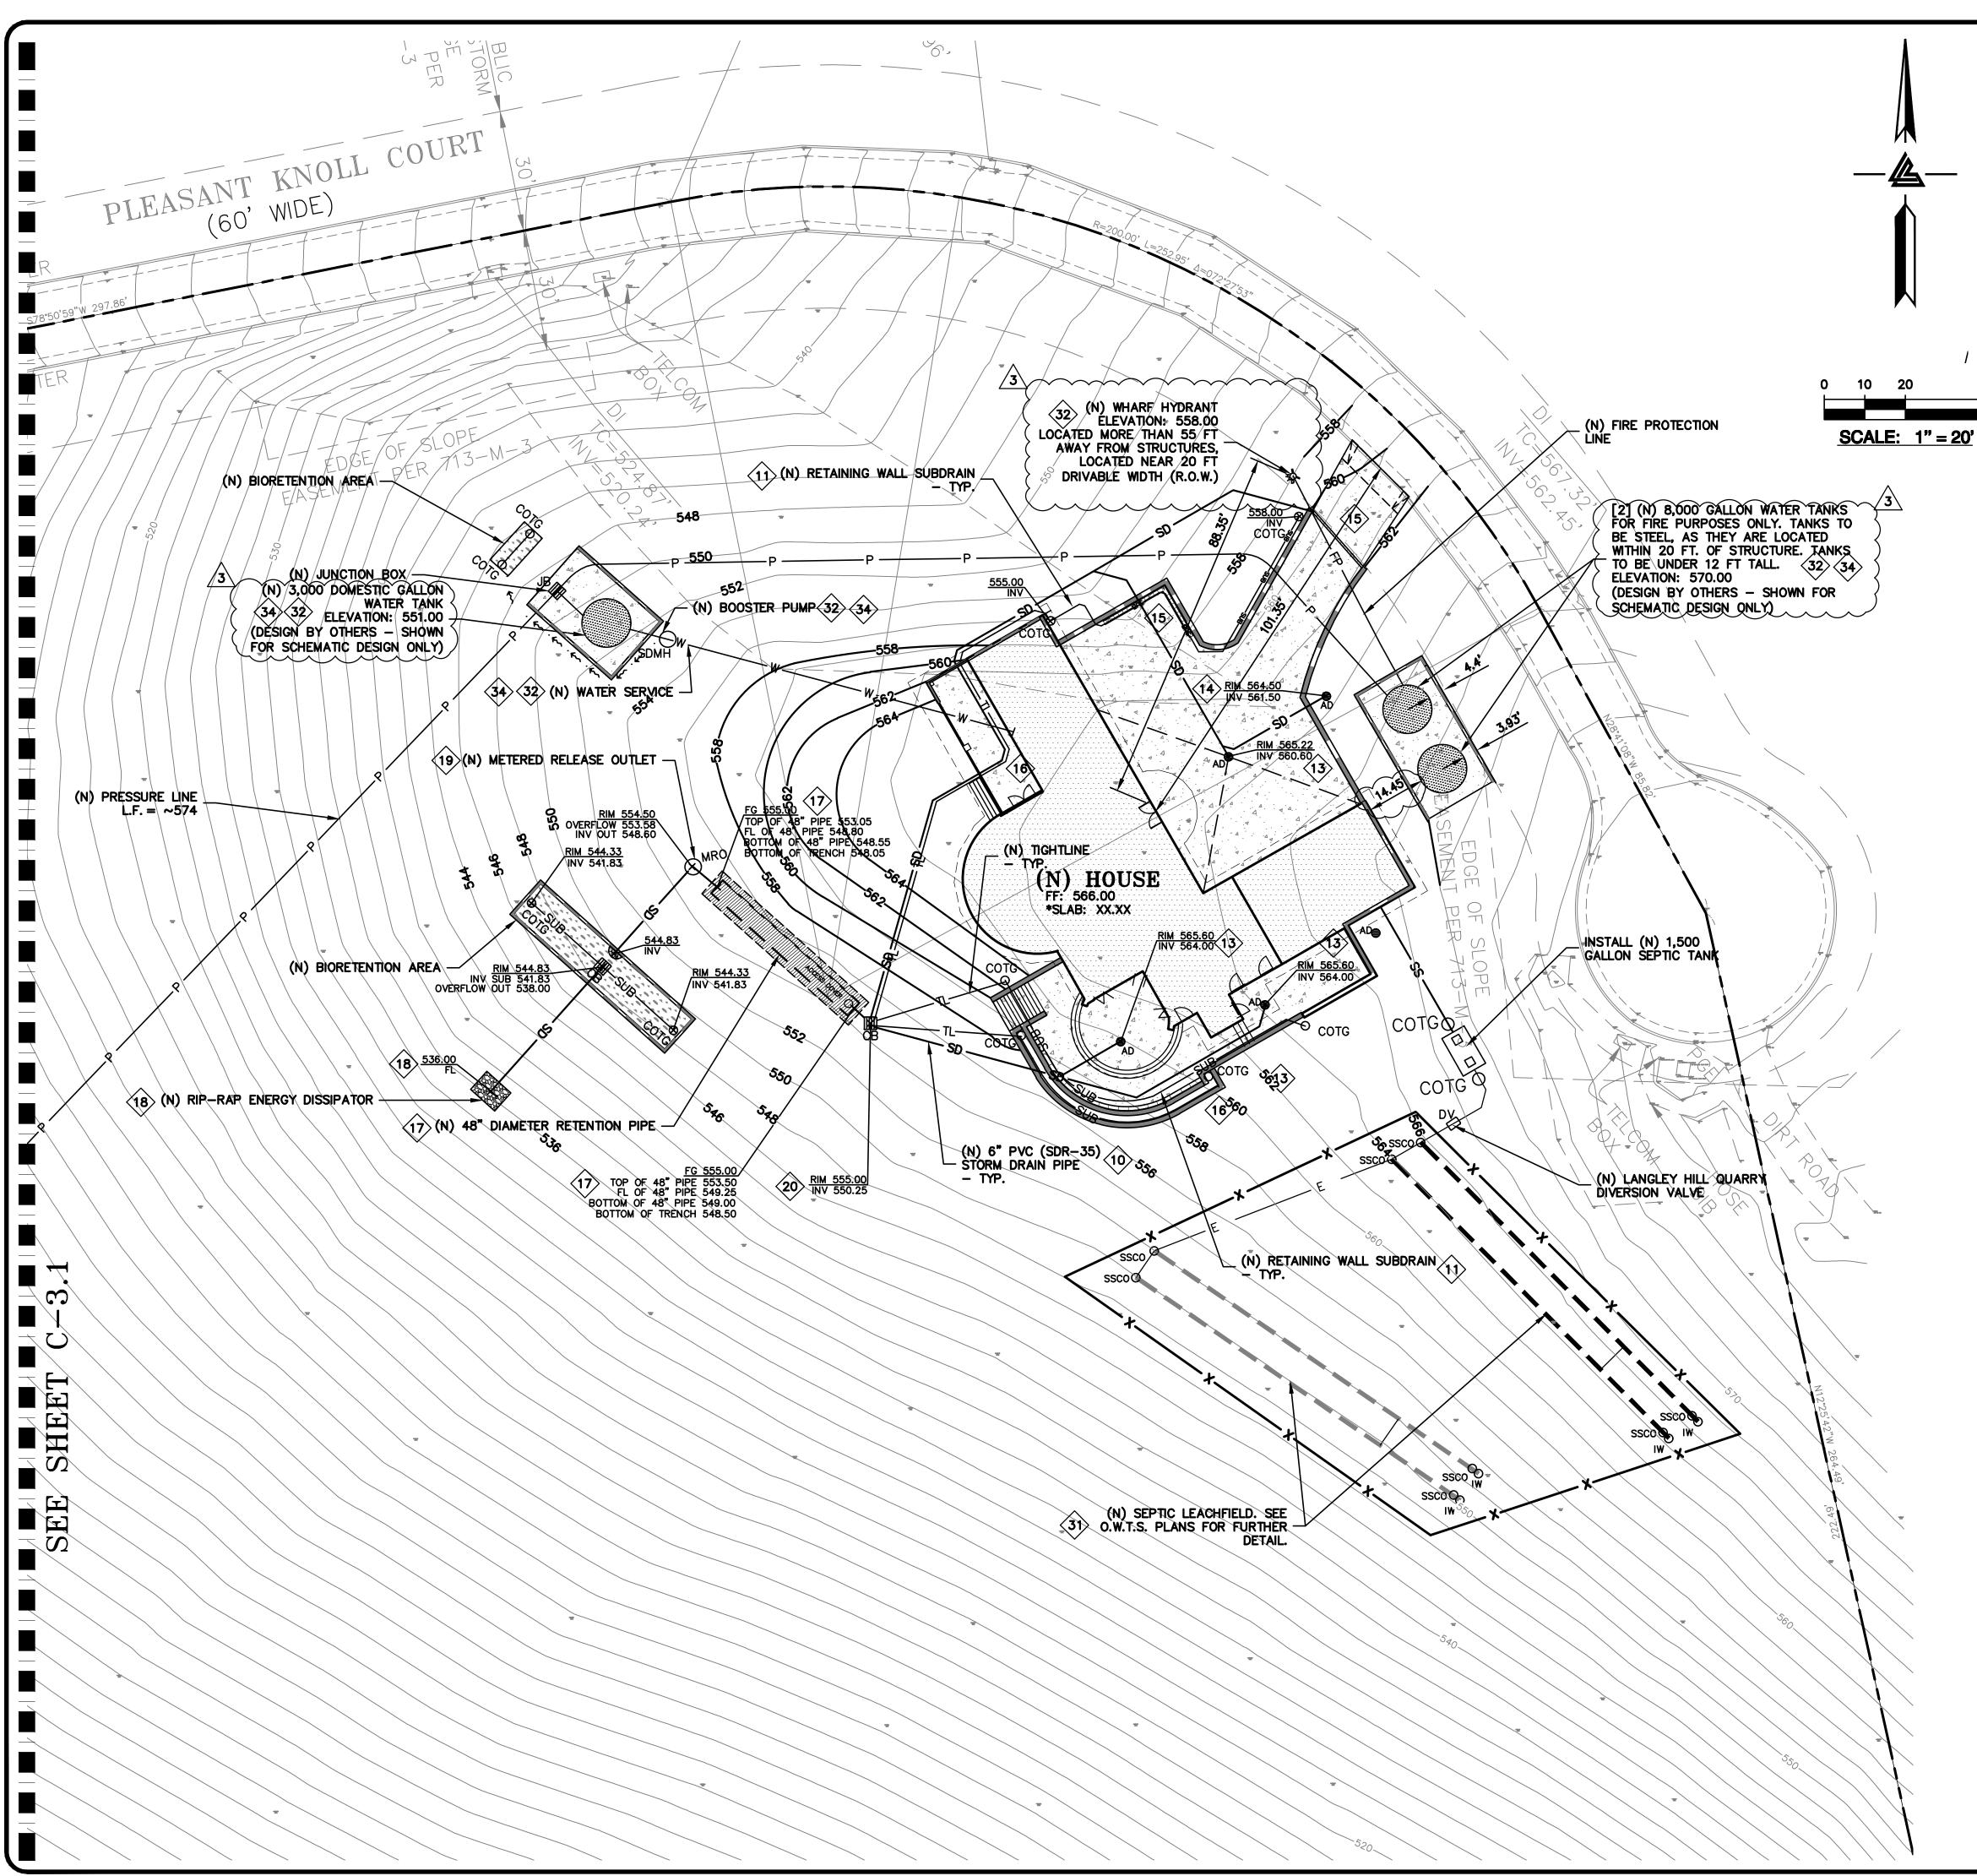

ROAD: PLEASANT KNOLL

COUNTY FILE NO.: PLN23-183

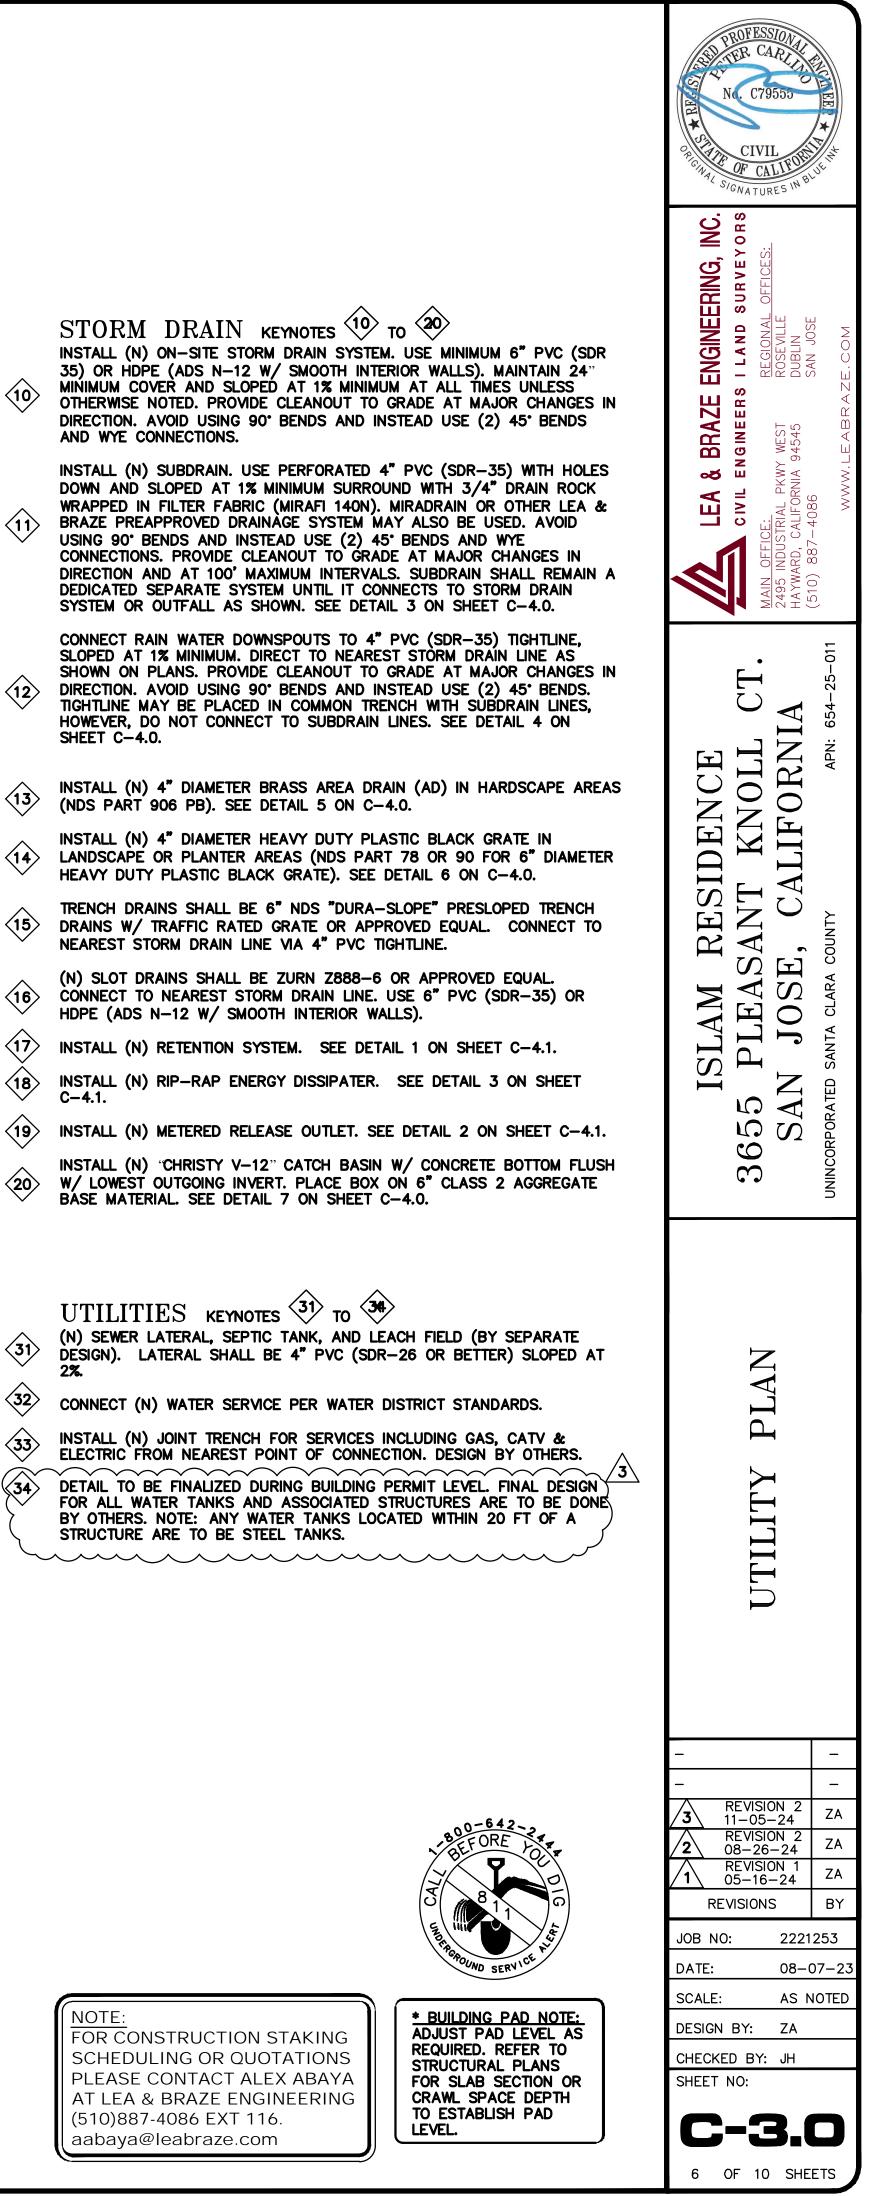

UTILITIES KEYNOTES (31) to (34)(N) SEWER LATERAL, SEPTIC TANK, AND LEACH FIELD (BY SEPARATE DESIGN). LATERAL SHALL BE 4" PVC (SDR-26 OR BETTER) SLOPED AT  $\langle 31 \rangle$ **32** CONNECT (N) WATER SERVICE PER WATER DISTRICT STANDARDS. INSTALL (N) JOINT TRENCH FOR SERVICES INCLUDING GAS, CATV & ELECTRIC FROM NEAREST POINT OF CONNECTION. DESIGN BY OTHERS.  $\langle 33 \rangle$  $\sim\!\!\sim\!\!\sim\!\!\sim\!\!\sim\!\!\sim\!\!\sim$ DETAIL TO BE FINALIZED DURING BUILDING PERMIT LEVEL. FINAL DESIGN FOR ALL WATER TANKS AND ASSOCIATED STRUCTURES ARE TO BE DONE BY OTHERS. NOTE: ANY WATER TANKS LOCATED WITHIN 20 FT OF A STRUCTURE ARE TO BE STEEL TANKS. 

STORM DRAIN KEYNOTES (10) to (20)

(NDS PART 906 PB). SEE DETAIL 5 ON C-4.0.

NEAREST STORM DRAIN LINE VIA 4" PVC TIGHTLINE.

HDPE (ADS N-12 W/ SMOOTH INTERIOR WALLS).

AND WYE CONNECTIONS.

SHEET C-4.0.

 $\langle 10 \rangle$ 

 $\langle 11 \rangle$ 

**<12**>

13

 $\langle 14 \rangle$ 

**<15** 

16

**<17**>


**(20)** 




\* BUILDING PAD NOTE: ADJUST PAD LEVEL AS REQUIRED. REFER TO STRUCTURAL PLANS FOR SLAB SECTION OR CRAWL SPACE DEPTH TO ESTABLISH PAD LEVEL.

NOTE: FOR CONSTRUCTION STAKING SCHEDULING OR QUOTATIONS PLEASE CONTACT ALEX ABAY AT LEA & BRAZE ENGINEERING (510)887-4086 EXT 116.

aabaya@leabraze.com

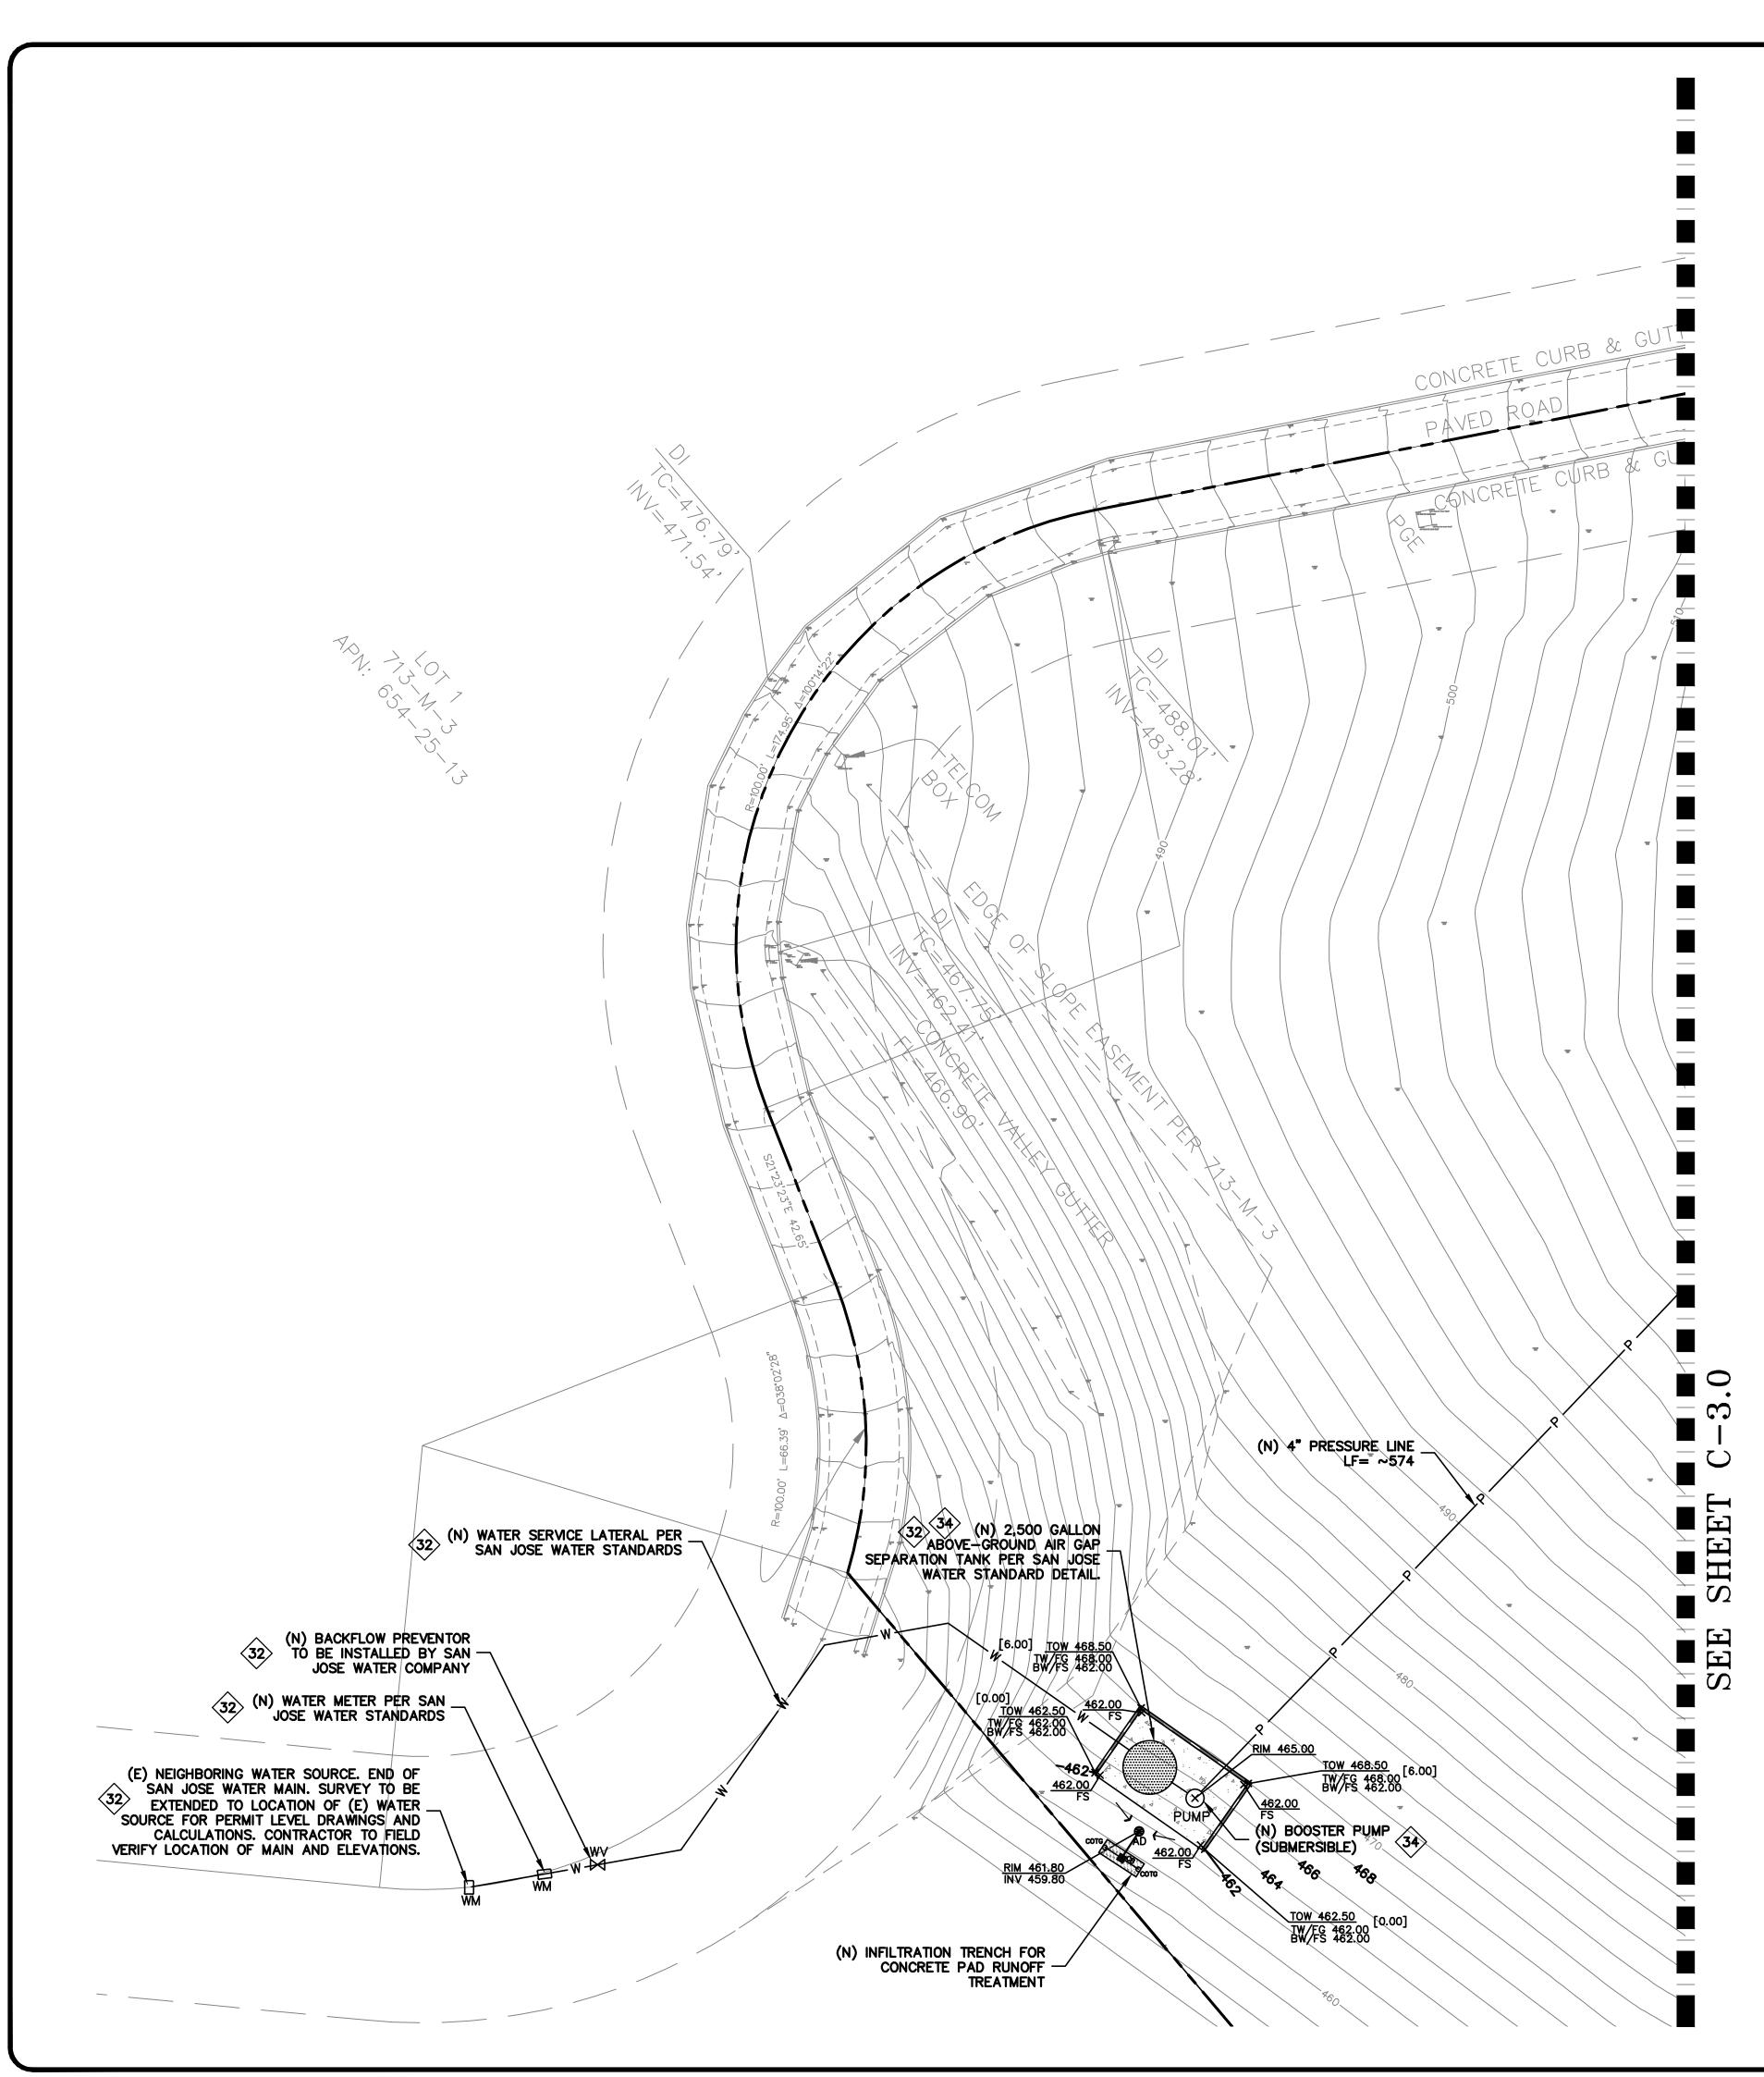

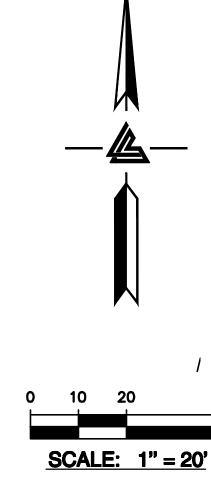

GATE NOTE: PER ARCHITECTURAL TEAM (E) GATE IS LOCATED DOWN THE ROAD (SOUTHWEST). (E) GATE IS MECHANICAL. (E) KNOX KEY SWITCH TO BE UPGRADED AS NEEDED TO BE FUNCTIONAL TO THE FIRE DEPARTMENT.

INC. ENGINEERING, I S I LAND SURVEY S BRAZE STORM DRAIN KEYNOTES (10) to (20)INSTALL (N) ON-SITE STORM DRAIN SYSTEM. USE MINIMUM 6" PVC (SDR 35) OR HDPE (ADS N-12 W/ SMOOTH INTERIOR WALLS). MAINTAIN 24" MINIMUM COVER AND SLOPED AT 1% MINIMUM AT ALL TIMES UNLESS  $\langle 10 \rangle$ <u>ы</u> OTHERWISE NOTED. PROVIDE CLEANOUT TO GRADE AT MAJOR CHANGES IN DIRECTION. AVOID USING 90° BENDS AND INSTEAD USE (2) 45° BENDS AND WYE CONNECTIONS. INSTALL (N) SUBDRAIN. USE PERFORATED 4" PVC (SDR-35) WITH HOLES DOWN AND SLOPED AT 1% MINIMUM SURROUND WITH 3/4" DRAIN ROCK WRAPPED IN FILTER FABRIC (MIRAFI 140N). MIRADRAIN OR OTHER LEA & BRAZE PREAPPROVED DRAINAGE SYSTEM MAY ALSO BE USED. AVOID <11> USING 90° BENDS AND INSTEAD USE (2) 45° BENDS AND WYE CONNECTIONS. PROVIDE CLEANOUT TO GRADE AT MAJOR CHANGES IN DIRECTION AND AT 100' MAXIMUM INTERVALS. SUBDRAIN SHALL REMAIN A DEDICATED SEPARATE SYSTEM UNTIL IT CONNECTS TO STORM DRAIN CT SYSTEM OR OUTFALL AS SHOWN. SEE DETAIL 3 ON SHEET C-4.0.  $\triangleleft$ CONNECT RAIN WATER DOWNSPOUTS TO 4" PVC (SDR-35) TIGHTLINE, SLOPED AT 1% MINIMUM. DIRECT TO NEAREST STORM DRAIN LINE AS T KNOLL SHOWN ON PLANS. PROVIDE CLEANOUT TO GRADE AT MAJOR CHANGES IN CE DIRECTION. AVOID USING 90° BENDS AND INSTEAD USE (2) 45° BENDS. TIGHTLINE MAY BE PLACED IN COMMON TRENCH WITH SUBDRAIN LINES, SIDEN HOWEVER, DO NOT CONNECT TO SUBDRAIN LINES. SEE DETAIL 4 ON SHEET C-4.0. INSTALL (N) 4" DIAMETER BRASS AREA DRAIN (AD) IN HARDSCAPE AREAS (13) (NDS PART 906 PB). SEE DETAIL 5 ON C-4.0.  $\triangleleft$ Ú  $\square$ INSTALL (N) 4" DIAMETER HEAVY DUTY PLASTIC BLACK GRATE IN **(14)** LANDSCAPE OR PLANTER AREAS (NDS PART 78 OR 90 FOR 6" DIAMETER R HEAVY DUTY PLASTIC BLACK GRATE). SEE DETAIL 6 ON C-4.0. •  $\mathcal{O}$ E TRENCH DRAINS SHALL BE 6" NDS "DURA-SLOPE" PRESLOPED TRENCH M A C **<15** DRAINS W/ TRAFFIC RATED GRATE OR APPROVED EQUAL. CONNECT TO JO SLA NEAREST STORM DRAIN LINE VIA 4" PVC TIGHTLINE. Ц (N) SLOT DRAINS SHALL BE ZURN Z888-6 OR APPROVED EQUAL. CONNECT TO NEAREST STORM DRAIN LINE. USE 6" PVC (SDR-35) OR **(16)** Z Ι HDPE (ADS N-12 W/ SMOOTH INTERIOR WALLS).  $\mathbf{\Omega}$  $\triangleleft$ N OI  $\langle 17 \rangle$  INSTALL (N) RETENTION SYSTEM. SEE DETAIL 1 ON SHEET C-4.1.  $\odot$ (18) INSTALL (N) RIP-RAP ENERGY DISSIPATER. SEE DETAIL 3 ON SHEET C-4.1.  $\mathbf{r}$ (19) INSTALL (N) METERED RELEASE OUTLET. SEE DETAIL 2 ON SHEET C-4.1. INSTALL (N) "CHRISTY V-12" CATCH BASIN W/ CONCRETE BOTTOM FLUSH 20> W/ LOWEST OUTGOING INVERT. PLACE BOX ON 6" CLASS 2 AGGREGATE BASE MATERIAL. SEE DETAIL 7 ON SHEET C-4.0. Z UTILITIES KEYNOTES (31) TO (34) K (N) SEWER LATERAL, SEPTIC TANK, AND LEACH FIELD (BY SEPARATE DESIGN). LATERAL SHALL BE 4" PVC (SDR-26 OR BETTER) SLOPED AT 31 Η Ц 2%.  $\langle 32 \rangle$ CONNECT (N) WATER SERVICE PER WATER DISTRICT STANDARDS. INSTALL (N) JOINT TRENCH FOR SERVICES INCLUDING GAS, CATV & ELECTRIC FROM NEAREST POINT OF CONNECTION. DESIGN BY OTHERS. H 33 ILI DETAIL TO BE FINALIZED DURING BUILDING PERMIT LEVEL. FINAL DESIGN FOR ALL WATER TANKS AND ASSOCIATED STRUCTURES ARE TO BE DONE **〈34〉** F BY OTHERS. NOTE: ANY WATER TANKS LOCATED WITHIN 20 FT OF A STRUCTURE ARE TO BE STEEL TANKS. **REVISION 2** 11-05-24 REVISION 2 08-26-24 REVISION 1 05–16–24 REVISIONS JOB NO: 2221253 DATE: 08-07-23 SCALE: AS NOTED \* BUILDING PAD NOTE: NOTE: DESIGN BY: ZA ADJUST PAD LEVEL AS FOR CONSTRUCTION STAKING REQUIRED. REFER TO SCHEDULING OR QUOTATIONS CHECKED BY: JH STRUCTURAL PLANS PLEASE CONTACT ALEX ABAYA FOR SLAB SECTION OR SHEET NO: CRAWL SPACE DEPTH AT LEA & BRAZE ENGINEERING TO ESTABLISH PAD (510)887-4086 EXT 116.

LEVEL.

aabaya@leabraze.com

ZA


ZA


ZA

ΒY

**C-3.1** 

7 OF 10 SHEETS

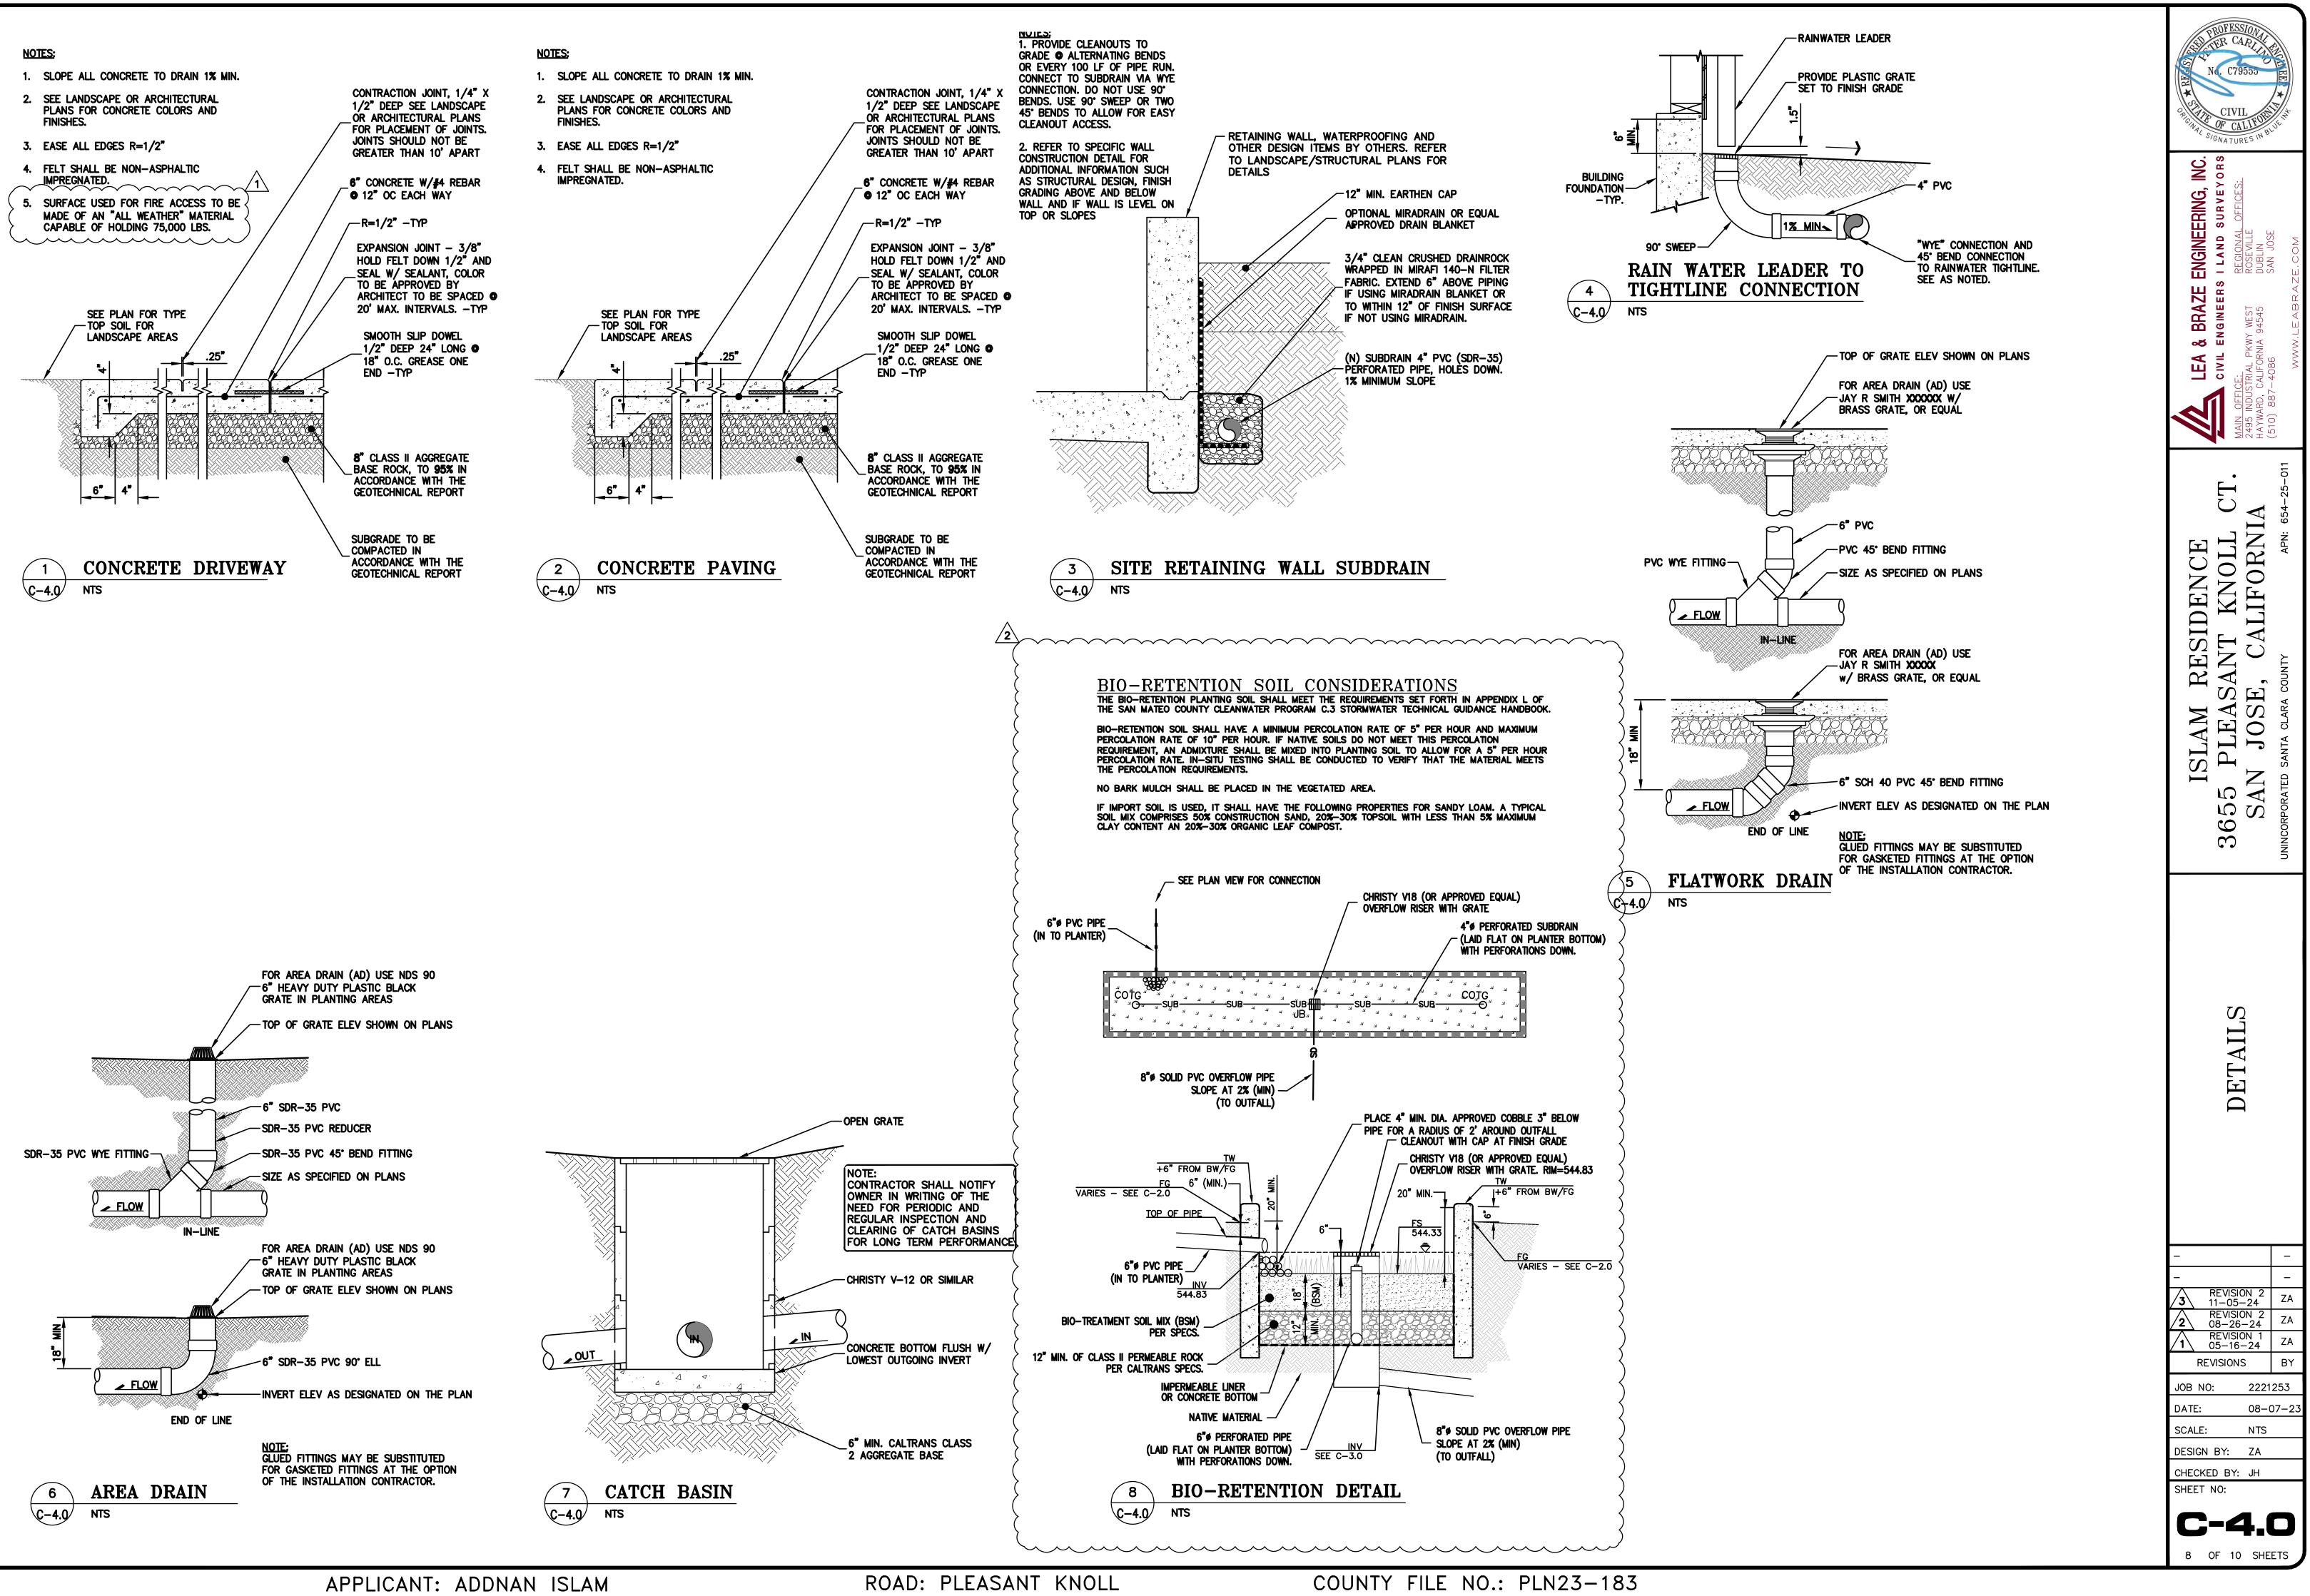

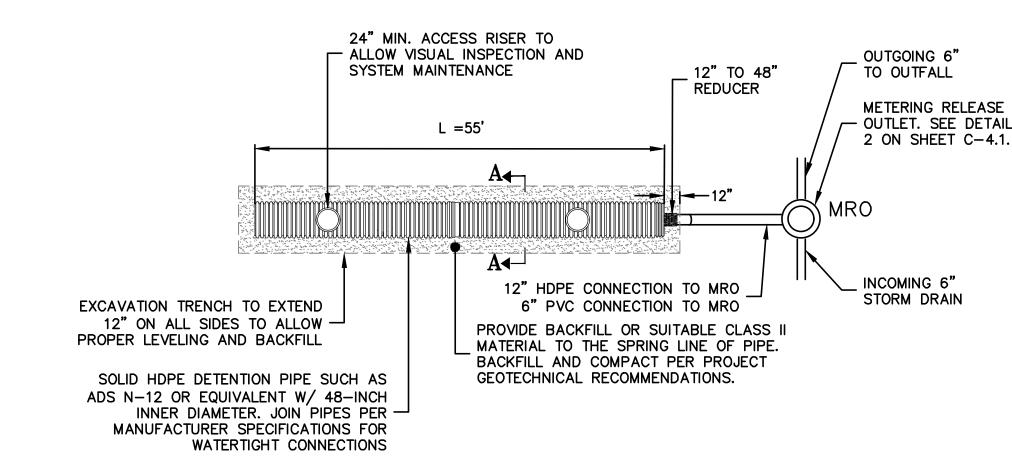

# PLAN VIEW

STORAGE PIPE	NOMINAL	MIN. SIDE
NOMINAL I.D.	O.D.	COVER
48"	54"	12"
(1200 MM)	(1372 MM)	(292 MM)

1. ALL REFERENCES TO CLASS I OR II MATERIAL ARE PER ASTM D2321 "STANDARD PRACTICE FOR

NOTES:

UNDERGROUND INSTALLATION OF THERMOPLASTIC PIPE FOR SEWERS AND OTHER GRAVITY FLOW APPLICATIONS", LATEST EDITION.


2. ALL RETENTION AND DETENTION SYSTEMS SHALL BE INSTALLED IN ACCORDANCE WITH ASTM D2321, LATEST EDITION AND THE MANUFACTURER'S PUBLISHED INSTALLATION GUIDELINES.


3. MEASURES SHOULD BE TAKEN TO PREVENT THE MIGRATION OF NATIVE FINES INTO THE BACKFILL MATERIAL, WHEN REQUIRED. SEE ASTM D2321.


4. FILTER FABRIC: A GEOTEXTILE FABRIC MAY BE USED AS SPECIFIED BY THE ENGINEER TO PREVENT THE MIGRATION OF FINES FROM THE NATIVE SOIL INTO THE SELECT BACKFILL MATERIAL.

TRENCH BOTTOM MAY BE STABILIZED USING A GEOTEXTILE MATERIAL.

5. <u>FOUNDATION:</u> WHERE THE TRENCH BOTTOM IS UNSTABLE, THE CONTRACTOR SHALL EXCAVATE TO A DEPTH REQUIRED BY THE ENGINEER AND REPLACE WITH SUITABLE MATERIAL AS SPECIFIED BY THE ENGINEER. AS AN ALTERNATIVE AND AT THE DISCRETION OF THE DESIGN ENGINEER, THE

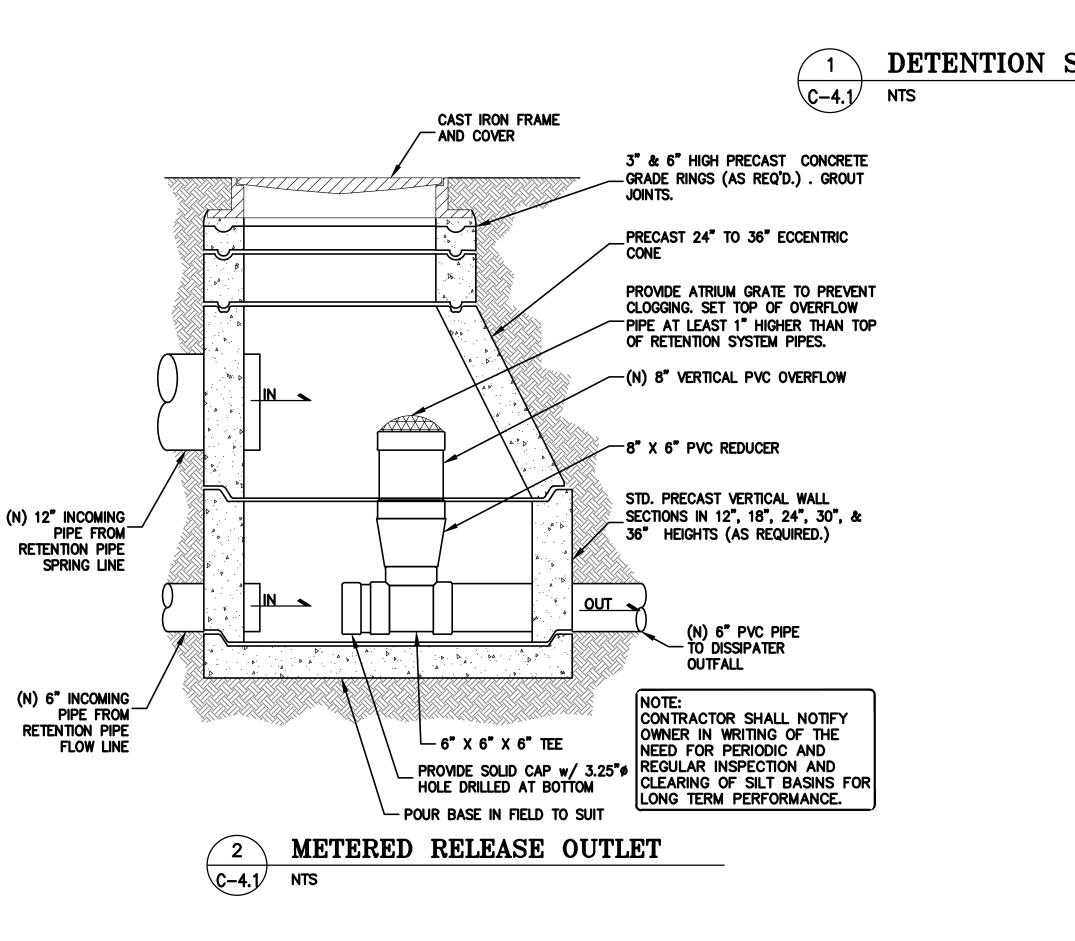





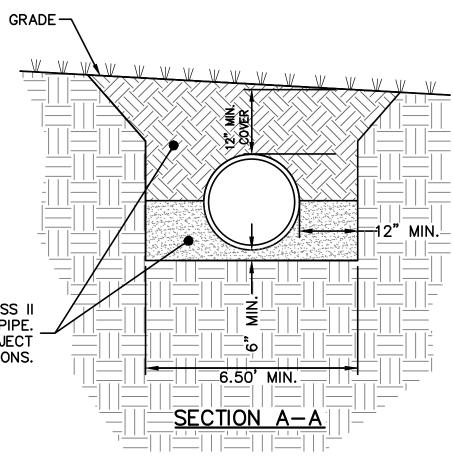

PROVIDE BACKFILL OR SUITABLE CLASS II MATERIAL TO THE SPRING LINE OF PIPE. BACKFILL AND COMPACT PER PROJECT

# DETENTION SYSTEM DETAIL

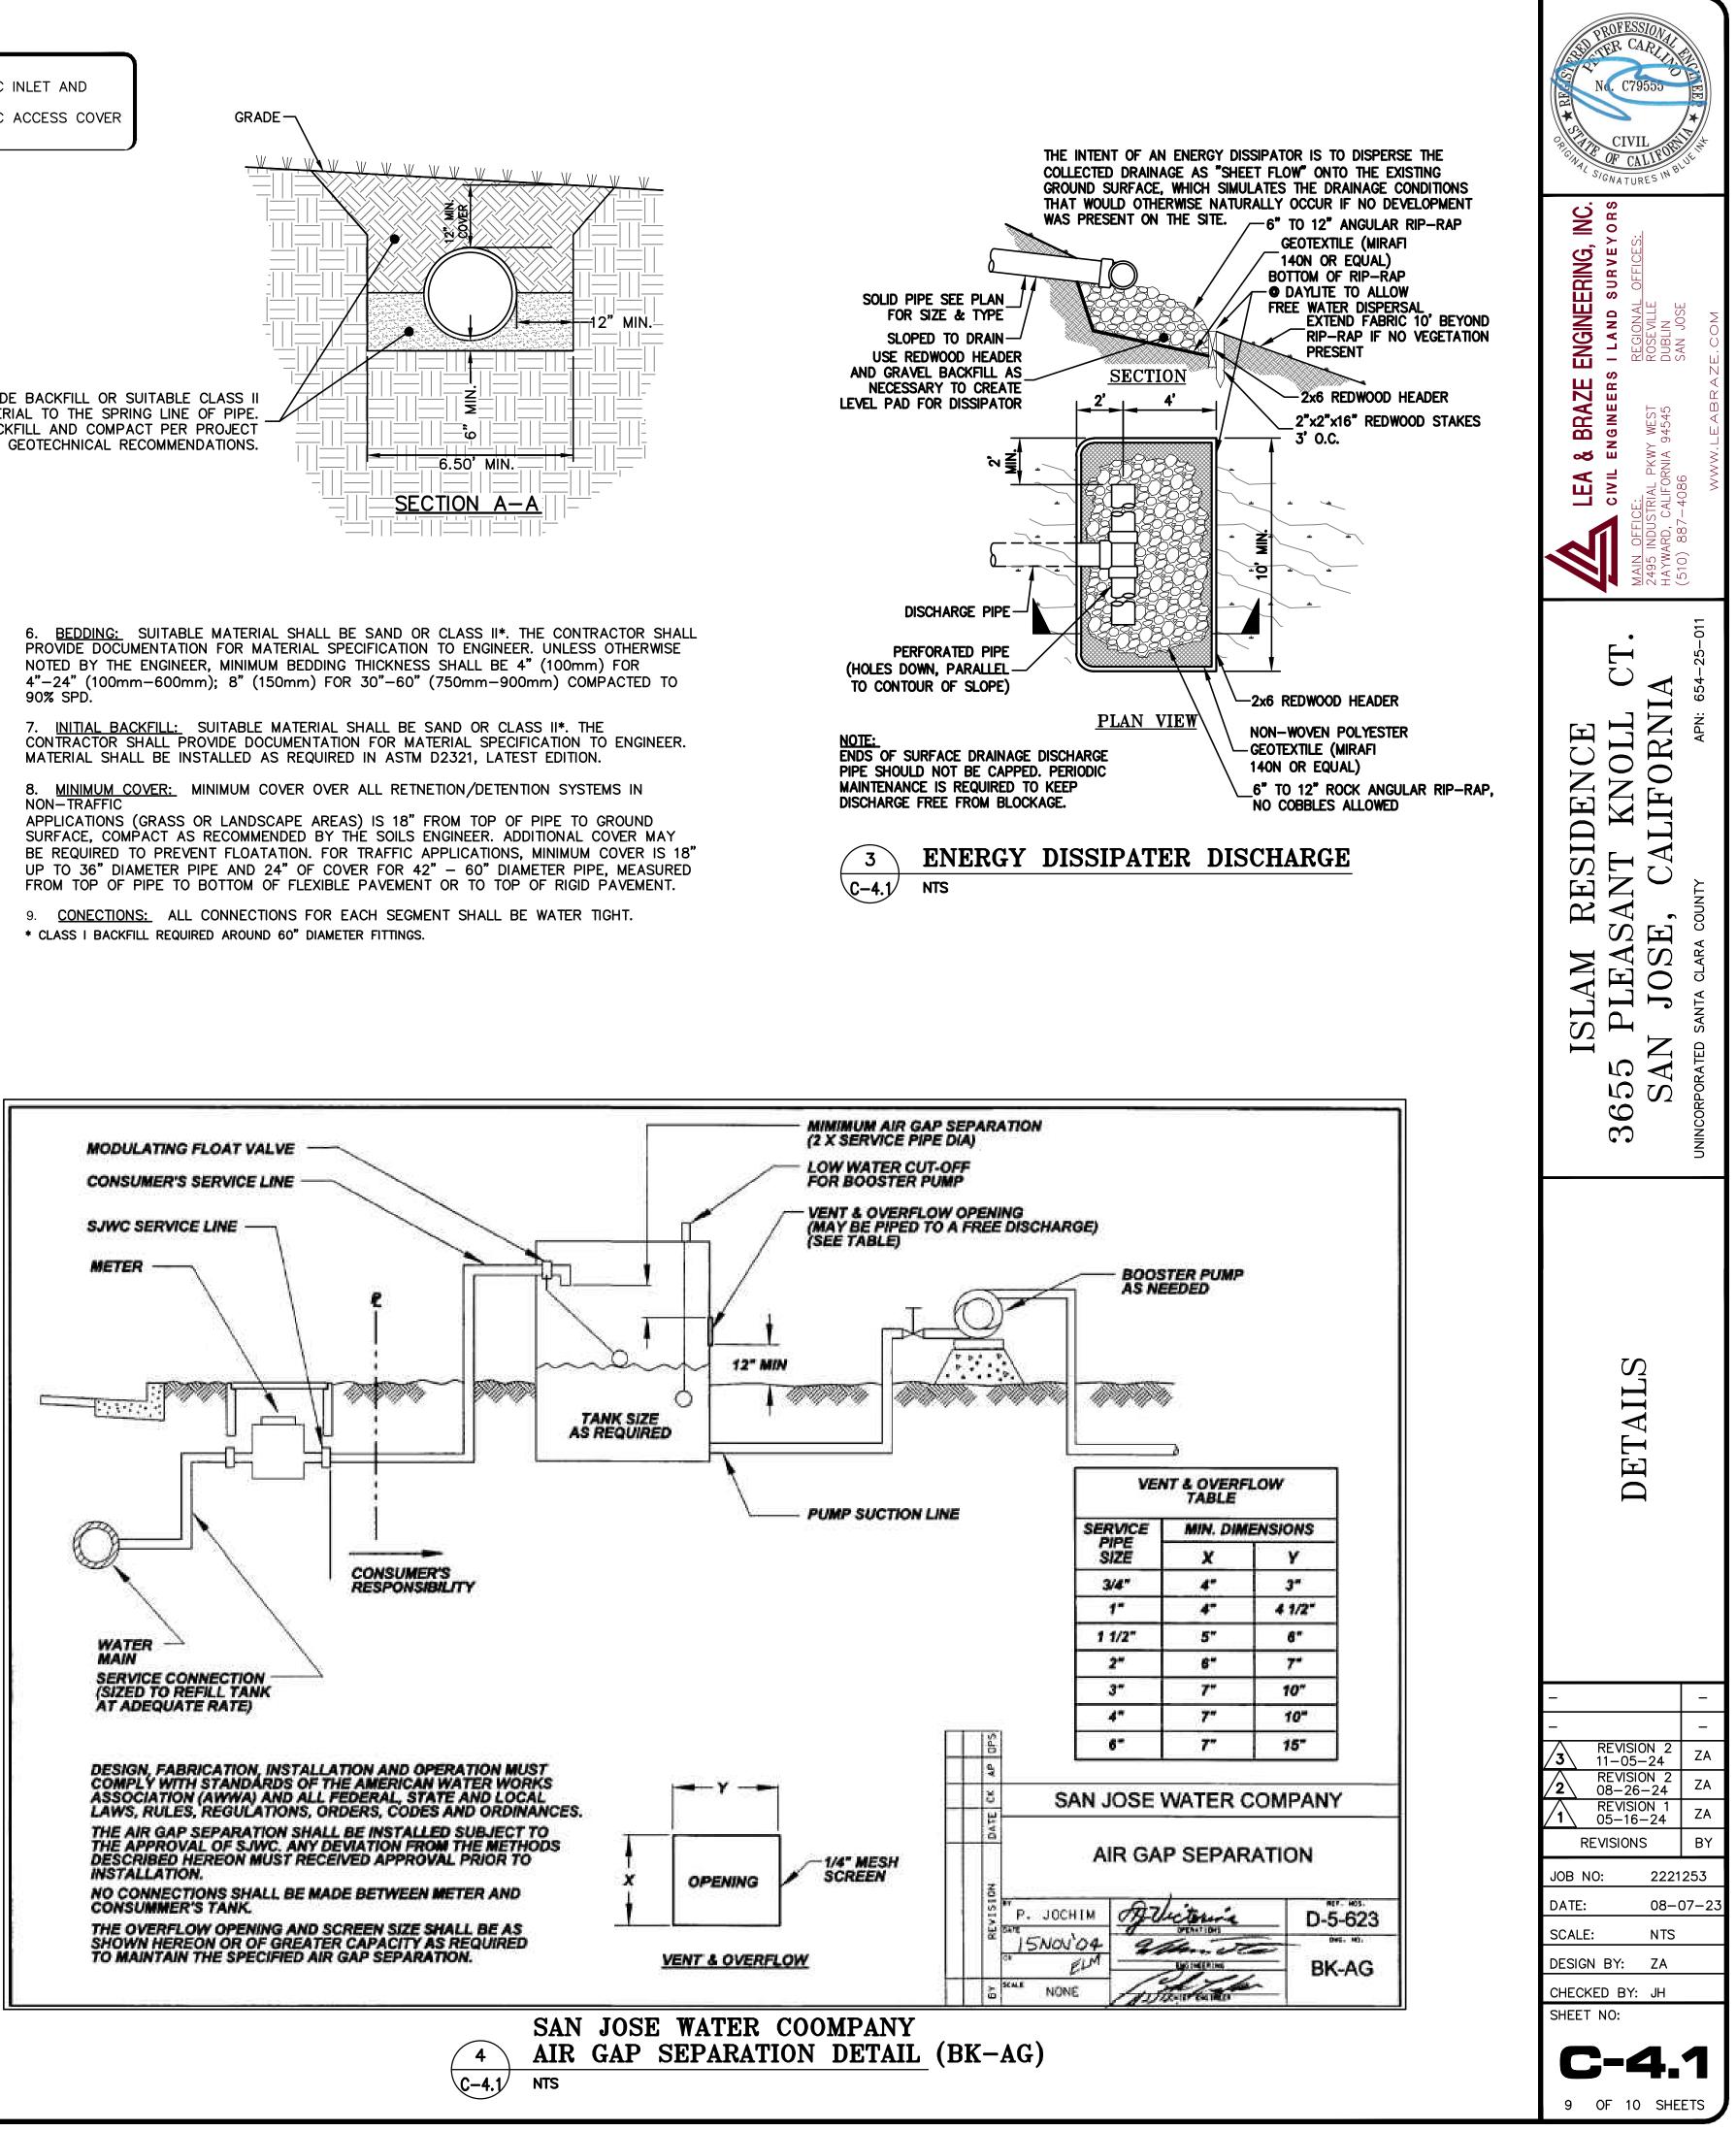

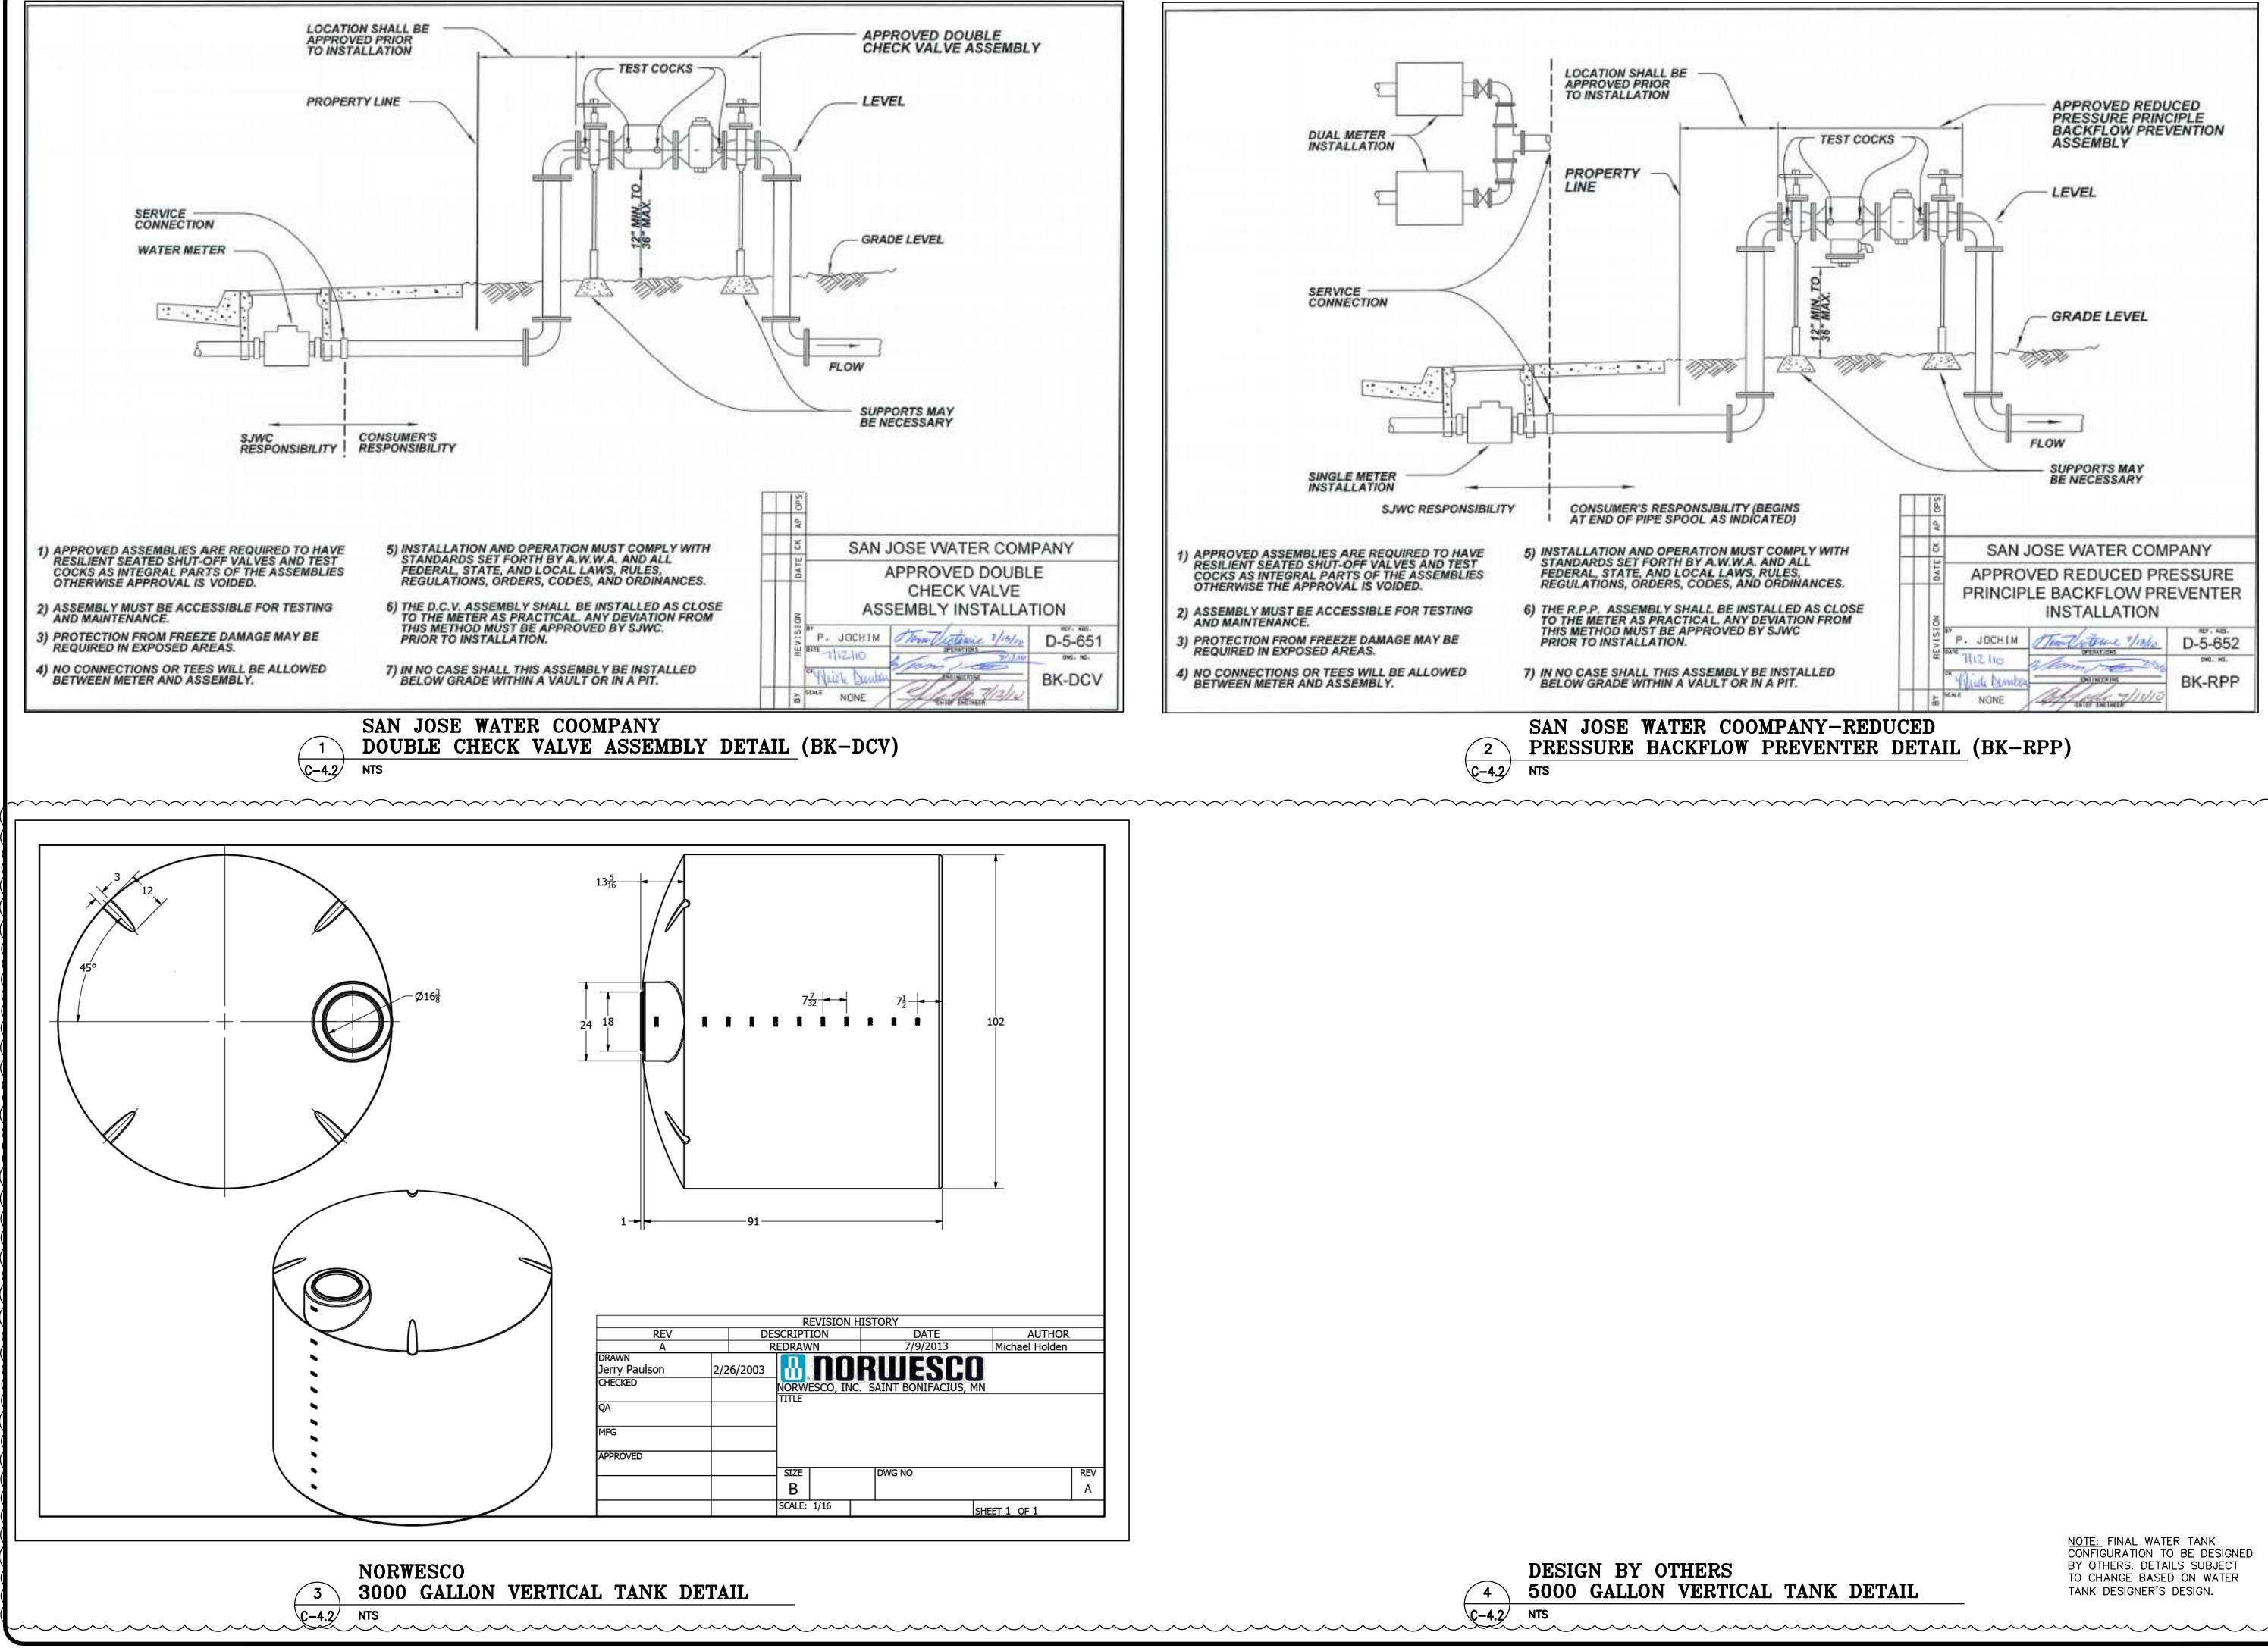

APPLICANT: ADDNAN ISLAM

KNOLL LIFORN SIDENCE F Ú Ξ R •  $\mathcal{O}$ E A N M JO LA Ц  $\mathcal{O}$ Z Ι  $\mathbf{r}$  $\mathcal{O}$ Π  $\triangleleft$ H Ē  $\square$ **REVISION 2** 3 11-05-24 2 REVISION 2 08-26-24 REVISION 1 05-16-24 REVISIONS JOB NO: 2221253 DATE: 08-07-2 NTS SCALE: DESIGN BY: ZA CHECKED BY: JH SHEET NO: C-4.210 OF 10 SHEETS

GNATUR

INC.

ENGINEERING,

BRAZE

త

LEA civil

Ξ

 $\bigcirc$ 

 $\triangleleft$ 

တ

# GENERAL NOTES

ALL GENERAL NOTES, SHEET NOTES, AND LEGEND NOTES FOUND IN THESE DOCUMENTS SHALL APPLY TYPICALLY THROUGHOUT. IF INCONSISTENCIES ARE FOUND IN THE VARIOUS NOTATIONS, NOTIFY THE ENGINEER IMMEDIATELY IN WRITING REQUESTING CLARIFICATION.

THESE DRAWINGS AND THEIR CONTENT ARE AND SHALL REMAIN THE PROPERTY OF LEA AND BRAZE ENGINEERING, INC. WHETHER THE PROJECT FOR WHICH THEY ARE PREPARED IS EXECUTED OR NOT. THEY ARE NOT TO BE USED BY ANY PERSONS ON OTHER PROJECTS OR EXTENSIONS OF THE PROJECT EXCEPT BY AGREEMENT IN WRITING AND WITH APPROPRIATE COMPENSATION TO THE ENGINEER.

ALL WORK SHALL COMPLY WITH APPLICABLE CODES AND TRADE STANDARDS WHICH GOVERN EACH PHASE OF WORK INCLUDING, BUT NOT LIMITED TO, CALIFORNIA MECHANICAL CODE, CALIFORNIA PLUMBING CODE, CALIFORNIA ELECTRICAL CODE, CALIFORNIA FIRE CODE, CALTRANS STANDARDS AND SPECIFICATIONS, AND ALL APPLICABLE STATE AND/OR LOCAL CODES AND/OR LEGISLATION.

IT IS THE RESPONSIBILITY OF THE CONTRACTOR AND ALL SUBCONTRACTORS TO CHECK AND VERIFY ALL CONDITIONS, DIMENSIONS, LINES AND LEVELS INDICATED. PROPER FIT AND ATTACHMENT OF ALL PARTS IS REQUIRED. SHOULD THERE BE ANY DISCREPANCIES, IMMEDIATELY NOTIFY THE ENGINEER FOR CORRECTION OR ADJUSTMENT THE EVENT OF FAILURE TO DO SO, THE CONTRACTOR SHALL BE RESPONSIBLE FOR CORRECTION OF ANY ERROR.

ALL DIMENSIONS AND CONDITIONS SHALL BE CHECKED AND VERIFIED ON THE JOB BY EACH SUBCONTRACTOR BEFORE HE/SHE BEGINS HIS/HER WORK. ANY ERRORS, OMISSION, OR DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE OWNER/CONTRACTOR BEFORE CONSTRUCTION BEGINS.

COMMENCEMENT OF WORK BY THE CONTRACTOR AND/OR ANY SUBCONTRACTOR SHALL INDICATE KNOWLEDGE AND ACCEPTANCE OF ALL CONDITIONS DESCRIBED IN THESE CONSTRUCTION DOCUMENTS, OR EXISTING ON SITE, WHICH COULD AFFECT THEIR WORK.

# WORK SEQUENCE

IN THE EVENT ANY SPECIAL SEQUENCING OF THE WORK IS REQUIRED BY THE OWNER OR THE CONTRACTOR, THE CONTRACTOR SHALL ARRANGE A CONFERENCE BEFORE ANY SUCH WORK IS BEGUN.

SITE EXAMINATION: THE CONTRACTOR AND ALL SUBCONTRACTORS SHALL THOROUGHLY EXAMINE THE SITE AND FAMILIARIZE HIM/HERSELF WITH THE CONDITIONS UNDER WHICH THE WORK IS TO BE PERFORMED. THE CONTRACTOR SHALL VERIFY AT THE SITE ALL MEASUREMENTS AFFECTING HIS/HER WORK AND SHALL BE RESPONSIBLE FOR THE CORRECTIONS OF THE SAME. NO EXTRA COMPENSATION WILL BE ALLOWED TO THE CONTRACTOR FOR EXPENSES DUE TO HIS/HER NEGLECT TO EXAMINE, OR FAILURE TO DISCOVER, CONDITIONS WHICH AFFECT HIS/HER WORK.

LEA AND BRAZE ENGINEERING, INC. EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO A THIRD PARTY WITHOUT FIRST OBTAINING THE WRITTEN PERMISSION AND CONSENT OF LEA AND BRAZE ENGINEERING, INC. IN THE EVENT OF UNAUTHORIZED REUSE OF THESE PLANS BY A THIRD PARTY, THE THIRD PARTY SHALL HOLD HARMLESS LEA AND BRAZE ENGINEERING, INC.

CONSTRUCTION IS ALWAYS LESS THAN PERFECT SINCE PROJECTS REQUIRE THE COORDINATION AND INSTALLATION OF MANY INDIVIDUAL COMPONENTS BY VARIOUS CONSTRUCTION INDUSTRY TRADES. THESE DOCUMENTS CANNOT PORTRAY ALL COMPONENTS OR ASSEMBLIES EXACTLY. IT IS THE INTENTION OF THESE ENGINEERING DOCUMENTS THAT THEY REPRESENT A REASONABLE STANDARD OF CARE IN THEIR CONTENT. IT IS ALSO PRESUMED BY THESE DOCUMENTS THAT CONSTRUCTION REVIEW SERVICES WILL BE PROVIDED BY THE ENGINEER. SHOULD THE OWNER NOT RETAIN THE ENGINEER TO PROVIDE SUCH SERVICES, OR SHOULD HE/SHE RETAIN THE ENGINEER TO PROVIDE ONLY PARTIAL OR LIMITED SERVICES, THEN IT SHALL BE THE OWNER'S AND CONTRACTOR'S RESPONSIBILITY TO FULLY RECOGNIZE AND PROVIDE THAT STANDARD OF CARE.

IF THE OWNER OR CONTRACTOR OBSERVES OR OTHERWISE BECOMES AWARE OF ANY FAULT OR DEFECT IN THE PROJECT OR NONCONFORMANCE WITH THE CONTRACT DOCUMENTS, PROMPT WRITTEN NOTICE THEREOF SHALL BE GIVEN BY THE OWNER AND/OR CONTRACTOR TO THE ENGINEER.

THE ENGINEER SHALL NOT HAVE CONTROL OF OR CHARGE OF AND SHALL NOT BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK, FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, SUBCONTRACTORS, OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK, OR FOR THE FAILURE OF ANY OF THEM TO CARRY OUT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

# SITE PROTECTION

PROTECT ALL LANDSCAPING THAT IS TO REMAIN. ANY DAMAGE OR LOSS RESULTING FROM EXCAVATION. GRADING, OR CONSTRUCTION WORK SHALL BE CORRECTED OR REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE LOCATION OF ALL EXISTING SITE UTILITIES AND SHALL COORDINATE THEIR REMOVAL OR MODIFICATIONS (IF ANY) TO AVOID ANY INTERRUPTION OF SERVICE TO ADJACENT AREAS. THE GENERAL CONTRACTOR SHALL INFORM HIM/HERSELF OF MUNICIPAL REGULATIONS AND CARRY OUT HIS/HER WORK IN COMPLIANCE WITH ALL FEDERAL AND STATE REQUIREMENTS TO REDUCE FIRE HAZARDS AND INJURIES TO THE PUBLIC.

# STORMWATER POLLUTION PREVENTION NOTES

- 1) STORE, HANDLE, AND DISPOSE OF CONSTRUCTION MATERIALS AND WASTES PROPERLY, SO AS TO PREVENT THEIR CONTACT WITH STORMWATER.
- 2) CONTROL AND PREVENT THE DISCHARGE OF ALL POTENTIAL POLLUTANTS, INCLUDING SOLID WASTES, PAINTS, CONCRETE, PETROLEUM PRODUCTS, CHEMICALS, WASH WATER OR SEDIMENT, AND NON-STORMWATER DISCHARGES TO STORM DRAINS AND WATER COURSES.
- 3) USE SEDIMENT CONTROL OR FILTRATION TO REMOVE SEDIMENT FROM DEWATERING EFFLUENT.
- 4) AVOID CLEANING, FUELING, OR MAINTAINING VEHICLES ON SITE, EXCEPT IN A DESIGNATED AREA IN WHICH RUNOFF IS CONTAINED AND TREATED.
- 5) DELINEATE CLEARING LIMITS, EASEMENTS, SETBACKS, SENSITIVE OR CRITICAL AREAS, BUFFER ZONES, TREES AND DISCHARGE COURSE WITH FIELD MARKERS.
- 6) PROTECT ADJACENT PROPERTIES AND UNDISTURBED AREAS FROM CONSTRUCTION IMPACTS USING VEGETATIVE BUFFER STRIPS, SEDIMENT BARRIERS OF FILTERS, DIKES, MULCHING, OR OTHER MEASURES AS APPROPRIATE.
- 7) PERFORM CLEARING AND EARTH MOVING ACTIVITIES DURING DRY WEATHER TO THE MAXIMUM EXTENT PRACTICAL.
- 8) LIMIT AND TIME APPLICATIONS OF PESTICIDES AND FERTILIZERS TO PREVENT POLLUTED RUNOFF.
- 9) LIMIT CONSTRUCTION ACCESS ROUTES AND STABILIZE DESIGNATED ACCESS POINTS.
- 10) AVOID TRACKING DIRT OR MATERIALS OFF-SITE; CLEAN OFF-SITE PAVED AREAS AND SIDEWALKS USING DRY SWEEPING METHODS TO THE MAXIMUM EXTENT PRACTICAL.

# SUPPLEMENTAL MEASURES

- A. THE PHRASE "NO DUMPING DRAINS TO BAY" OR EQUALLY EFFECTIVE PHRASE MUST BE LABELED ON STORM DRAIN INLETS (BY STENCILING, BRANDING, OR PLAQUES) TO ALERT THE PUBLIC TO THE DESTINATION OF STORM WATER AND TO PREVENT DIRECT DISCHARGE OF POLLUTANTS INTO THE STORM DRAIN.
- B. USING FILTRATION MATERIALS ON STORM DRAIN COVERS TO REMOVE SEDIMENT FROM DEWATERING EFFLUENT.
- C. STABILIZING ALL DENUDED AREAS AND MAINTAINING EROSION CONTROL MEASURES CONTINUOUSLY FROM OCTOBER 15 AND APRIL 15.
- D. REMOVING SPOILS PROMPTLY, AND AVOID STOCKPILING OF FILL MATERIALS, WHEN RAIN IS FORECAST. IF RAIN THREATENS, STOCKPILED SOILS AND OTHER MATERIALS SHALL BE COVERED WITH A TARP OR OTHER WATERPROOF MATERIAL.
- E. STORING, HANDLING, AND DISPOSING OF CONSTRUCTION MATERIALS AND WASTES SO AS TO AVOID THEIR ENTRY TO THE STORM DRAIN SYSTEMS OR WATER BODY.
- F. AVOIDING CLEANING, FUELING, OR MAINTAINING VEHICLES ON-SITE, EXCEPT IN AN AREA DESIGNATED TO CONTAIN AND TREAT RUNOFF.

# GRADING & DRAINAGE NOTES:

1. <u>SCOPE OF WORK</u>

THESE SPECIFICATIONS AND APPLICABLE PLANS PERTAIN TO AND INCLUDE ALL SITE GRADING AND EARTHWORK ASSOCIATED WITH THE PROJECT INCLUDING, BUT NOT LIMITED TO THE FURNISHING OF ALL LABOR, TOOLS AND EQUIPMENT NECESSARY FOR SITE CLEARING AND GRUBBING, SITE PREPARATION, DISPOSAL OF EXCESS OR UNSUITABLE MATERIAL, STRIPPING, KEYING, EXCAVATION, OVER EXCAVATION, RECOMPACTION PREPARATION FOR SOIL RECEIVING FILL, PAVEMENT, FOUNDATION OF SLABS, EXCAVATION, IMPORTATION OF ANY REQUIRED FILL MATERIAL, PROCESSING, PLACEMENT AND COMPACTION OF FILL AND SUBSIDIARY WORK NECESSARY TO COMPLETE THE GRADING TO CONFORM TO THE LINES, GRADING AND SLOPE SHOWN ON THE PROJECT GRADING PLANS.

- 2. <u>GENERAL</u>
  - SPECIFICATIONS, THE SOILS REPORT BY QUANTUM GEOTECHNICAL; AND THE COUNTY OF SANTA CLARA.
  - AS SHOWN ON PLANS, BUT NO STEEPER THAN TWO (2) HORIZONTAL TO ONE (1) VERTICAL.
  - INCLUDING CLEARING.

## CLEARING AND GRUBBING 3.

- DISPOSED OF OFF THE SITE BY THE CONTRACTOR.
- FOLLOWING METHODS WILL BE USED:
- (2) EXCAVATE AND CRUSH THE UTILITY LINE IN THE TRENCH.
- SITE PREPARATION AND STRIPPING
- COMPACTED FILL AND PAVEMENT AREAS.
- iummocks or other uneven features which may inh REQUIREMENTS FOR COMPACTING FILL MATERIAL.
- EXCAVATION
- B. EXCAVATED MATERIALS SUITABLE FOR COMPACTED FILL MATERIAL SHALL BE UTILIZED IN MAKING THE SHALL BE DISPOSED OF OFF THE SITE BY THE CONTRACTOR.

A. ALL SITE GRADING AND EARTHWORK SHALL CONFORM TO THE RECOMMENDATIONS OF THESE

B. ALL FILL MATERIALS SHALL BE DENSIFIED SO AS TO PRODUCE A DENSITY NOT LESS THAN 90% RELATIVE COMPACTION BASED UPON ASTM TEST DESIGNATION D1557. FIELD DENSITY TEST WILL BE PERFORMED IN ACCORDANCE WITH ASTM TEST DESIGNATION 2922 AND 3017. THE LOCATION AND FREQUENCY OF THE FIELD DENSITY TEST WILL BE AS DETERMINED BY THE SOIL ENGINEER. THE RESULTS OF THESE TEST AND COMPLIANCE WITH THE SPECIFICATIONS WILL BE THE BASIS UPON WHICH SATISFACTORY COMPLETION OF THE WORK WILL BE JUDGED BY THE SOIL ENGINEER. ALL CUT AND FILL SLOPES SHALL BE CONSTRUCTED

C. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SATISFACTORY COMPLETION OF ALL THE EARTHWORK IN ACCORDANCE WITH THESE PLANS AND SPECIFICATIONS. NO DEVIATION FROM THESE SPECIFICATIONS SHALL BE MADE EXCEPT UPON WRITTEN APPROVAL BY THE SOILS ENGINEER. BOTH CUT AND FILL AREAS SHALL BE SURFACE COMPLETED TO THE SATISFACTION OF THE SOILS ENGINEER AT THE CONCLUSION OF ALL GRADING OPERATIONS AND PRIOR TO FINAL ACCEPTANCE. THE CONTRACTOR SHALL NOTIFY THE SOILS ENGINEER AT LEAST TWO (2) WORKING DAYS PRIOR TO DOING ANY SITE GRADING AND EARTHWORK

A. THE CONTRACTOR SHALL ACCEPT THE SITE IN ITS PRESENT CONDITION. ALL EXISTING PUBLIC IMPROVEMENTS SHALL BE PROTECTED. ANY IMPROVEMENTS DAMAGED SHALL BE REPLACED BY THE CONTRACTOR AS DIRECTED BY THE LOCAL JURISDICTION WITH NO EXTRA COMPENSATION.

B. ALL ABANDONED BUILDINGS AND FOUNDATIONS, TREE (EXCEPT THOSE SPECIFIED TO REMAIN FOR LANDSCAPING PURPOSES), FENCES, VEGETATION AND ANY SURFACE DEBRIS SHALL BE REMOVED AND

C. ALL ABANDONED SEPTIC TANKS AND ANY OTHER SUBSURFACE STRUCTURES EXISTING IN PROPOSED DEVELOPMENT AREAS SHALL BE REMOVED PRIOR TO ANY GRADING OR FILL OPERATION. ALL APPURTENANT DRAIN FIELDS AND OTHER CONNECTING LINES MUST ALSO BE TOTALLY REMOVED.

D. ALL ABANDONED UNDERGROUND IRRIGATION OR UTILITY LINES SHALL BE REMOVED OR DEMOLISHED. THE APPROPRIATE FINAL DISPOSITION OF SUCH LINES DEPEND UPON THEIR DEPTH AND LOCATION AND THE METHOD OF REMOVAL OR DEMOLITION SHALL BE DETERMINED BY THE SOILS ENGINEER. ONE OF THE

(1) EXCAVATE AND TOTALLY REMOVE THE UTILITY LINE FROM THE TRENCH.

(3) CAP THE ENDS OF THE UTILITY LINE WITH CONCRETE TO PREVENT THE ENTRANCE OF WATER. THE LOCATIONS AT WHICH THE UTILITY LINE WILL BE CAPPED WILL BE DETERMINED BY THE UTILITY DISTRICT ENGINEER. THE LENGTH OF THE CAP SHALL NOT BE LESS THAN FIVE FEET, AND THE CONCRETED MIX EMPLOYED SHALL HAVE MINIMUM SHRINKAGE.

A. ALL SURFACE ORGANICS SHALL BE STRIPPED AND REMOVED FROM BUILDING PADS, AREAS TO RECEIVE

B. UPON THE COMPLETION OF THE ORGANIC STRIPPING OPERATION, THE GROUND SURFACE (NATIVE SOIL SUBGRADE) OVER THE ENTIRE AREA OF ALL BUILDING PADS. STREET AND PAVEMENT AREAS AND ALL AREAS TO RECEIVE COMPACTED FILL SHALL BE PLOWED OR SCARIFIED UNTIL THE SURFACE IS FREE OF UNIFORM SOIL COMPACTION. T GROUND SURFACE SHALL THEN BE DISCED OR BLADED TO A DEPTH OF AT LEAST 6 INCHES. UPON ENGINEER'S SATISFACTION. THE NEW SURFACE SHALL BE WATER CONDITIONED AND RECOMPACTED PER

A. UPON COMPLETION OF THE CLEARING AND GRUBBING, SITE PREPARATION AND STRIPPING, THE CONTRACTOR SHALL MAKE EXCAVATIONS TO LINES AND GRADES NOTED ON THE PLAN. WHERE REQUIRED BY THE SOILS ENGINEER. UNACCEPTABLE NATIVE SOILS OR UNENGINEERED FILL SHALL BE OVER EXCAVATED BELOW THE DESIGN GRADE. SEE PROJECT SOILS REPORT FOR DISCUSSION OF OVER EXCAVATION OF THE UNACCEPTABLE MATERIAL. RESULTING GROUND LINE SHALL BE SCARIFIED, MOISTURE-CONDITIONED AND RECOMPACTED AS SPECIFIED IN SECTION 4 OF THESE SPECIFICATIONS. COMPACTED FILL MATERIAL SHALL BE PLACED TO BRING GROUND LEVEL BACK TO DESIGN GRADE.

REQUIRED COMPACTED FILLS. THOSE NATIVE MATERIALS CONSIDERED UNSUITABLE BY THE SOILS ENGINEER

PLACING. SPREADING AND COMPACTING FILL MATERIAL

A. FILL MATERIALS

THE MATERIALS PROPOSED FOR USE AS COMPACTED FILL SHALL BE APPROVED BY THE SOILS ENGINEER BEFORE COMMENCEMENT OF GRADING OPERATIONS. THE NATIVE MATERIAL IS CONSIDERED SUITABLE FOR FILL: HOWEVER, ANY NATIVE MATERIAL DESIGNATED UNSUITABLE BY THE SOILS ENGINEER SHALL BE REMOVED FROM THE SITE BY THE CONTRACTOR. ANY IMPORTED MATERIAL SHALL BE APPROVED FOR use by the soils engineer, in writing, before being imported to the site and shall possess SUFFICIENT FINES TO PROVIDE A COMPETENT SOIL MATRIX AND SHALL BE FREE OF VEGETATIVE AND ORGANIC MATTER AND OTHER DELETERIOUS MATERIALS. ALL FILL VOIDS SHALL BE FILLED AND PROPERLY COMPACTED. NO ROCKS LARGER THAN THREE INCHES IN DIAMETER SHALL BE PERMITTED.

**B. FILL CONSTRUCTION** 

THE SOILS ENGINEER SHALL APPROVE THE NATIVE SOIL SUBGRADE BEFORE PLACEMENT OF ANY COMPACTED FILL MATERIAL. UNACCEPTABLE NATIVE SOIL SHALL BE REMOVED AS DIRECTED BY THE SOILS ENGINEER. THE RESULTING GROUND LINE SHALL BE SCARIFIED MOISTURE CONDITIONED AND RECOMPACTED AS SPECIFIED IN SECTION 4 OF THESE SPECIFICATIONS. COMPACTED FILL MATERIAL SHALL BE PLACED TO BRING GROUND LEVEL BACK TO DESIGN GRADE. GROUND PREPARATION SHALL BE FOLLOWED CLOSELY BY FILL PLACEMENT TO PREVENT DRYING OUT OF THE SUBSOIL BEFORE PLACEMENT of the fill.

THE APPROVED FILL MATERIALS SHALL BE PLACED IN UNIFORM HORIZONTAL LAYERS NO THICKER THAN 8" IN LOOSE THICKNESS, LAYERS SHALL BE SPREAD EVENLY AND SHALL BE THOROUGHLY BLADE MIXED DURING THE SPREADING TO ENSURE UNIFORMITY OF MATERIAL IN EACH LAYER. THE SCARIFIED SUBGRADE AND FILL MATERIAL SHALL BE MOISTURE CONDITIONED TO AT LEAST OPTIMUM MOISTURE. when the moisture content of the fill is below that specified, water shall be added until THE MOISTURE DURING THE COMPACTION PROCESS. WHEN THE MOISTURE CONTENT OF THE FILL IS ABOVE THAT SPECIFIED. THE FILL MATERIAL SHALL BE AERATED BY BLADING OR OTHER SATISFACTORY METHODS UNTIL THE MOISTURE CONTENT IS AS SPECIFIED.

AFTER EACH LAYER HAS BEEN PLACED, MIXED, SPREAD EVENLY AND MOISTURE CONDITIONED, IT SHALL BE COMPACTED TO AT LEAST THE SPECIFIED DENSITY.

THE FILL OPERATION SHALL BE CONTINUED IN COMPACTED LAYERS AS SPECIFIED ABOVE UNTIL THE FILL HAS BEEN BROUGHT TO THE FINISHED SLOPES AND GRADES AS SHOWN ON THE PLANS. NO LAYER SHALL BE ALLOWED TO DRY OUT BEFORE SUBSEQUENT LAYERS ARE PLACED.

COMPACTION EQUIPMENT SHALL BE OF SUCH DESIGN THAT IT WILL BE ABLE TO COMPACT THE FILL TO THE SPECIFIED MINIMUM COMPACTION WITHIN THE SPECIFIED MOISTURE CONTENT RANGE. COMPACTION OF EACH LAYER SHALL BE CONTINUOUS OVER ITS ENTIRE AREA UNTIL THE REQUIRED MINIMUM DENSITY HAS BEEN OBTAINED.

7. CUT OR FILL SLOPES

> ALL CONSTRUCTED SLOPES, BOTH CUT AND FILL, SHALL BE NO STEEPER THAN 2 TO 1 (HORIZONTAL TO VERTICAL). DURING THE GRADING OPERATION, COMPACTED FILL SLOPES SHALL BE OVERFILLED BY AT LEAST ONE FOOT HORIZONTALLY AT THE COMPLETION OF THE GRADING OPERATIONS, THE EXCESS FILL EXISTING ON THE SLOPES SHALL BE BLADED OFF TO CREATE THE FINISHED SLOPE EMBANKMENT. ALL CUT AND FILL SLOPES SHALL BE TRACK WALKED AFTER BEING BROUGHT TO FINISH GRADE AND THEN BE PLANTED WITH EROSION CONTROL SLOPE PLANTING. THE SOILS ENGINEER SHALL REVIEW ALL CUT SLOPES TO DETERMINE IF ANY ADVERSE GEOLOGIC CONDITIONS ARE EXPOSED. IF SUCH CONDITIONS DO OCCUR, THE SOILS ENGINEER SHALL RECOMMEND THE APPROPRIATE MITIGATION MEASURES AT THE TIME OF THEIR DETECTION.

# 8. <u>SEASONAL LIMITS AND DRAINAGE CONTROL</u>

FILL MATERIALS SHALL NOT BE PLACED, SPREAD OR COMPACTED WHILE IT IS AT AN UNSUITABLY HIGH MOISTURE CONTENT OR DURING OTHERWISE UNFAVORABLE CONDITIONS. WHEN THE WORK IS INTERRUPTED FOR ANY REASON THE FILL OPERATIONS SHALL NOT BE RESUMED UNTIL FIELD TEST PERFORMED BY THE SOILS ENGINEER INDICATE THAT THE MOISTURE CONDITIONS IN AREAS TO BE FILLED ARE AS PREVIOUSLY SPECIFIED. ALL EARTH MOVING AND WORKING OPERATIONS SHALL BE CONTROLLED TO PREVENT WATER FROM RUNNING INTO EXCAVATED AREAS. ALL EXCESS WATER SHALL BE PROMPTLY REMOVED AND THE SITE KEPT DRY.

## DUST CONTROL 9.

THE CONTRACTOR SHALL TAKE ALL STEPS NECESSARY FOR THE ALLEVIATION OR PREVENTION OF ANY DUST NUISANCE ON OR ABOUT THE SITE CAUSED BY THE CONTRACTOR'S OPERATION EITHER DURING THE PERFORMANCE OF THE GRADING OR RESULTING FROM THE CONDITION IN WHICH THE CONTRACTOR LEAVES THE SITE. THE CONTRACTOR SHALL ASSUME ALL LIABILITY INCLUDING COURT COST OF CO-DEFENDANTS FOR ALL CLAIMS RELATED TO DUST OR WIND-BLOWN MATERIALS ATTRIBUTABLE TO HIS WORK. COST FOR THIS ITEM OF WORK IS TO BE INCLUDED IN THE EXCAVATION ITEM AND NO ADDITIONAL COMPENSATION SHALL BE ALLOWED.

# 10. INDEMNITY

THE CONTRACTOR WILL HOLD HARMLESS, INDEMNIFY AND DEFEND THE ENGINEER, THE OWNER AND HIS CONSULTANTS AND EACH OF THEIR OFFICERS AND EMPLOYEES AND AGENTS, FROM ANY AND ALL LIABILITY CLAIMS, LOSSES OR DAMAGE ARISING OR ALLEGED TO HEREIN, BUT NOT INCLUDING THE SOLE NEGLIGENCE OF THE OWNER. THE ARCHITECT, THE ENGINEER AND HIS CONSULTANTS AND EACH OF THEIR OFFICERS AND EMPLOYEES AND AGENTS.

# 11. <u>SAFETY</u>

IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES. THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE. INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

THE DUTY OF THE ENGINEERS TO CONDUCT CONSTRUCTION REVIEW OF THE CONTRACTOR'S PERFORMANCE IS NOT INTENDED TO INCLUDE REVIEW OF THE ADEQUACY OF THE CONTRACTOR'S SAFETY MEASURES, IN, ON OR NEAR THE CONSTRUCTION SITE.

12. GUARANTEE

NEITHER THE FINAL PAYMENT, NOR THE PROVISIONS IN THE CONTRACT, NOR PARTIAL, NOR ENTIRE USE OR OCCUPANCY OF THE PREMISES BY THE OWNER SHALL CONSTITUTE AN ACCEPTANCE OF THE WORK NOT DONE IN ACCORDANCE WITH THE CONTRACT OR RELIEVES THE CONTRACTOR OF LIABILITY IN RESPECT TO ANY EXPRESS WARRANTIES OR RESPONSIBILITY FOR FAULTY MATERIAL OR WORKMANSHIP.

THE CONTRACTOR SHALL REMEDY ANY DEFECTS IN WORK AND PAY FOR ANY DAMAGE TO OTHER WORK RESULTING THERE FROM WHICH SHALL APPEAR WITHIN A PERIOD OF ONE (1) CALENDAR YEAR FROM THE DATE OF FINAL ACCEPTANCE OF THE WORK.

13. TRENCH BACKFILL

> either the on-site inorganic soil or approved imported soil may be used as trench BACKFILL. THE BACKFILL MATERIAL SHALL BE MOISTURE CONDITIONED PER THESE SPECIFICATIONS AND SHALL BE PLACED IN LIFTS OF NOT MORE THAN SIX INCHES IN HORIZONTAL UNCOMPACTED LAYERS AND BE COMPACTED BY MECHANICAL MEANS TO A MINIMUM OF 90% RELATIVE COMPACTION. IMPORTED SAND MAY BE USED FOR TRENCH BACKFILL MATERIAL PROVIDED IT IS COMPACTED TO AT LEAST 90% RELATIVE COMPACTION. WATER JETTING ASSOCIATED WITH COMPACTION USING VIBRATORY EQUIPMENT WILL BE PERMITTED ONLY WITH IMPORTED SAND BACKFILL WITH THE APPROVAL OF THE SOILS ENGINEER. ALL PIPES SHALL BE BEDDED WITH SAND EXTENDING FROM THE TRENCH BOTTOM TO TWELVE INCHES ABOVE THE PIPE. SAND BEDDING IS TO BE COMPACTED AS SPECIFIED ABOVE FOR SAND BACKFILL.

EROSION CONTROL

A. ALL GRADING, EROSION AND SEDIMENT CONTROL AND RELATED WORK UNDERTAKEN ON THIS SITE IS SUBJECT TO ALL TERMS AND CONDITIONS OF THE COUNTY GRADING ORDINANCE AND MADE A PART HEREOF BY REFERENCE.

B. THE CONTRACTOR WILL BE LIABLE FOR ANY AND ALL DAMAGES TO ANY PUBLICLY OWNED AND MAINTAINED ROAD CAUSED BY THE AFORESAID CONTRACTOR'S GRADING ACTIVITIES, AND SHALL BE RESPONSIBLE FOR THE CLEANUP OF ANY MATERIAL SPILLED ON ANY PUBLIC ROAD ON THE HAUL ROUTE.

C. THE EROSION CONTROL MEASURES ARE TO BE OPERABLE DURING THE RAINY SEASON, GENERALLY FROM OCTOBER FIRST TO APRIL FIFTEENTH. EROSION CONTROL PLANTING IS TO BE COMPLETED BY OCTOBER FIRST. NO GRADING OR UTILITY TRENCHING SHALL OCCUR BETWEEN OCTOBER FIRST AND APRIL FIFTEENTH UNLESS AUTHORIZED BY THE LOCAL JURISDICTION.

D. ALL EROSION CONTROL MEASURES SHALL BE MAINTAINED UNTIL DISTURBED AREAS ARE STABILIZED AND CHANGES TO THIS EROSION AND SEDIMENT CONTROL PLAN SHALL BE MADE TO MEET FIELD CONDITIONS ONLY WITH THE APPROVAL OF OR AT THE DIRECTION OF THE SOILS ENGINEER.

E. DURING THE RAINY SEASON, ALL PAVED AREAS SHALL BE KEPT CLEAR OF EARTH MATERIAL AND DEBRIS. THE SITE SHALL BE MAINTAINED SO AS TO MINIMIZE SEDIMENT-LADEN RUNOFF TO ANY STORM DRAINAGE SYSTEM.

F. ALL EROSION CONTROL FACILITIES MUST BE INSPECTED AND REPAIRED AT THE END OF EACH WORKING DAY DURING THE RAINY SEASON.

G. WHEN NO LONGER NECESSARY AND PRIOR TO FINAL ACCEPTANCE OF DEVELOPMENT, SEDIMENT BASINS SHALL BE REMOVED OR OTHERWISE DEACTIVATED AS REQUIRED BY THE LOCAL JURISDICTION.

H. A CONSTRUCTION ENTRANCE SHALL BE PROVIDED AT ANY POINT OF EGRESS FROM THE SITE TO ROADWAY. A CONSTRUCTION ENTRANCE SHOULD BE COMPOSED OF COARSE DRAIN ROCK (2" TO 3") MINIMUM DIAMETER) AT LEAST EIGHT INCHES THICK BY FIFTY (50) FEET LONG BY TWENTY (20) FEET WIDE UNLESS SHOWN OTHERWISE ON PLAN AND SHALL BE MAINTAINED UNTIL THE SITE IS PAVED.

PROPORTIONS:

K. WATER UTILIZED IN THE STABILIZATION MATERIAL SHALL BE OF SUCH QUALITY THAT IT WILL PROMOTE GERMINATION AND STIMULATE GROWTH OF PLANTS. IT SHALL BE FREE OF POLLUTANT MATERIALS AND WEED SEED.

L. HYDROSEEDING SHALL CONFORM TO THE PROVISIONS OF SECTION 20, EROSION CONTROL AND HIGHWAY PLANTING". OF THE STANDARD SPECIFICATIONS OF THE STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION, AS LAST REVISED.

M. A DISPERSING AGENT MAY BE ADDED TO THE HYDROSEEDING MATERIAL, PROVIDED THAT THE CONTRACTOR FURNISHES SUITABLE EVIDENCE THAT THE ADDITIVE WILL NOT ADVERSELY AFFECT THE PERFORMANCE OF THE SEEDING MIXTURE.

N. STABILIZATION MATERIALS SHALL BE APPLIED AS SOON AS PRACTICABLE AFTER COMPLETION OF GRADING OPERATIONS AND PRIOR TO THE ONSET OF WINTER RAINS. OR AT SUCH OTHER TIME AS DIRECTED BY THE COUNTY ENGINEER. THE MATERIAL SHALL BE APPLIED BEFORE INSTALLATION OF OTHER LANDSCAPING MATERIALS SUCH AS TREES, SHRUBS AND GROUND COVERS.

P. THE CONTRACTOR SHALL MAINTAIN THE SOIL STABILIZATION MATERIAL AFTER PLACEMENT. THE COUNTY ENGINEER MAY REQUIRE SPRAY APPLICATION OF WATER OR OTHER MAINTENANCE ACTIVITIES TO ASSURE THE EFFECTIVENESS OF THE STABILIZATION PROCESS. APPLICATION OF WATER SHALL BE ACCOMPLISHED USING NOZZLES THAT PRODUCE A SPRAY THAT DOES NOT CONCENTRATE OR WASH AWAY THE STABILIZATION MATERIALS.

15. <u>CLEANUP</u>

BE ALLOWED.

I. ALL AREAS SPECIFIED FOR HYDROSEEDING SHALL BE NOZZLE PLANTED WITH STABILIZATION MATERIAL CONSISTING OF FIBER, SEED, FERTILIZER AND WATER, MIXED AND APPLIED IN THE FOLLOWING

FIBER, 2000 LBS/ACRE

SEED, 200 LBS/ACRE (SEE NOTE J, BELOW) FERTILIZER (11-8-4), 500 LBS/ACRE

WATER, AS REQUIRED FOR APPLICATION

J. SEED MIX SHALL BE PER CALTRANS STANDARDS.

O. THE STABILIZATION MATERIAL SHALL BE APPLIED WITHIN 4-HOURS AFTER MIXING. MIXED MATERIAL NOT USED WITHIN 4-HOURS SHALL BE REMOVED FROM THE SITE.

THE CONTRACTOR MUST MAINTAIN THE SITE CLEAN, SAFE AND IN USABLE CONDITION. ANY SPILLS OF SOIL, ROCK OR CONSTRUCTION MATERIAL MUST BE REMOVED FROM THE SITE BY THE CONTRACTOR DURING CONSTRUCTION AND UPON COMPLETION OF THE PROJECT. COST FOR THIS ITEM OF WORK SHALL BE INCLUDED IN THE EXCAVATION AND COMPACTION ITEM AND NO ADDITIONAL COMPENSATION SHALL

> NOTE: THESE NOTES ARE INTENDED TO BE USED AS A GENERAL GUIDELINE. THE REFERENCED SOILS REPORT FOR THE PROJECT AND GOVERNING AGENCY GRADING ORDINANCE SHALL SUPERSEDE THESE NOTES. THE SOILS ENGINEER MAY MAKE ON-SITE RECOMMENDATIONS DURING GRADING OPERATIONS.

ROFESSION N. C79555 Rome CIVIL N. CT9555 Rome CIVIL N. CIVIL N. CONSTITUTES IN BLUE
LEA & BRAZE ENGINEERING, INC. LEA & BRAZE ENGINEERING, INC. CIVIL ENGINEERS I LAND SURVEYORS MAIN OFFICE. 2495 INDUSTRIAL PKWY WEST HAYWARD, CALIFORNIA 94545 (510) 887–4086 (510) 887–4086 NWW.LEABRAZE.COM
ISLAM RESIDENCE 3655 PLEASANT KNOLL CT. SAN JOSE, CALIFORNIA unincorporated same clara county april 654-25-01
GRADING SPECIFICATIONS
-       -         -       -         3       REVISION 2 11-05-24       ZA         2       REVISION 2 08-26-24       ZA         1       REVISION 1 05-16-24       ZA         1       REVISION 1 05-16-24       ZA         BY       JOB NO:       2221253         DATE:       08-07-23         SCALE:       NO SCALE         DESIGN BY:       ZA         CHECKED BY:       XIX         SHEET NO:
C-5.0

# **PURPOSE:**

THE PURPOSE OF THIS PLAN IS TO STABILIZE THE SITE TO PREVENT EROSION OF GRADED AREAS AND TO PREVENT SEDIMENTATION FROM LEAVING THE CONSTRUCTION AREA AND AFFECTING NEIGHBORING SITES. NATURAL AREAS. PUBLIC FACILITIES OR ANY OTHER AREA THAT MIGHT BE AFFECTED BY SEDIMENTATION. ALL MEASURES SHOWN ON THIS PLAN SHOULD BE CONSIDERED THE MINIMUM REQUIREMENTS NECESSARY. SHOULD FIELD CONDITIONS DICTATE ADDITIONAL MEASURES, SUCH MEASURES SHALL BE PER CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD'S FIELD MANUAL FOR EROSION AND SEDIMENTATION CONTROL AND THE CALIFORNIA STORM WATER QUALITY ASSOCIATION BEST MANAGEMENT PRACTICES HANDBOOK FOR CONSTRUCTION. LEA & BRAZE ENGINEERING SHOULD BE NOTIFIED IMMEDIATELY SHOULD CONDITIONS CHANGE.

# **EROSION CONTROL NOTES:**

- 1. IT SHALL BE THE OWNER'S/CONTRACTOR'S RESPONSIBILITY TO MAINTAIN CONTROL OF THE ENTIRE CONSTRUCTION OPERATION AND TO KEEP THE ENTIRE SITE IN COMPLIANCE WITH THIS EROSION CONTROL PLAN.
- 2. THE INTENTION OF THIS PLAN IS FOR INTERIM EROSION AND SEDIMENT CONTROL ONLY. ALL EROSION CONTROL MEASURES SHALL CONFORM TO CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD'S FIELD MANUAL FOR EROSION AND SEDIMENTATION CONTROL, THE CALIFORNIA STORM WATER QUALITY ASSOCIATION BEST MANAGEMENT PRACTICES HANDBOOK FOR CONSTRUCTION. AND THE LOCAL GOVERNING AGENCY FOR THIS PRO IFCT
- 3. OWNER/CONTRACTOR SHALL BE RESPONSIBLE FOR MONITORING EROSION AND SÉDIMENT CONTROL MEASURES PRIOR TO. DURING. AND AFTER STORM EVENTS. PERSON IN CHARGE OF MAINTAINING EROSION CONTROL MEASURES SHOULD WATCH LOCAL WEATHER REPORTS AND ACT APPROPRIATELY TO MAKE SURE ALL NECESSARY MEASURES ARE IN PLACE.
- 4. SANITARY FACILITIES SHALL BE MAINTAINED ON THE SITE AT ALL TIMES.
- 5. DURING THE RAINY SEASON. ALL PAVED AREAS SHALL BE KEPT CLEAR OF EARTH MATERIAL AND DEBRIS. THE SITE SHALL BE MAINTAINED SO AS TO MINIMIZE SEDIMENT-LADEN RUNOFF TO ANY STORM DRAINAGE SYSTEM, INCLUDING EXISTING DRAINAGE SWALES AND WATERCOURSES.
- 6. CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND WATER POLLUTION WILL BE MINIMIZED. COMPLIANCE WITH FEDERAL, STATE AND LOCAL LAWS CONCERNING POLLUTION SHALL BE MAINTAINED AT ALL TIMES.
- 7. CONTRACTOR SHALL PROVIDE DUST CONTROL AS REQUIRED BY THE APPROPRIATE FEDERAL, STATE AND LOCAL AGENCY REQUIREMENTS.
- 8. ALL MATERIALS NECESSARY FOR THE APPROVED EROSION CONTROL MEASURES SHALL BE IN PLACE BY OCTOBER 15TH.
- 9. EROSION CONTROL SYSTEMS SHALL BE INSTALLED AND MAINTAINED THROUGHOUT THE RAINY SEASON, OR FROM OCTOBER 15TH THROUGH APRIL 15TH, WHICHEVER IS LONGER.
- 10. IN THE EVENT OF RAIN, ALL GRADING WORK IS TO CEASE IMMEDIATELY AND THE SITE IS TO BE SEALED IN ACCORDANCE WITH THE APPROVAL EROSION CONTROL MEASURES AND APPROVED EROSION CONTROL PLAN.
- 11. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CHECKING AND REPAIRING EROSION CONTROL SYSTEMS AFTER EACH STORM.
- 12. ADDITIONAL EROSION CONTROL MEASURES MAY BE REQUIRED BY LOCAL JURISDICTION'S ENGINEERING DEPARTMENT OR BUILDING OFFICIALS.
- 13. MEASURES SHALL BE TAKEN TO COLLECT OR CLEAN ANY ACCUMULATION OR DEPOSIT OF DIRT. MUD. SAND. ROCKS. GRAVEL OR DEBRIS ON THE SURFACE OF ANY STREET. ALLEY OR PUBLIC PLACE OR IN ANY PUBLIC STORM DRAIN SYSTEMS. THE REMOVAL OF AFORESAID SHALL BE DONE BY STREET SWEEPING OR HAND SWEEPING. WATER SHALL NOT BE USED TO WASH SEDIMENTS INTO PUBLIC OR PRIVATE DRAINAGE FACILITIES.
- 14. EROSION CONTROL MEASURES SHALL BE ON-SITE FROM SEPTEMBER 15TH THRU APRIL 15TH.
- 15. ALL EROSION CONTROL MEASURES SHALL BE INSTALLED AND MAINTAINED THROUGHOUT THE RAINY SEASON OR FROM OCTOBER 15 THROUGH APRIL 15. WHICHEVER IS GREATER.
- 16. PLANS SHALL BE DESIGNED TO MEET C3 REQUIREMENTS OF THE MUNICIPAL STORMWATER REGIONAL PERMIT("MRP") NPDES PERMIT CAS 612008.
- 17. THE CONTRACTOR TO NPDES (NATIONAL POLLUTION DISCHARGE ELIMINATION SYSTEM) BEST MANAGEMENT PRACTICES (BMP) FOR SEDIMENTATION PREVENTION AND EROSION CONTROL TO PREVENT DELETERIOUS MATERIALS OR POLLUTANTS FROM ENTERING THE TOWN OR COUNTY STORM DRAIN SYSTEMS.
- 18. THE CONTRACTOR MUST INSTALL ALL EROSION AND SEDIMENT CONTROL MEASURES PRIOR TO THE INCEPTION OF ANY WORK ONSITE AND MAINTAIN THE MEASURES UNTIL THE COMPLETION OF ALL LANDSCAPING.
- 19. THE CONTRACTOR SHALL MAINTAIN ADJACENT STREETS IN A NEAT, CLEAN DUST FREE AND SANITARY CONDITION AT ALL TIMES AND TO THE SATISFACTION OF THE TOWN INSPECTOR. THE ADJACENT STREET SHALL AT ALL TIMES BE KEPT CLEAN OF DEBRIS, WITH DUST AND OTHER NUISANCE BEING CONTROLLED AT ALL TIMES. THE CONTRACTOR BE RESPONSIBLE FOR ANY CLEAN UP ON ADJACENT STREETS AFFECTED BY THE BY THEIR CONSTRUCTION, METHOD OF STREET CLEANING SHALL BE BY DRY SWEEPING OF ALL PAVED AREAS. NO STOCKPILING OF BUILDING MATERIALS WITHIN THE TOWN RIGHT-OF-WAY.
- 20. SEDIMENTS AND OTHER MATERIALS SHALL NOT BE TRACKED FROM THE SITE BY VEHICLE TRAFFIC. THE CONTRACTOR SHALL INSTALL A STABILIZED CONSTRUCTION ENTRANCE PRIOR TO THE INSPECTION OF ANY WORK ONSITE AND MAINTAIN IT FOR THE DURATION OF THE CONSTRUCTION PROCESS SO AS TO NOT INHIBIT SEDIMENTS FROM BEING DEPOSITED INTO THE PUBLIC RIGHT-OF-WAY UNTIL THE COMPLETION OF ALL LANDSCAPING.
- 21. THE CONTRACTOR SHALL PROTECT DOWN SLOPE DRAINAGE COURSES, STREAMS AND STORM DRAINS WITH ROCK FILLED SAND BAGS, TEMPORARY SWALES, SILT FENCES, AND EARTH PERMS IN CONJUNCTION OF ALL LANDSCAPING.
- 22. STOCKPILED MATERIALS SHALL BE COVERED WITH VISQUEEN OR A TARPAULIN UNTIL THE MATERIAL IS REMOVED FROM THE SITE. ANY REMAINING BARE SOIL THAT EXISTS AFTER THE STOCKPILE HAS BEEN REMOVED SHALL BE COVERED UNTIL A NATURAL GROUND COVER IS ESTABLISHED OR IT IS SEEDED OR PLANTED TO PROVIDE GROUND COVER PRIOR TO THE FALL RAINY SEASON.
- 23. EXCESS OR WASTE CONCRETE MUST NOT BE WASHED INTO THE PUBLIC RIGHT-OF-WAYOR ANY OTHER DRAINAGE SYSTEM. PROVISIONS SHALL BE MADE TO RETAIN CONCRETE WASTES ON SITE UNTIL THEY CAN BE DISPOSED OF AS SOLID WASTE.
- 24. TRASH AND CONSTRUCTION RELATED SOLID WASTES MUST BE DEPOSITED INTO A COVERED RECEPTACLE TO PREVENT CONTAMINATION AND DISPERSAL BY WIND

# EROSION CONTROL NOTES CONTINUED:

- TOWN INSPECTOR.
- FOLLOWING AND DURING ALL RAIN EVENTS, TO PUBLIC OWNED FACILITIES.

# **EROSION CONTROL MEASURES:**

- LEAVE DENUDED SLOPES SHALL BE PROTECTED WITH EROSION CONTROL MEASURES IMMEDIATELY FOLLOWING GRADING ON THE SLOPES.
- 2. SITE CONDITIONS AT TIME OF PLACEMENT OF EROSION CONTROL MEASURES HYDROSEEDING, STRAW BALES, ROCK SACKS, ETC. SHALL BE TAKEN TO PREVENT EROSION AND SEDIMENTATION FROM LEAVING SITE. EROSION THE NEED OF CONSTRUCTION SHIFT.
- OF GRADING. ALL CONSTRUCTION TRAFFIC ENTERING ONTO THE PAVED ROADS MUST CROSS THE STABILIZED CONSTRUCTION ENTRANCES. CONTRACTOR SHALL MAINTAIN STABILIZED ENTRANCE AT EACH VEHICLE ACCESS POINT TO EXISTING PAVED STREETS. ANY MUD OR DEBRIS TRACKED ONTO PUBLIC STREETS SHALL BE REMOVED DAILY AND AS REQUIRED BY THE GOVERNING AGENCY.
- 4. ALL EXPOSED SLOPES THAT ARE NOT VEGETATED SHALL BE HYDROSEEDED. REVISED. REFER TO THE EROSION CONTROL SECTION OF THE GRADING SPECIFICATIONS THAT ARE A PART OF THIS PLAN SET FOR FURTHER INFORMATION.
- 5. INLET PROTECTION SHALL BE INSTALLED AT OPEN INLETS TO PREVENT ENTRY OF SEDIMENT. MINIMUM INLET PROTECTION SHALL CONSIST OF A ROCK SACKS OR AS SHOWN ON THIS PLAN
- 6. THIS EROSION AND SEDIMENT CONTROL PLAN MAY NOT COVER ALL THE PERFORM A FIELD REVIEW AND MAKE RECOMMENDATIONS AS NEEDED. THE GOVERNING AGENCY OF ANY CHANGES.
- 7. THE EROSION CONTROL MEASURES SHALL CONFORM TO THE LOCAL JURISDICTION'S STANDARDS AND THE APPROVAL OF THE LOCAL JURISDICTION'S ENGINEERING DEPARTMENT.
- 8. STRAW ROLLS SHALL BE PLACED AT THE TOE OF SLOPES AND ALONG THE REFER TO MANUFACTURES SPECIFICATIONS FOR PLACEMENT AND INSTALLATION INSTRUCTIONS.

# **REFERENCES:**

- EROSION AND SEDIMENTATION CONTROL
- 2. CALIFORNIA STORM WATER QUALITY ASSOCIATION BEST MANAGEMENT PRACTICES HANDBOOK FOR CONSTRUCTION

# **PERIODIC MAINTENANCE:**

- 1. MAINTENANCE IS TO BE PERFORMED AS FOLLOWS: A. DAMAGES CAUSED BY SOIL EROSION OR CONSTRUCTION SHALL BE
- B. SWALES SHALL BE INSPECTED PERIODICALLY AND MAINTAINED AS NEEDED.
- EACH STORM AND REPAIRS MADE AS NEEDED.
- OF 1' FOOT.
- AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
- 2. GRAVEL BAG INLET PROTECTION SHALL BE CLEANED OUT WHENEVER
- 3. STRAW ROLLS SHALL BE PERIODICALLY CHECKED TO ASSURE PROPER FUNCTION AND CLEANED OUT WHENEVER THE SEDIMENT DEPTH REACHED HALF THE HEIGHT OF THE ROLL.
- AND CLEANED OUT WHENEVER THE SEDIMENT DEPTH REACHES ONE FOOT IN HEIGHT.
- SILT/SOIL BUILDUP.
- INTERVALS TO ASSURE PROPER FUNCTION

24. FUELS, OILS, SOLVENTS AND OTHER TOXIC MATERIALS MUST BE STORED IN ACCORDANCE WITH THEIR LISTING AND ARE NOT TO CONTAMINATE THE SOIL AND SURFACE WATERS. ALL APPROVED STORAGE CONTAINERS ARE TO BE PROTECTED FROM THE WEATHER. SPILLS MUST BE CLEANED UP IMMEDIATELY AND DISPOSED OF IN A PROPER MANNER. SPILLS MUST NOT BE WASHED INTO THE DRAINAGE SYSTEM.

25. DUST CONTROL SHALL BE DONE BY WATERING AND AS OFTEN AS REQUIRED BY THE

26. SILT FENCE(S) AND/OR FIBER ROLL(S) SHALL BE INSTALLED PRIOR TO SEPTEMBER 15TH AND SHALL RÉMAIN IN PLACE UNTIL THE LANDSCAPING GROUND COVER IS INSTALLED. CONTRACTOR SHALL CONTINUOUSLY MONITOR THESE MEASURES,

1. THE FACILITIES SHOWN ON THIS PLAN ARE DESIGNED TO CONTROL EROSION AND SEDIMENT DURING THE RAINY SEASON, OCTOBER 15TH TO APRIL 15. EROSION CONTROL FACILITIES SHALL BE IN PLACE PRIOR TO OCTOBER 15TH OF ANY YEAR. GRADING OPERATIONS DURING THE RAINY SEASON WHICH

WILL VARY. APPROPRIATE ACTION INCLUDING TEMPORARY SWALES, INLETS, CONTROL MEASURES SHALL BE ADJUSTED AS THE CONDITIONS CHANGE AND

3. CONSTRUCTION ENTRANCES SHALL BE INSTALLED PRIOR TO COMMENCEMENT

IF HYDROSEEDING IS NOT USED OR IS NOT EFFECTIVE BY OCTOBER 15. THEN OTHER IMMEDIATE METHODS SHALL BE IMPLEMENTED, SUCH AS EROSION CONTROL BLANKETS, OR A THREE-STEP APPLICATION OF 1) SEED, MULCH, FERTILIZER 2) BLOWN STRAW 3) TACKIFIER AND MULCH. HYDROSEEDING SHALL BE IN ACCORDANCE WITH THE PROVISIONS OF SECTION 20" EROSION CONTROL AND HIGHWAY PLANTING" OF THE STANDARD SPECIFICATION OF THE STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION, AS LAST

SEDIMENT FROM ENTERING THE STORM DRAIN SYSTEM. INLETS NOT USED IN CONJUNCTION WITH EROSION CONTROL ARE TO BE BLOCKED TO PREVENT

SITUATIONS THAT MAY ARISE DURING CONSTRUCTION DUE TO UNANTICIPATED FIELD CONDITIONS. VARIATIONS AND ADDITIONS MAY BE MADE TO THIS PLAN IN THE FIELD. A REPRESENTATIVE OF LEA & BRAZE ENGINEERING SHALL CONTRACTOR IS RESPONSIBLE TO NOTIFY LEA & BRAZE ENGINEERING AND

DOWN SLOPE PERIMETER OF THE PROJECT. THEY SHALL BE PLACED AT 25 FOOT INTERVALS ON GRADED SLOPES. PLACEMENT SHALL RUN WITH THE CONTOURS AND ROLLS SHALL BE TIGHTLY END BUTTED. CONTRACTOR SHALL

1. CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD'S FIELD MANUAL FOR

REPAIRED AT THE END OF EACH WORKING DAY.

C. SEDIMENT TRAPS, BERMS, AND SWALES ARE TO BE INSPECTED AFTER

D. SEDIMENT SHALL BE REMOVED AND SEDIMENT TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN SEDIMENT HAS ACCUMULATED TO A DEPTH


E. SEDIMENT REMOVED FROM TRAP SHALL BE DEPOSITED IN A SUITABLE F. RILLS AND GULLIES MUST BE REPAIRED.

SEDIMENT DEPTH IS ONE HALF THE HEIGHT OF ONE GRAVEL BAG.

4. SILT FENCE SHALL BE PERIODICALLY CHECKED TO ASSURE PROPER FUNCTION

5. CONSTRUCTION ENTRANCE SHALL BE REGRAVELED AS NECESSARY FOLLOWING

6. ANY OTHER EROSION CONTROL MEASURES SHOULD BE CHECKED AT REGULAR

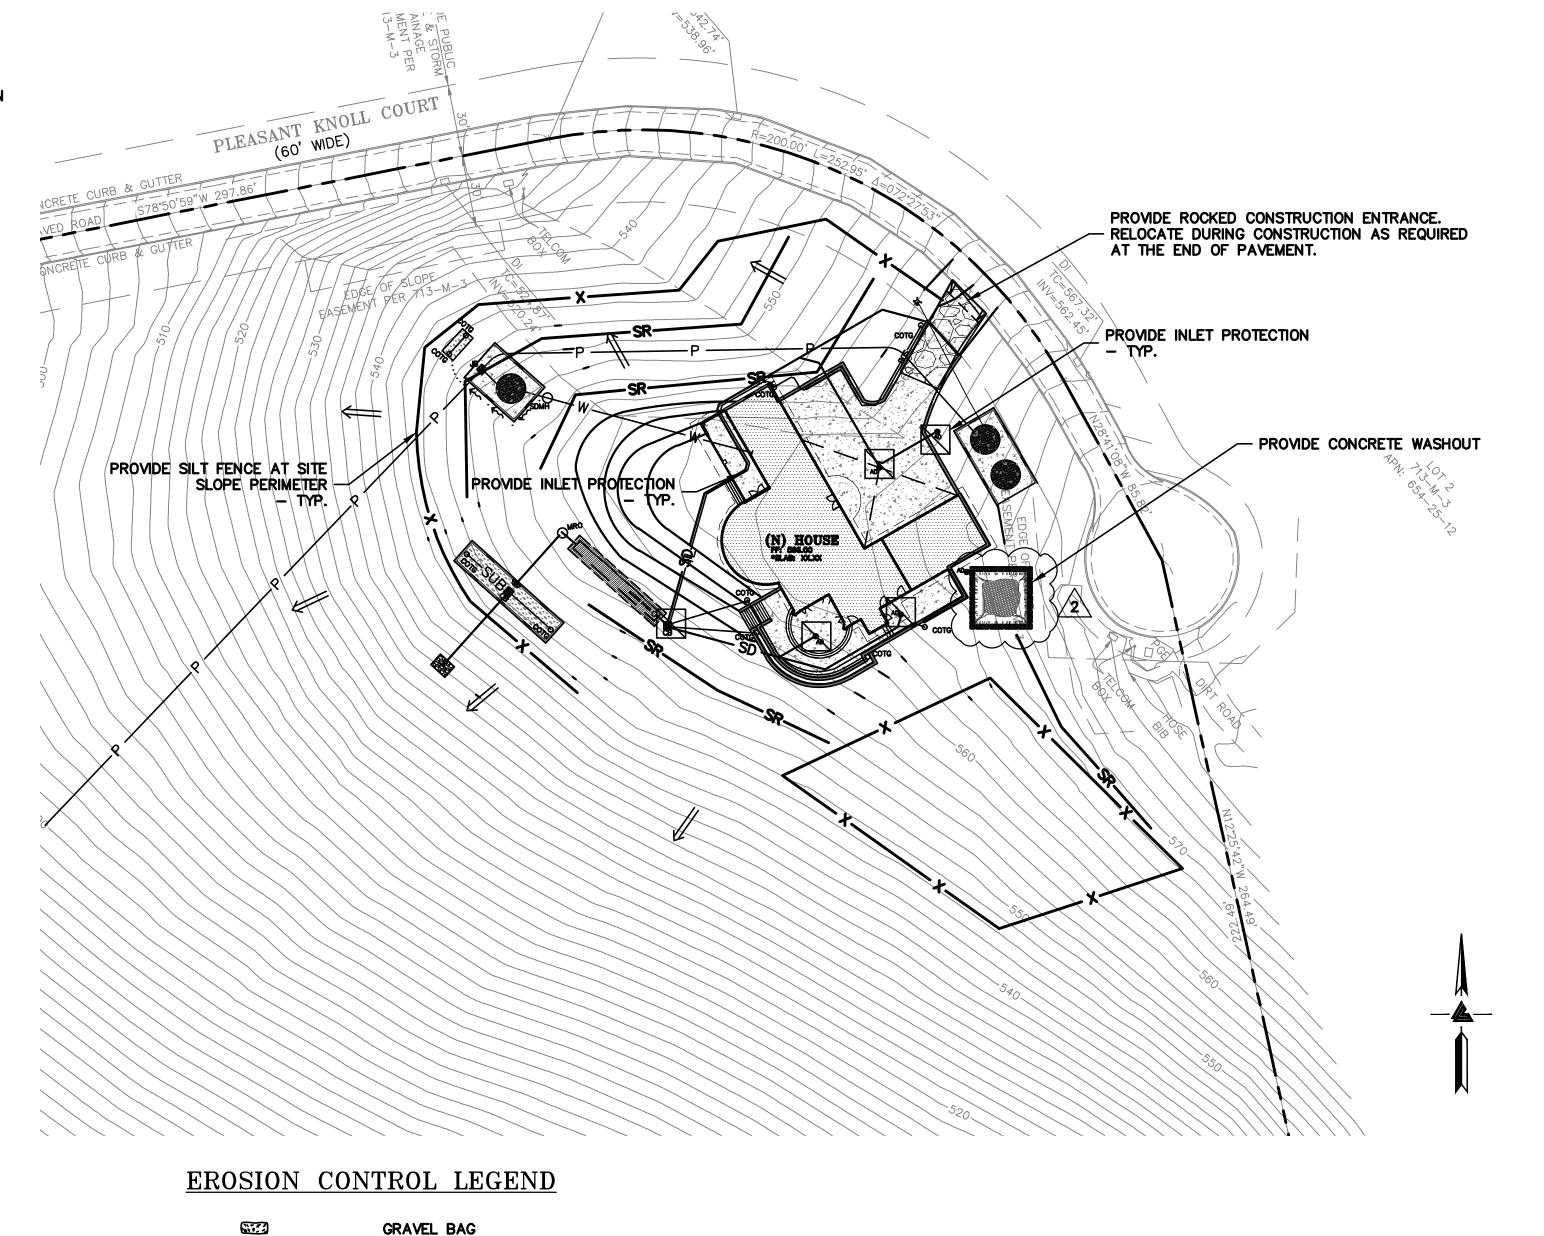

# $\mathbb{N}$

SEDIMENTATION BASIN

INLET PROTECTION




SILT FENCE





CONCRETE WASHOUT



TREE PROTECTION



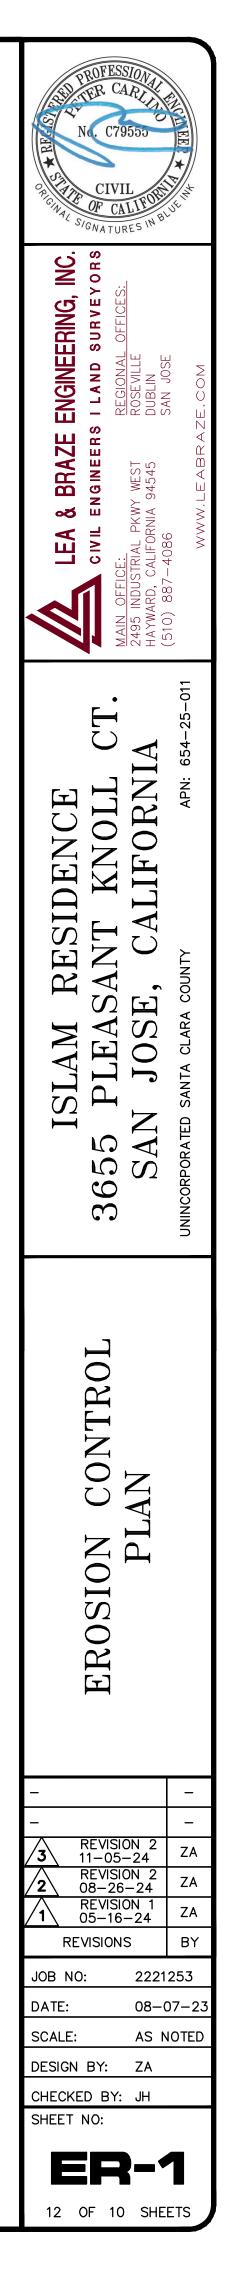


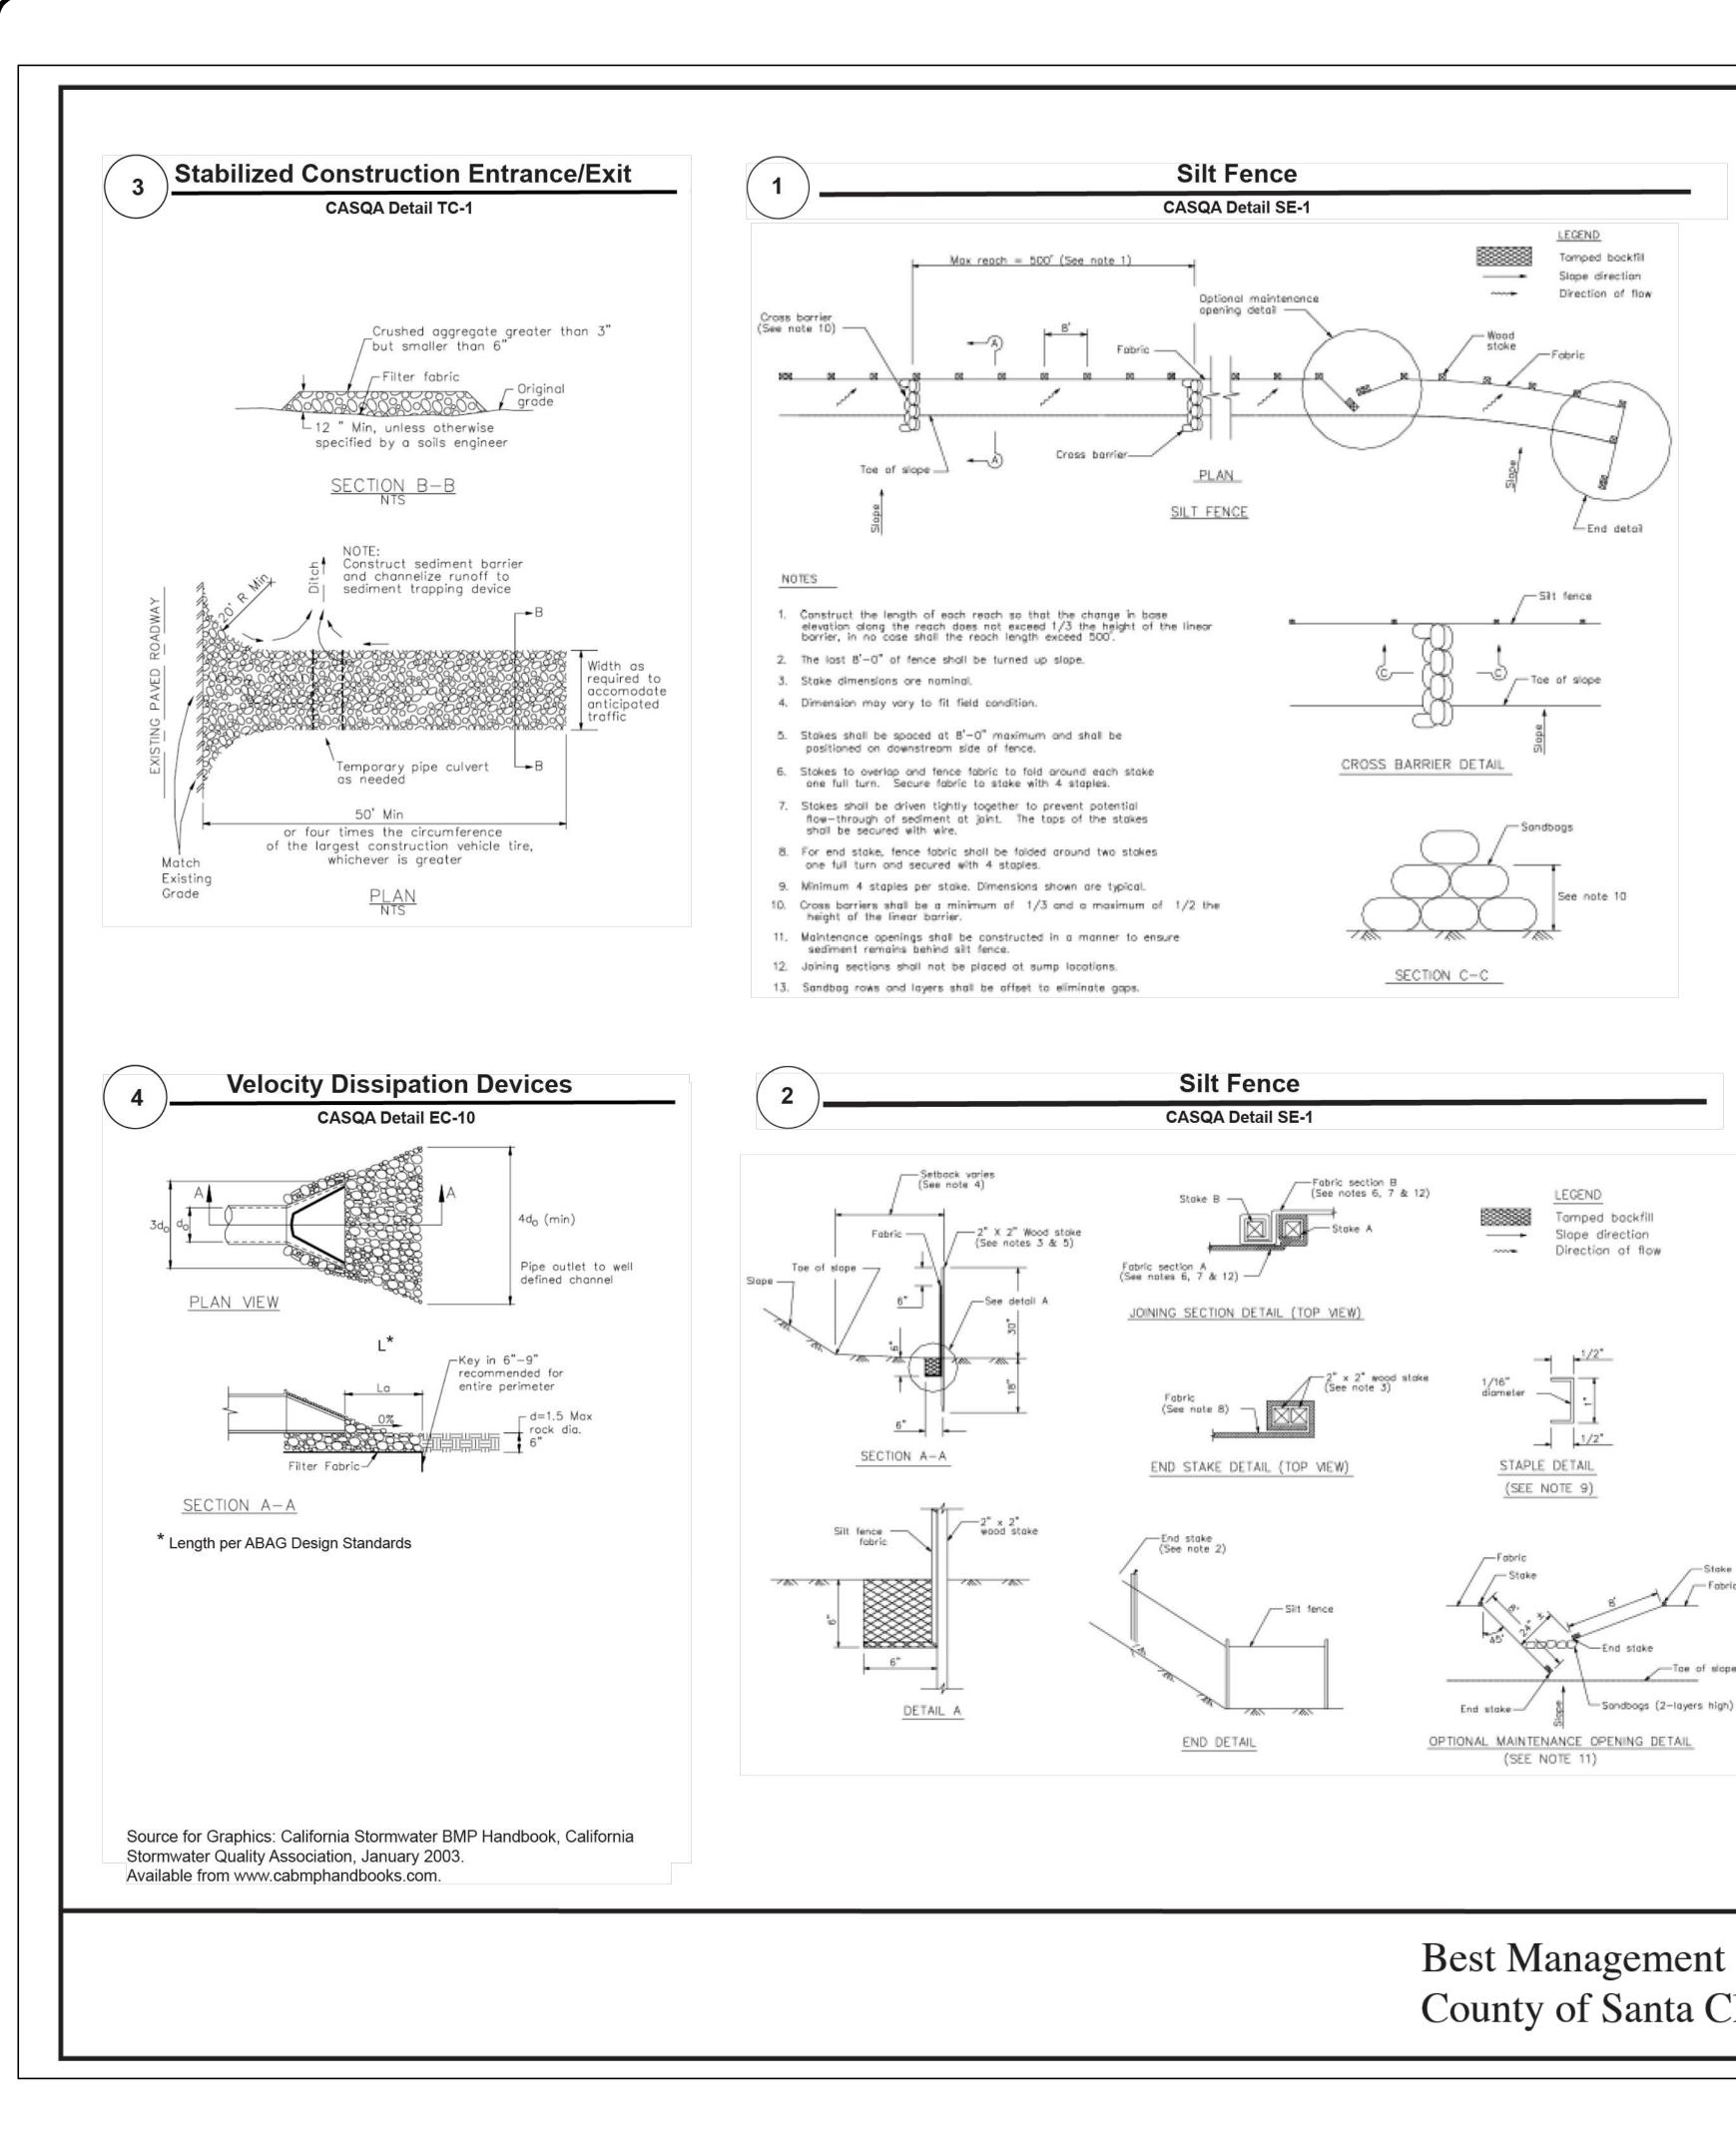


# STANDARD BEST MANAGEMENT PRACTICE NOTES


- 1. Solid and Demolition Waste Management: Provide designated waste collection areas and containers on site away from streets, gutters, storm drains, and waterways, and arrange for regular disposal. Waste containers must be watertight and covered at all times except when waste is deposited. Refer to Erosion & Sediment Control Field Manual, 4th Edition (page C3) or latest.
- 2. <u>Hazardous Waste Management</u>: Provide proper handling and disposal of hazardous wastes by a licensed hazardous waste material hauler. Hazardous wastes shall be stored and properly labeled in sealed containers constructed of suitable materials. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-5 to C-6) or latest.
- 3. Spill Prevention and Control: Provide proper storage areas for liquid and solid materials, including chemicals and hazardous substances, away from streets, gutters, storm drains, and waterways. Spill control materials must be kept on site where readily accessible. Spills must be cleaned up immediately and contaminated soil disposed properly. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-7 to C-8, C-13 to C-14) or latest.
- 4. Vehicle and Construction Equipment Service and Storage: An area shall be designated for the maintenance, where onsite maintenance is required, and storage of equipment that is protected from stormwater run-on and runoff. Measures shall be provided to capture any waste oils, lubricants, or other potential pollutants and these wastes shall be properly disposed of off site. Fueling and major maintenance/repair, and washing shall be conducted off-site whenever feasible. Refer to Erosion & Sediment Control Field Manual, 4th Edition (page C9) or latest.
- 5. Material Delivery, Handling and Storage: In general, materials should not be stockpiled on site. Where temporary stockpiles are necessary and approved by the County, they shall be covered with secured plastic sheeting or tarp and located in designated areas near construction entrances and away from drainage paths and waterways. Barriers shall be provided around storage areas where materials are potentially in contact with runoff. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-11 to C-12) or latest.
- 6. <u>Handling and Disposal of Concrete and Cement</u>: When concrete trucks and equipment are washed on-site, concrete wastewater shall be contained in designated containers or in a temporary lined and watertight pit where wasted concrete can harden for later removal. If possible have concrete contractor remove concrete wash water from site. In no case shall fresh concrete be washed into the road right-of-way. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-15 to C-16) or latest.
- 7. Pavement Construction Management: Prevent or reduce the discharge of pollutants from paving operations, using measures to prevent run-on and runoff pollution and properly disposing of wastes. Avoid paving in the wet season and reschedule paving when rain is in the forecast. Residue from saw-cutting shall be vacuumed for proper disposal. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-17 to C-18) or latest.
- 8. Contaminated Soil and Water Management: Inspections to identify contaminated soils should occur prior to construction and at regular intervals during construction. Remediating contaminated soil should occur promptly after identification and be specific to the contaminant identified, which may include hazardous waste removal. Refer to Erosion & Sediment Control Field Manual, 4th Edition (pages C-19 to C-20) or latest.
- 9. <u>Sanitary/Septic Water Management</u>: Temporary sanitary facilities should be located away from drainage paths, waterways, and traffic areas. Only licensed sanitary and septic waste haulers should be used. Secondary containment should be provided for all sanitary facilities. Refer to Erosion & Sediment Control Field Manual, 4th Edition (page C-21) or latest.
- 10. Inspection & Maintenance: Areas of material and equipment storage sites and temporary sanitary facilities must be inspected weekly. Problem areas shall be identified and appropriate additional and/or alternative control measures implemented immediately, within 24 hours of the problem being identified.

# Best Management Practices and Erosion Control Details Sheet 1 County of Santa Clara

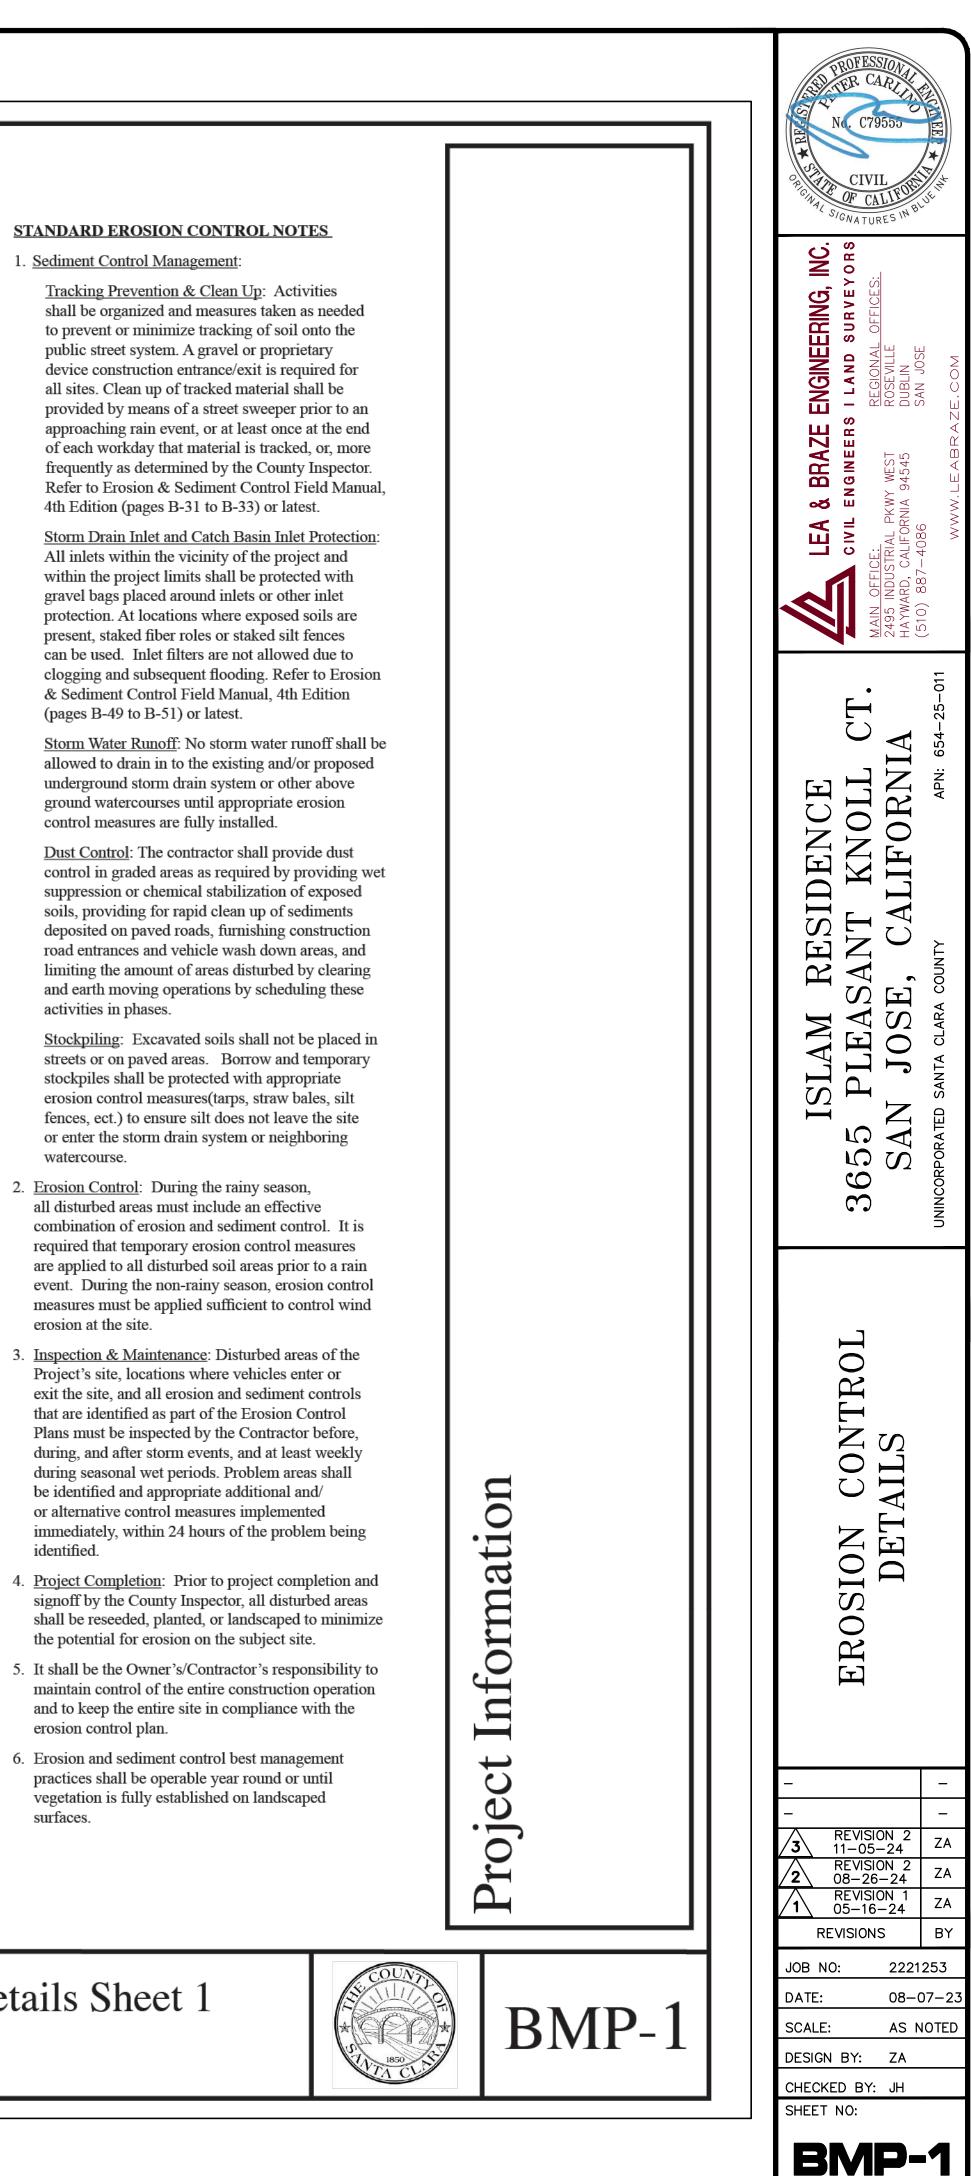

13 OF 10 SHEETS

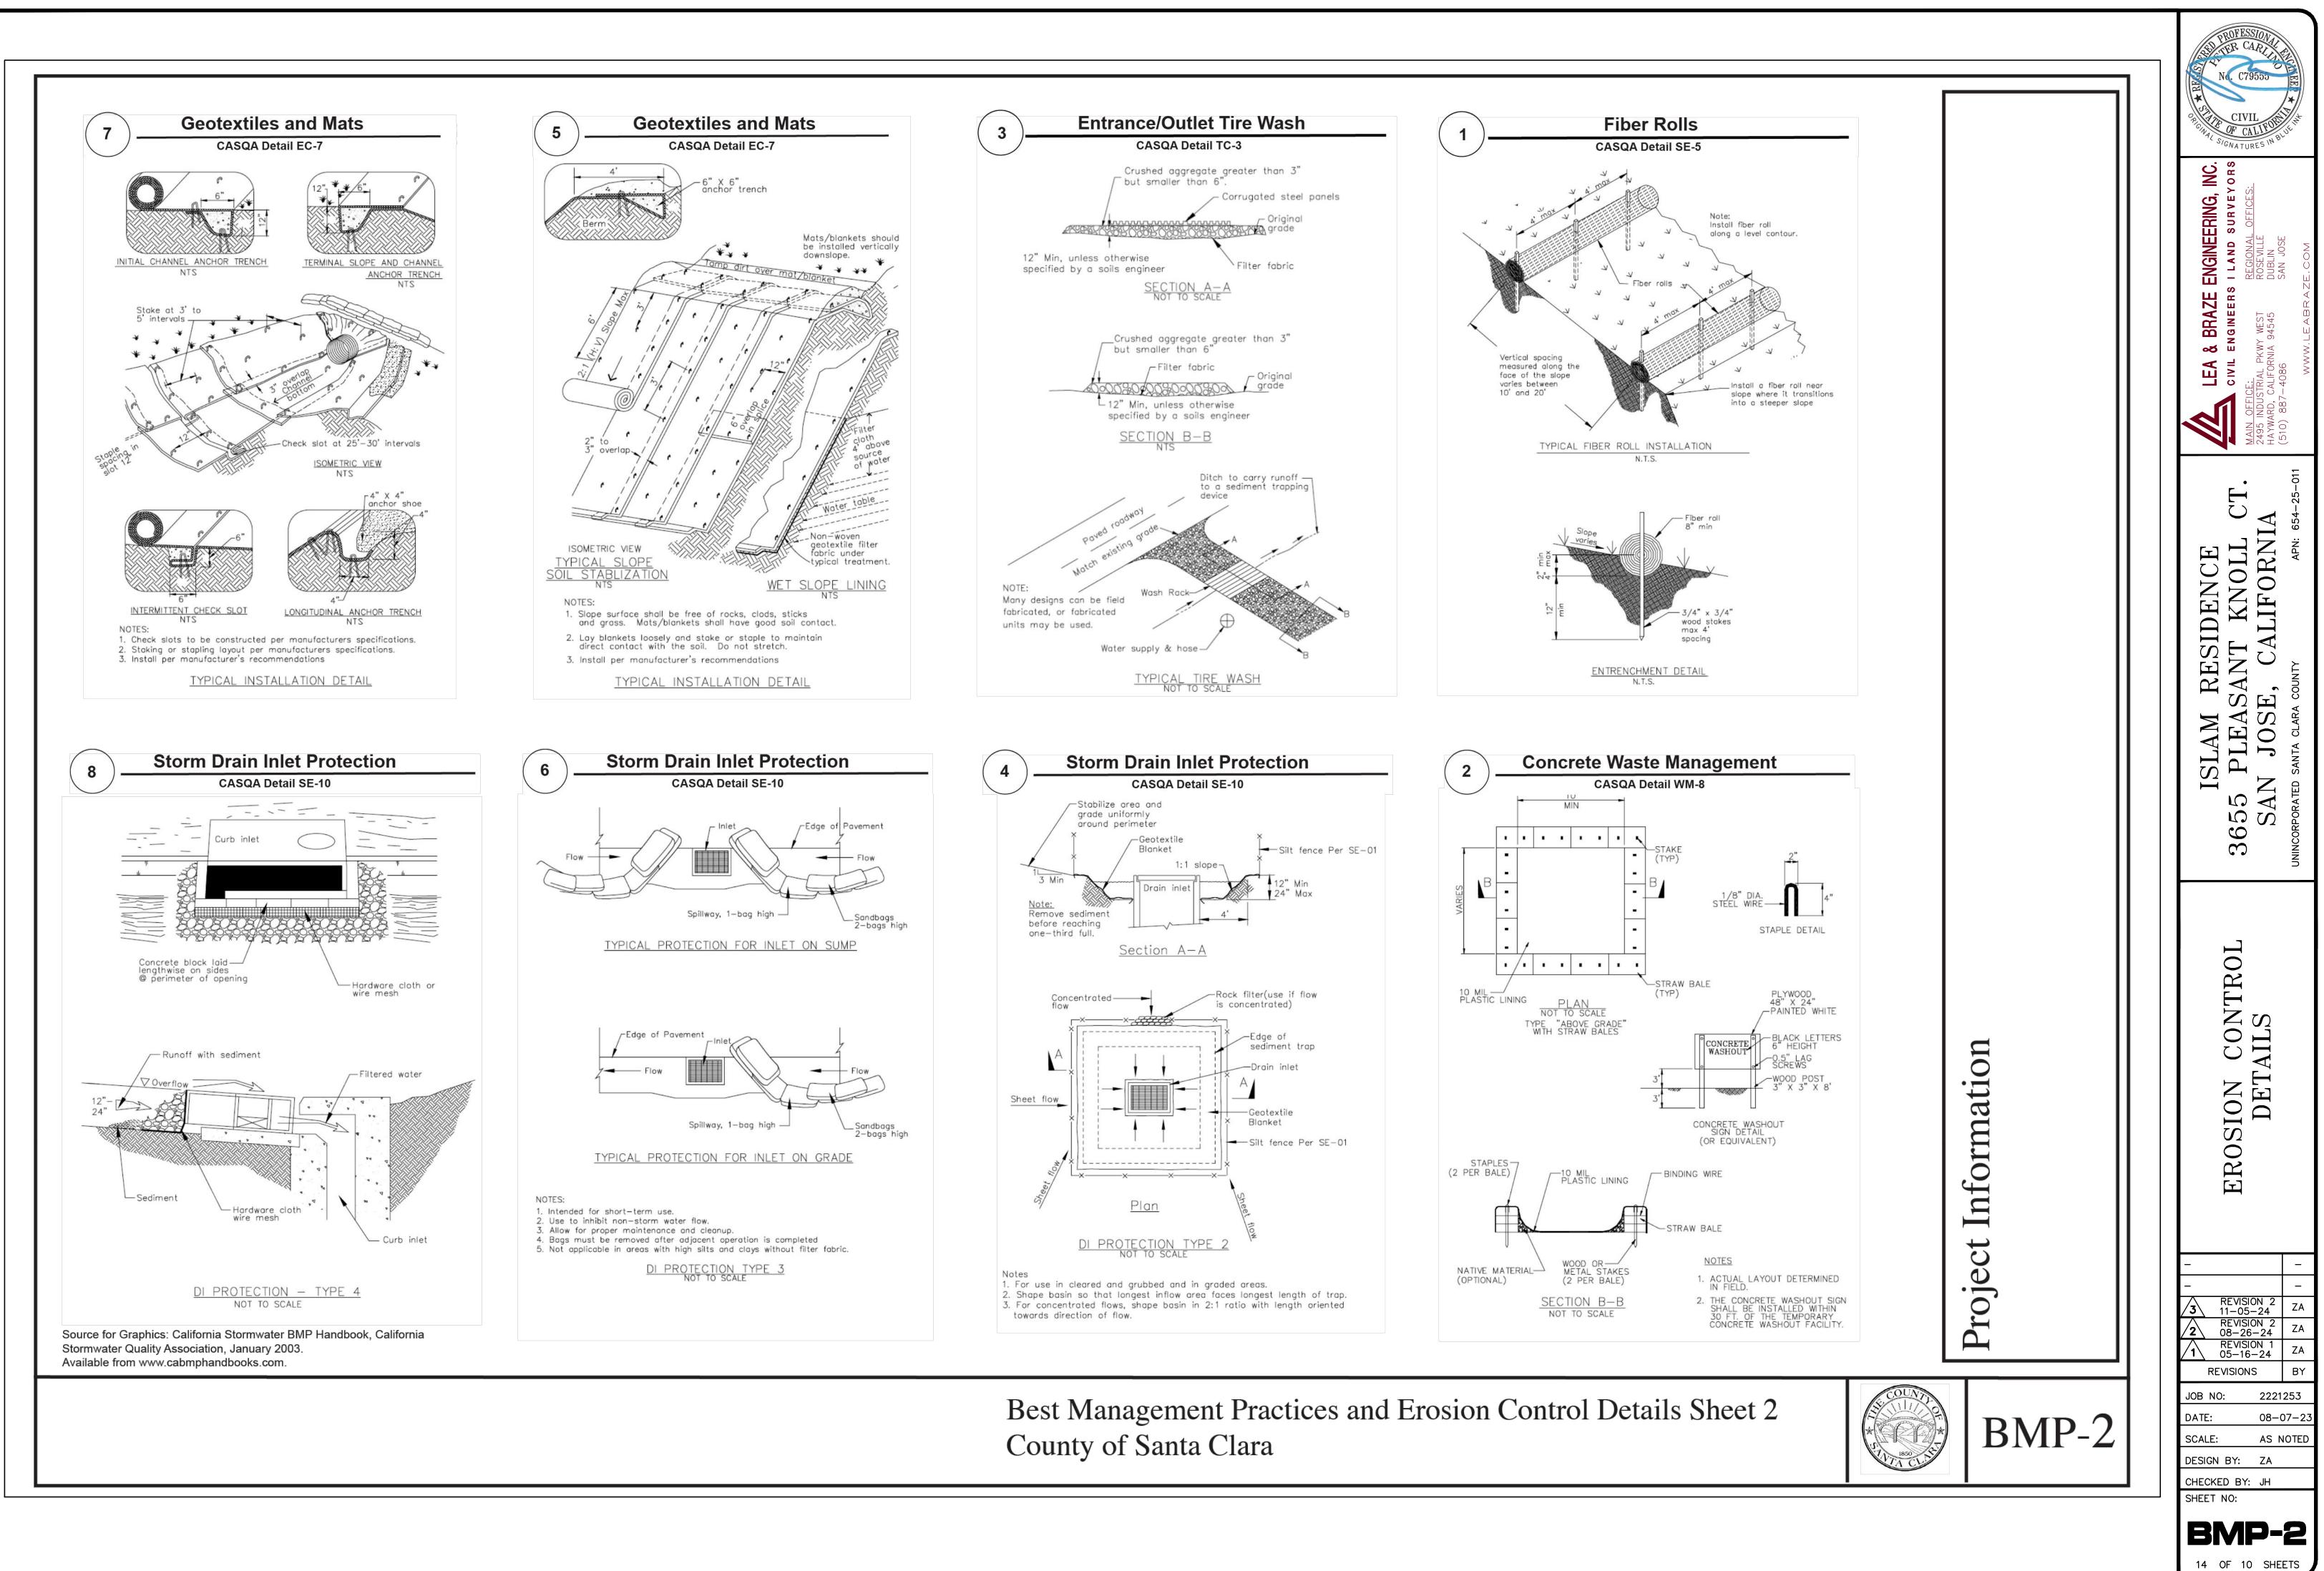

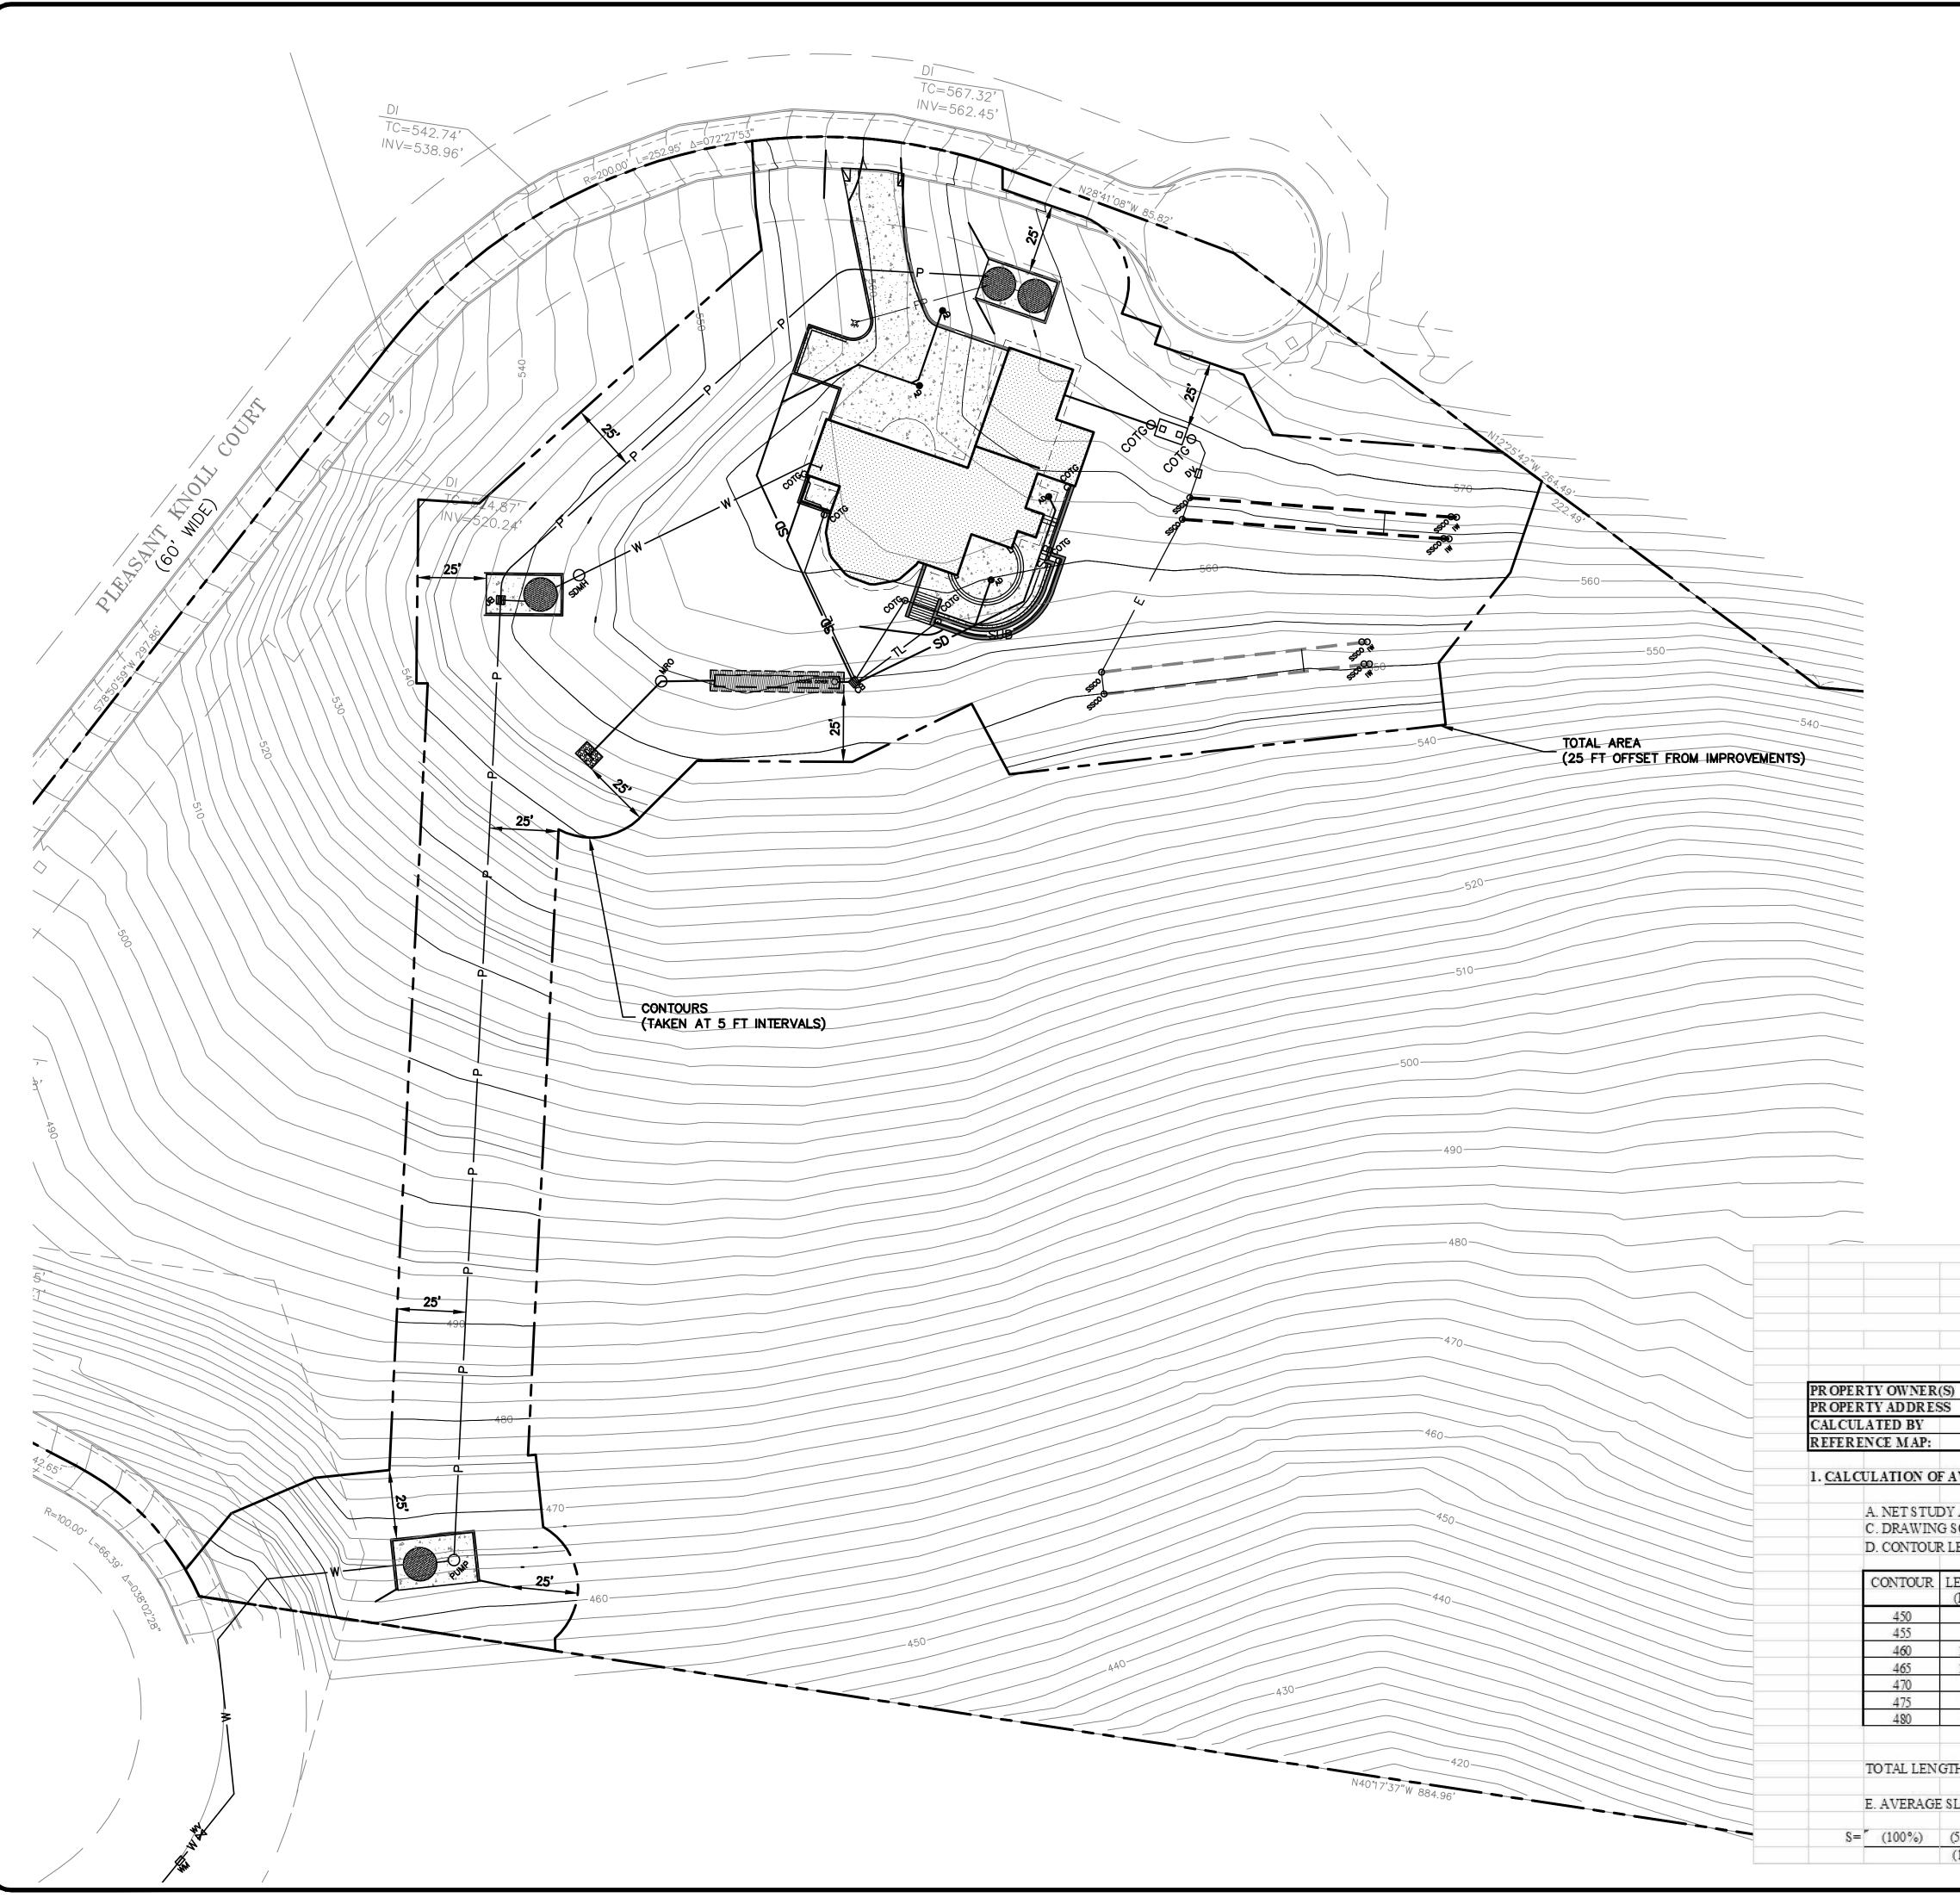

15 SCAL	30 E: 1":	60 <b>= 30'</b>	

		CO	UNTY OF SANT	TA CLARA				
		LL LEP	& BRAZE ENG	INEERING, INC.				
- 1961 Sp 10			1	4		19 July 20 - 20 ( 19 - 10 )		
C.	ALCULAT	TIONS BY LE	A & BRAZE E	NGINEERING (5	10) 887-40	86		
		CALCUI	ATION OF AV	ERAGE SLOPE				
		CALCUL	Allow OF AV	ERAGE SLOFE				
5)	Islam Resi	dence						
5) 5	3655 Plea	sant Knoll Ct						
	ZA				DATE		M	ay 17, 202
	Grading an	id Drainage Pla	n byLea & Braz	e #2221253 CI	JOB#			222125
AVERAG	GE SLOPE		-					5- 
Y AREA (	(A):	r 1.057	ACRES	P. CONTOU		AT ZD	5	ft
SCALE	,An)	1.857		B. CONTOU	K IN IEK VA	ът (I)		IL.
19 99 360 901 ST 5 308 111	WITHIN N	ET STUDY A	350		-		-	
LENOITI	WIIIINI							
LENGTH		CONTOUR	LENGTH	CONTOUR	LENGTH		CONTOUR	LENGT
(FEET)			(FEET)		(FEET)			(FEET)
40.4		485	50.0	520	54.4		555	527.3
50.1	W 2	490	50.0	525	57.8		560	457.0
128.0		495	51.4	530	58.5		565	314.2
113.6		500	50.7	535	62.0		570	239.0
89.5		505	52.1	540	76.0			
53.1		510	51.9	545	327.4			
50.0		515	53.4	550	466.5		-	
	-				-		TOTAL	3524.3
TUMIT	עם ע וסדד	MAPSCALE	0 = I =			TOTAL	3524.3	ET.
TTT (IMOL	IIILIDI	WM SCALL	.)-L-			TOTAL	5524.5	11.
SLOPE W	ITHIN NE	T AREA OF I	от				r	
-2012 1								
(5.0 FT)		(3524 FT)	-	21.79%				
(1.857)	43560				-		r	Ĩ

No. C79555 REALIZED CALLPOINT REALIZED CONTRACTOR OF CALLPOINT REALIZED CONTRACTOR OF CALLPOINT REALIZED TO CONTRACTOR OF CALLPOINT	
LEA & BRAZE ENGINEERING, INC. LEA & BRAZE ENGINEERING, INC. civil ENGINEERS I LAND SURVEYORS MAIN OFFICE: 2495 INDUSTRIAL PKWY WEST HAYWARD, CALIFORNIA 94545 (510) 887–4086 SAN JOSE	VV VV VV.LEADRAZE.COM
ISLAM RESIDENCE 3655 PLEASANT KNOLL CT. SAN JOSE, CALIFORNIA UNINCORPORATED SANTA CLARA COUNTY APIN 654-25-011	
AVERAGE LOT SLOPE	
– – – – REVISIONS BY	_
JOB NO: 2221253 DATE: 05–17–2	4
SCALE: AS NOTED DESIGN BY: ZA	
CHECKED BY: JH	
SHEET NO:	

# REFERENCES

# THIS GRADING AND DRAINAGE PLAN IS SUPPLEMENTAL

1. TOPOGRAPHIC SURVEY BY XXXX ENGINEERING, ENTITLED:

"TOPOGRAPHIC SURVEY" 3655 PLEASANT KNOLL COURT SAN JOSE, CA

2. SITE PLAN BY CAMARGO & ASSOCIATES ARCHITECTS ENTITLED: "SITE PLAN" 3655 PLEASANT KNOLL COURT SAN JOSE, CA

THE CONTRACTOR SHALL REFER TO THE ABOVE NOTED SURVEY AND PLAN, AND SHALL VERIFY BOTH EXISTING AND PROPOSED ITEMS ACCORDING TO THEM.

# ABBREVIATIONS

AD BFP CB G CO	AREA DRAIN BACKFLOW PREVENTO CATCH BASIN CENTER LINE CLEANOUT
DIV E	DIVERSION VALVE EFFLUENT
ĒLEV	ELEVATIONS
(E)	EXISTING
ŕĽ	FLOW LINE
	INVERT ELEVATION
JT	JOINT TRENCH
LNDG	
MM AX MIN	MAXIMUM MINIMUM
(N)	NEW
NTS	NOT TO SCALE
0.C.	ON CENTER
PL	PROPERTY LINE
ŘM	RIM ELEVATION
SS	SANITARY SEWER
SSCO	SANITARY SEWER
	CLEANOUT
SSMH	SANITARY SEWER
OTD	MANHOLE
STD	STANDARD
TW/FG	TOP OF WALL/FINISH GRADE
TYP	TYPICAL
w/	WITH
₩. wL	WATER LINE
• –	

# GENERAL INSTALLATION NOTES:

# PERMITS:

CONSTRUCTION OF THE SEWAGE DISPOSAL SYSTEM SHALL NOT COMMENCE WITHOUT WRITTEN APPROVAL FROM SANTA CLARA COUNTY ENVIRONMENTAL HEALTH SERVICES.

# PLAN CHANGES

CHANGES TO THE PLANS OR SPECIFICATIONS SHALL BE MADE ONLY AFTER CONSULTATION WITH AND APPROVAL OF THE DESIGNER AND PERMITTING AGENCY.

INSTALLATION: ALL INSTALLATION WORK SHALL BE IN ACCORDANCE WITH COUNTY OF SANTA CLARA.

LOCATION OF THE SEPTIC TANK AND LEACHING TRENCHES; LOCATIONS SHOWN ON THE PLANS ARE SUBJECT TO ADJUSTMENT IN THE FIELD BY DESIGNER WITH APPROVAL OF THE PERMITTING AGENCY. TRENCHES SHALL BE INSTALLED ALONG LEVEL CONTOUR TO ENSURE THE TRENCH BOTTOM IS MAINTAINED LEVEL THROUGHOUT THE ENTIRE LENGTH. A TRIPOD-MOUNTED LASER SHALL BE REQUIRED ON SITE.

MINIMUM DISTANCES (IN FEET)

MEASURED FROM:

ALL WELLS AND SPRINGS

STEEP SLOPES\*\*\*

DRAINAGE/SWALE

FOUNDATION

PROPERTY LINE

SEPTIC TANKS

SWIMMING POOL

PONDS AND LANSLIDES

LINED DRAINAGE DITCH

ENERGY DISSIPATERS\*\*\*\*

CLOSED DRAIN PIPE OR CULVERT


WATERCOURSES\* (TOP OF BANK)

CUT OR STEEP EMBANKMENTS (TOP OF CUT)

ROAD EASEMENT, PAVEMENT, OR DRIVEWAY

UNLINED EARTHEN CHANNEL OR V-DITCH

RESERVOIRS (HIGHWATER MARK)

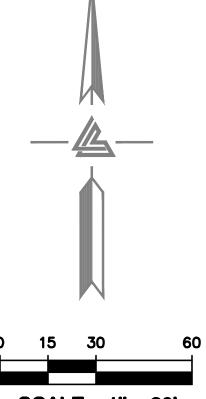

SCALE: 1" = 30'

SEPTIC

TANK

100'

100'

200'

10 FEET

50'

5'

10'

N/A

25'

- 5'

100'

10'

15'

25'

15'

10' X 20' | 10' X 20'

10 FEET

DISPOSAL

FEILD

100'

100'

200'

4 X H\*\*

4 X H\*\*

50'

10'

10'

6'

25'

100'

10'

15'

25'

# CONVENTIONAL SYSTEM LEACH LINE CALCULATIONS:

PERCOLATION RATE BASED ON FIELD DATA WAS OBSERVED TO BE 17 MPI. IN ACCORDANCE WITH TABLE 1 (SECTION 3 BACK OF PAGE 3-18) OF THE SANTA CLARA COUNTY ONSITE SYSTEMS MANUAL THE APPLICATION RATE IS 0.68 GPD/SQFT (WITH INTERPOLATION).

HOME IS PROPOSED WITH 4 BEDROOMS THEREFORE, WASTEWATER FLOW IS 525 GAL/DAY PER TABLE 3-1 (SECTION 3) OF THE SANTA CLARA COUNTY ONSITE SYSTEMS MANUAL.

REQUIRED LENGTH CALCULATED BY THE EQUATION SUPPLIED ON PAGE 3-17 OF THE SANTA CLARA COUNTY ONSITE SYSTEMS MANUAL (SECTION 3) THAT STATES:

TRENCH LENGTH = Q/(R\*A)

Q=FLOW RATE (GPD) R=WASTEWATER APPLICATION RATE (GPD/SQFT) A=TOTAL INFILTRATIVE AREA PER LINEAR FOOT (SQFT) [4 SQFT STANDARD]

REQUIRED TRENCH LENGTH FOR 100% CAPACITY CALCULATION (OWTS ORDINANCE REQUIRES 2 100% FIELD "PRIMARY AND SECONDARY"): 525/(4\*0.68) = 194 FT REQUIRED

TOTAL CONVENTIONAL DISPERSAL TRENCH LENGTH REQUIRED = 388 LINEAR FEET

SEE DISPERSAL TRENCH TABLE ON SHEET SS-2 FOR BREAKDOWN OF LEACH LINE LENGTH PROVIDED IN EACH FIELD. 

						SLY) IN A				, HAVING	A BED	OR BANKS	AND
**	H EQU	ALS THE	E HEIGHT	OF UT	OR EM	BANKMEN	T IN	FEET.	THIS S	ETBACK	DISTANCE		IENT

TREES 12" (OR GREATER) IN Ø MEASURED @ 4.5' TALL 15'

MUST NOT BE LESS THAN 25 FEET OR MORE THAN 100 FEET. \*\*\* AS DEFINED BY THE REGIONAL WATER QUALITY CONTROL BOARD HAVING JURISDICTION, BUT NOT EXCEEDING 67 PERCENT.

\* WATERCOURSE - A RUNNING STREAM FED ROM PERMANENT OR NATURAL SOURCES, INCLUDING RIVERS, CREEKS, RUNS, AND RIVULETS. THERE MUST BE A STREAM, USUALLY FLOWING IN A PARTICULAR DIRECTION

SANTA CLARA COUNTY OWTS SETBACKS:

(M) NO PRIVATE SEWAGE DISPOSAL SYSTEM MAY BE APPROVED ON ANY PARCEL OF LAND WHERE PERCOLATION RATE EXCEEDS 120 MIN/INCH OR IS LESS THAN ONE MIN/INCH.

(N) NO PART OF ANY PRIVATE SEWAGE DISPOSAL SYSTEM MAY CROSS ANY PROPERTY LINE.

(0) UPON NOTICE FROM THE DIRECTOR THAT WORK ON THE SEWAGE DISPOSAL SYSTEM IS BEING CONDUCTED IN VIOLATION OF THIS CHAPTER, OR IN AN UNSAFE OR DANGEROUS MANNER, THE WORK MUST BE IMMEDIATELY STOPPED. THE STOP-WORK MUST BE ISSUED TO THE OWNER OF THE PROPERTY INVOLVED, OR THE OWNER'S AGENT, OR THE PERSON DOING THE WORK. IT MUST STATE THE CONDITIONS UNDER WHICH WORK MAY B RESUMERD.NO PRIVATE SEWAGE DISPOSAL SYSTEM MAY BE APPROVED ON ANY PARCEL OF LAND WHERE PERCOLATOIN RATE EXCEEDS 120 MIN/INCH OR IS LESS THAN ONE MIN/INCH.

\*\*\*\* ENERGY DISSIPATERS - 10 FEET DOWNSLOPE AND 20 FEET TO THE SIDE.

\*\*\*\*\*PER PAGE 24 OF 199 OF THE COUNTY LAND USE MANUAL.

# ENGINEERED PLANS FOR ON-SITE W TREATMENT SYSTEM [OW 3655 PLEASANT KNOLL CO SAN JOSE, CALIFORNIA

# $\sim$

 $\Leftarrow$ 





COUNTY REQUIRES LEACH LINES TO BE STAKED OUT BY A SURVEYOR PRIOR TO INSTALLATION. FOR CONSTRUCTION STAKING SCHEDULING OR QUOTATIONS PLEASE CONTACT ALEX ABAYA AT LEA & BRAZE ENGINEERING (510)887-4086 EXT 116. aabaya@leabraze.com


NOTE

# AREA BELOW IS FOR SANTA CLARA COUNTY DEPARTMENT OF

	Sector of the sector	OWTS       TITLE       SHEET       ISLAM       RESIDENCE       EA & BRAZE ENGINERING, INC.         OWTS       TITLE       SHEET       3655       PLEASANT       KNOLL       CUL       EN IN SURVEYORS         SAN JOSE, CALIFORNIA       JONNCORPORATE SANT CLURINIA       APNI SCHERE, INV.       REGIONAL OFFICE.       REGIONAL OFFICE.       REGIONAL OFFICE.         UNINCORPORATED SANTA CLURINIA       APNI SCHERE, INV.       APNI SCHERE, INV.       REGIONAL OFFICE.       REGIONAL OFFICE.         UNINCORPORATED SANTA CLURINIA       APNI SCHERE, INV.       APNI SCHERE, INV.       REGIONAL OFFICE.       REGIONAL OFFICE.
-  -		 2 DEH REVIEW ZA 01-09-24 ZA DEH REVIEW ZA 07-06-23 ZA REVISIONS BY JOB NO: 2221253 DATE: 05-02-23 SCALE: AS NOTED DESIGN BY: ZA CHECKED BY: JH SHEET NO: OVVTS SSS-1 01 OF 03 SHEETS

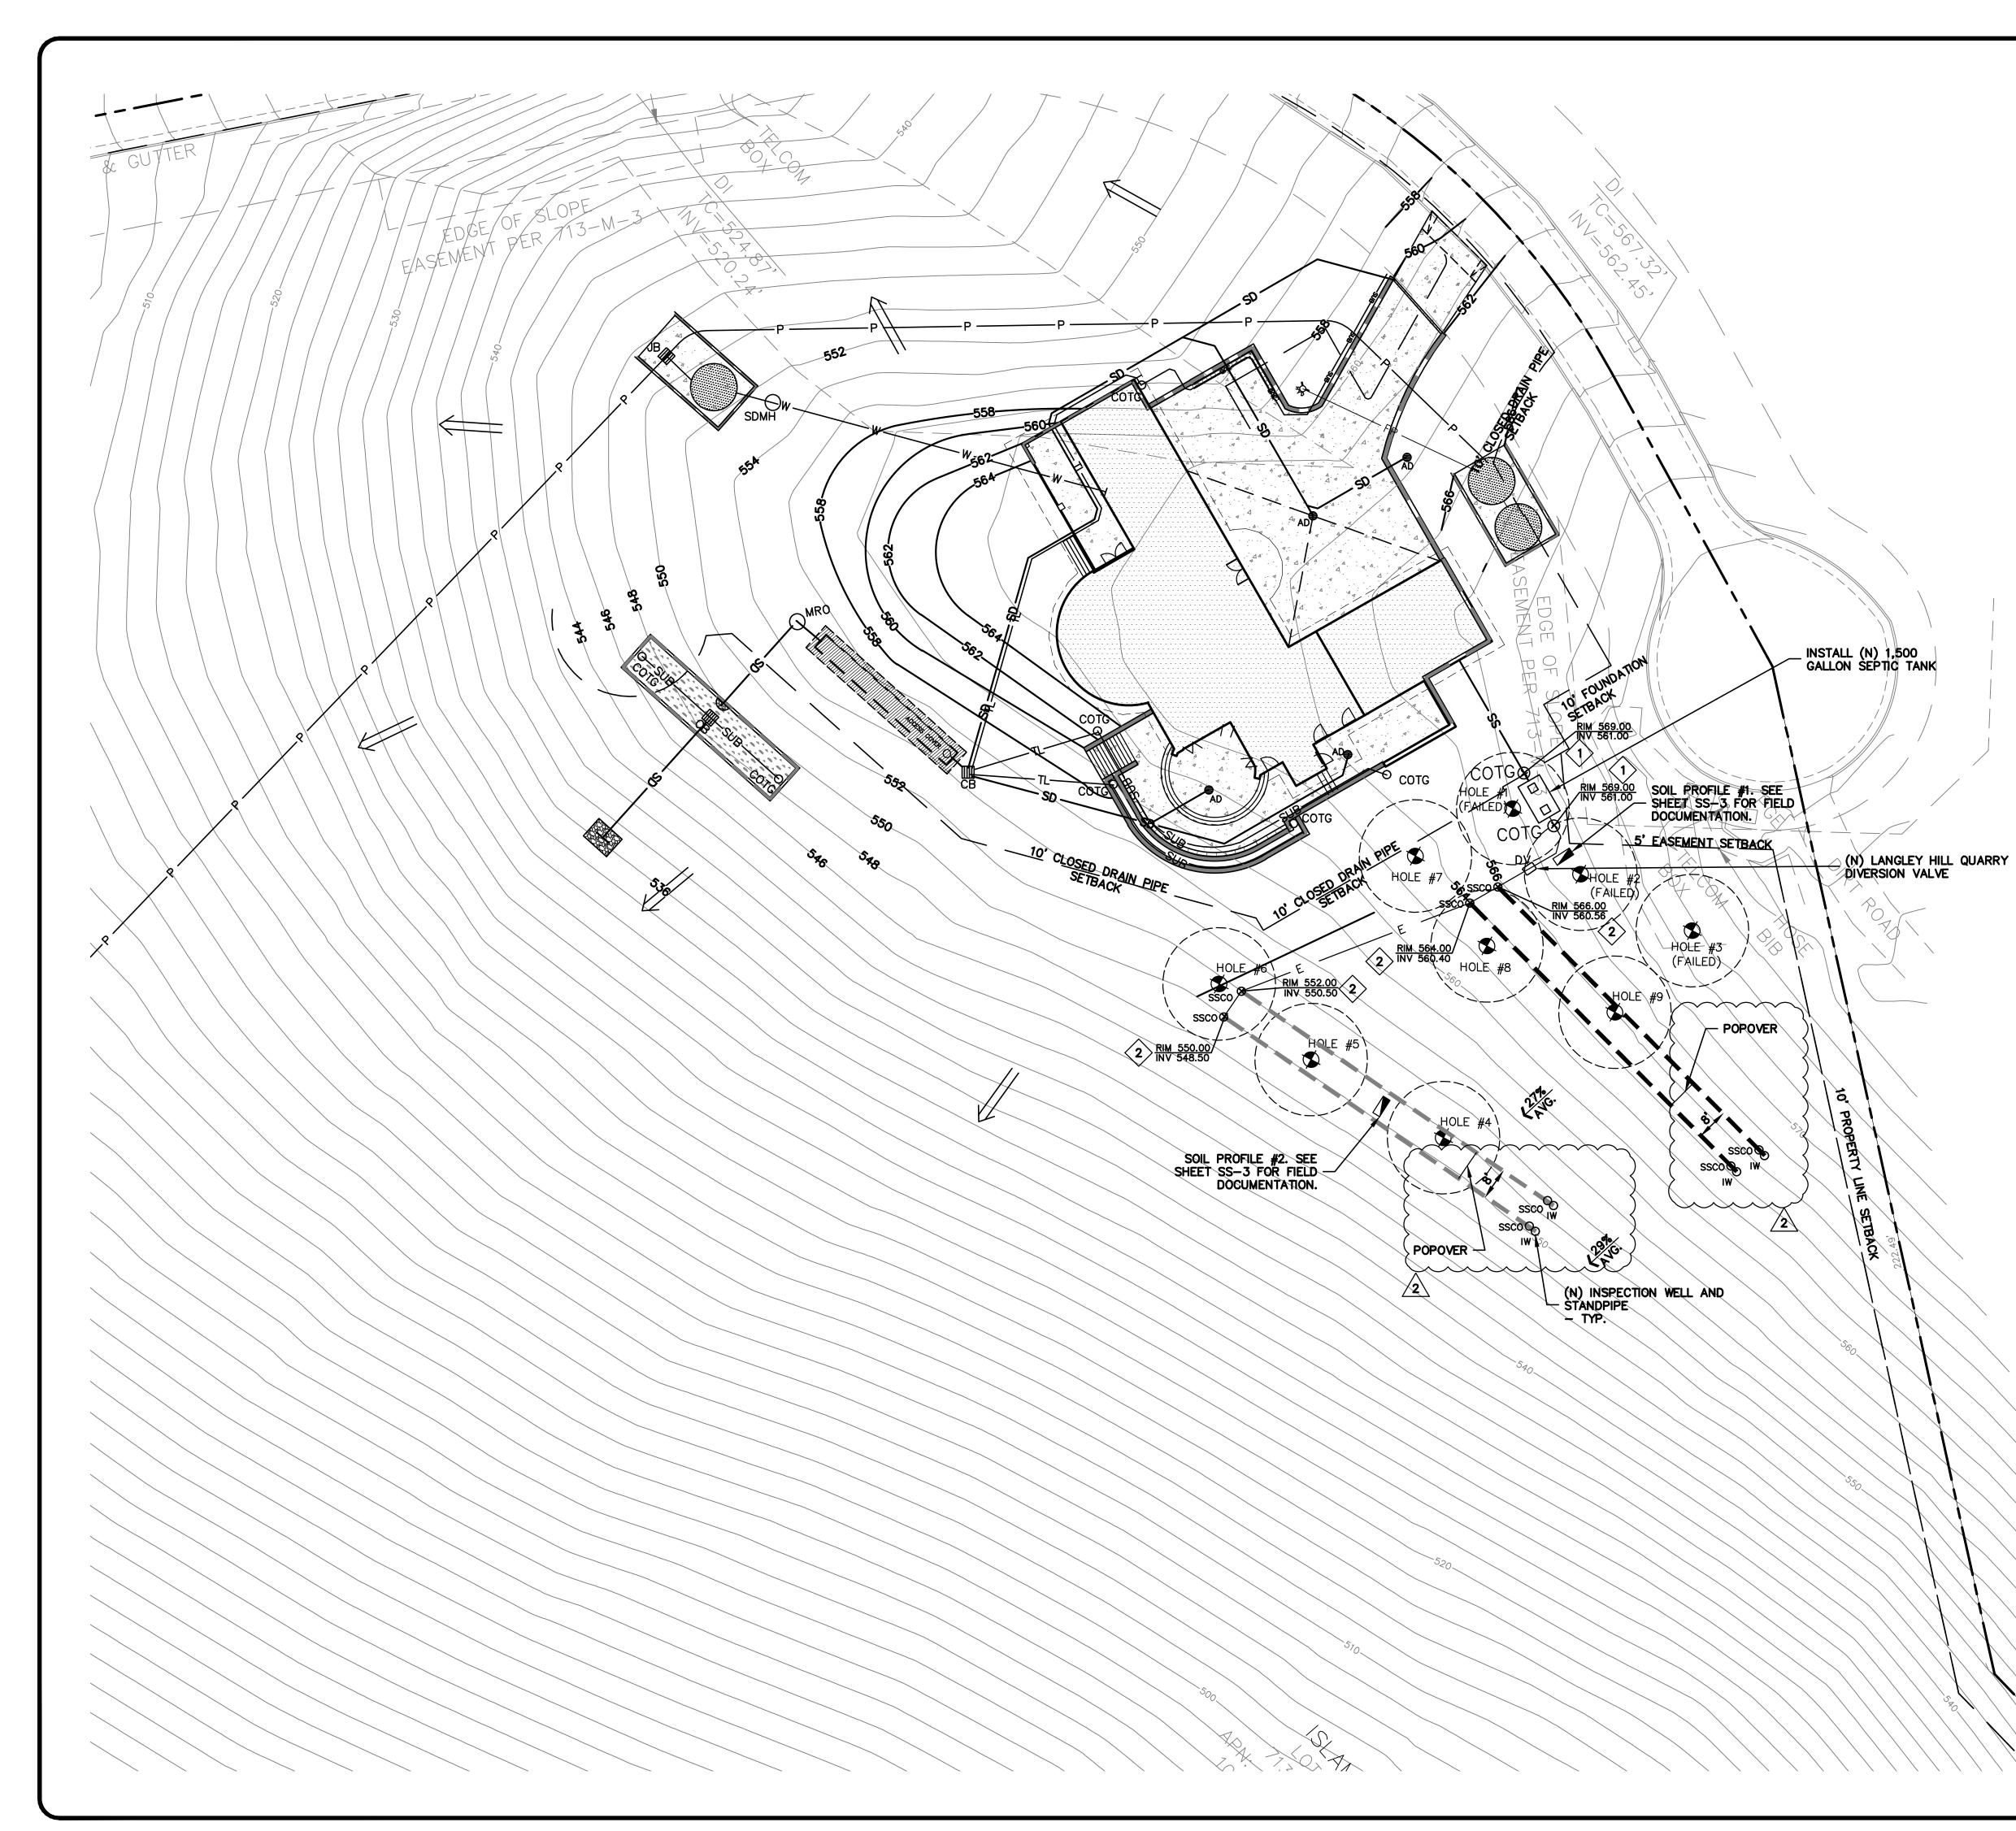

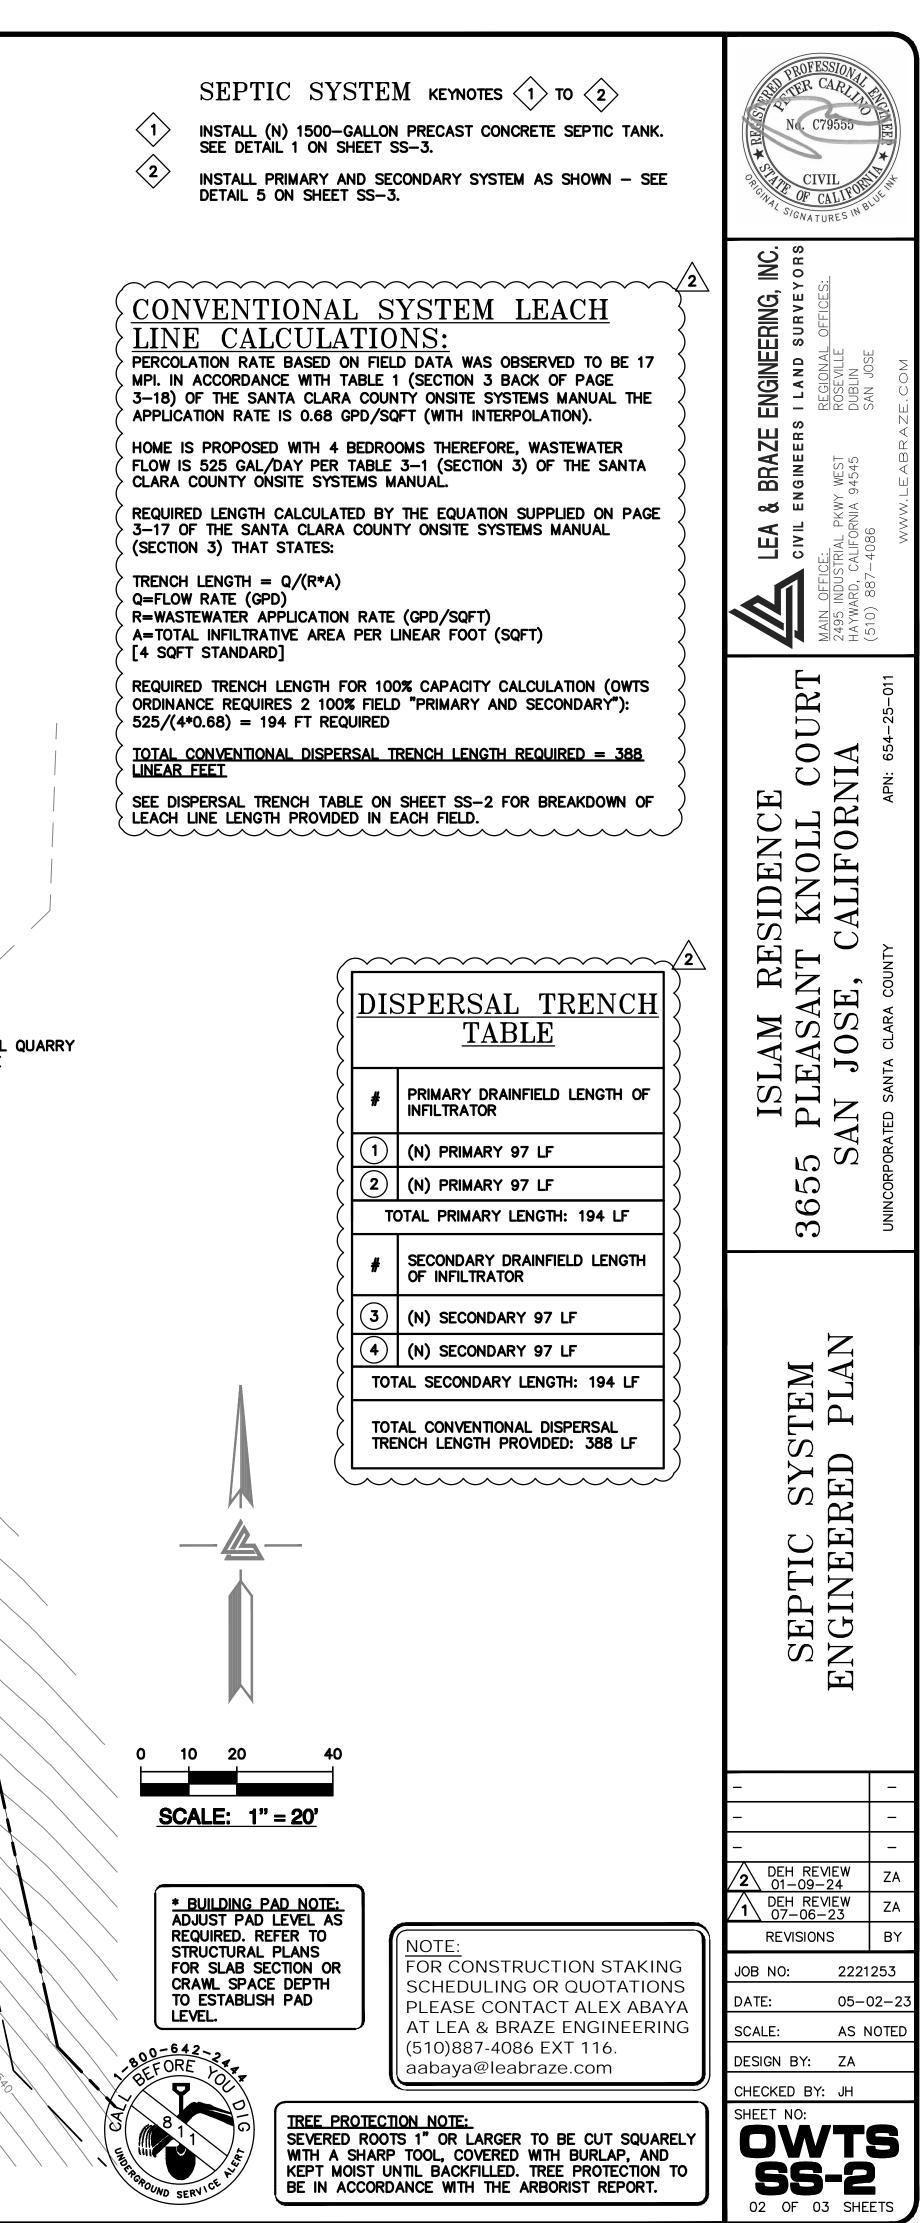


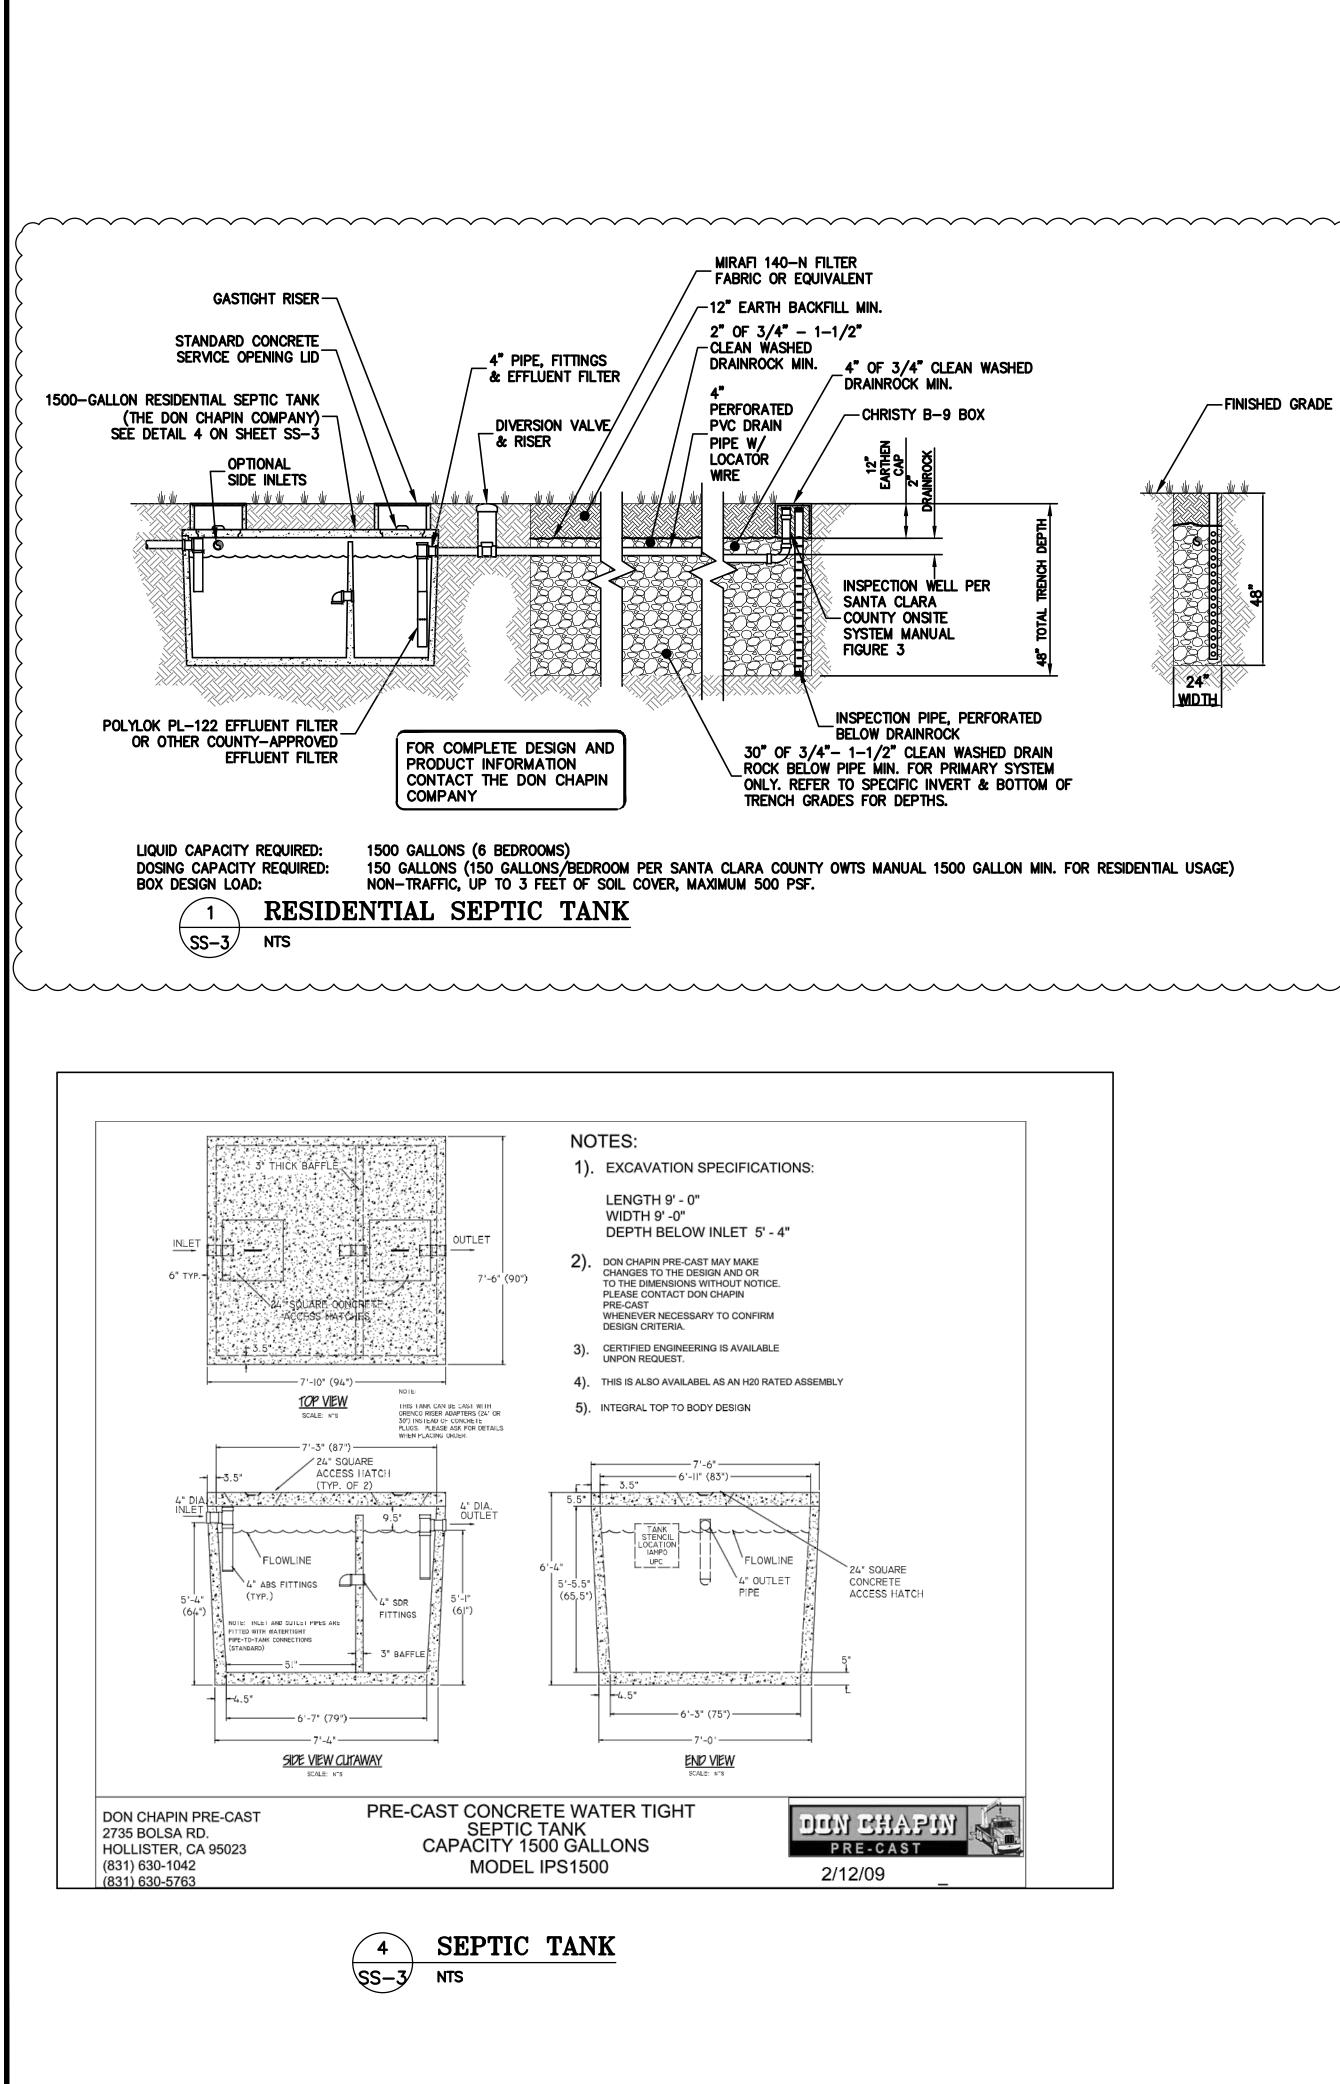


24\*

WDTH

1					SOIL PERG	COLATION	I TEST R	ECORDED	MEASUR					
>	OWNER//	nav se straslavnava	A. 2000	1. V.D.De - 825				SR#:			PLN FILE	#		
>	LOCATION	N: 3655 PI	easant Ki	noll Cour	t			REHS/RC	:E:			TECT DA	TE 1. 13/1	2/201
>	CONTACT	PERSON	: John Ha	lbom				PHONE:	(408) 965	-8478		1. No.2452 (AMU) (2013)	TE 1: 12/1 TE 2: 02/1	
\$	HOLE #7		DEPTH =	3.0' (TE	ST DATE	02/17/23	3)	HOLE #8	2	DEPTH =	3.0' (TE	ST DATE	: 02/17/23	:)
	TIN	ЛЕ		RLEVEL			· <u>/</u>		ME	2 2	LEVEL		,,	,
$\wedge$	START	FINISH	START	FINISH			MPI	START	FINISH	START			∆INCH	M
$\sim \sim $	13:30	14:00	28	24 3/8	30	3 5/8	8.28	13:33	14:03	28	23 5/8	30	4 3/8	6.8
) (	14:00	14:30	28 2/8	24 5/8	30	3 5/8	8.28	14:03	14:33	28	23 5/8	30	4 3/8	6.8
$\langle \rangle$	14:30	15:00	28	24 4/8	30	3 5/8	8.28	14:33	15:03	28	23 5/8	30	4 3/8	6.3
$\langle \rangle$									15		CTADIE			
$\langle \langle \rangle$				STABLE Stabiliz	ed MPI	8.2	28				STABLE Stabiliz	ed MPI	6	86
$\langle \langle \rangle$						0.2					0.0001112		U.	
$\langle \langle \rangle$	HOLE #9		DEPTH =	3.0' (TE	ST DATE:	02/17/23	3)	HOLE #4	ii i	DEPTH =	4.5' (TE	ST DATE:	: 12/12/22	:)
$\mathbf{z}$	TIN	ЛЕ	WATEF	RLEVEL				TII	ME	WATEF	R LEVEL			
) (	START	FINISH	START	FINISH	$\triangle$ MIN	$\triangle$ INCH	MPI	START	FINISH	START	FINISH	$\triangle$ MIN	△INCH	M
) >	15:14	15:15	28	22 4/8	5	5 4/8	0.91	9:09	9:39	16	12 1/8	30	3 7/8	7.
) >	15:20	15:25	28 1/8	22 6/8	5	5 3/8	0.93	9:39	10:09	16 2/8	12 2/8	30	4	7.
>	15:25	15:30	28 1/8	22 6/8 STABLE	5	5 3/8	0.93	10:09	10:39	16 1/8	12 2/8 STABLE	30	37/8	7.
$\left( \right) \right)$				201 201 - 2010-2010-20	ed MPI	0.9	12	e			01 02 000	ed MPI	7	66
$\left\{ \right\}$							-				0.0.0.111			
$\langle \rangle$	HOLE #5		DEPTH =	4.0' (TE	ST DATE:	12/12/22	2)	HOLE #6		DEPTH =	4.0' (TE	ST DATE:	12/12/22	:)
$\langle \rangle$	TIN	ЛЕ	WATEF	RLEVEL		69°		١١T	ME	WATEF	R LEVEL	14 14	y	
$\langle \rangle$	START	FINISH	START	FINISH	$\triangle MIN$	$\triangle$ INCH	MPI	START	FINISH	START	FINISH	$\triangle MIN$	△INCH	M
$\langle \rangle$	9:12	9:42	10	7 5/8	30	2 3/8	12.63	9:15	9:45	23	22 1/8	30	7/8	34.
1 /	9:42	10:12	10	75/8	30	2 3/8	12.63	9:45	10:15	23	22 1/8	30	7/8	34.
$\langle \rangle$	4:12	10:42	10	76/8	30	2 2/8	13.33	10:15	10:45	23	22 1/8	30	7/8	34.
$\left\{ \right\}$				STABLE							STABLE	2		
						I								
				13 9		1		° .		а) С				
			5 	2 2 2										
				Stabiliz	ed MPI	12.	87				Stabiliz	ed MPI	34	.29
				Stabiliz	ed MPI	12.	87				Stabiliz	ed MPI	34	.29
	HOLE			Stabiliz	ed MPI	12.	87		7	8	Stabiliz 9	ed MPI	34	
	HOLE	MPI		Stabiliz	red MPI	12.	87		7 8.28	8 6.86				.29 6 34.
	Table Custom Car		d MPI				87		55 - 55. 55 - 55.76	2. 20402040130	9	4	5	6
	Stablized	Stabilize	ana penara		R	4	87		8.28	6.86	9 0.92 1.29	4 7.66	5 12.87	

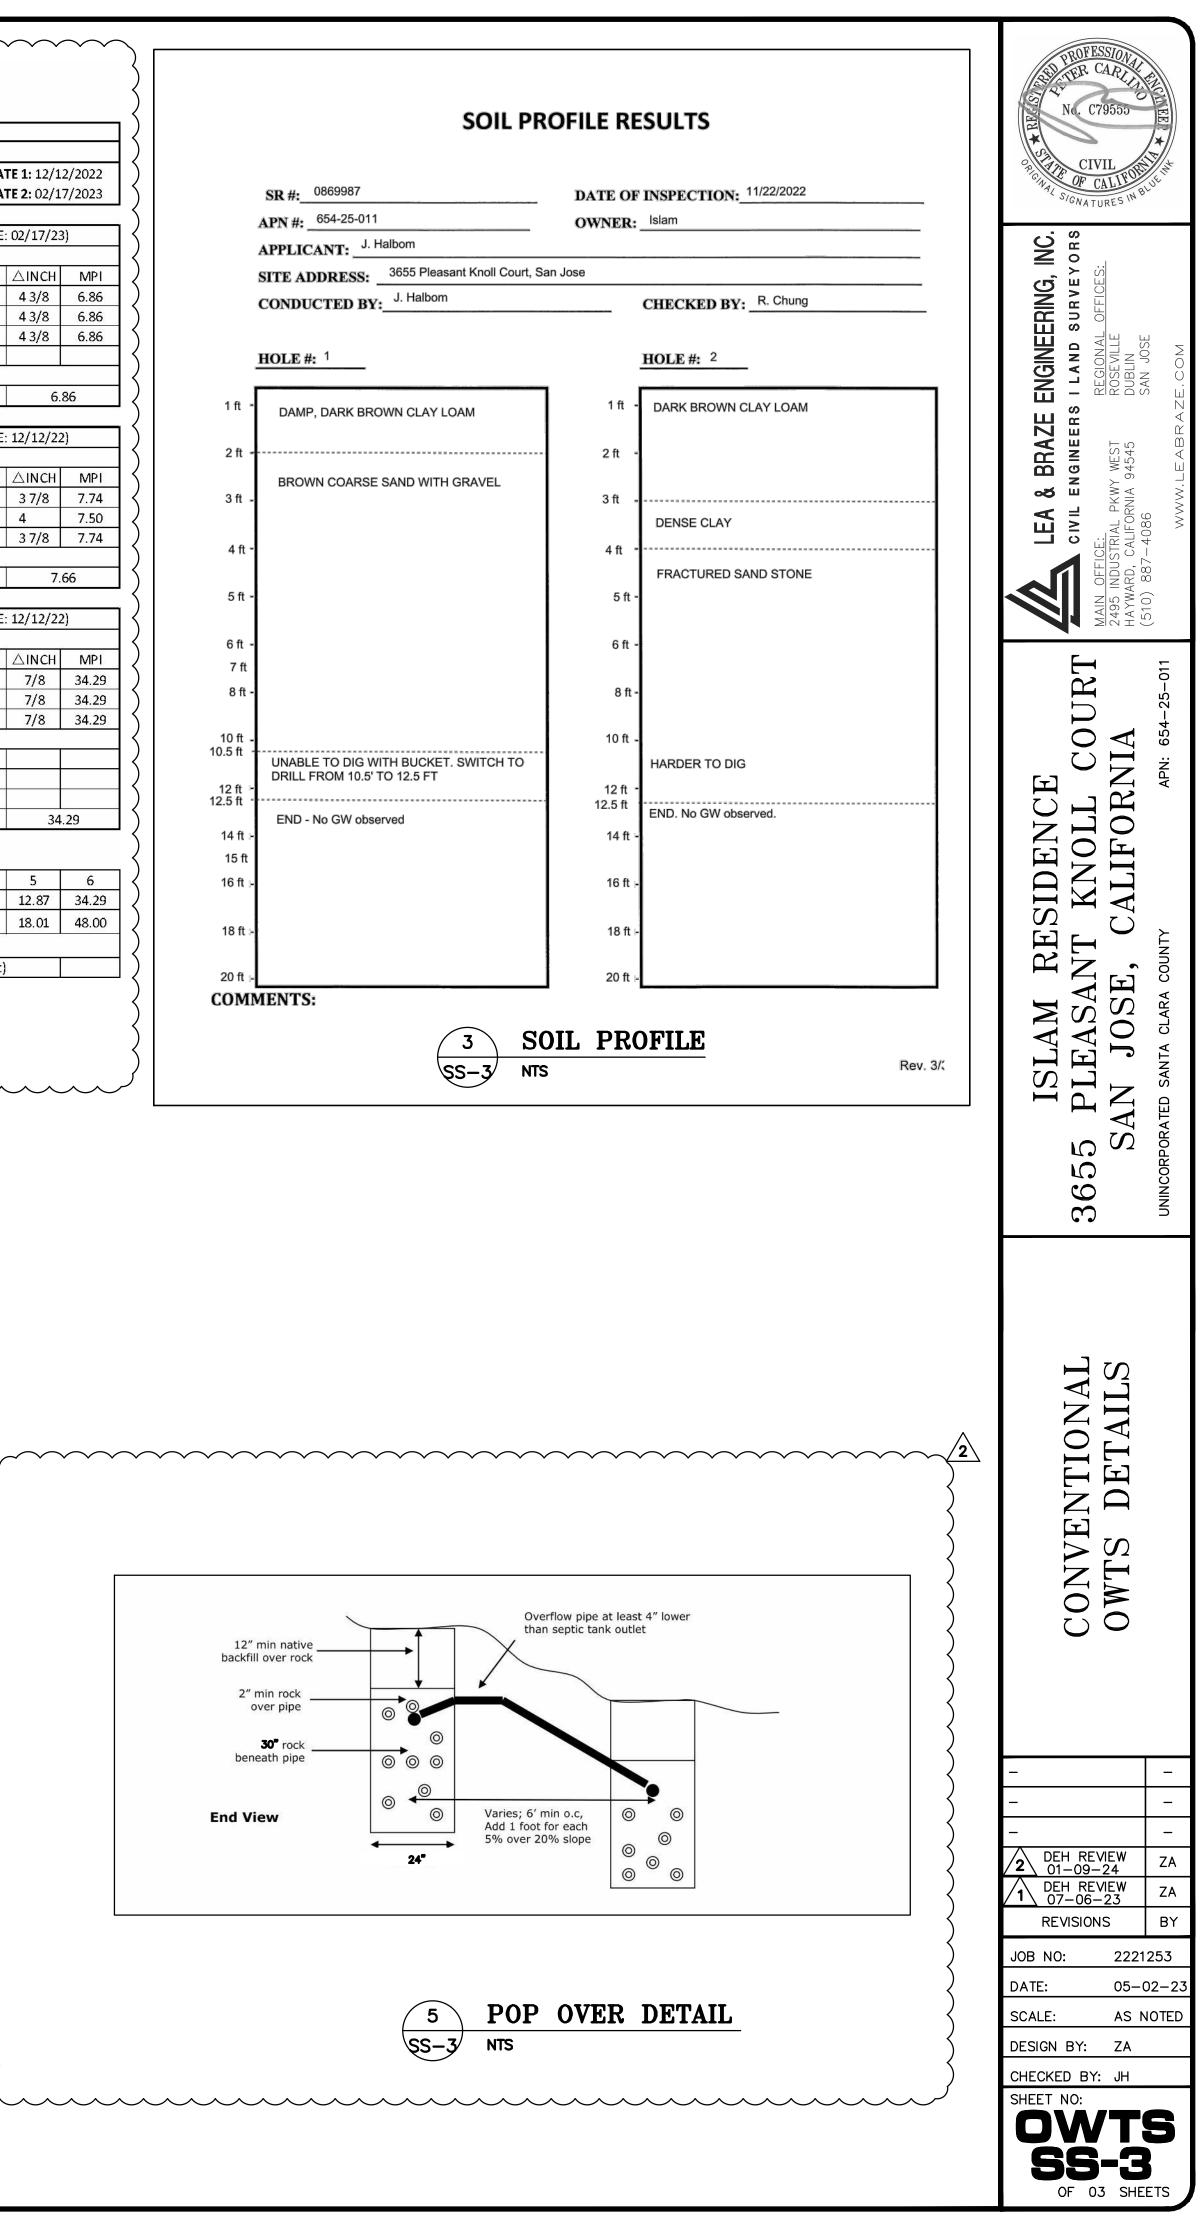

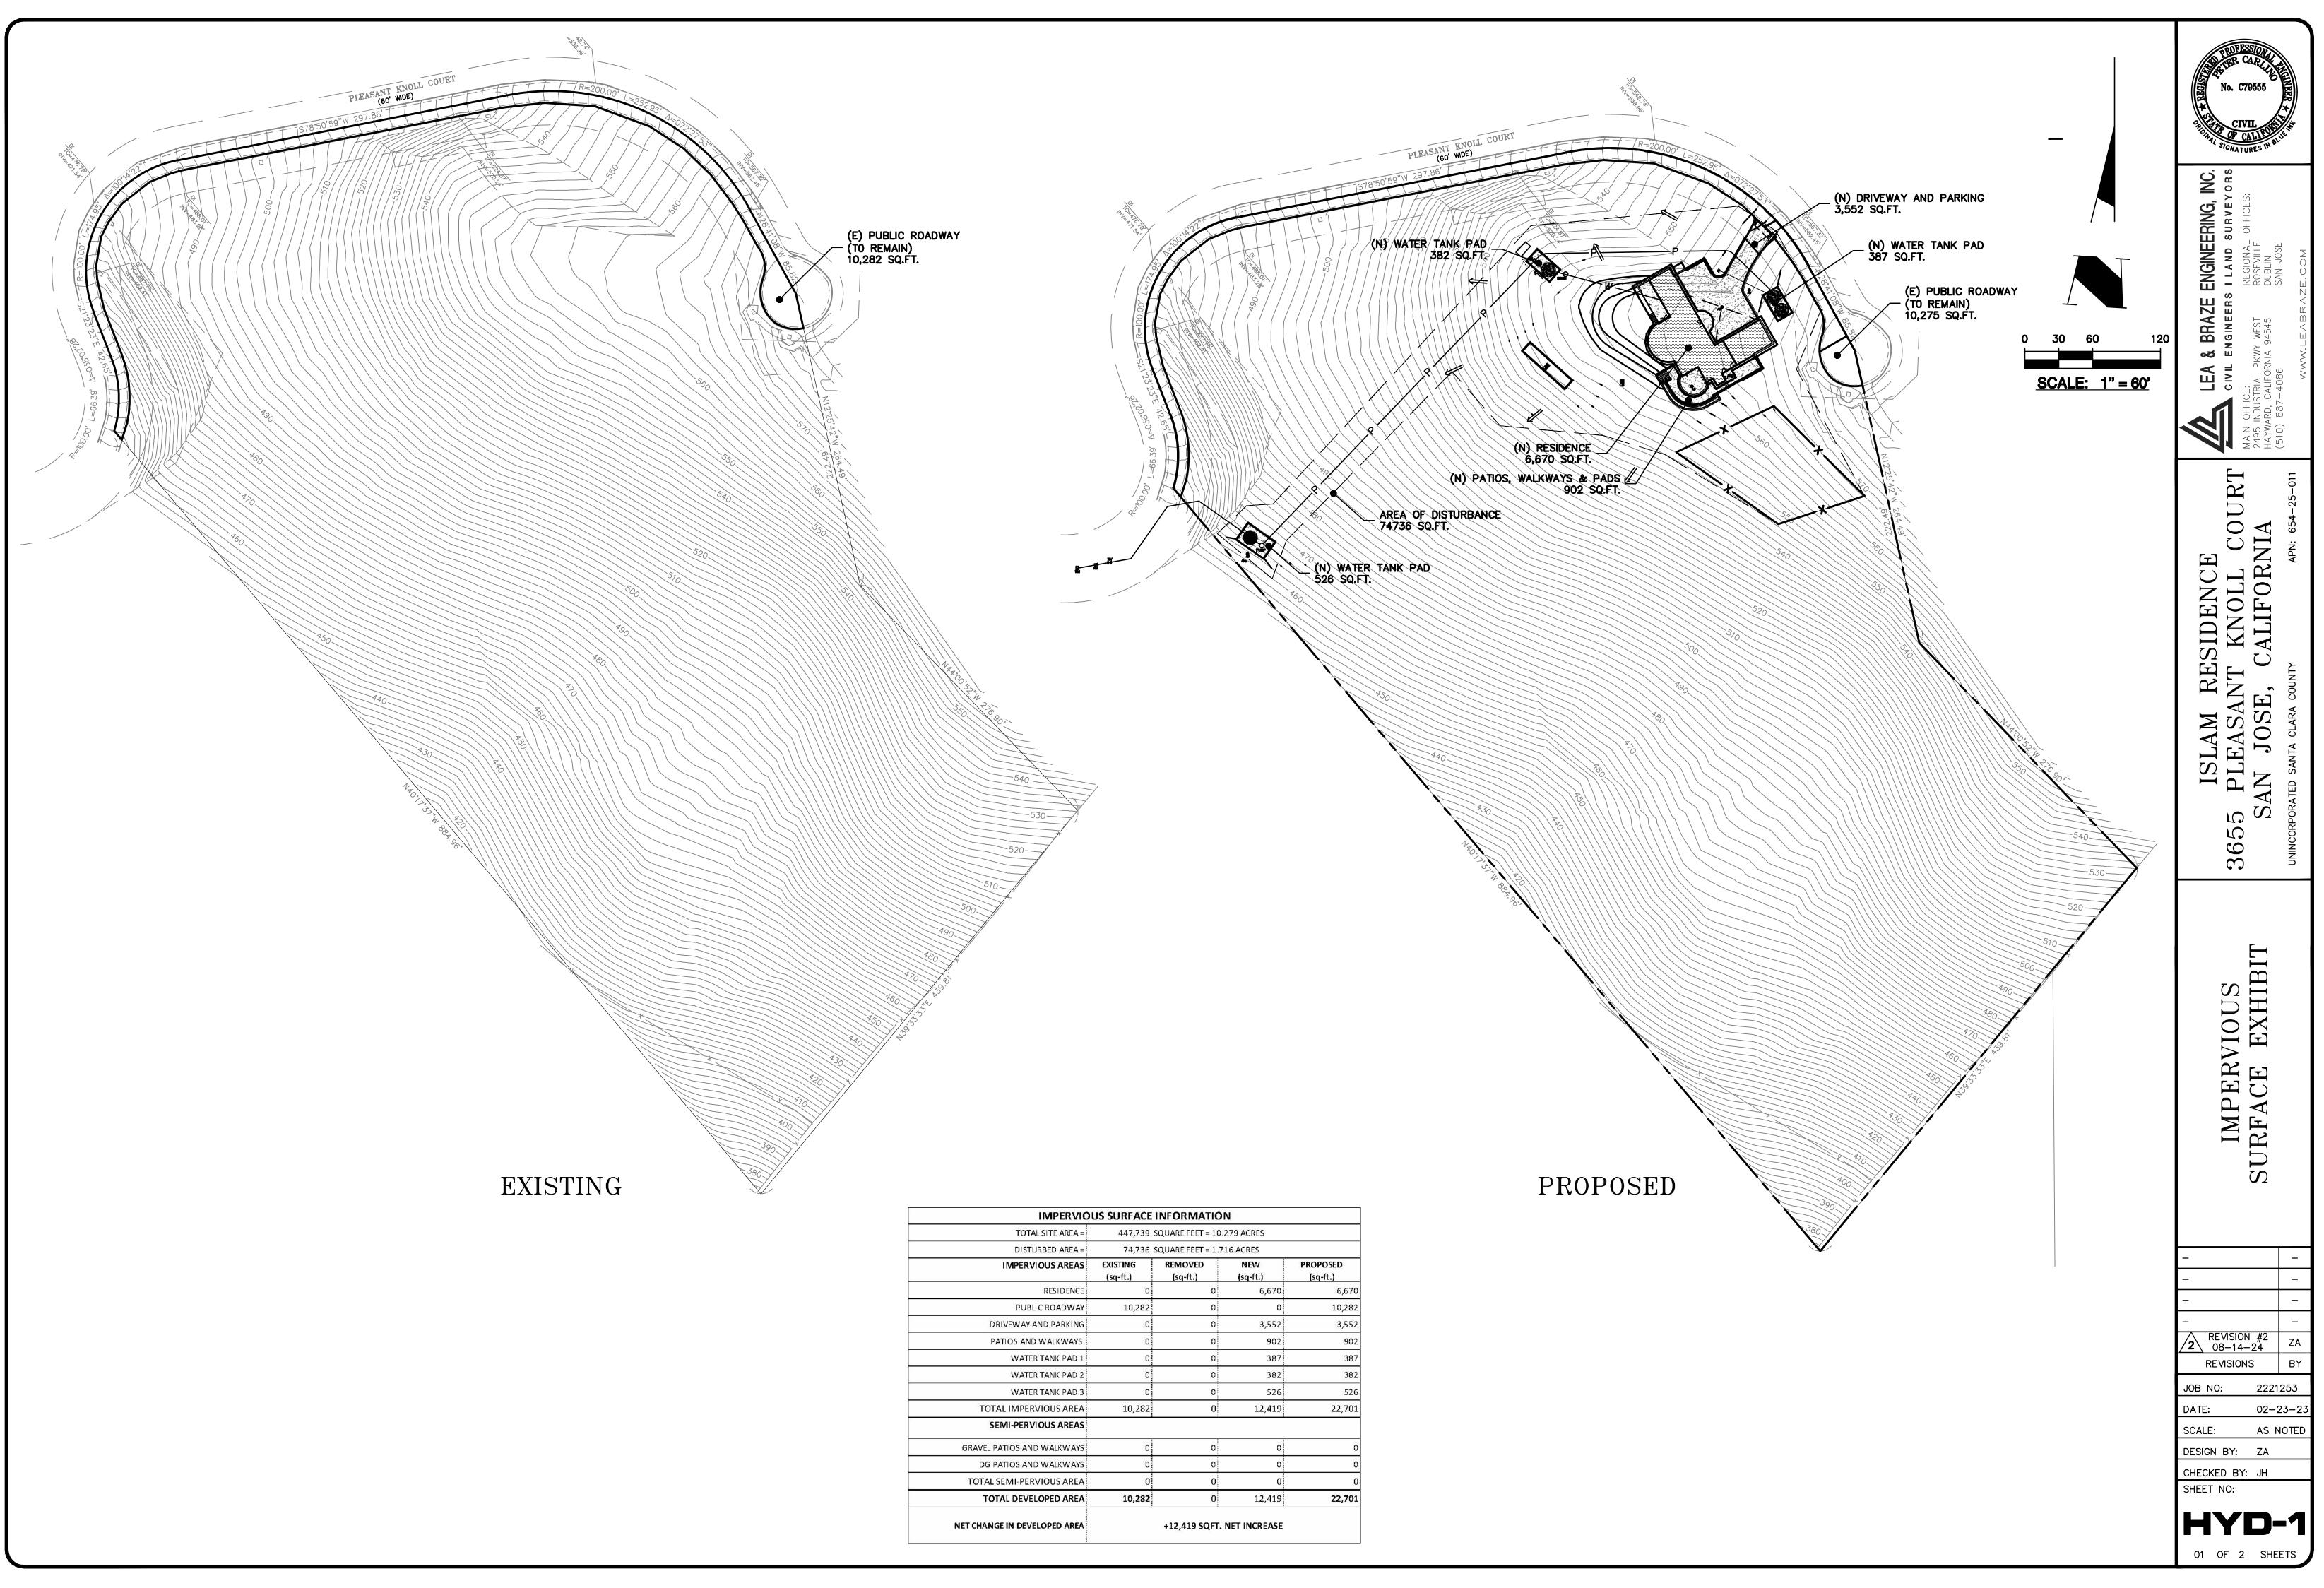

IMPERVIO	US SURFACE	INFORMATIO	N	
TOTAL SITE AREA =	447,739 9	SQUARE FEET = 10.2	279 ACRES	
DISTURBED AREA =	74,736 9	SQUARE FEET = 1.7	16 ACRES	
IMPERVIOUS AREAS	EXISTING (sq-ft.)	REMOVED (sq-ft.)	NEW (sq-ft.)	PROPOSED (sq-ft.)
RESIDENCE	o	o	6,670	6,670
PUBLIC ROADWAY	10 <i>,</i> 282	o	0	10,282
DRIVEWAY AND PARKING	0	0	3,552	3,552
PATIOS AND WALKWAYS	0	0	902	902
WATER TANK PAD 1	0	0	387	387
WATER TANK PAD 2	0	0	382	382
WATER TANK PAD 3	0	0	526	526
TOTAL IMPERVIOUS AREA	10,282	0	12,419	22,701
SEMI-PERVIOUS AREAS	·	·		
GRAVEL PATIOS AND WALKWAYS	0	0	o	0
DG PATIOS AND WALKWAYS	0	0	0	0
TOTAL SEMI-PERVIOUS AREA	0	0	0	0
TOTAL DEVELOPED AREA	10,282	0	12,419	22,701
NET CHANGE IN DEVELOPED AREA	·	+12,419 SQFT.	NET INCREASE	

IMPERVIOUS AREAS	PROPOSED (sq-ft.)	COLLECTED (sq-ft.)	NOT COLLECTED (sq-ft.)
DMA AREA	12,512	SQUARE FEET =	0.287 ACRES
DRAINAGE MANA	AGEMENT	AREA 1	-77

RESIDENCE	6,670	6,670	0
PUBLIC ROADWAY	0	0	0
DRIVEWAY AND PARKING	3,552	3,552	0
PATIOS AND WALKWAYS	902	902	0
WATER TANK PAD 1	387	387	0
TOTAL IMPERVIOUS AREA	11 <b>,</b> 511	11,511	0
SEMI-PERVIOUS AREAS			·······
GRAVEL PATIOS AND WALKWAYS	0	0	0
DG PATIOS AND WALKWAYS	0	0	0
TOTAL SEMI-PERVIOUS AREA	0	0	0
LANDSCAPE AREA	1,001	1,001	0
TOTAL COLLECTED IMPERVIOUS AREA	11,511	sq-ft.	Sr. (7
REQUIRED TREATMENT AREA (4%)	460	sq-ft.	
PROVIDED TREATMENT AREA	500	sq-ft.	


# DRAINAGE MANAGEMENT AREA 2


DMA AREA	749	SQUARE FEET = 0	.017 ACRES
IMPERVIOUS AREAS	PROPOSED (sq-ft.)	COLLECTED (sq-ft.)	NOT COLLECTED (sq-ft.)
RESIDENCE	0	0	0
PUBLIC ROADWAY	0	0	0
DRIVEWAY AND PARKING	0	0	0
PATIOS AND WALKWAYS	0	0	0
WATER TANK PAD 2	382	382	0
TOTAL IMPERVIOUS AREA	382	382	0
SEMI-PERVIOUS AREAS			
GRAVEL PATIOS AND WALKWAYS	0	0	0
DG PATIOS AND WALKWAYS	0	0	0
TOTAL SEMI-PERVIOUS AREA	0	0	0
LANDSCAPE AREA	367	367	0
TOTAL COLLECTED IMPERVIOUS AREA	382	sq-ft.	
REQUIRED TREATMENT AREA (4%)	15 :	sq-ft.	
PROVIDED TREATMENT AREA	75	sq-ft.	

	DRAINAGE	MANAGEMENT	AREA	3	
--	----------	------------	------	---	--

DMA AREA	795	SQUARE FEET = 0	.018 ACRES
IMPERVIOUS AREAS	PROPOSED (sq-ft.)	COLLECTED (sq-ft.)	NOT COLLECTEE (sq-ft.)
RESIDENCE	0	0	(
PUBLIC ROADWAY	0	0	(
DRIVEWAY AND PARKING	0	0	(
PATIOS AND WALKWAYS	0	0	(
WATER TANK PAD 3	526	526	C
TOTAL IMPERVIOUS AREA	526	526	(
SEMI-PERVIOUS AREAS			
GRAVEL PATIOS AND WALKWAYS	0	0	(
DG PATIOS AND WALKWAYS	0	0	C
TOTAL SEMI-PERVIOUS AREA	0	0	(
LANDSCAPE AREA	269	269	(
TOTAL COLLECTED IMPERVIOUS AREA	526	sq-ft.	Xe
REQUIRED TREATMENT AREA (4%)	21	sq-ft.	
PROVIDED TREATMENT AREA	35	sq-ft.	

IMPERVIO	US SURFACE	INFORMATIC	N		
TOTAL SITE AREA =	447,739 SQUARE FEET = 10.279 ACRES				
DISTURBED AREA =	67,178 SQUARE FEET = 1.542 ACRES				
IMPERVIOUS AREAS	EXISTING (sq-ft.)	REMOVED (sq-ft.)	NEW (sq-ft.)	PROPOSED (sq-ft.)	
RESIDENCE	0	0	6,670	6,670	
PUBLIC ROADWAY	10,282	0	0	10,282	
DRIVEWAY AND PARKING	0	0	3,552	3,552	
PATIOS AND WALKWAYS	0	0	902	902	
WATER TANK PAD 1	0	0	387	387	
WATER TANK PAD 2	0	0	382	382	
WATER TANK PAD 3	0	O	526	526	
TOTAL IMPERVIOUS AREA	10,282	0	12,419	22,701	
SEMI-PERVIOUS AREAS	7.5	(X)	ia <sup>-</sup>		
GRAVEL PATIOS AND WALKWAYS	0	0	0	0	
DG PATIOS AND WALKWAYS	0	0	0	0	
TOTAL SEMI-PERVIOUS AREA	0	0	0	0	
TOTAL DEVELOPED AREA	10, <b>282</b>	0	1 <b>2</b> ,419	<b>22,7</b> 01	
NET CHANGE IN DEVELOPED AREA	+12,419 SQFT. NET INCREASE				

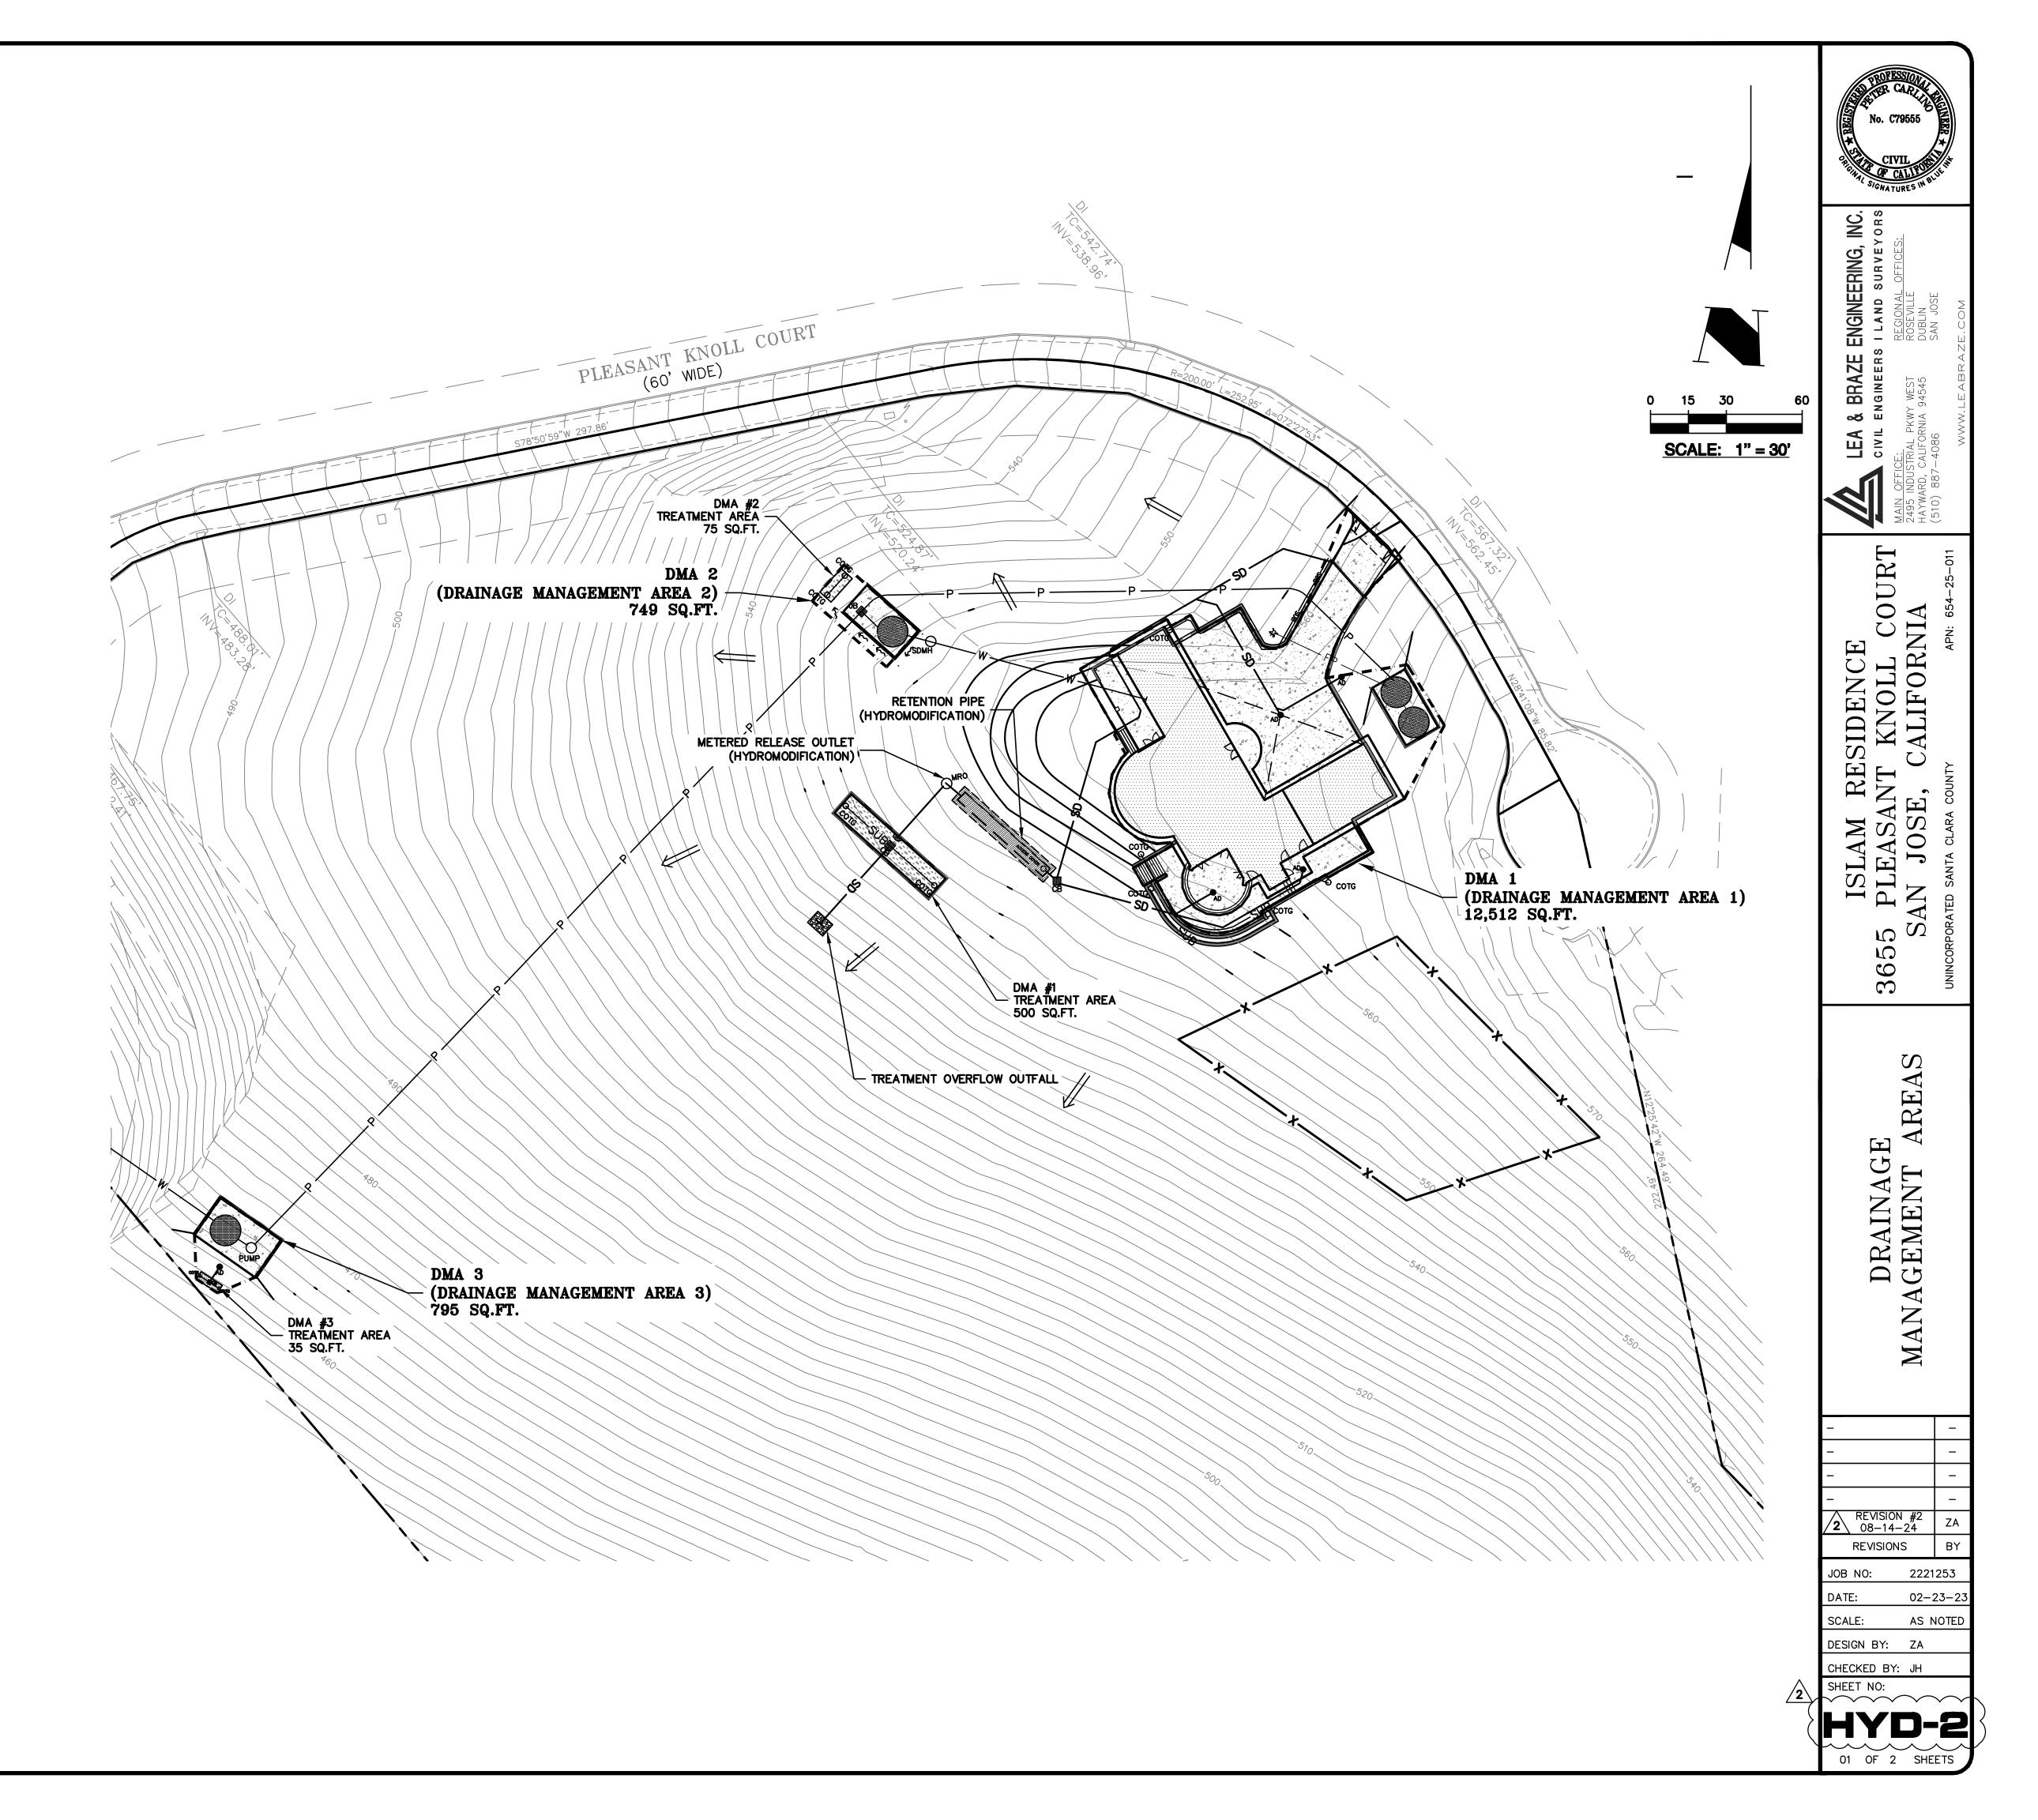


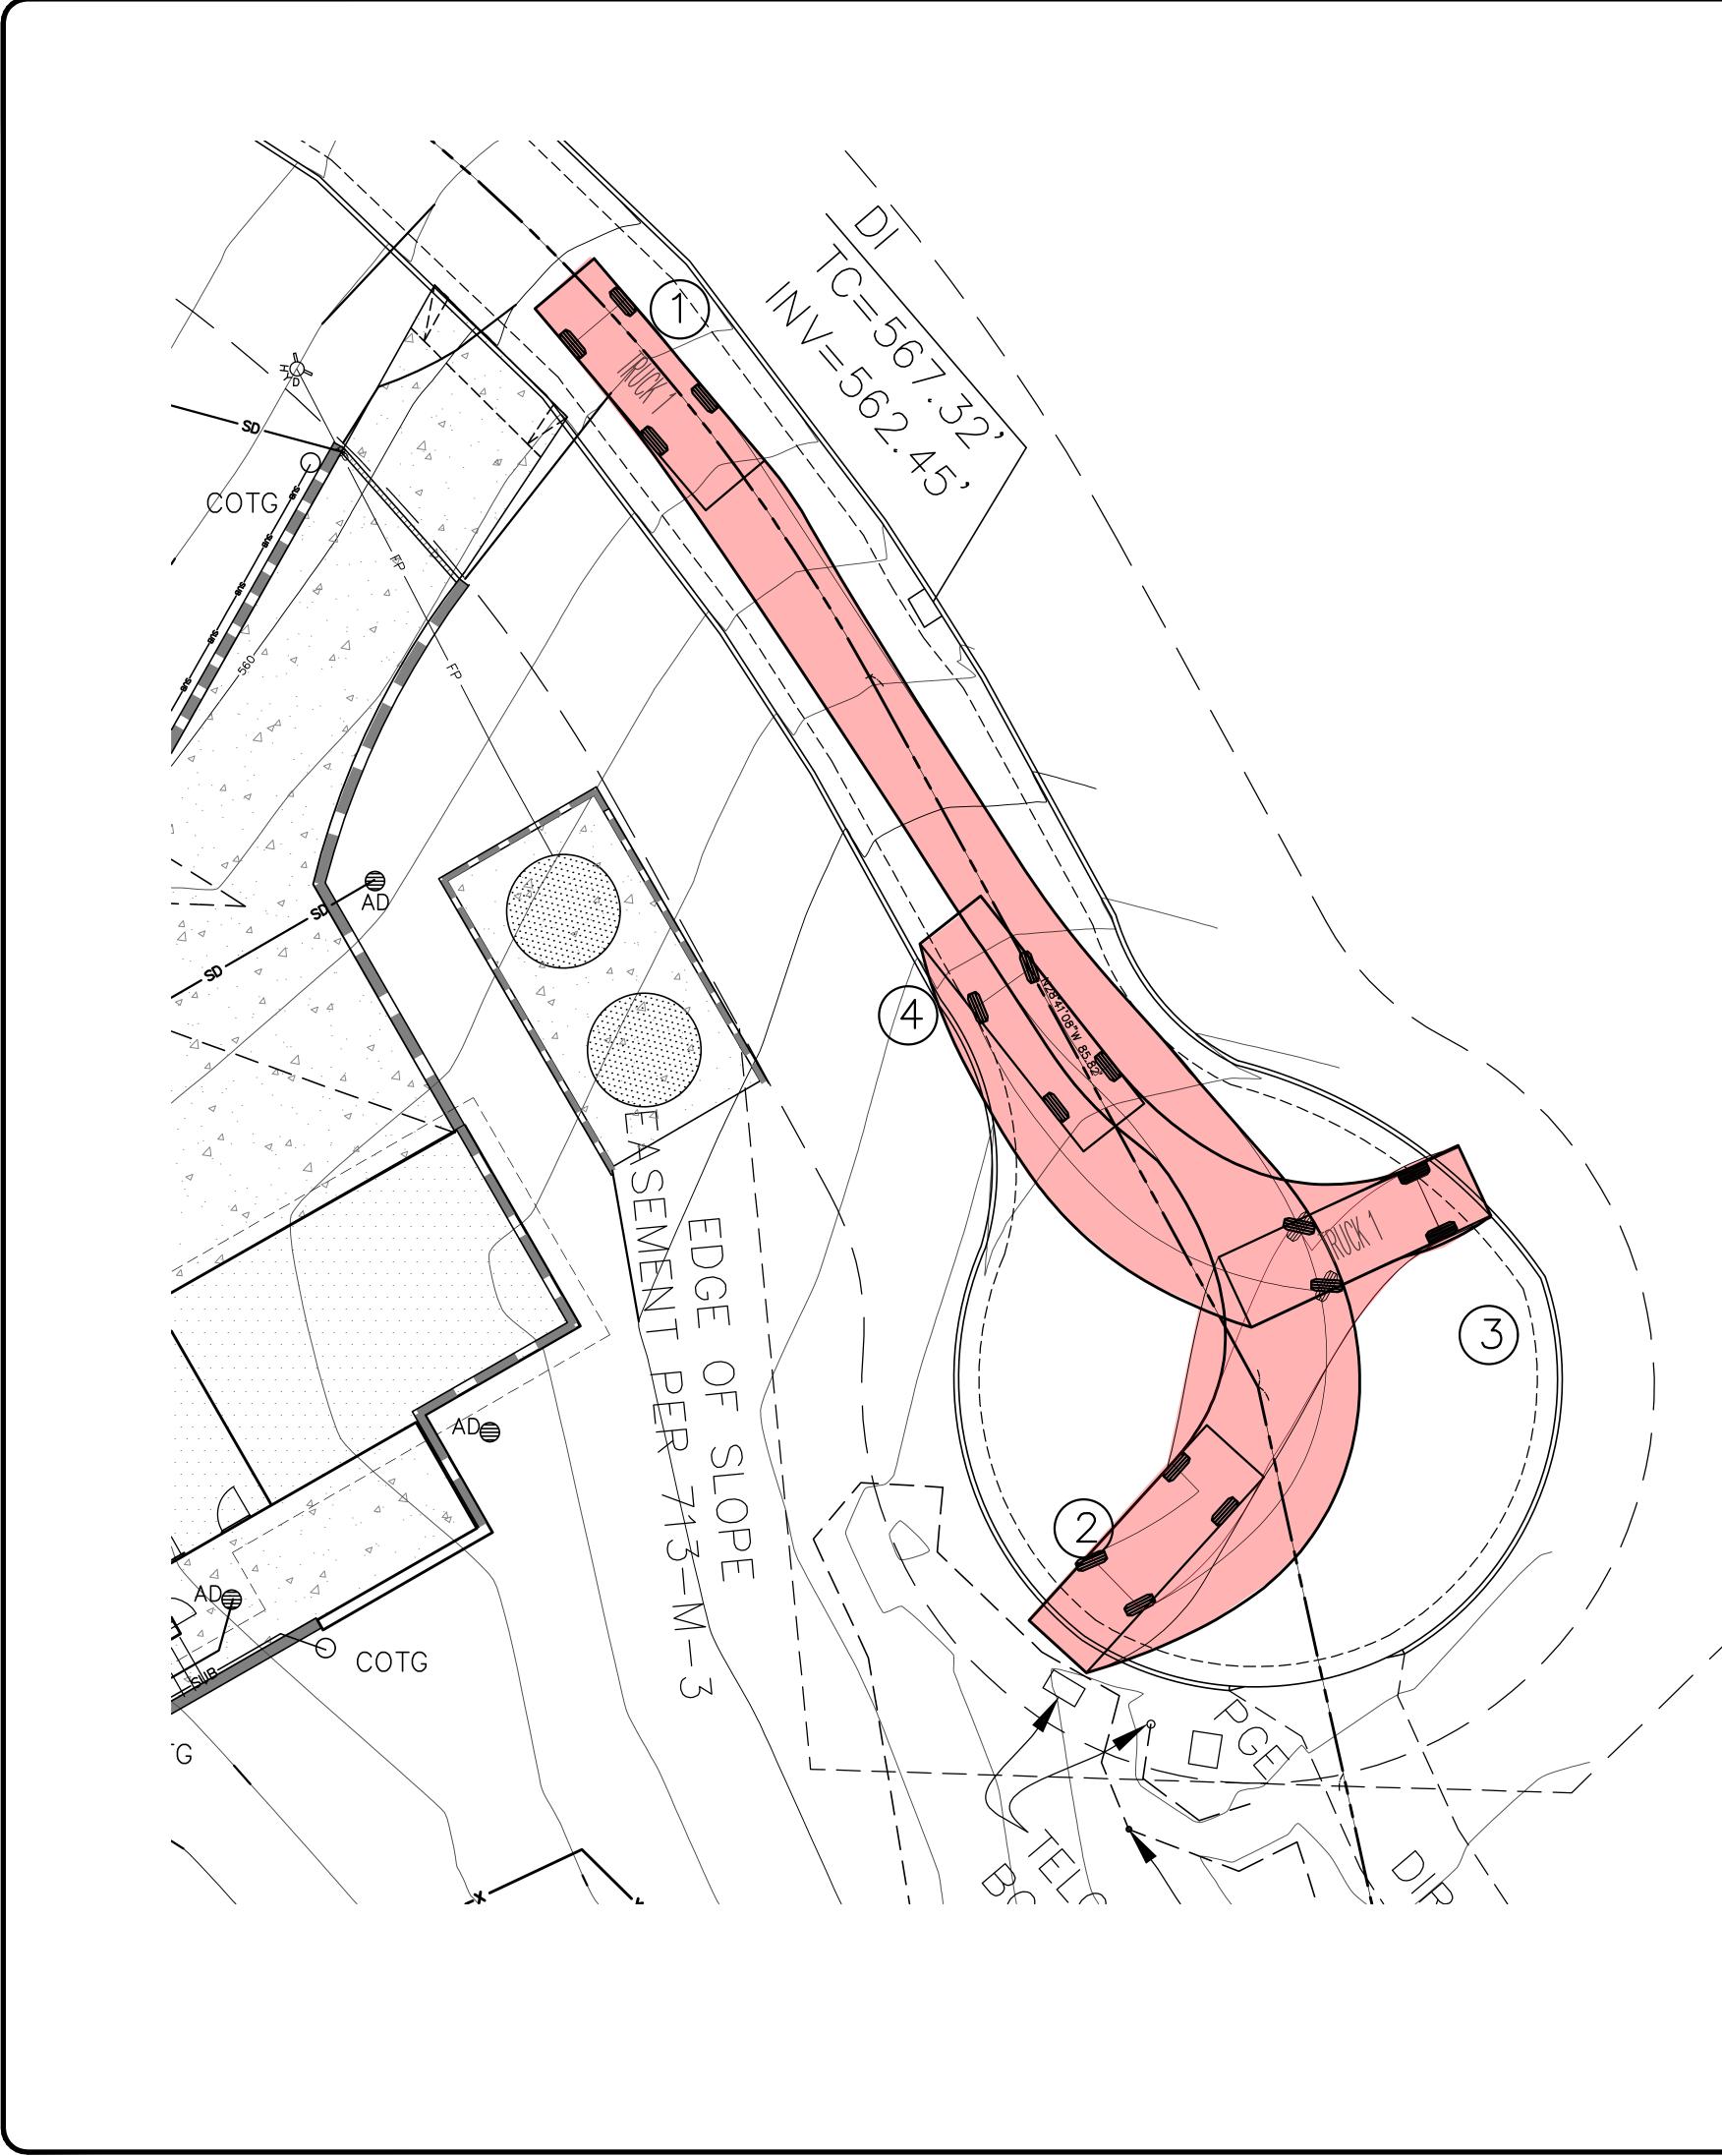




Overall Width Overall Body Height Min Body Ground Clea Track Width Lock-to-lock time Max Wheel Angle

$\int \int \int dt$	Image: Non-State State
	ISLAM RESIDENCE 3655 PLEASANT KNOLL CT. SAN JOSE, CALIFORNIA UNINCORPORATED SANT CLAN APN: 654-25-011 510) 887-44
	FIRETRUCK ANALYSIS: 3-PT TURN
28.000ft 8.200ft 10.000ft 1.576ft 8.166ft 6.00s 37.407	-       -         JOB NO:       2221253         DATE:       11-05-24         SCALE:       AS NOTED         DESIGN BY:       ZA         CHECKED BY:       PC         SHEET NO:       -         1       OF 1         SHEETS

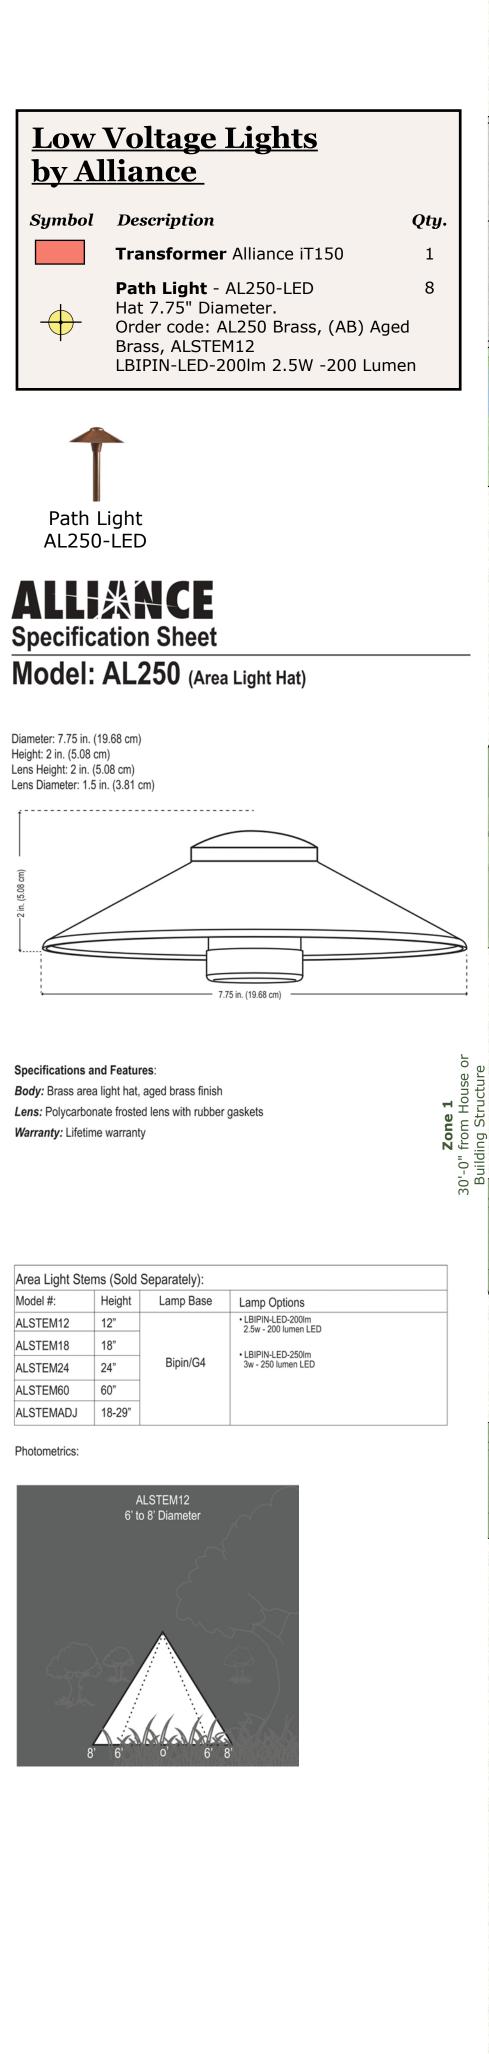

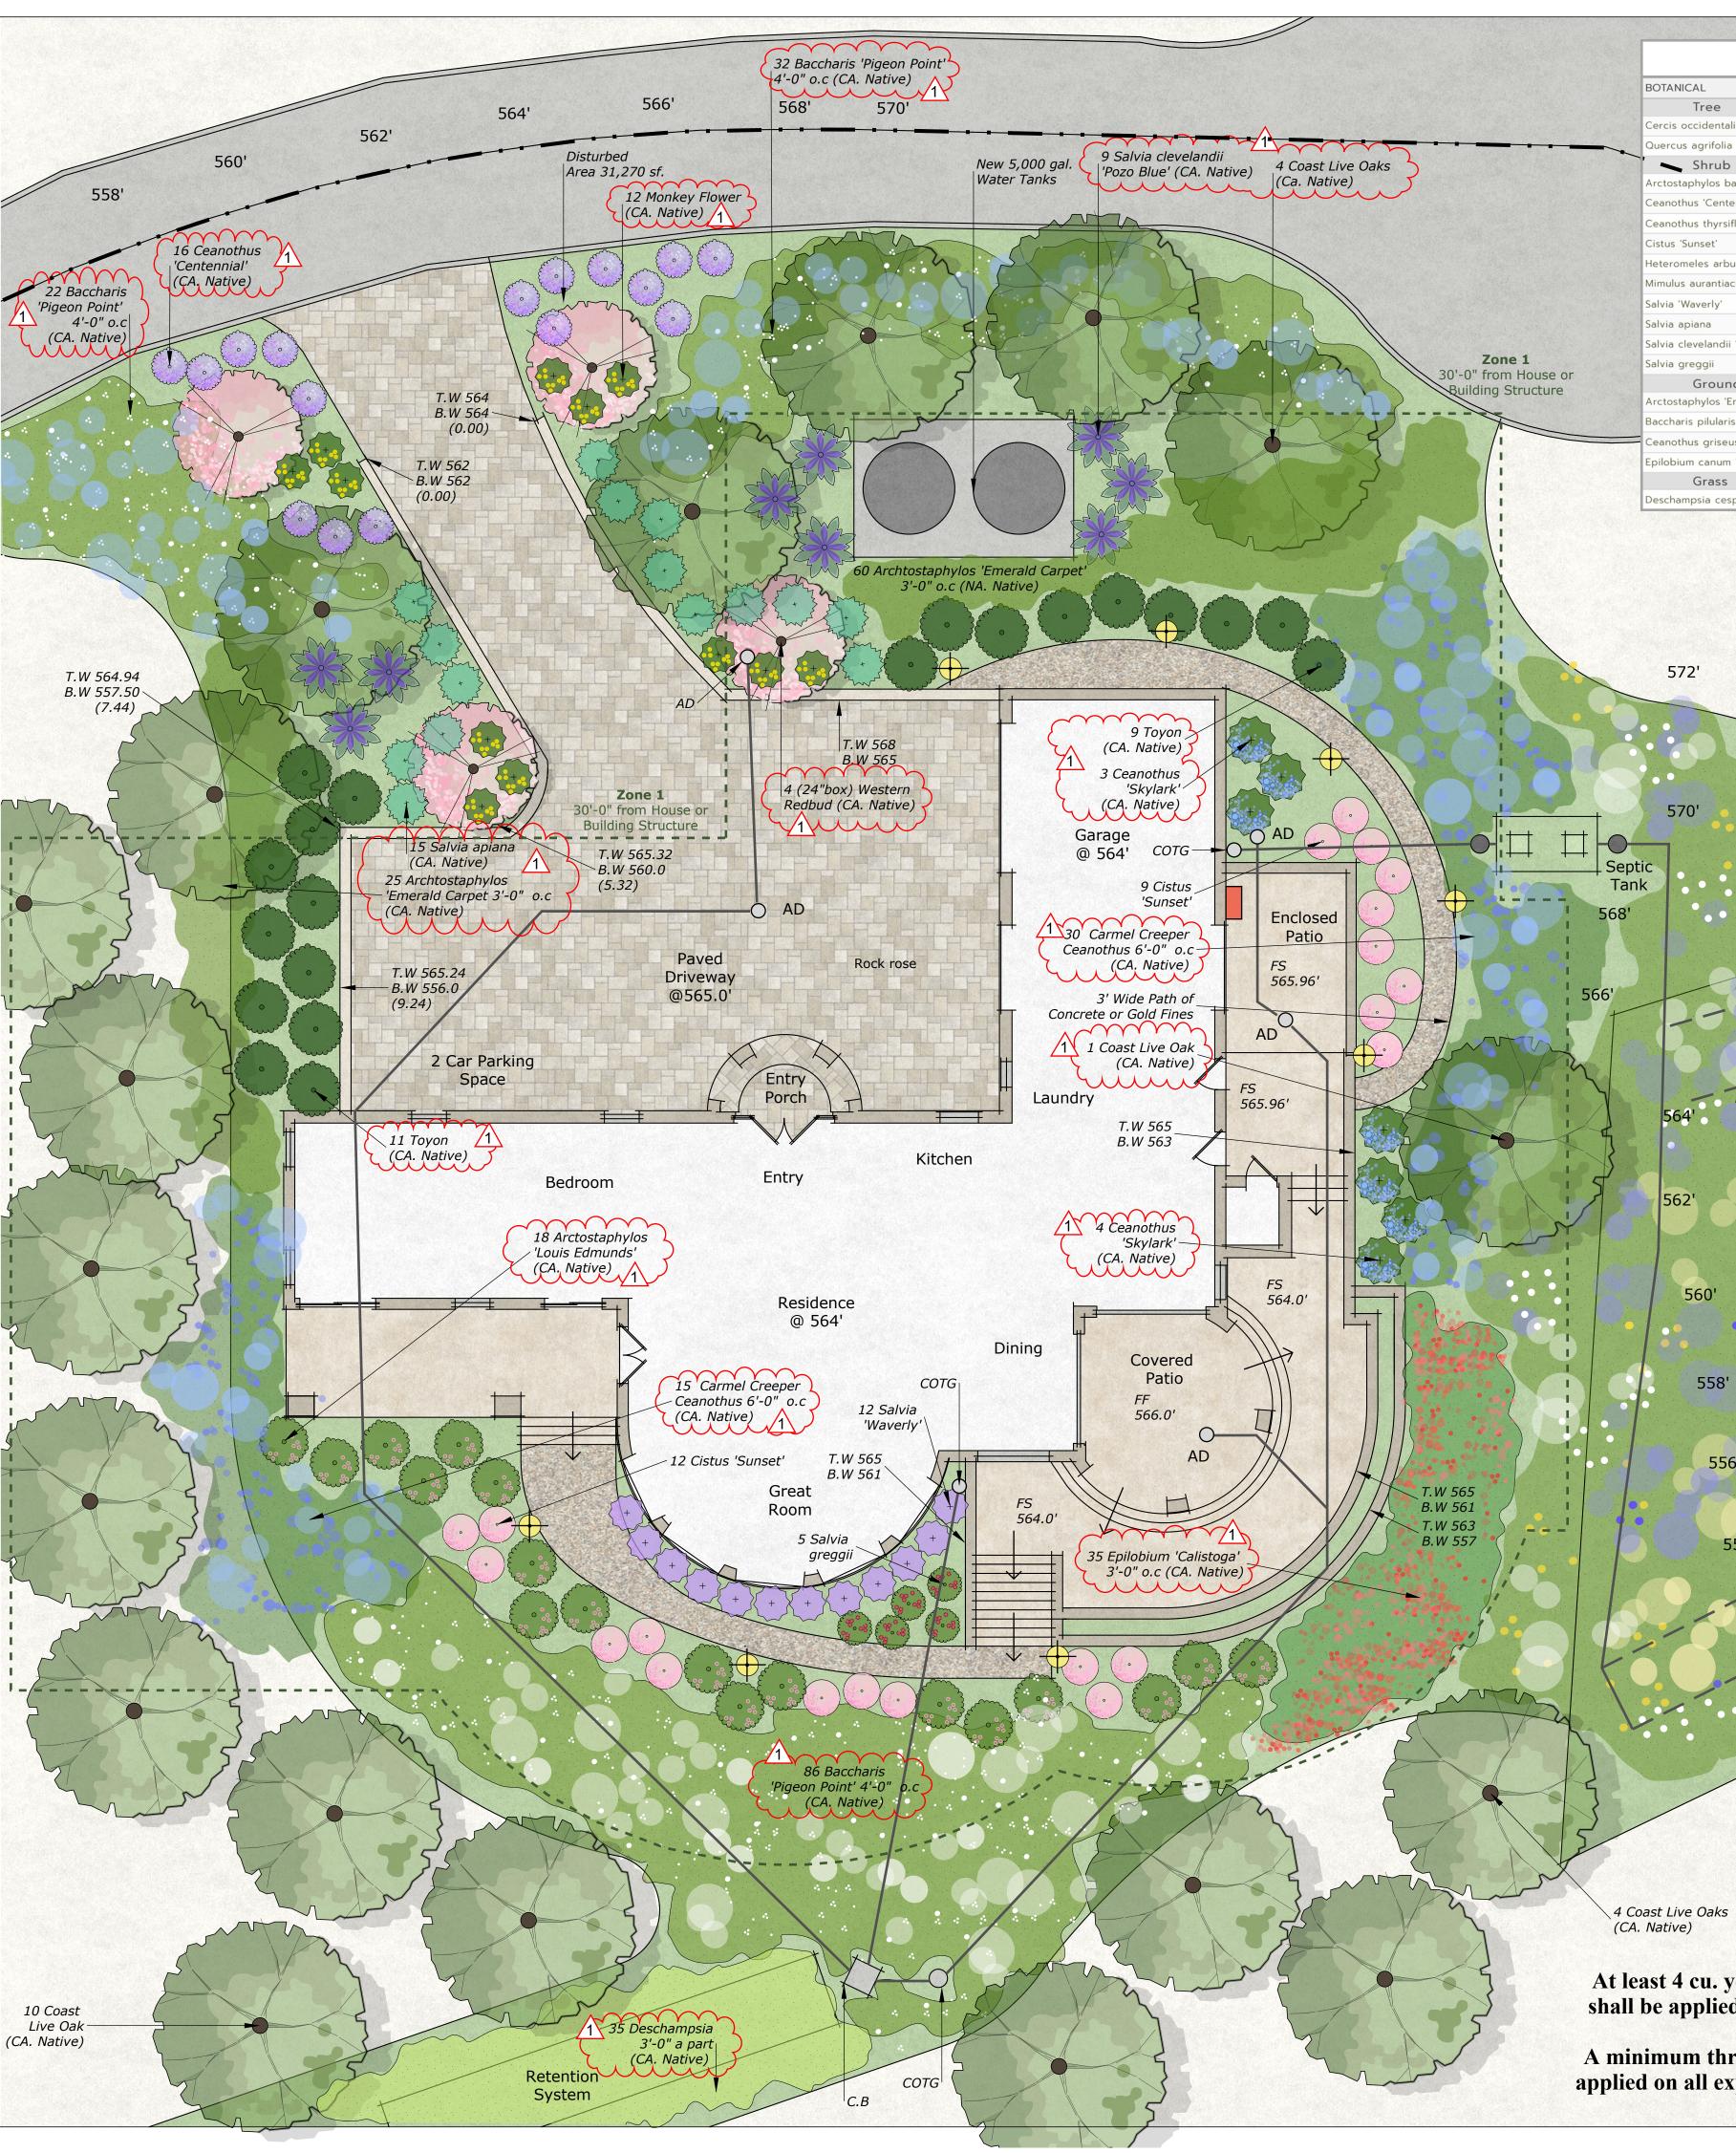

	PLANT LEGEN	<b>ND</b>			$\sim$
NICAL	COMMON	SIZE	QTY	WATER	REMARKS
Tree					×
s occidentalis	Western Redbud	24" box	4	Low	CA. Native
cus agrifolia	Coast Live Oak	24" box	19	Low	Standard. CA. Nativ
Shrub				(	×
staphylos bakeri 'Louis Edmunds'	Louis Edmunds Manzanita	5 gal	18	Low	CA. Native
othus 'Centennial'	Centennial Mountain Lilac	1 gal	16	Low	CA. Native
othus thyrsiflorus 'Skylark'	Skylark Mountain Lilac	5 gal	7	Low	CA. Native
s 'Sunset'	Sunset Rockrose	1 gal	21	Low	≻
omeles arbutifolia	Toyon	5 gal	20	Low	CA. Native
lus aurantiacus	Sticky Monkey Flower	1 gal	12	Low	CA. Native
'Waverly'	Waverly Sage	1 gal	12	Low	>
apiana	White Sage	5 gal	15	Low	CA. Native
a clevelandii 'Pozo Blue'	Grey Musk Sage	5 gal	9	Low	CA. Native
greggii	Autumn Sage	1 gal	5	Low	
Ground cover					$\succ$
staphylos 'Emerald Carpet'	Manzanita Emerald Carpet	1 gal	85	Low	CA. Native
aaris pilularis 'Pigeon Point'	Pigeon Point Coyote Bush	1 gal	140	Low	CA. Native
othus griseus var. horizontalis	Carmel Creeper Ceanothus	1 gal	45	Low	CA. Native
pium canum 'Calistoga'	Calistoga California Fuchsia	1 gal	35	Low	CA. Native
Grass					
nampsia cespitosa	Tufted Hair Grass	1 gal	35	Low	CA. Native

California Wildflower Seed Mix

California Wildflower

Seed Mix on

Disturbed Grade of Leach Field

on Disturbed Grade

Septic Leach



REVISIONS

11-21-24 AD

BY

N & ASSOCIATES ARCHITECTS eal Gilroy Ca. 95020 9 (408) 842-0245 Økaa.design AITKEN APE 39 Re m (*b*) N 8262 Rancho l Calif. Reg.#22 ANDSC တ်ို ARÈN  $\geq$ 

San Jose SIDENCE PL LIGHTING Knoll Court, RE  $\mathfrak{A}$ Z ANTING Pleasant  $\checkmark$ ISI PL. 3655



DATE	11-21-24
SCALE	1"=10'-0"
RAWN	SL - AD
JOB	ISLAM
	SCALE PRAWN


546'

558'

556

At least 4 cu. yds. of compost, six (6) inches deep, shall be applied per 1,000 sq. ft. of landscape area.

A minimum three (3") inch layer of mulch shall be applied on all exposed soil surfaces of planting areas.



\* NOTES (E) = Existing

AD = Area Drain **CB** = Catch Basin **COTG = Clean Out to Grade** 

**Refer to C-3.0 Utility Plan** for more specification

L-1

# **IRRIGATION NOTES**

1. THE IRRIGATION SYSTEM IS TO BE INSTALLED IN CONFORMANCE WITH ALL LOCAL CODES.

2. THIS IRRIGATION DESIGN IS DIAGRAMMATIC IN NATURE AND DOES NOT REPRESENT AN EXACT LAYOUT. THE CONTRACTOR SHALL MAKE MINOR ADJUSTMENTS IN HEAD, VALVE, AND PIPING LAYOUT. FOR GRAPHIC CLARITY, PIPING MAY BE SHOWN OUTSIDE OF PLANTING AREAS BUT SHOULD BE INSTALLED IN BEDS WHENEVER POSSIBLE.

3. REMOTE CONTROL VALVES SHALL BE INSTALLED FLUSH WITH FINISH GRADE AND SHOULD BE INSTALLED IN PLANTING AREAS ONLY. USE EXISTING VALVE BOXES WHEN POSSIBLE.

4. WHERE PIPE PASSES UNDER DRIVING SURFACES, AND WALKS PROVIDE PVC SLEEVES AS NOTED ON PLANS. CONTRACTOR TO USE EXISTING SLEEVING WHEN POSSIBLE AND IS TO LOCATE ON SITE.

5. CONTRACTOR TO CONFIRM THE LOCATION OF ALL EXISTING UTILITIES AND UNDERGROUND STRUCTURES PRIOR TO EXCAVATION OF TRENCHES. CONTRACTOR TO REPAIR ANY DAMAGES CAUSED BY, OR DURING THE PERFORMANCE OF HIS WORK AT NO EXTRA COST TO THE OWNER.

6. A DIAGRAM OF THE IRRIGATION PLAN SHOWING HYDROZONES SHALL BE KEPT WITH THE IRRIGATION CONTROLLER FOR SUBSEQUENT MANAGEMENT PURPOSES.

7. AN IRRIGATION AUDIT REPORT SHALL BE COMPLETED BY A CERTIFIED IRRIGATION AUDITOR AT THE TIME OF FINAL INSPECTION

# SOIL PREPARATION, MULCH AND AMENDMENTS

THE FOLLOWING CRITERIA SHALL BE USED IN THE PREPARATION OF ON-SITE SOILS AND FOR MULCHING PROCEDURES:


A) PRIOR TO THE PLANTING OF ANY MATERIALS, COMPACTED SOILS SHALL BE TRANSFORMED TO A FRIABLE CONDITION. ON ENGINEERED SLOPES, ONLY AMENDED PLANTING HOLES NEED MEET THIS REQUIREMENT.


B) SOIL AMENDMENTS SHALL BE INCORPORATED ACCORDING TO RECOMMENDATIONS OF THE SOIL REPORT AND WHAT IS APPROPRIATE FOR THE PLANTS SELECTED.

C) FOR LANDSCAPE INSTALLATIONS, COMPOST AT A RATE OF A MINIMUM OF FOUR CUBIC YARDS PER 1,000 SOUARE FEET OF PERMEABLE AREA SHALL BE INCORPORATED TO A DEPTH OF SIX INCHES INTO THE SOIL. SOILS WITH GREATER THAN 6% ORGANIC MATTER IN THE TOP 6 INCHES OF SOIL ARE EXEMPT FROM ADDING COMPOST AND TILLING.

D) A MINIMUM THREE INCH (3") LAYER OF BARK MULCH SHALL BE APPLIED ON ALL EXPOSED SOIL SURFACES OF PLANTING AREAS EXCEPT IN TURF AREAS, CREEPING OR ROOTING GROUNDCOVERS, OR DIRECT SEEDING APPLICATIONS WHERE MULCH IS CONTRAINDICATED.

Color Indicates he Irrigated Area Hydrozone Number (Valve)							
	Hydrozone - Valves						
1 2 3	1,804 SF Very Low Water Drip 120 SF Med. Water Drip (Trees) 1,505 SF Low Water Drip	10 11	1,975 SF Low Water Drip 140 SF Med. Water Drip (Trees)				
4	1,090 SF Low Water Drip 3,800 SF Low. Water Spray (at grade w/ pcv raiser -Wildflowers	12 13 14	1,320 SF Very Low Water Drip 1,210 SF Low Water Drip 1,570 SF Very Low Water Drip				
6 7 8 9	2,710 SF Low. Water Spray (at grade w/ pcv raiser -Wildflowers 2,680 SF Low. Water Spray (at grade w/ pcv raiser -Wildflowers 200 SF Med. Water Drip (Trees) 820 SF Very Low Water Drip	-					
Total Irrigated Landscape Area Represent 20,944 sf.							

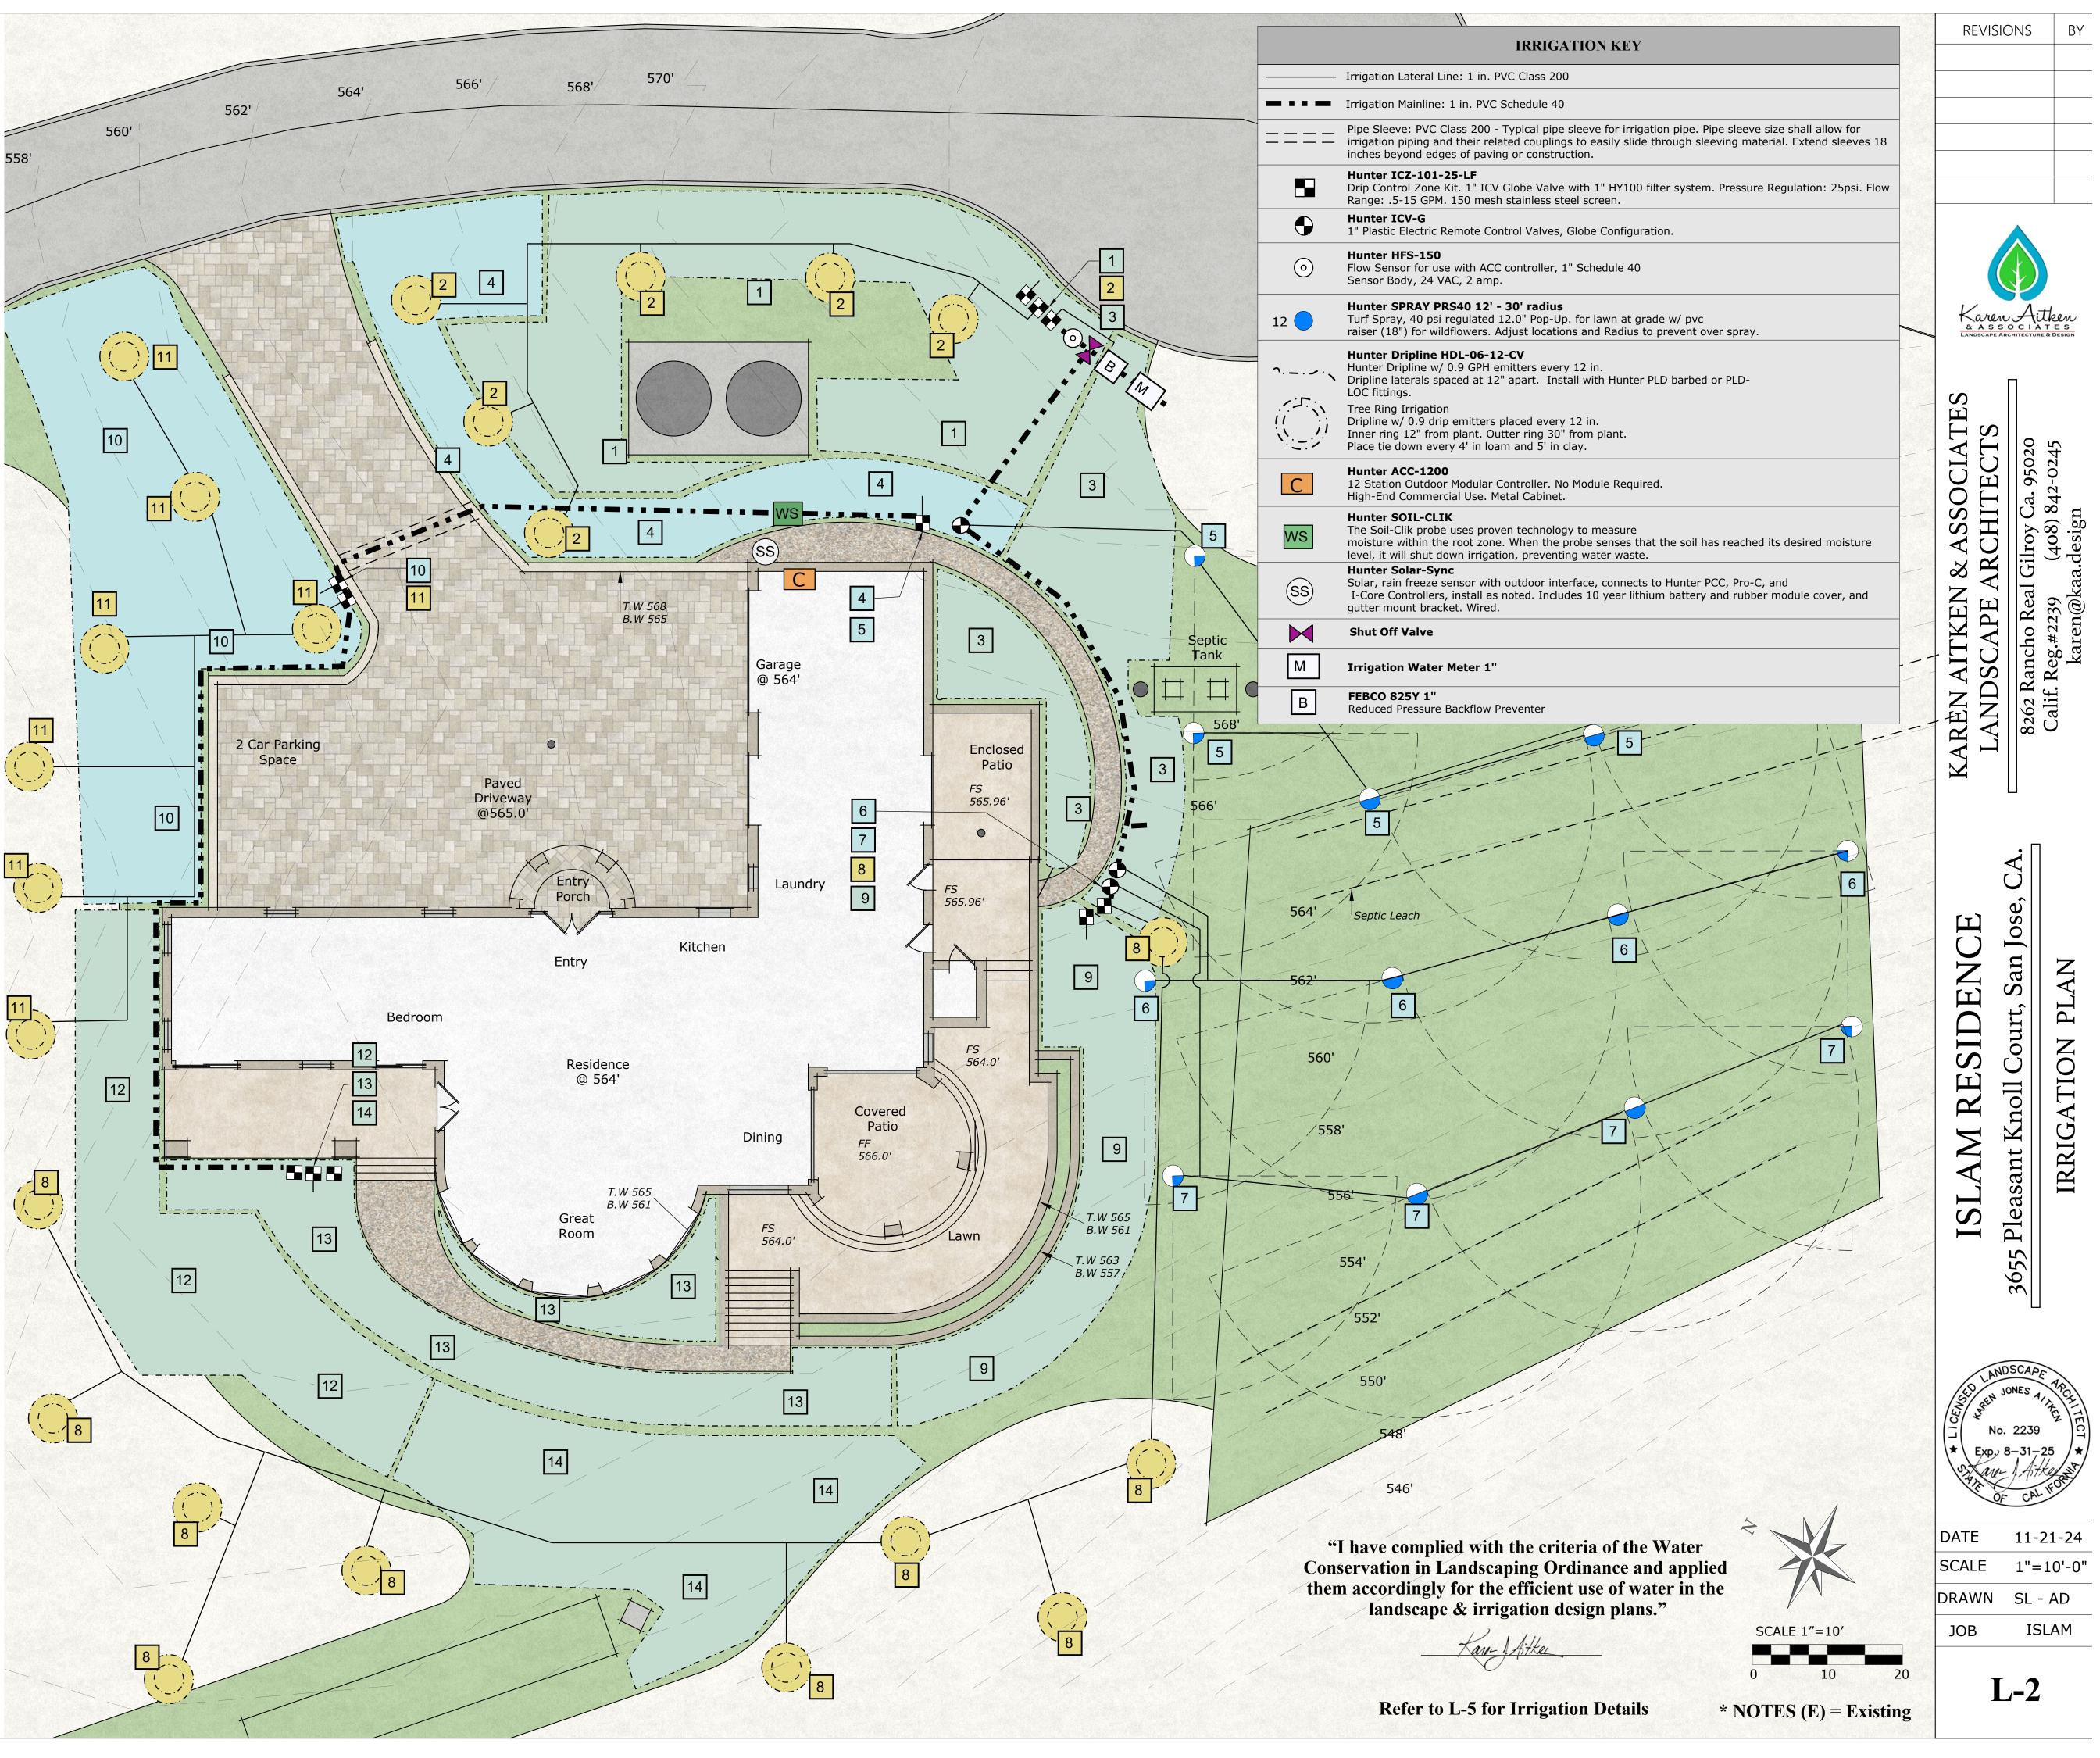

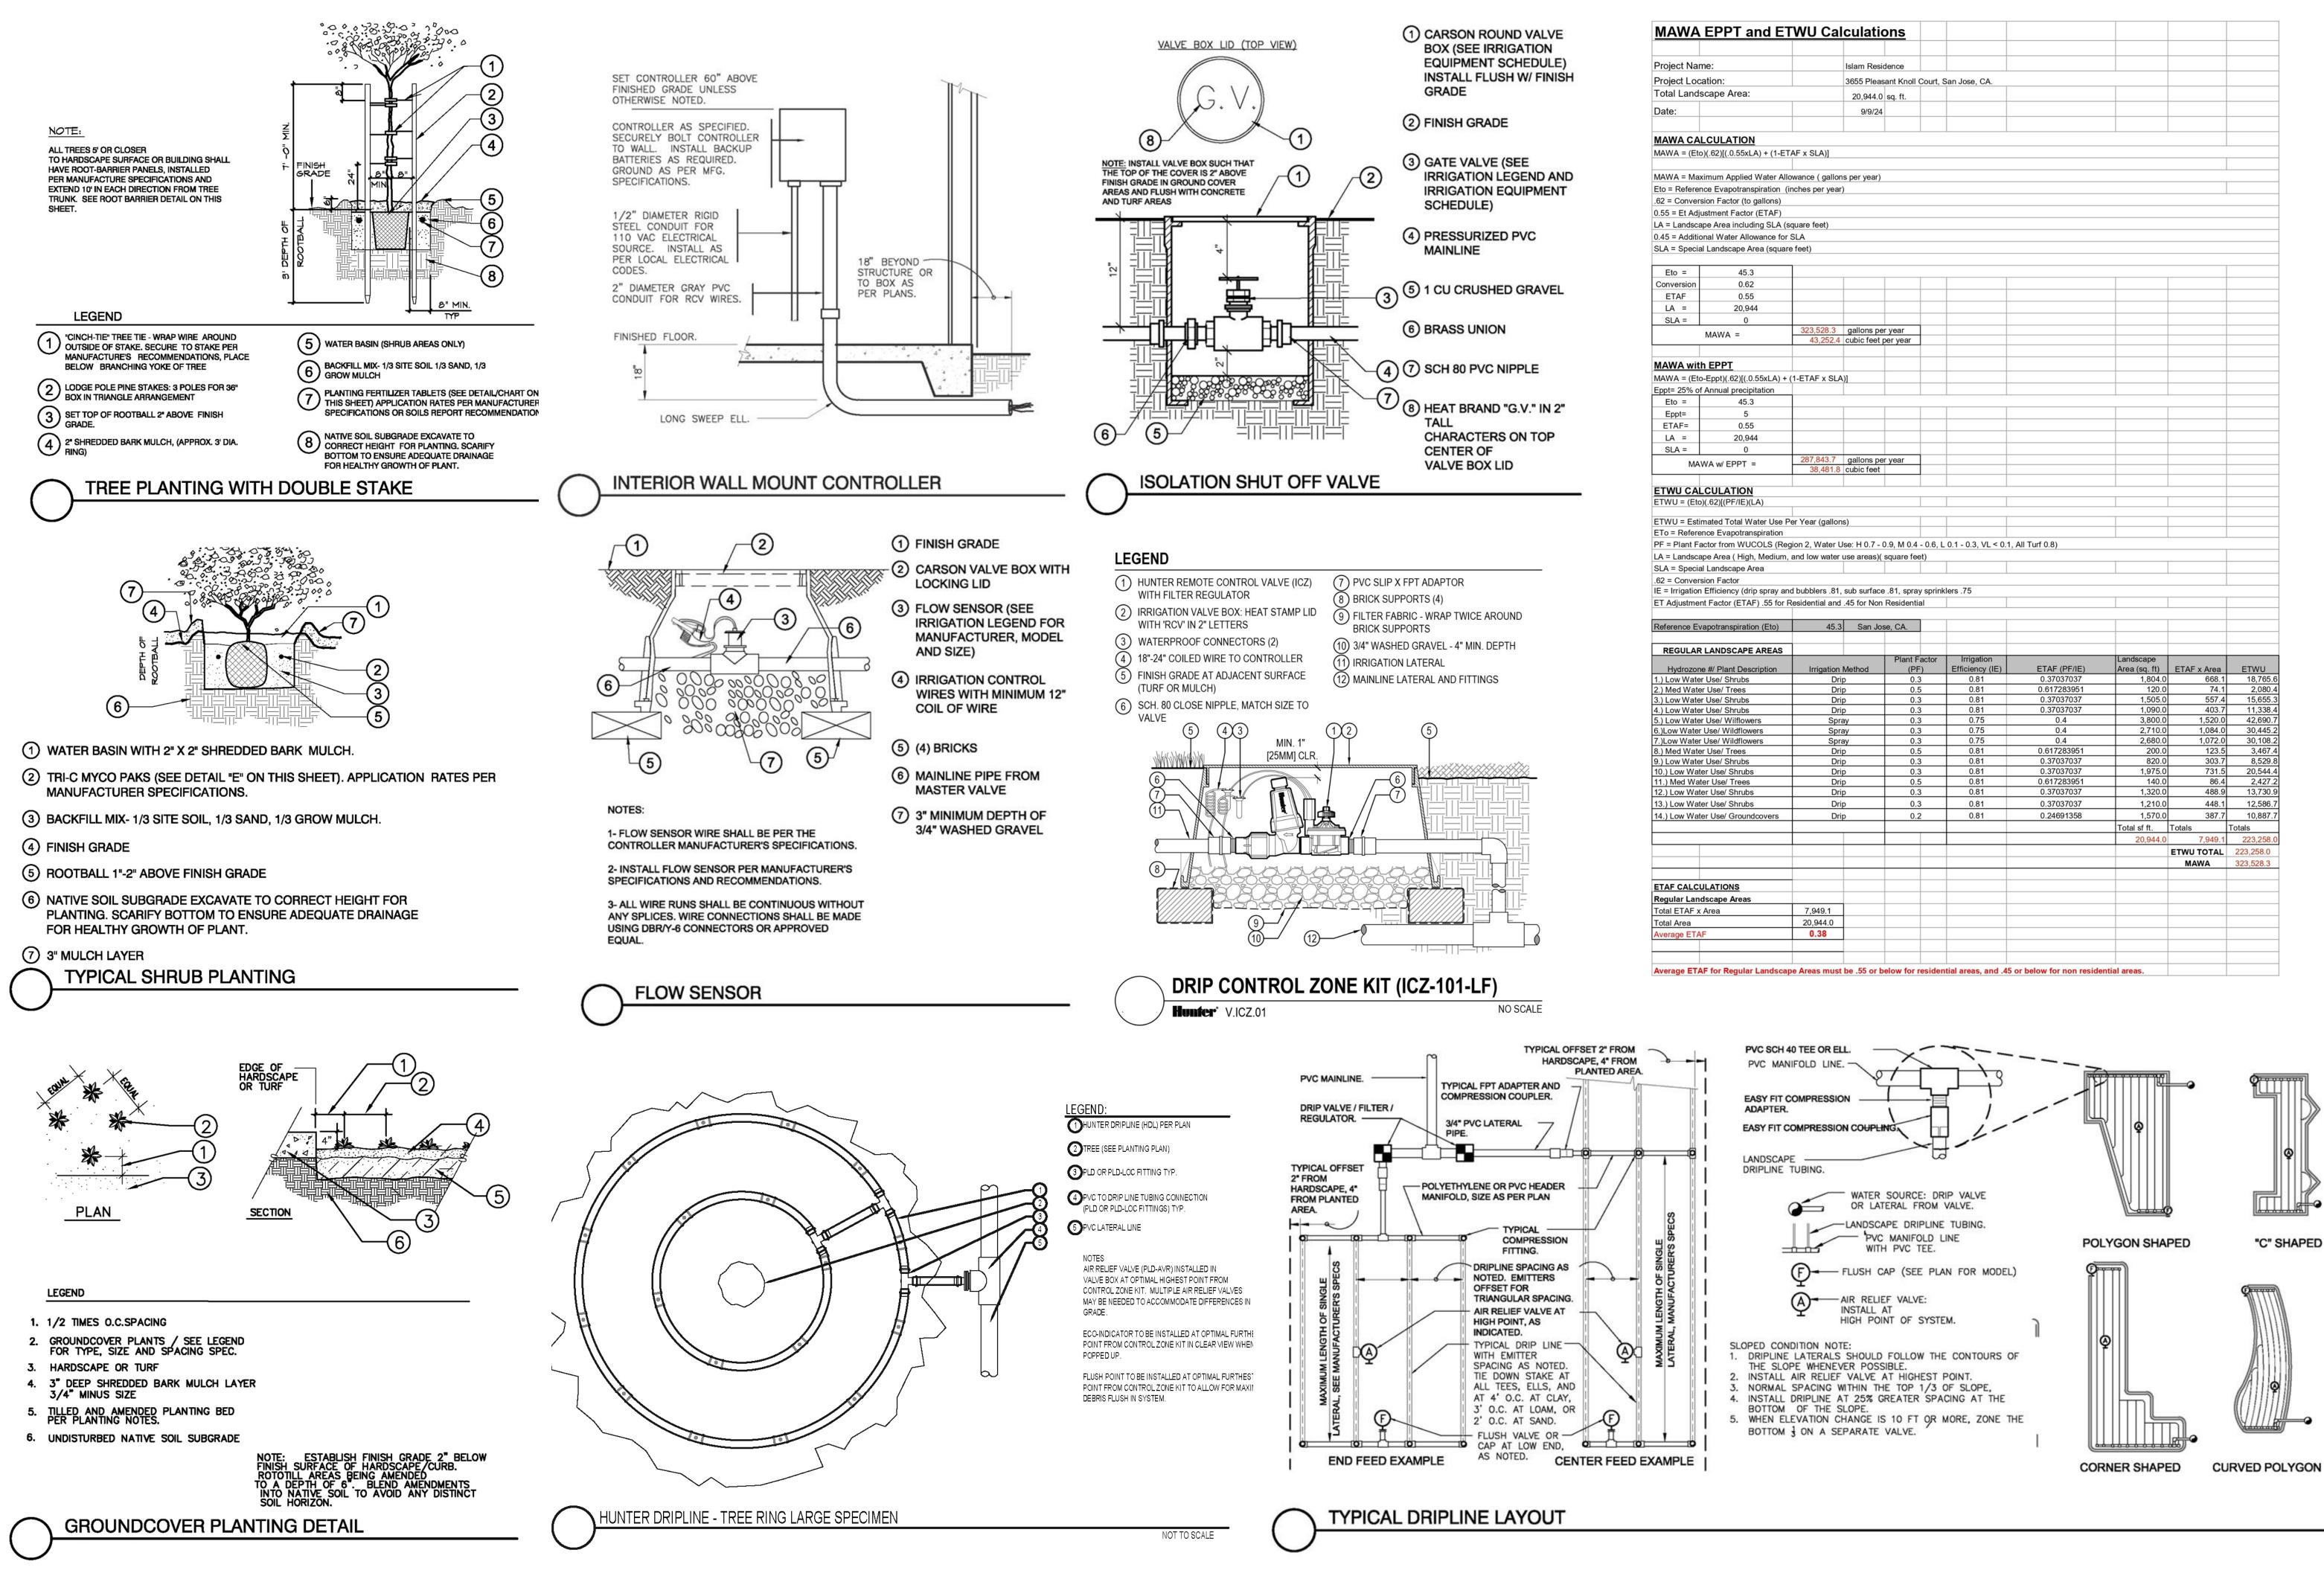

and E	TWU Ca	culation	ons					
		Islam Resi	dence					
			sant Knoll Court	San Jose CA				
a:								
		20,944.0						
		9/9/24	·					
<u>N N</u>								
xLA) + (1-ET	TAF x SLA)]							
ed Water Alle	owance ( gallor	is per year)						
nspiration (i	inches per year	)						
to gallons)								
tor (ETAF)								
uding SLA (s	square feet)							
llowance for	SLA							
Area (squar	re feet)							
5.3		1						
62			<u> </u>	_			· · · · · · · · · · · · · · · · · · ·	
55			<u> </u>	_			·	
944			<u> </u>					
0	202 502 0	aclication						
	323,528.3	gallons pe cubic feet						
	45,252.4		por you	+				
				++				
O FEWLAN								
	(1-ETAF x SLA	01						
5.3								
5.3 5								
55								
944								
)								
· =	287,843.7	gallons pe	er year					
=		cubic feet						
N								
)(LA)								
Water Use F	Per Year (gallon	s)						
anspiration		-,						
UCOLS (Reg	gion 2, Water L	Jse: H 0.7 -	0.9, M 0.4 - 0.6,	, L 0.1 - 0.3, VL < 0.1	I, All Turf 0.8)			
gh, Medium,	, and low water	use areas)(	square feet)					
Area								
			e .81, spray spri	nklers .75		1	1	
AF) .55 for F	Residential and	.45 for Non	Residential					
tion ( <b>E</b> to)	45.0	Care la						
tion (Eto)	45.3	San Jo	se, CA.					
PE AREAS			Plant Factor	Irrigation		Landscape		
escription	Irrigation	Method						
s	Dri	mounou	(PF)	Efficiency (IE)	ETAF (PF/IE)	Area (sq. ft)	ETAF x Area	ETWU
		р	0.3	Efficiency (IE) 0.81	0.37037037	Area (sq. ft) 1,804.0	668.1	18,765
	Dri	p p	0.3	Efficiency (IE) 0.81 0.81	0.37037037 0.617283951	Area (sq. ft) 1,804.0 120.0	668.1 74.1	18,765 2,080
	Dri	p p p	0.3 0.5 0.3	Efficiency (IE) 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037	Area (sq. ft) 1,804.0 120.0 1,505.0	668.1 74.1 557.4	18,765 2,080 15,655
s	Dri Dri	p p p p	0.3 0.5 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037	Area (sq. ft) 1,804.0 120.0 1,505.0 1,090.0	668.1 74.1 557.4 403.7	18,765 2,080 15,655 11,338
s wers	Dri	p p p p ay	0.3 0.5 0.3	Efficiency (IE) 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037	Area (sq. ft) 1,804.0 120.0 1,505.0	668.1 74.1 557.4 403.7 1,520.0	18,765 2,080 15,655 11,338 42,690
s wers owers	Dri Dri Spr	p p p p ay ay	0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4	Area (sq. ft) 1,804.0 120.0 1,505.0 1,090.0 3,800.0 2,710.0 2,680.0	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0	18,765 2,080 15,655 11,338 42,690 30,445 30,108
s wers owers owers	Dri Dri Spr Spr Spr Dri	p p p ay ay ay p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.3 0.3 0.5	Efficiency (IE) 0.81 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.75 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.4 0.617283951	Area (sq. ft) 1,804.0 120.0 1,505.0 1,090.0 3,800.0 2,710.0 2,680.0 200.0	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467
s wers wers wers s	Dri Dri Spr Spr Dri Dri	p p p ay ay ay p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.3 0.5 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037	Area (sq. ft) 1,804.0 120.0 1,505.0 1,090.0 3,800.0 2,710.0 2,680.0 200.0 820.0	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529
s wers owers s s bs	Dri Dri Spr Spr Dri Dri Dri	р р р ау ау ау р р	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037	Area (sq. ft) 1,804.0 120.0 1,505.0 1,090.0 3,800.0 2,710.0 2,680.0 200.0 820.0 1,975.0	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544
s wers owers s bs s	Dri Dri Spr Spr Spr Dri Dri Dri Dri	р р р ау ау ау р р р	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.3 0.5 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951	Area (sq. ft) 1,804.0 120.0 1,505.0 1,090.0 3,800.0 2,710.0 2,680.0 200.0 820.0	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427
s wers wers wers s bs s bs bs bs	Dri Dri Spr Spr Dri Dri Dri	p p p ay ay ay p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.3 0.5	Efficiency (IE) 0.81 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037	Area (sq. ft) 1,804.0 120.0 1,505.0 1,090.0 3,800.0 2,710.0 2,680.0 200.0 820.0 1,975.0 140.0	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730
s wers wers s bs s bs bs bs bs	Dri Dri Spr Spr Dri Dri Dri Dri Dri Dri	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           1,40.0	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586
s wers wers s bs bs bs bs bs bs	Dri Dri Spr Spr Dri Dri Dri Dri Dri	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,900.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           1,320.0           1,210.0	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586
s wers wers s bs bs bs bs bs bs	Dri Dri Spr Spr Dri Dri Dri Dri Dri Dri	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,900.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586 10,887 Totals
s wers wers s bs bs bs bs bs bs	Dri Dri Spr Spr Dri Dri Dri Dri Dri Dri	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586 10,887 Totals 223,258
s wers wers s bs bs bs bs bs bs	Dri Dri Spr Spr Dri Dri Dri Dri Dri Dri	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals 7,949.1	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586 10,887 Totals 223,258.0
s wers wers s bs bs bs bs bs bs	Dri Dri Spr Spr Dri Dri Dri Dri Dri Dri	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals 7,949.1 ETWU TOTAL	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586 10,887 Totals 223,258.0
s wers wers s bs bs bs bs bs bs	Dri Dri Spr Spr Dri Dri Dri Dri Dri Dri	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals 7,949.1 ETWU TOTAL	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586 10,887 Totals 223,258.0
s wers owers s bs bs bs bs undcovers	Dri Dri Spr Spr Dri Dri Dri Dri Dri Dri	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals 7,949.1 ETWU TOTAL	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586 10,887 Totals 223,258.0
s wers owers s bs bs bs bs undcovers	Dri Dri Spr Spr Dri Dri Dri Dri Dri Dri	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals 7,949.1 ETWU TOTAL	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586 10,887 Totals 223,258.0
s wers owers owers s s bs bs bs undcovers	Dri Spr. Spr. Dri Dri Dri Dri Dri Dri Tri 7,949.1	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals 7,949.1 ETWU TOTAL	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586 10,887 Totals
s s wers owers owers s s s bs bs bs undcovers as as	Dri Spr. Spr. Dri Dri Dri Dri Dri Dri 7,949.1	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals 7,949.1 ETWU TOTAL	18,765 2,080 15,655 11,338 42,690 30,445 30,108 3,467 8,529 20,544 2,427 13,730 12,586 10,887 Totals 223,258
s wers owers owers s s bs bs bs undcovers	Dri Spr. Spr. Dri Dri Dri Dri Dri Dri Tri 7,949.1	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals 7,949.1 ETWU TOTAL	18,765. 2,080. 15,655. 11,338. 42,690. 30,445. 30,108. 3,467. 8,529. 20,544. 2,427. 13,730. 12,586. 10,887. Totals 223,258.
s wers owers s bs bs bs bs undcovers	Dri Spr. Spr. Dri Dri Dri Dri Dri Dri Tri 7,949.1	p p p ay ay ay p p p p p p p p	0.3 0.5 0.3 0.3 0.3 0.3 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.5 0.3 0.3 0.3	Efficiency (IE) 0.81 0.81 0.81 0.81 0.75 0.75 0.75 0.75 0.81 0.81 0.81 0.81 0.81 0.81 0.81 0.81	0.37037037 0.617283951 0.37037037 0.37037037 0.4 0.4 0.4 0.4 0.617283951 0.37037037 0.37037037 0.617283951 0.37037037 0.37037037 0.37037037	Area (sq. ft)           1,804.0           120.0           1,505.0           1,090.0           3,800.0           2,710.0           2,680.0           200.0           820.0           1,975.0           140.0           1,320.0           1,570.0           Total sf ft.	668.1 74.1 557.4 403.7 1,520.0 1,084.0 1,072.0 123.5 303.7 731.5 86.4 488.9 448.1 387.7 Totals 7,949.1 ETWU TOTAL	18,765. 2,080. 15,655. 11,338. 42,690. 30,445. 30,108. 3,467. 8,529. 20,544. 2,427. 13,730. 12,586. 10,887. Totals 223,258.

	Karen & ASS LANDSCAPE AN		There Re & Design
	KAREN AITKEN & ASSOCIATES LANDSCAPE ARCHITECTS	8262 Rancho Real Gilroy Ca. 95020	Calif. Reg.#2239 (408) 842-0245 karen@kaa.design
		3655 Pleasant Knoll Court, San Jose, CA.	IRRIGATION AND PLANTING DETAILS
	DATE	CA	21-24
C.	SCALE DRAWN JOB	SL	=10'-0" - AD SLAM

L-3

REVISIONS

BY