

APN: 575-20-037  
97.54 AC.


**SHEET INDEX**

- TM-01 EXISTING CONDITIONS
- TM-02 TREE REMOVAL
- TM-03 OVERALL VESTING TENTATIVE SUBDIVISION MAP
- TM-04 DEVELOPMENT AREA VESTING TENTATIVE SUBDIVISION MAP
- TM-05 AFFORDABLE HOUSING PLAN
- TM-06 PRELIMINARY GRADING, DRAINAGE, AND UTILITY PLAN
- TM-07 PRELIMINARY STORMWATER CONTROL PLAN
- TM-08 PRELIMINARY FIRE ACCESS PLAN
- WW-1 WASTEWATER FACILITIES LAYOUT
- WW-2 WASTEWATER TREATMENT DETAILS
- WW-3 WASTEWATER DISPOSAL DETAILS
- WW-4 WASTEWATER SITE EVALUATION DATA

EXISTING CONDITIONS  
TM-01

**CIRCLE HILL ESTATES**  
Santa Clara County, CA  
April 5, 2024


Michael LaBarbera Legacy Trust - Winery Land Development  
873 Blossom Hill Road San Jose, CA 95123  
408.947.1166

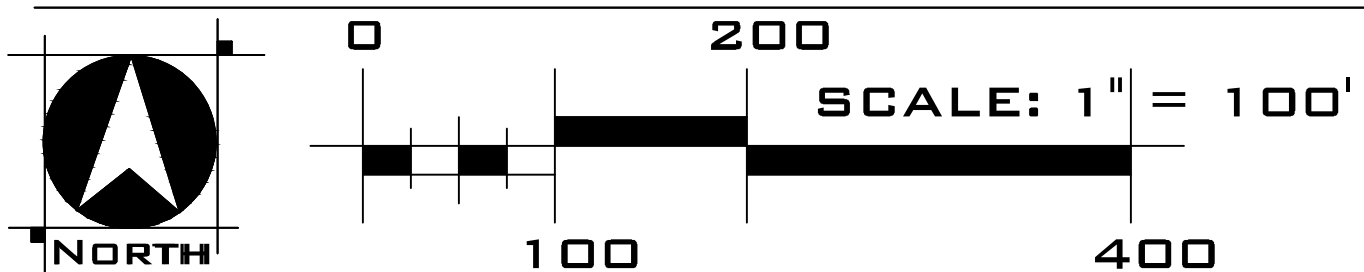

**Anderson Architects INC**

- Kurt B. Anderson, ASA  
Principal
- 126 W. Campbell Ave, Suite D  
Campbell, CA 95008
- Tel. 408.371.1269
- kbanderson@andersonarch.com  
Cell 408.202.5462

**WOOD RODGERS**  
BUILDING RELATIONSHIPS ONE PROJECT AT A TIME  
3875 HOPYARD ROAD, SUITE 345 Tel 925.847.1556  
Pleasanton, CA. 94568 Fax 925.847.1557

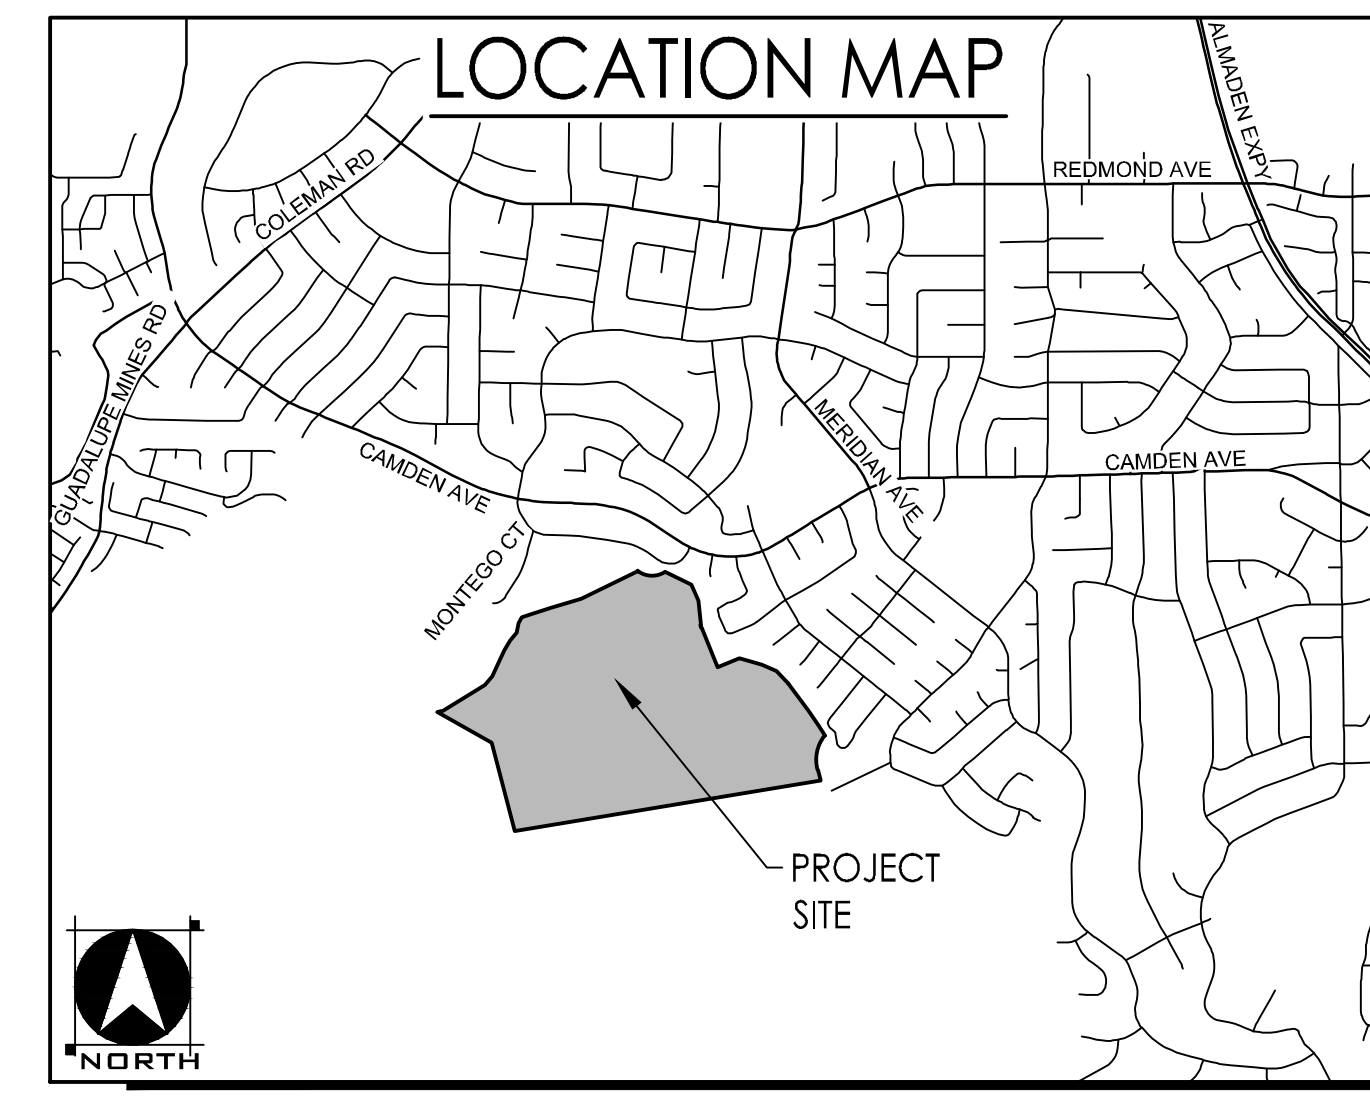


**TREE REMOVAL LEGEND\***

- REMAIN
- X REMOVE

\*SEE ARBORIST REPORT FOR DETAILS.

Michael LaBarbera Legacy Trust - Winery Land Development  
 873 Blossom Hill Road San Jose, CA 95123  
 408.947.1166


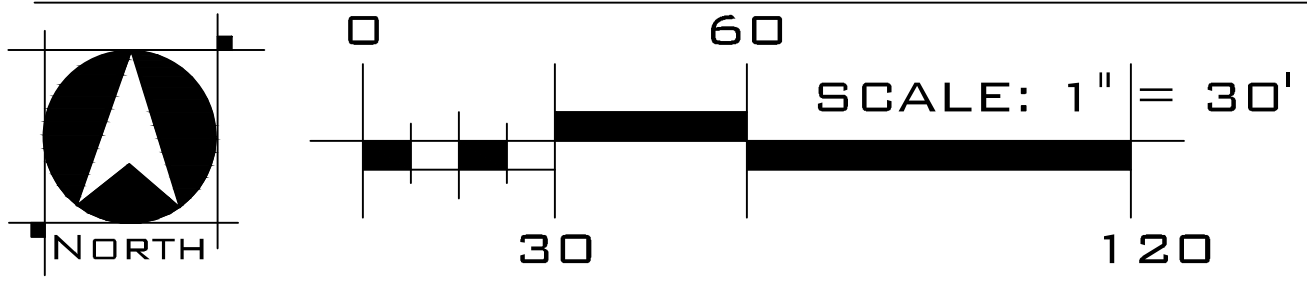


**Anderson Architects INC**

- Kurt B. Anderson, ASA  
Principal
- 120 W. Campbell Ave, Suite D  
Campbell, CA 95008
- Tel. 408.371.1299
- kbanderson@andersoninc.com  
Cal 408.202.5462

**WOOD RODGERS**  
 BUILDING RELATIONSHIPS ONE PROJECT AT A TIME  
 3875 HOPYARD ROAD, SUITE 345 Tel 925.847.1558  
 Pleasanton, CA. 94568 Fax 925.847.1557

TREE REMOVAL  
 TM-02  
**CIRCLE HILL ESTATES**  
 Santa Clara County, CA  
 April 5, 2024

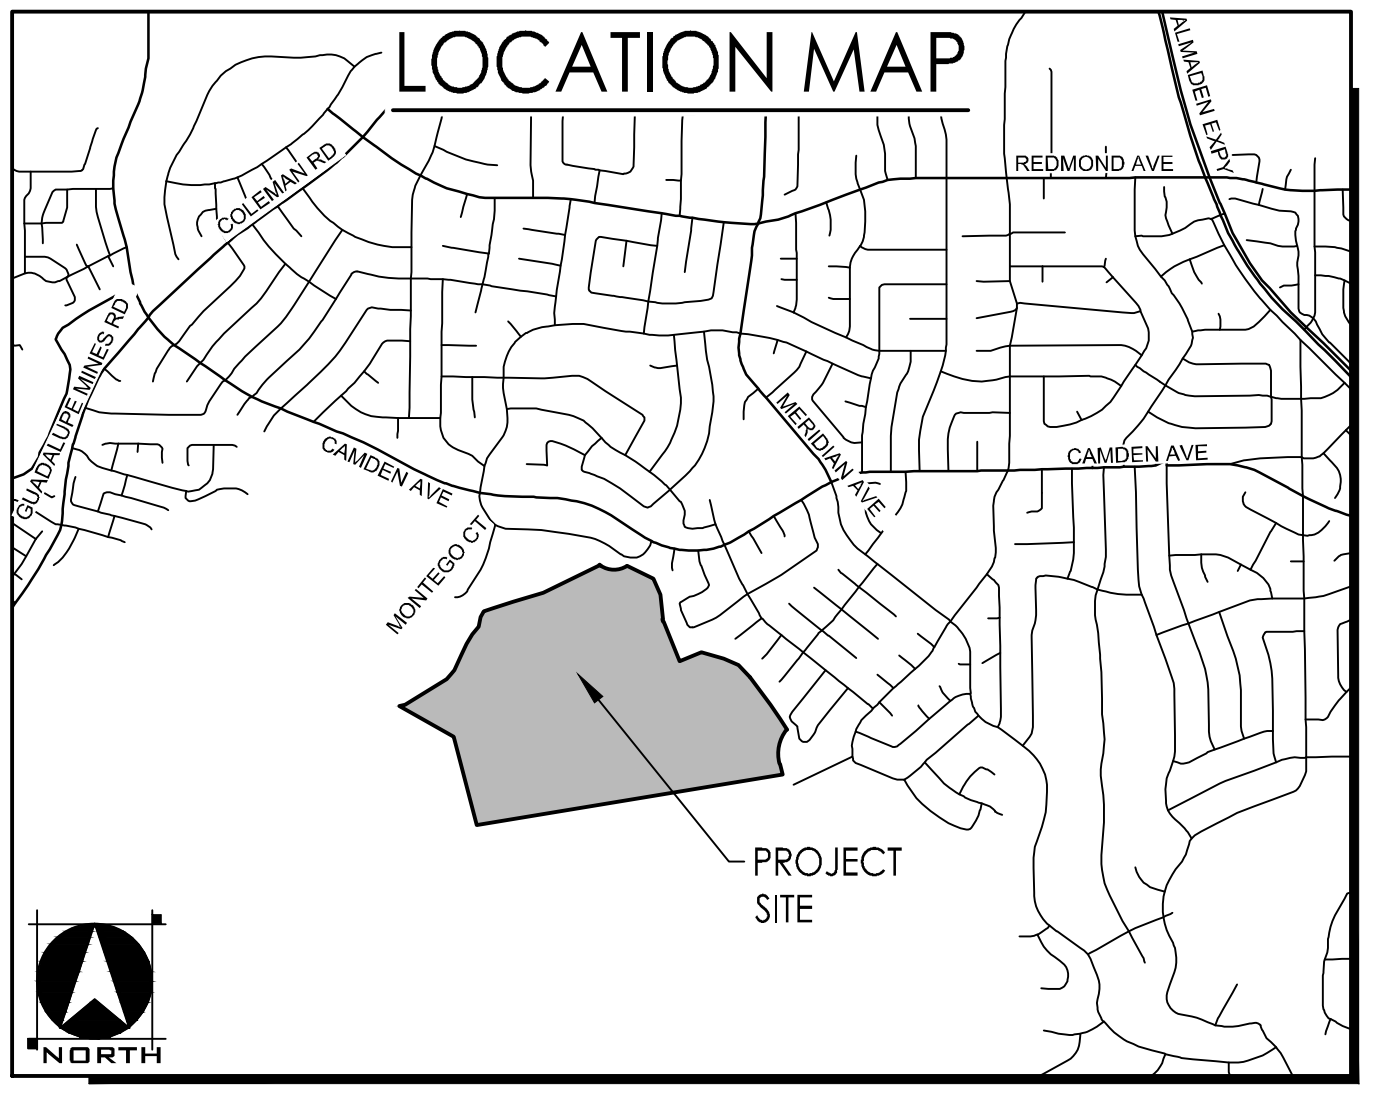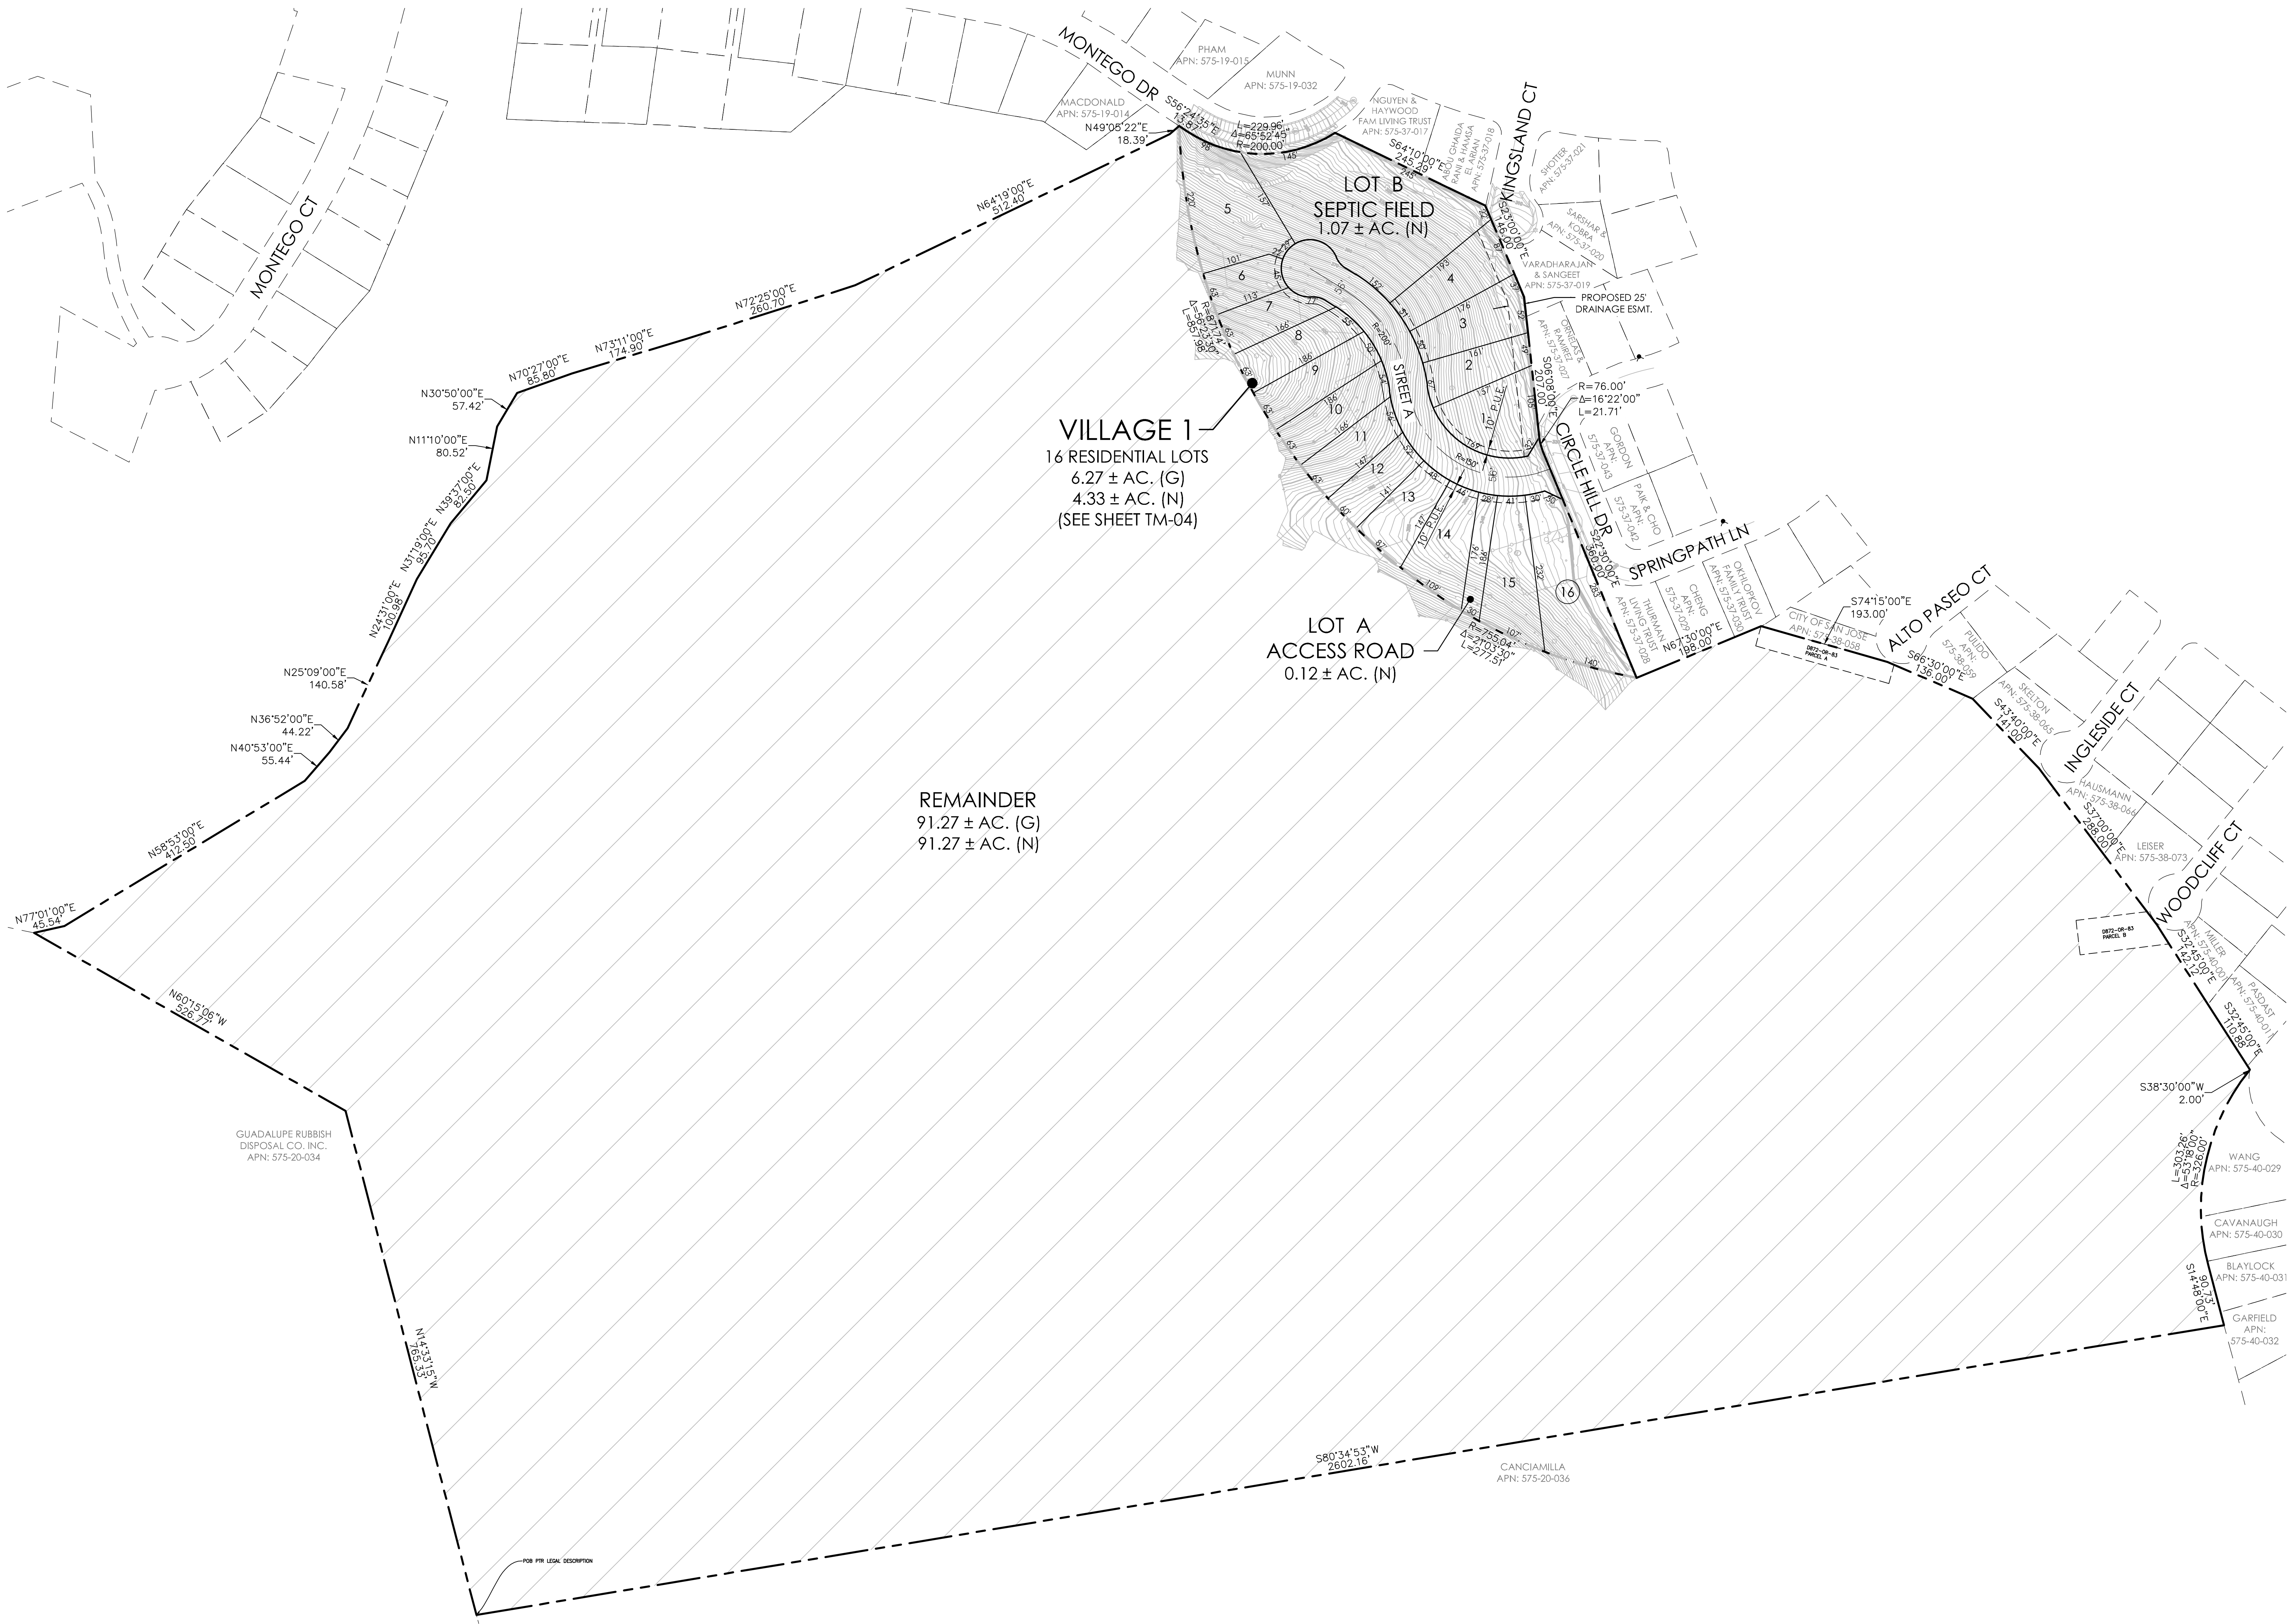

**PROJECT NOTES**

**APPLICANT/OWNER**  
MIKE LABARBERA  
873 BLOSSOM HILL ROAD  
SAN JOSE, CA 95123  
CONTACT: MIKE LABARBERA  
PHONE: (408) 947-1166

**PLANNER/ENGINEER**  
WOOD RODGERS INC.  
3875 HOPYARD ROAD, SUITE 345  
PLEASANTON, CA 94588  
CONTACT: PAUL MEUSER | KARRIE MOSCA  
PHONE: (925) 847-1549 | (925) 847-1547

**ASSESSOR'S PARCEL NO.**  
575-20-037

**AREA**  
97.54 ± ACRES GROSS

**PROPOSED DEVELOPMENT SUMMARY**  
16 SINGLE FAMILY RESIDENTIAL LOTS  
1 ACCESS ROAD LOT  
1 SEPTIC FIELD LOT  
1 REMAINDER LOT

**DENSITY**  
3.18 D.U./AC. GROSS

**EXISTING USE**  
VACANT

**PROPOSED USE**  
RESIDENTIAL

**EXISTING ZONING**  
HILLSIDE-D1

**EXISTING GENERAL PLAN**  
SANTA CLARA COUNTY

**PARK DISTRICT**  
SANTA CLARA COUNTY

**FIRE PROTECTION**  
SANTA CLARA COUNTY

**SCHOOL DISTRICT**  
SANTA CLARA COUNTY

**SEWER**  
PRIVATE

**STORM DRAIN**  
PRIVATE

**WATER**  
SAN JOSE WATER COMPANY



**ELECTRICITY**  
PG & E

**GAS**  
PG & E

**NOTES**  
1. SUBDIVIDER RESERVES THE RIGHT TO FILE MULTIPLE FINAL MAPS.  
2. THIS IS AN APPLICATION FOR A DEVELOPMENT PERMIT.  
3. PURSUANT TO SECTION 66434(g) OF THE SUBDIVISION MAP ACT, EASEMENTS TO BE ABANDONED ARE MARKED ON THE MAP.

Michael LaBarbera Legacy Trust - Winery Land Development  
873 Blossom Hill Road San Jose, CA 95123  
408.947.1166



VESTING TENTATIVE SUBDIVISION MAP  
TM-03

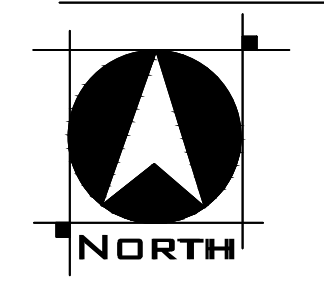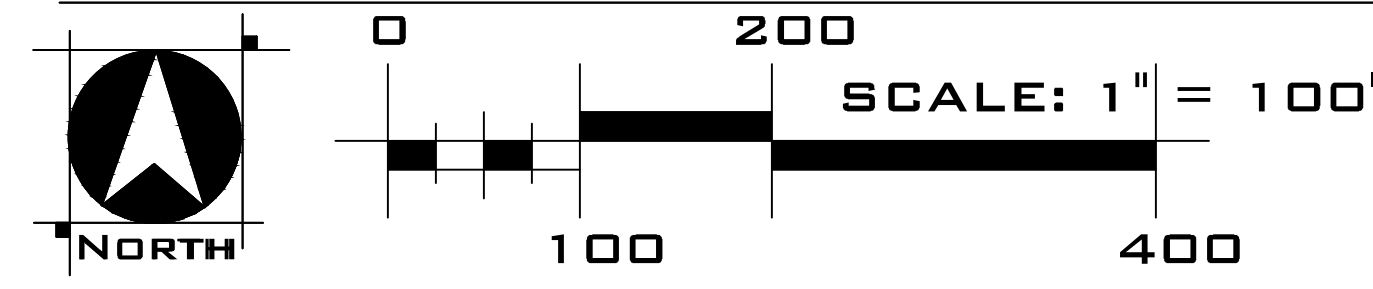

- Kurt B. Anderson, ASA  
Principal
- 126 W. Campbell Ave, Suite D  
Campbell, CA 95008
- Tel. 408.371.1269
- kbanderson@andersoninc.com  
Cell 408.202.5462



**CIRCLE HILL ESTATES**  
Santa Clara County, CA  
April 5, 2024

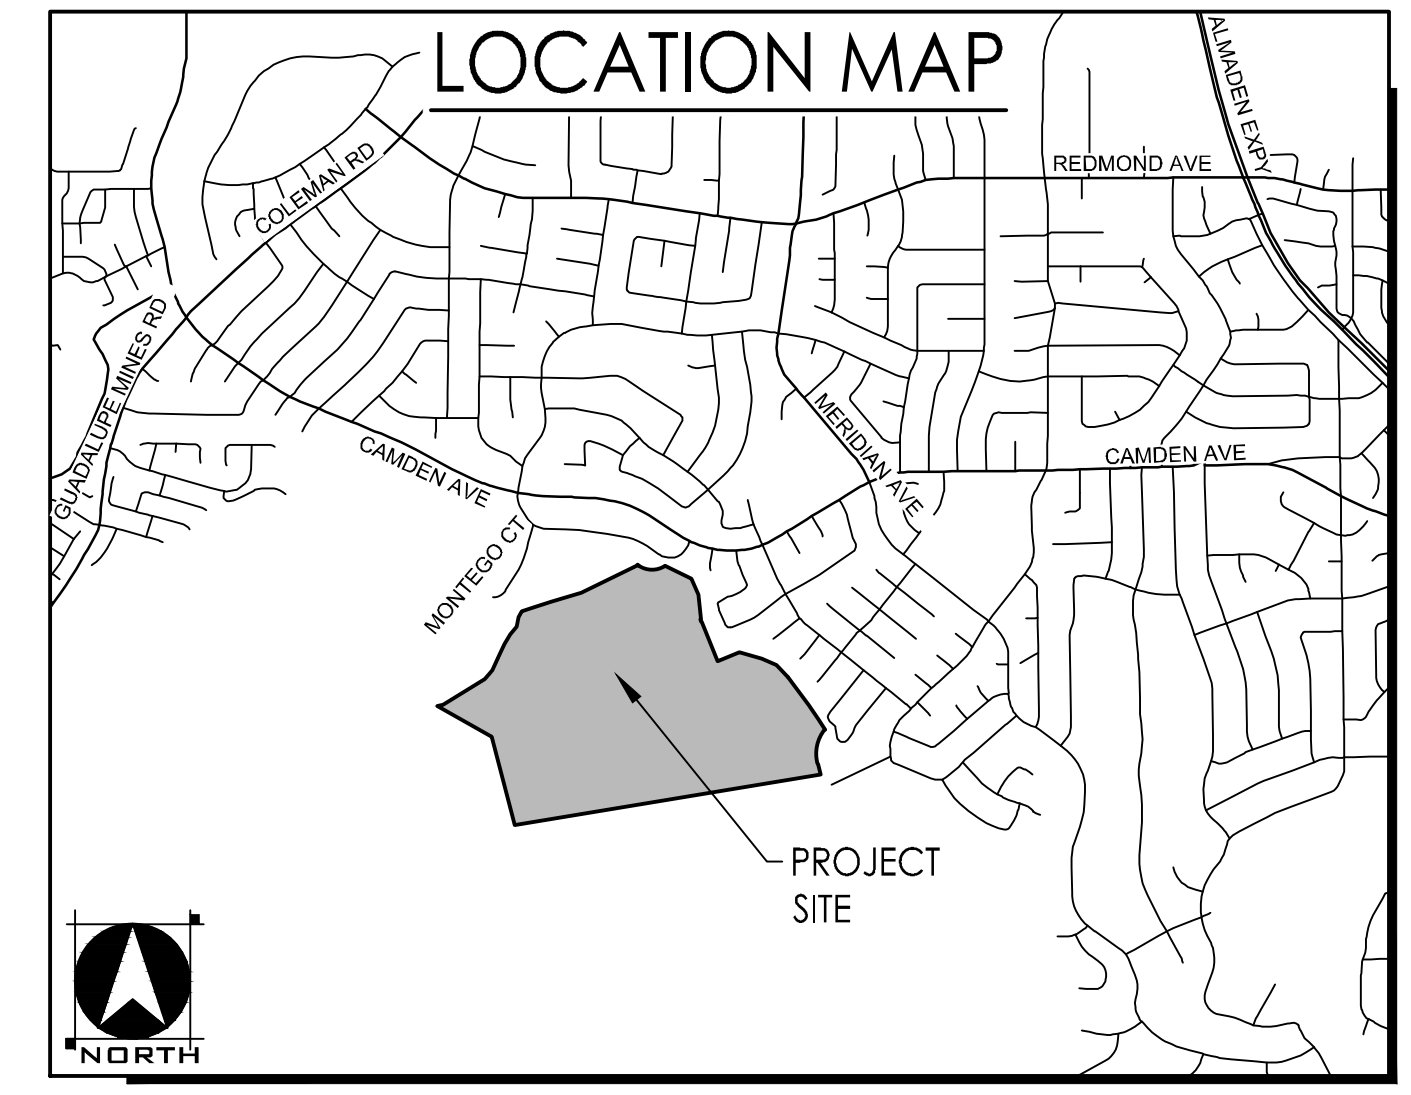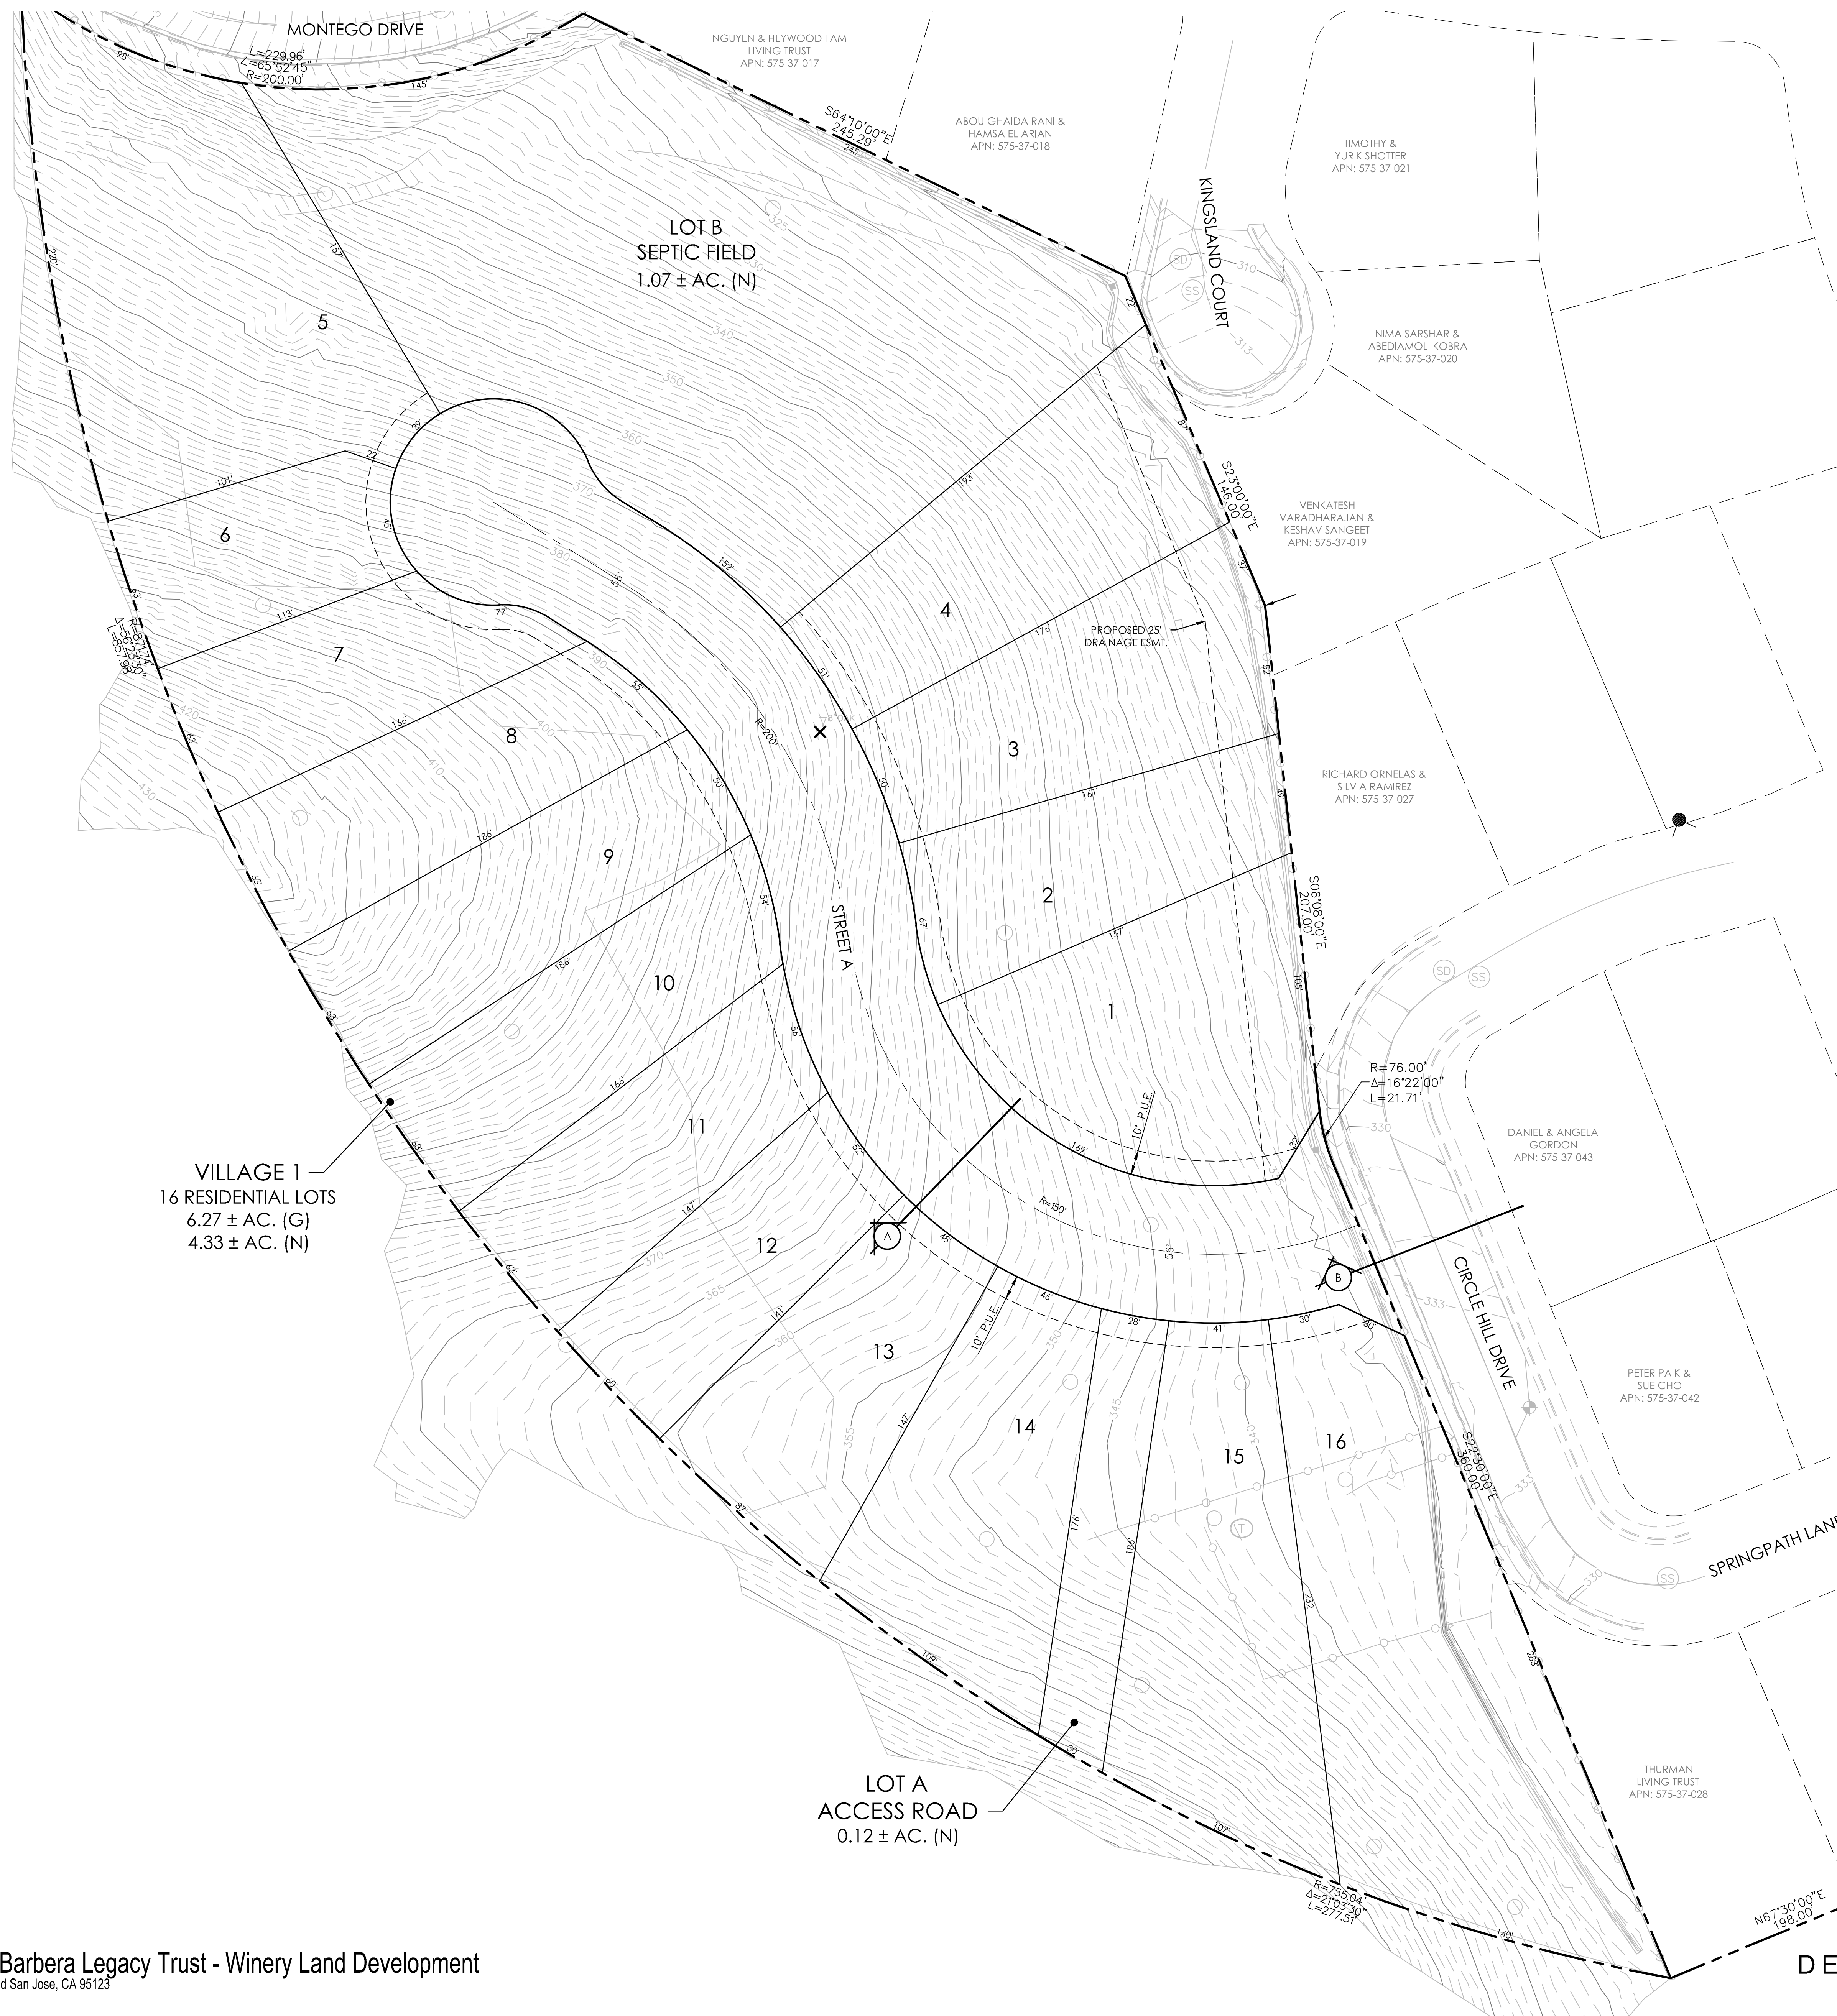

**LEGEND**


- BENCH MARK (SET PK NAIL)  
EL=333.5'
- FIRE HYDRANT
- 4" ABS PERC TEST RISER
- STORM DRAIN INLET
- STORM DRAIN MANHOLE
- SANITARY SEWER MANHOLE
- METAL STOCK WATER TROUGH
- WATER METER
- STREET LIGHT
- GATE
- PROPERTY LINE
- ELEVATION CONTOUR (6" INTERVAL)
- ELEVATION CONTOUR (1" INTERVAL)
- FENCE
- EDGE OF PAVEMENT
- CONCRETE VEE DITCH

**LAND USE SUMMARY**


LAND USE	AREA (NET)	DENSITY (NET)	DENSITY (GROSS)
16 SINGLE-FAMILY RESIDENTIAL LOTS	4.33 AC.		
1 ACCESS ROAD LOT	0.12 AC.		
1 SEPTIC FIELD LOT	1.07 AC.		
PUBLIC ROADS	0.75 AC.		
<b>TOTAL</b>	<b>6.27 AC.</b>	<b>4.61 DU/AC.</b>	<b>3.18 DU/AC.</b>

VILLAGE 1  
16 RESIDENTIAL LOTS  
6.27 ± AC. (G)  
4.33 ± AC. (N)

LOT A  
ACCESS ROAD  
0.12 ± AC. (N)

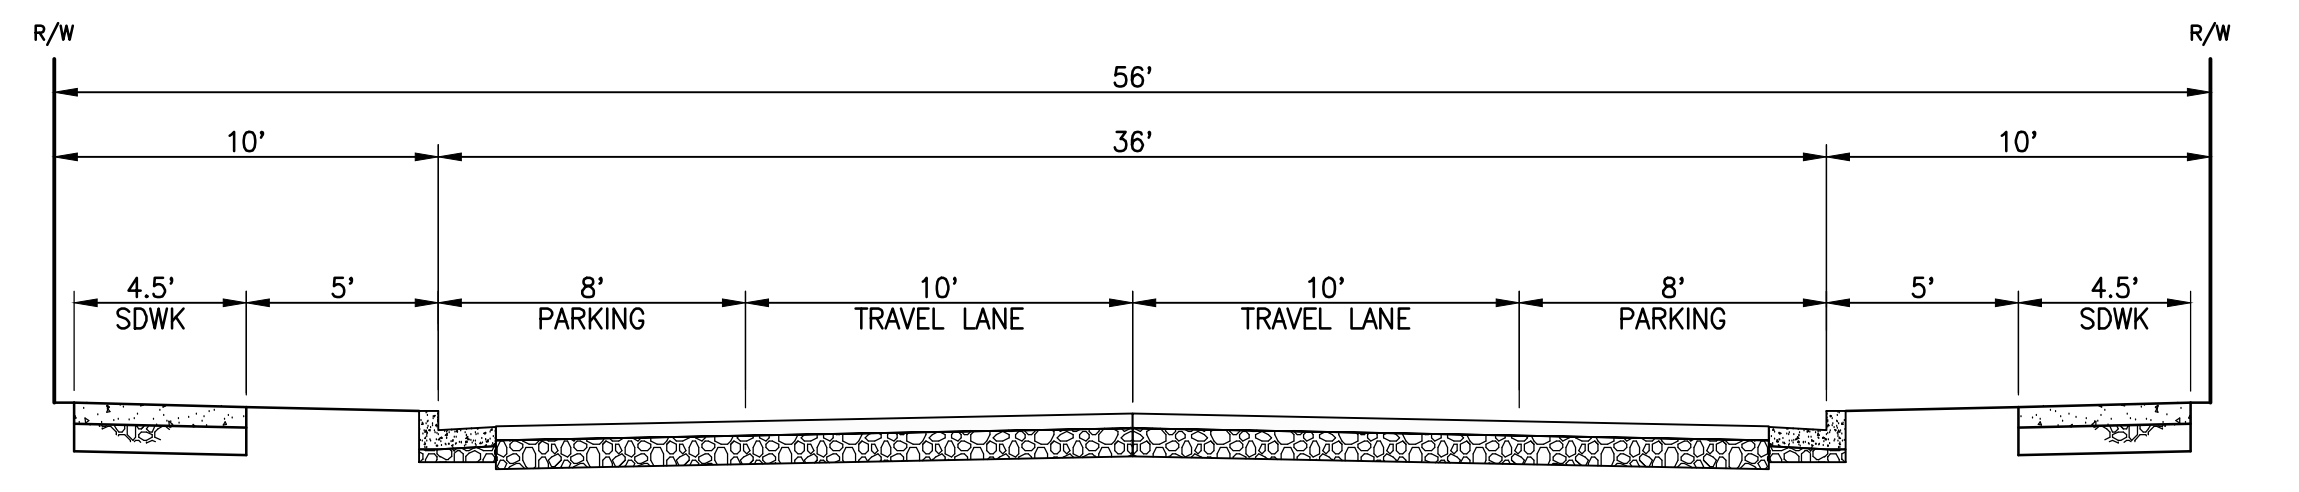


A RESIDENTIAL STREET  
PROPOSED STREET SECTION  
N12

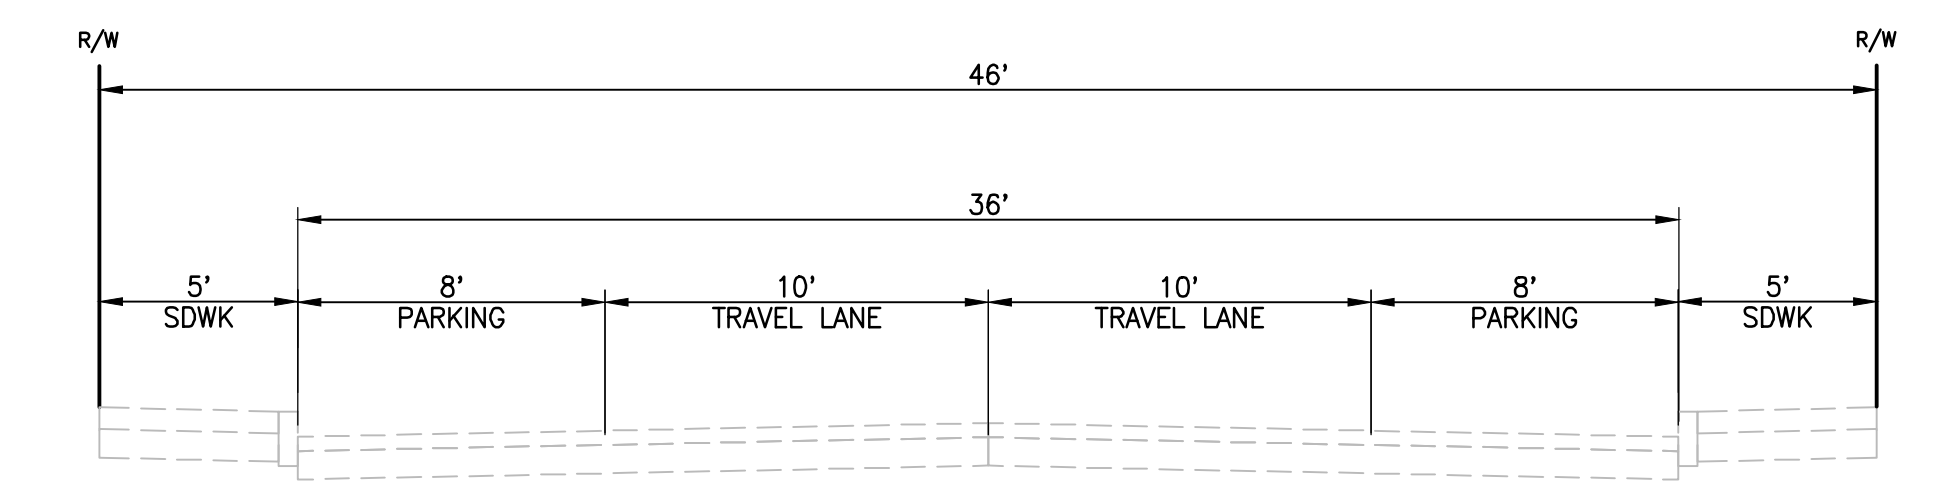

B EXISTING CIRCLE HILL DRIVE  
EXISTING STREET SECTION  
N12

Michael LaBarbera Legacy Trust - Winery Land Development  
873 Blossom Hill Road San Jose, CA 95123  
408.947.1166

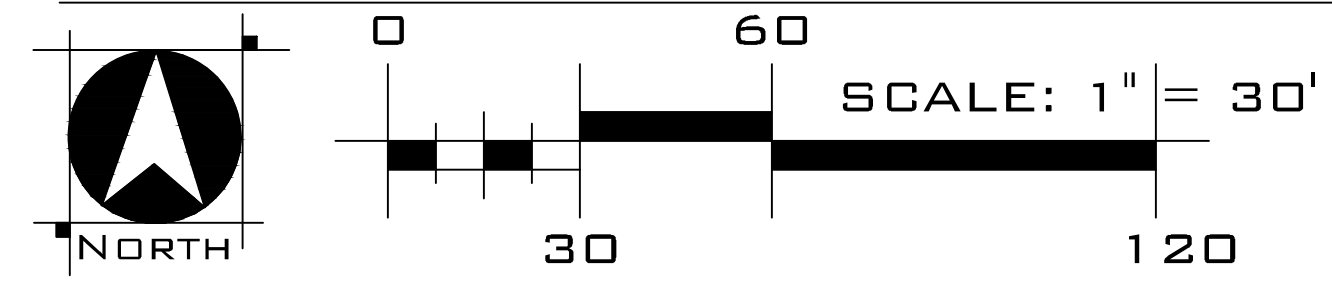

**Anderson Architects INC**


- Kurt B. Anderson, ASA  
Principal
- 120 W. Campbell Ave, Suite D  
Campbell, CA 95008
- Tel. 408.371.1269
- kbanderson@andersoninc.com  
Cell 408.202.9602

**WOOD RODGERS**  
BUILDING RELATIONSHIPS ONE PROJECT AT A TIME  
3875 HOPYARD ROAD, SUITE 345 TEL 925.847.1556  
PLEASANTON, CA. 94568 Fax 925.847.1557

DEVELOPMENT AREA VESTING TENTATIVE SUBDIVISION MAP  
TM-04

**CIRCLE HILL ESTATES**  
Santa Clara County, CA  
April 5, 2024


J:\Jobs\4396\_Circle Hill Estates\Circle Hill Estates-04\Planning\Exhibits\Tentative Map - PD\TM-04 TSM Dev Area.dwg 4/4/2024 4:24 PM Dean Christiansen

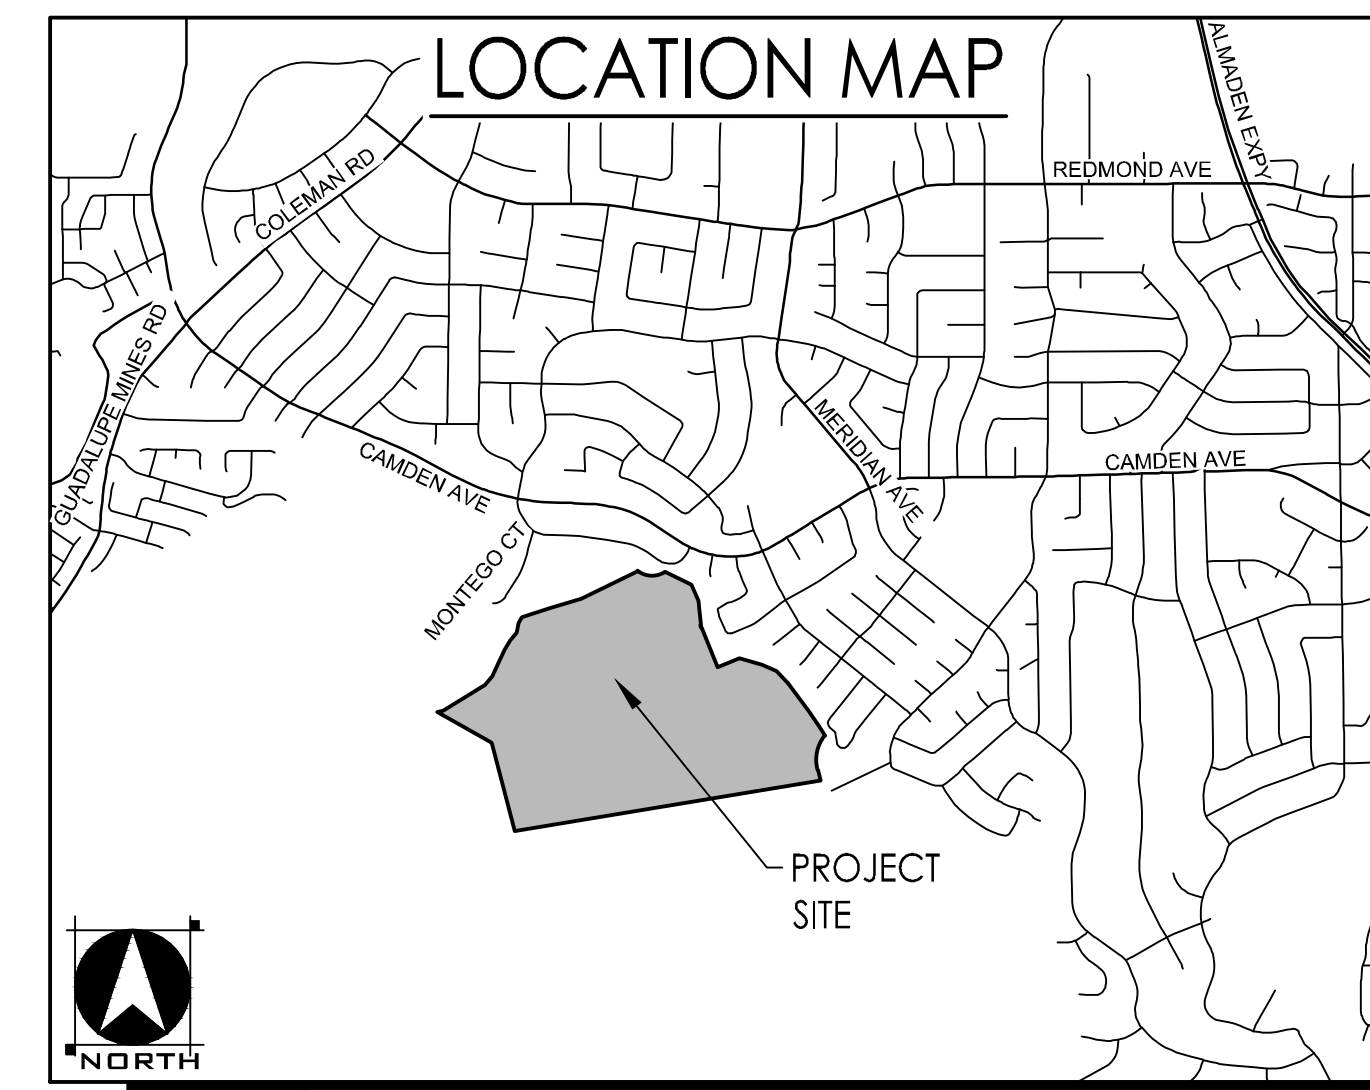

HOUSING SUMMARY			
	INCOME LEVEL	UNIT COUNT	PERCENT MIX
*	LOW INCOME	4	20
■	NOT RESTRICTED	16	80
TOTAL		20	100

\*LOW INCOME UNITS WILL BE PROVIDED AS ACCESSORY DWELLING UNITS, DEED RESTRICTED AS AFFORDABLE, ON THE SAME LOT AS A SINGLE FAMILY HOME WITH NO AFFORDABILITY RESTRICTIONS. THE LOCATION OF THE FOUR ACCESSORY DWELLING UNITS IS CONCEPTUAL. SUCH THAT THESE 4 UNITS CAN BE LOCATED ON ANY OF THE PROPOSED 16 LOTS.

Michael LaBarbera Legacy Trust - Winery Land Development  
 873 Blossom Hill Road San Jose, CA 95123  
 408.947.1166

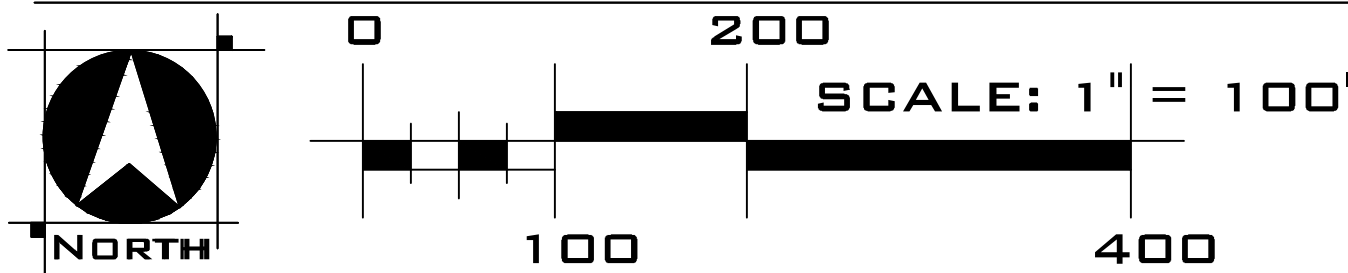

**Anderson Architects INC.**



- Kurt B. Anderson, ASA  
Principal
- 126 W. Campbell Ave, Suite D  
Campbell, CA 95008
- Tel. 408.371.1269
- kanderson@andersonarch.com  
Cell 408.202.5462

**WOOD RODGERS**  
 BUILDING RELATIONSHIPS ONE PROJECT AT A TIME  
 8676 WOODLAND ROAD SUITE 1285 Tel 925.847.1558  
 Pleasanton, CA. 94568 Fax 925.847.1557

AFFORDABLE HOUSING PLAN  
 TM-05

**CIRCLE HILL ESTATES**  
 Santa Clara County, CA  
 April 5, 2024



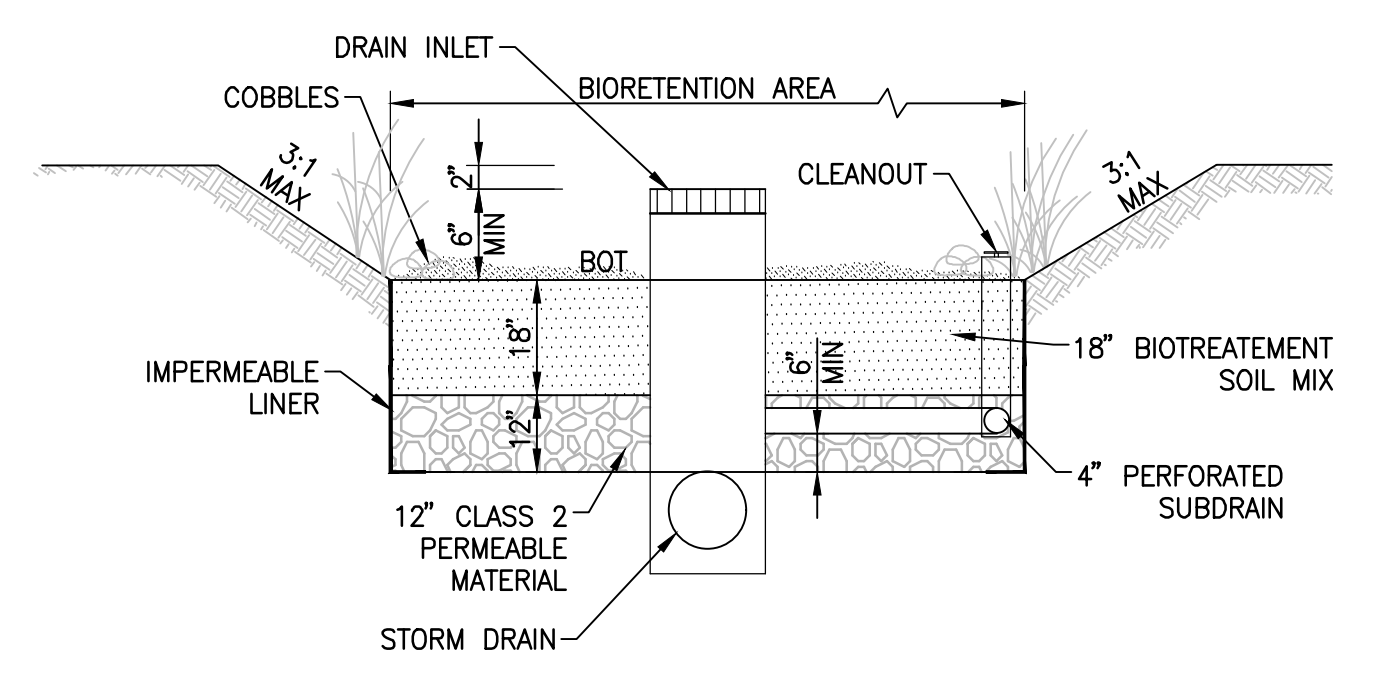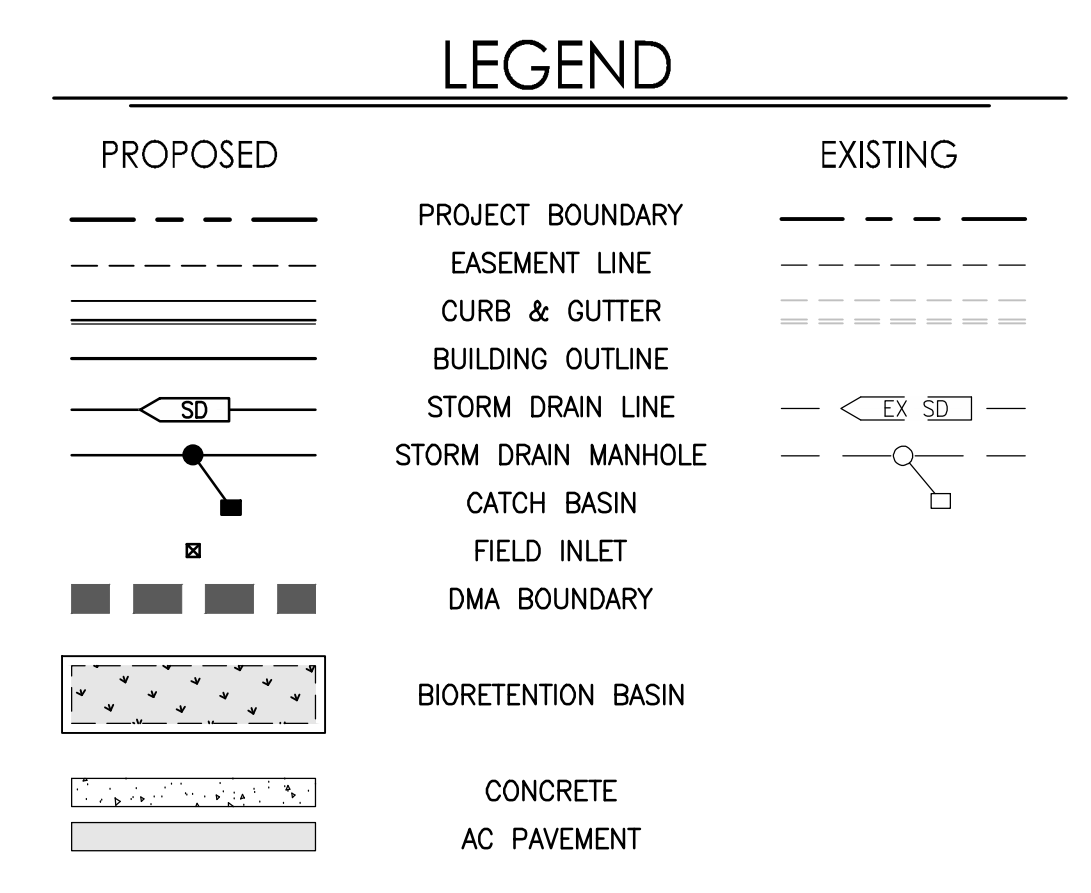


### ABBREVIATIONS

BOT	BOTTOM
DMA	DRAINAGE MANAGEMENT AREA
EX	EXISTING
MAX	MAXIMUM
MIN	MINIMUM
SD	STORM DRAIN
SF	SQUARE FEET
TCM	TREATMENT CONTROL MEASURE

### DRAINAGE MANAGEMENT AREA (DMA) SUMMARY

DMA	TOTAL DRAINAGE AREA (SF)	TOTAL IMPERVIOUS AREA (ROOFS AND PAVEMENT) (SF)	TOTAL PERVIOUS AREA (SF)	EFFECTIVE IMPERVIOUS AREA (SF)	REQUIRED TREATMENT AREA (4%) (SF)	PROVIDED TREATMENT AREA (SF)	TREATMENT MEASURE
1	69,280	22,410	46,870	27,097	1,084	1,092	BIORETENTION
2	123,920	33,807	90,113	42,818	1,713	1,714	BIORETENTION
3	9,147	1,780	7,367	2,517	101	101	BIORETENTION
4	11,735	1,773	9,962	2,769	111	114	BIORETENTION
5	12,484	1,777	10,707	2,848	114	115	BIORETENTION
6	46,554	136	46,418	-	-	-	SELF-TREATING

Michael LaBarbera Legacy Trust - Winery Land Development  
 873 Blossom Hill Road San Jose, CA 95123  
 408.947.1166

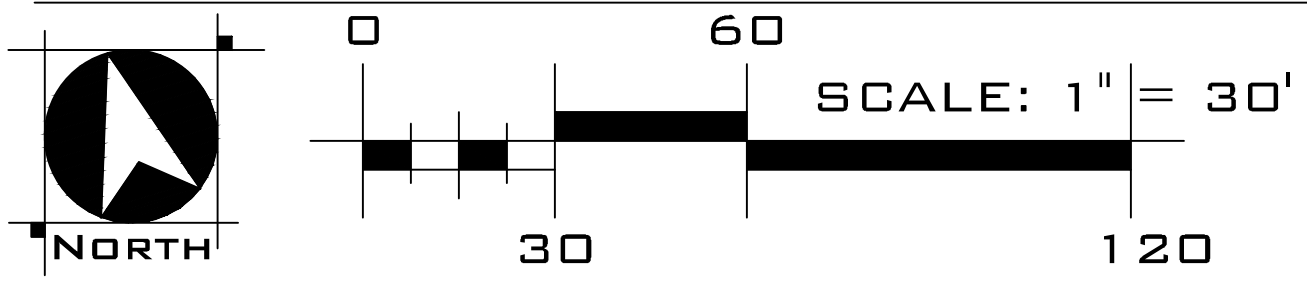


**Anderson Architects INC.**  
 Kurt B. Anderson, ASA  
 Principal  
 120 W. Campbell Ave, Suite D  
 Campbell, CA 95008  
 Tel. 408.371.1269  
 kbanderson@andersoninc.com  
 Cell 408.202.5462

**WOOD RODGERS**  
 BUILDING RELATIONSHIPS ONE PROJECT AT A TIME  
 3875 HOPYARD ROAD, SUITE 345 TEL 925.847.1556  
 PLEASANTON, CA. 94588 FAX 925.847.1557

PRELIMINARY STORMWATER CONTROL PLAN  
 TM-07

**CIRCLE HILL ESTATES**  
 Santa Clara County, CA  
 April 5, 2024

J:\Jobs\4396\_Circle Hill Estates\Circle Hill Estates-0A\Planning\Exhibits\Tentative Map - PD\TM-07 SWCP.dwg 4/4/2024 4:14 PM Dean Christiansen

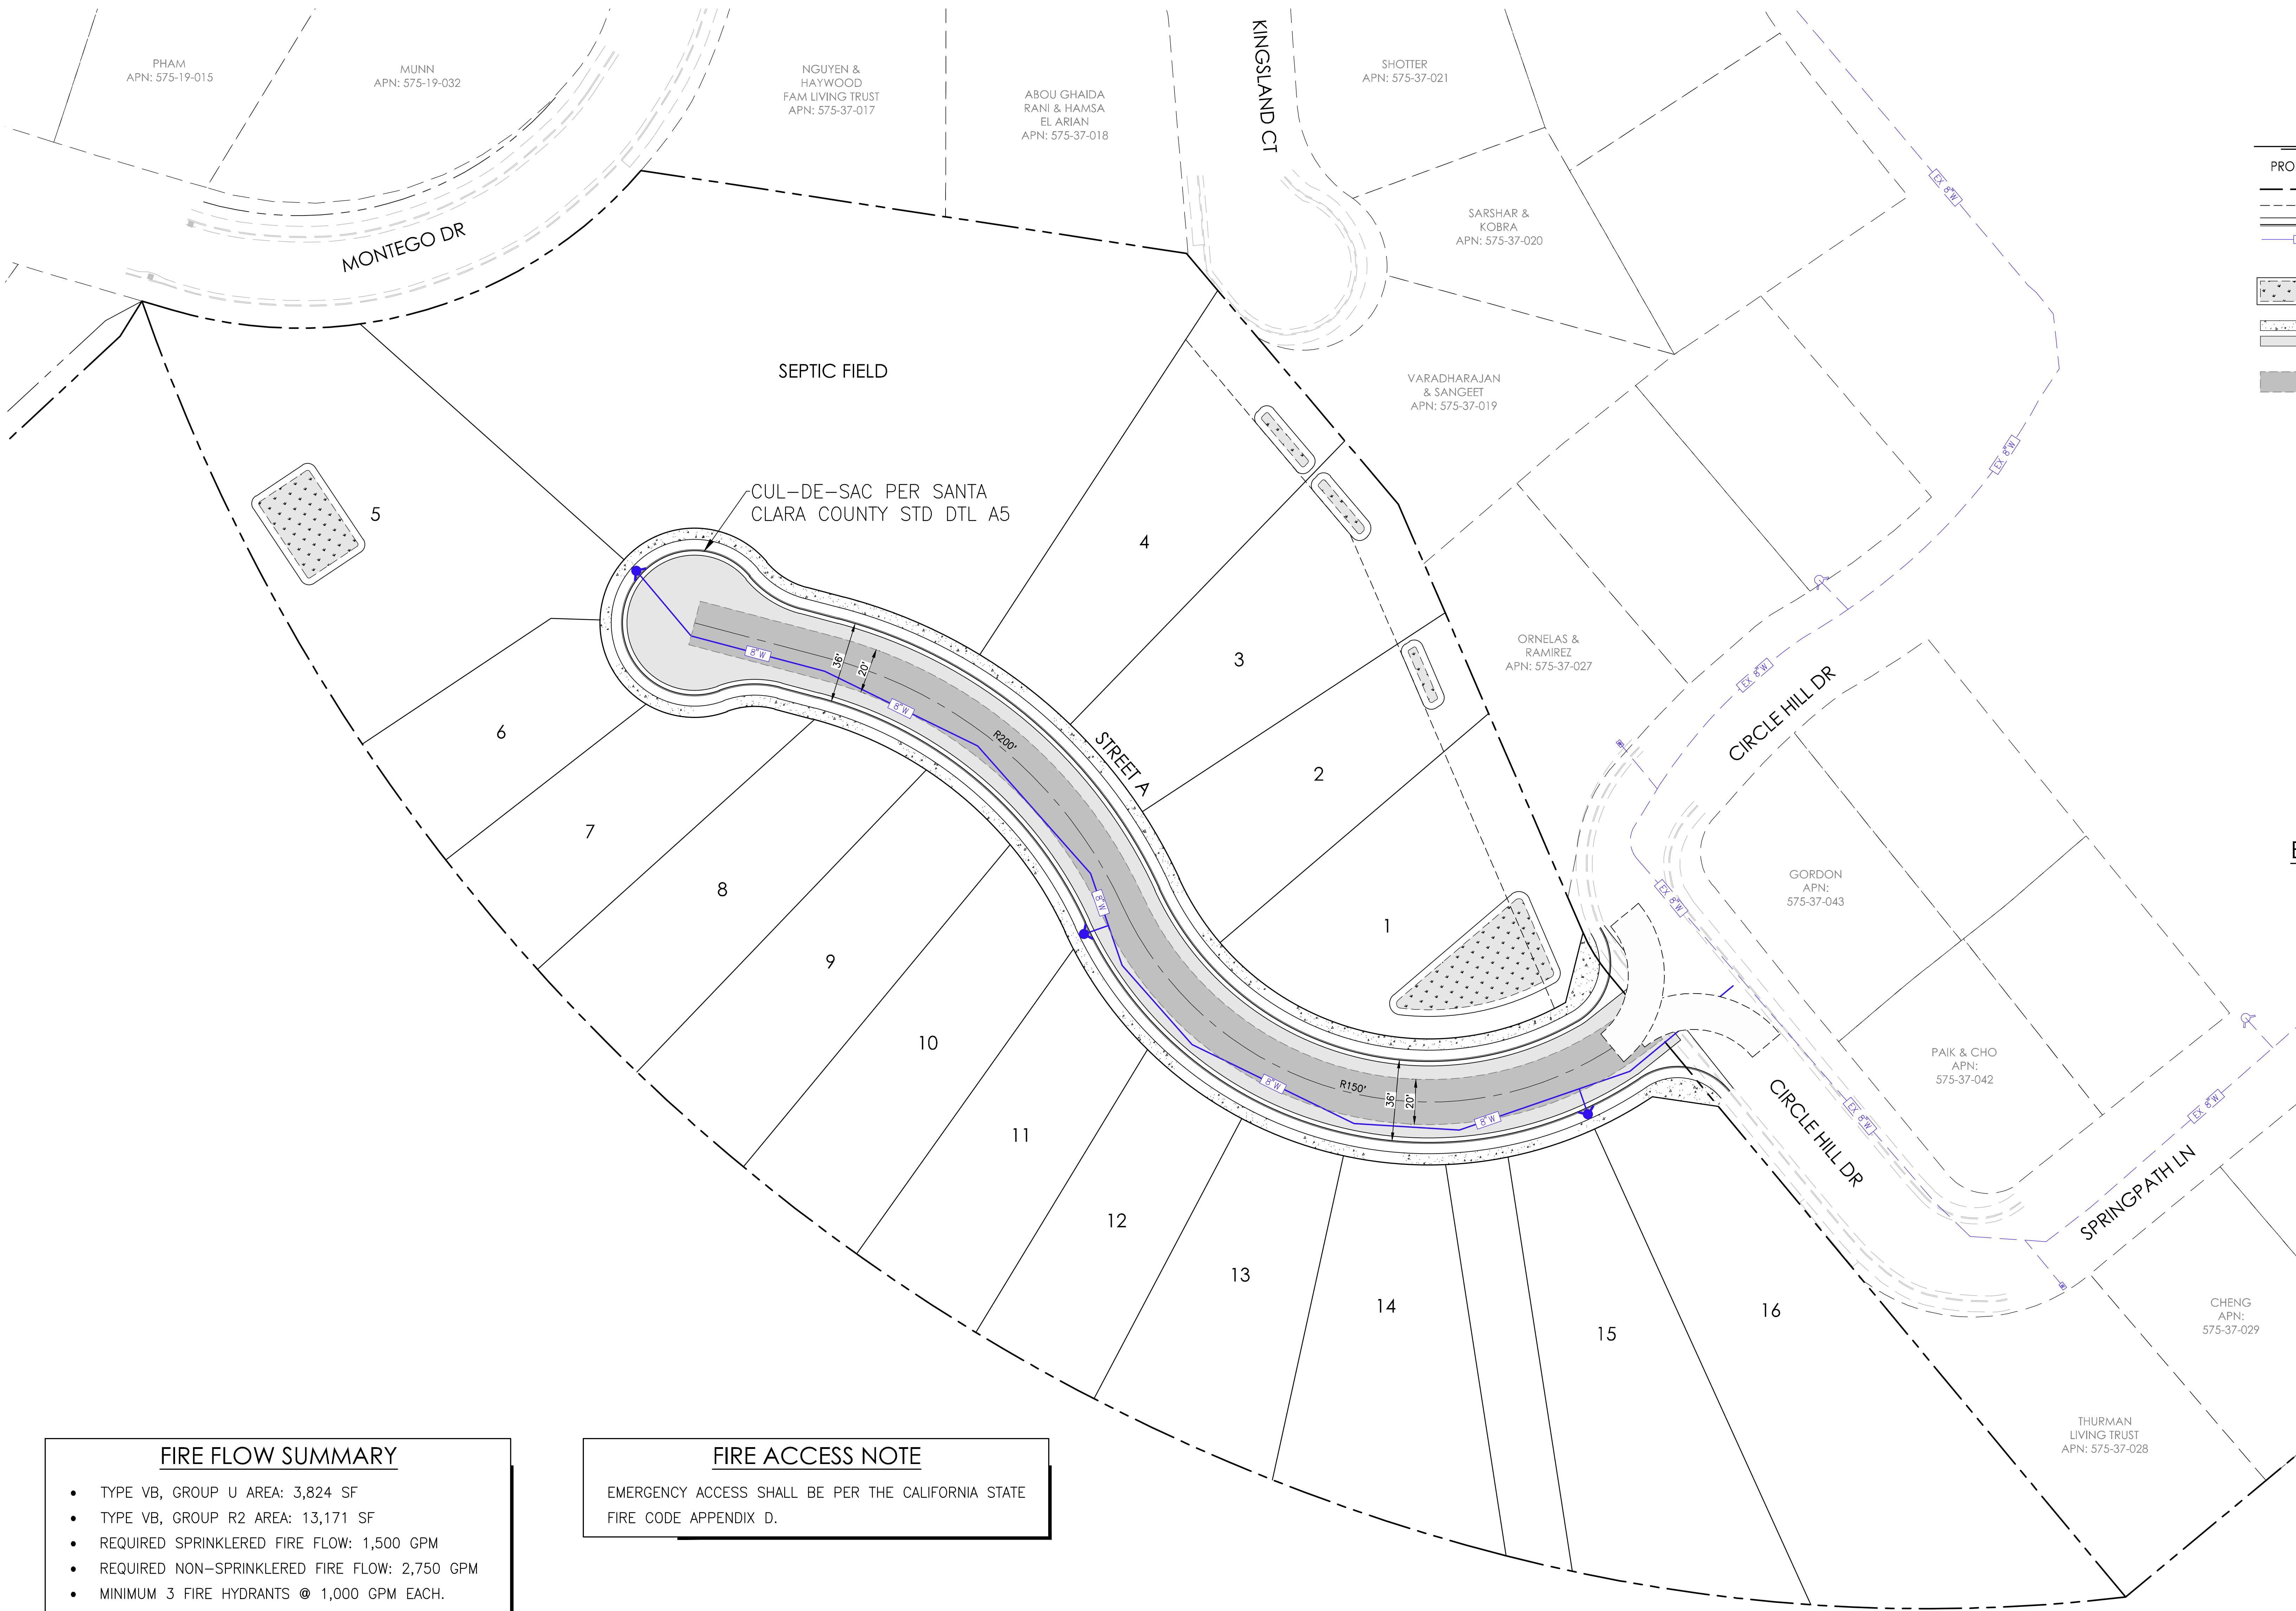


### LEGEND

PROPOSED	EXISTING

### ABBREVIATIONS

EX	EXISTING
DTL	DETAIL
STD	STANDARD
W	WATER

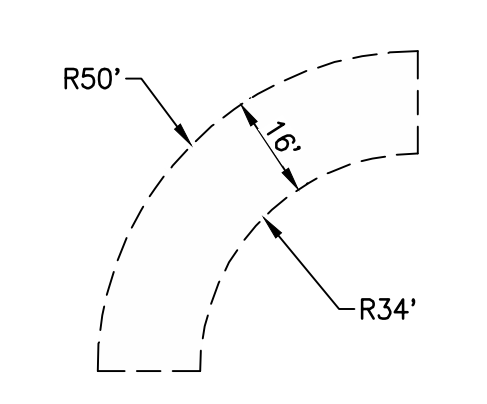

**EMERGENCY APPARATUS TURNING DETAIL**  
NTS


#### FIRE FLOW SUMMARY

- TYPE VB, GROUP U AREA: 3,824 SF
- TYPE VB, GROUP R2 AREA: 13,171 SF
- REQUIRED SPRINKLERED FIRE FLOW: 1,500 GPM
- REQUIRED NON-SPRINKLERED FIRE FLOW: 2,750 GPM
- MINIMUM 3 FIRE HYDRANTS @ 1,000 GPM EACH. AVERAGE SPACING 450 FEET. MAXIMUM DISTANCE FROM ANY POINT ON A STREET OR ROAD FRONTAGE TO HYDRANT IS 225 FEET.

#### FIRE ACCESS NOTE

EMERGENCY ACCESS SHALL BE PER THE CALIFORNIA STATE FIRE CODE APPENDIX D.

Michael LaBarbera Legacy Trust - Winery Land Development  
873 Blossom Hill Road San Jose, CA 95123  
408.947.1166

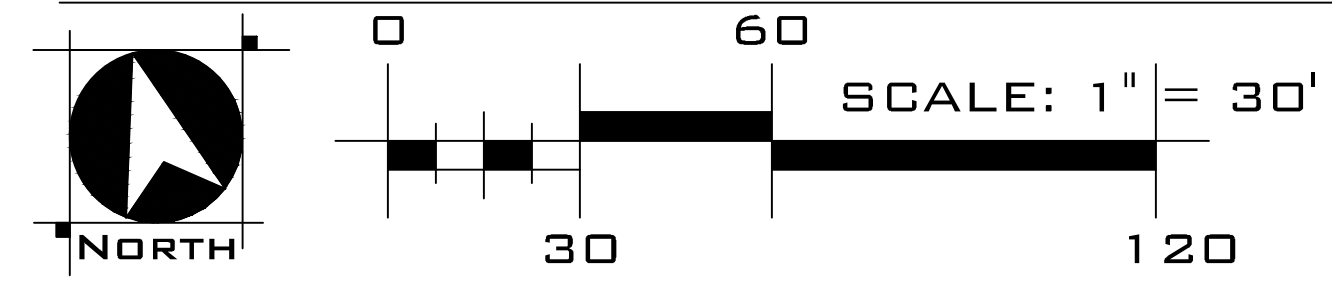

**Anderson Architects INC**

Kurt B. Anderson, ASA  
Principal  
120 W. Campbell Ave, Suite D  
Campbell, CA 95008  
Tel. 408.371.1269  
kanderson@andersoninc.com  
Cell 408.202.5462


**WOOD RODGERS**  
BUILDING RELATIONSHIPS ONE PROJECT AT A TIME  
3875 HOPYARD ROAD, SUITE 345 TEL 925.847.1558  
Pleasanton, CA. 94568 Fax 925.847.1557

PRELIMINARY FIRE ACCESS PLAN  
TM-08

**CIRCLE HILL ESTATES**  
Santa Clara County, CA  
April 5, 2024

J:\Jobs\4396\_Circle Hill Estates\Circle Hill Estates-04\Planning\Exhibits\Tentative Map - PD\TM-08 Fire Plan.dwg 4/4/2024 4:14 PM Dean Christiansen



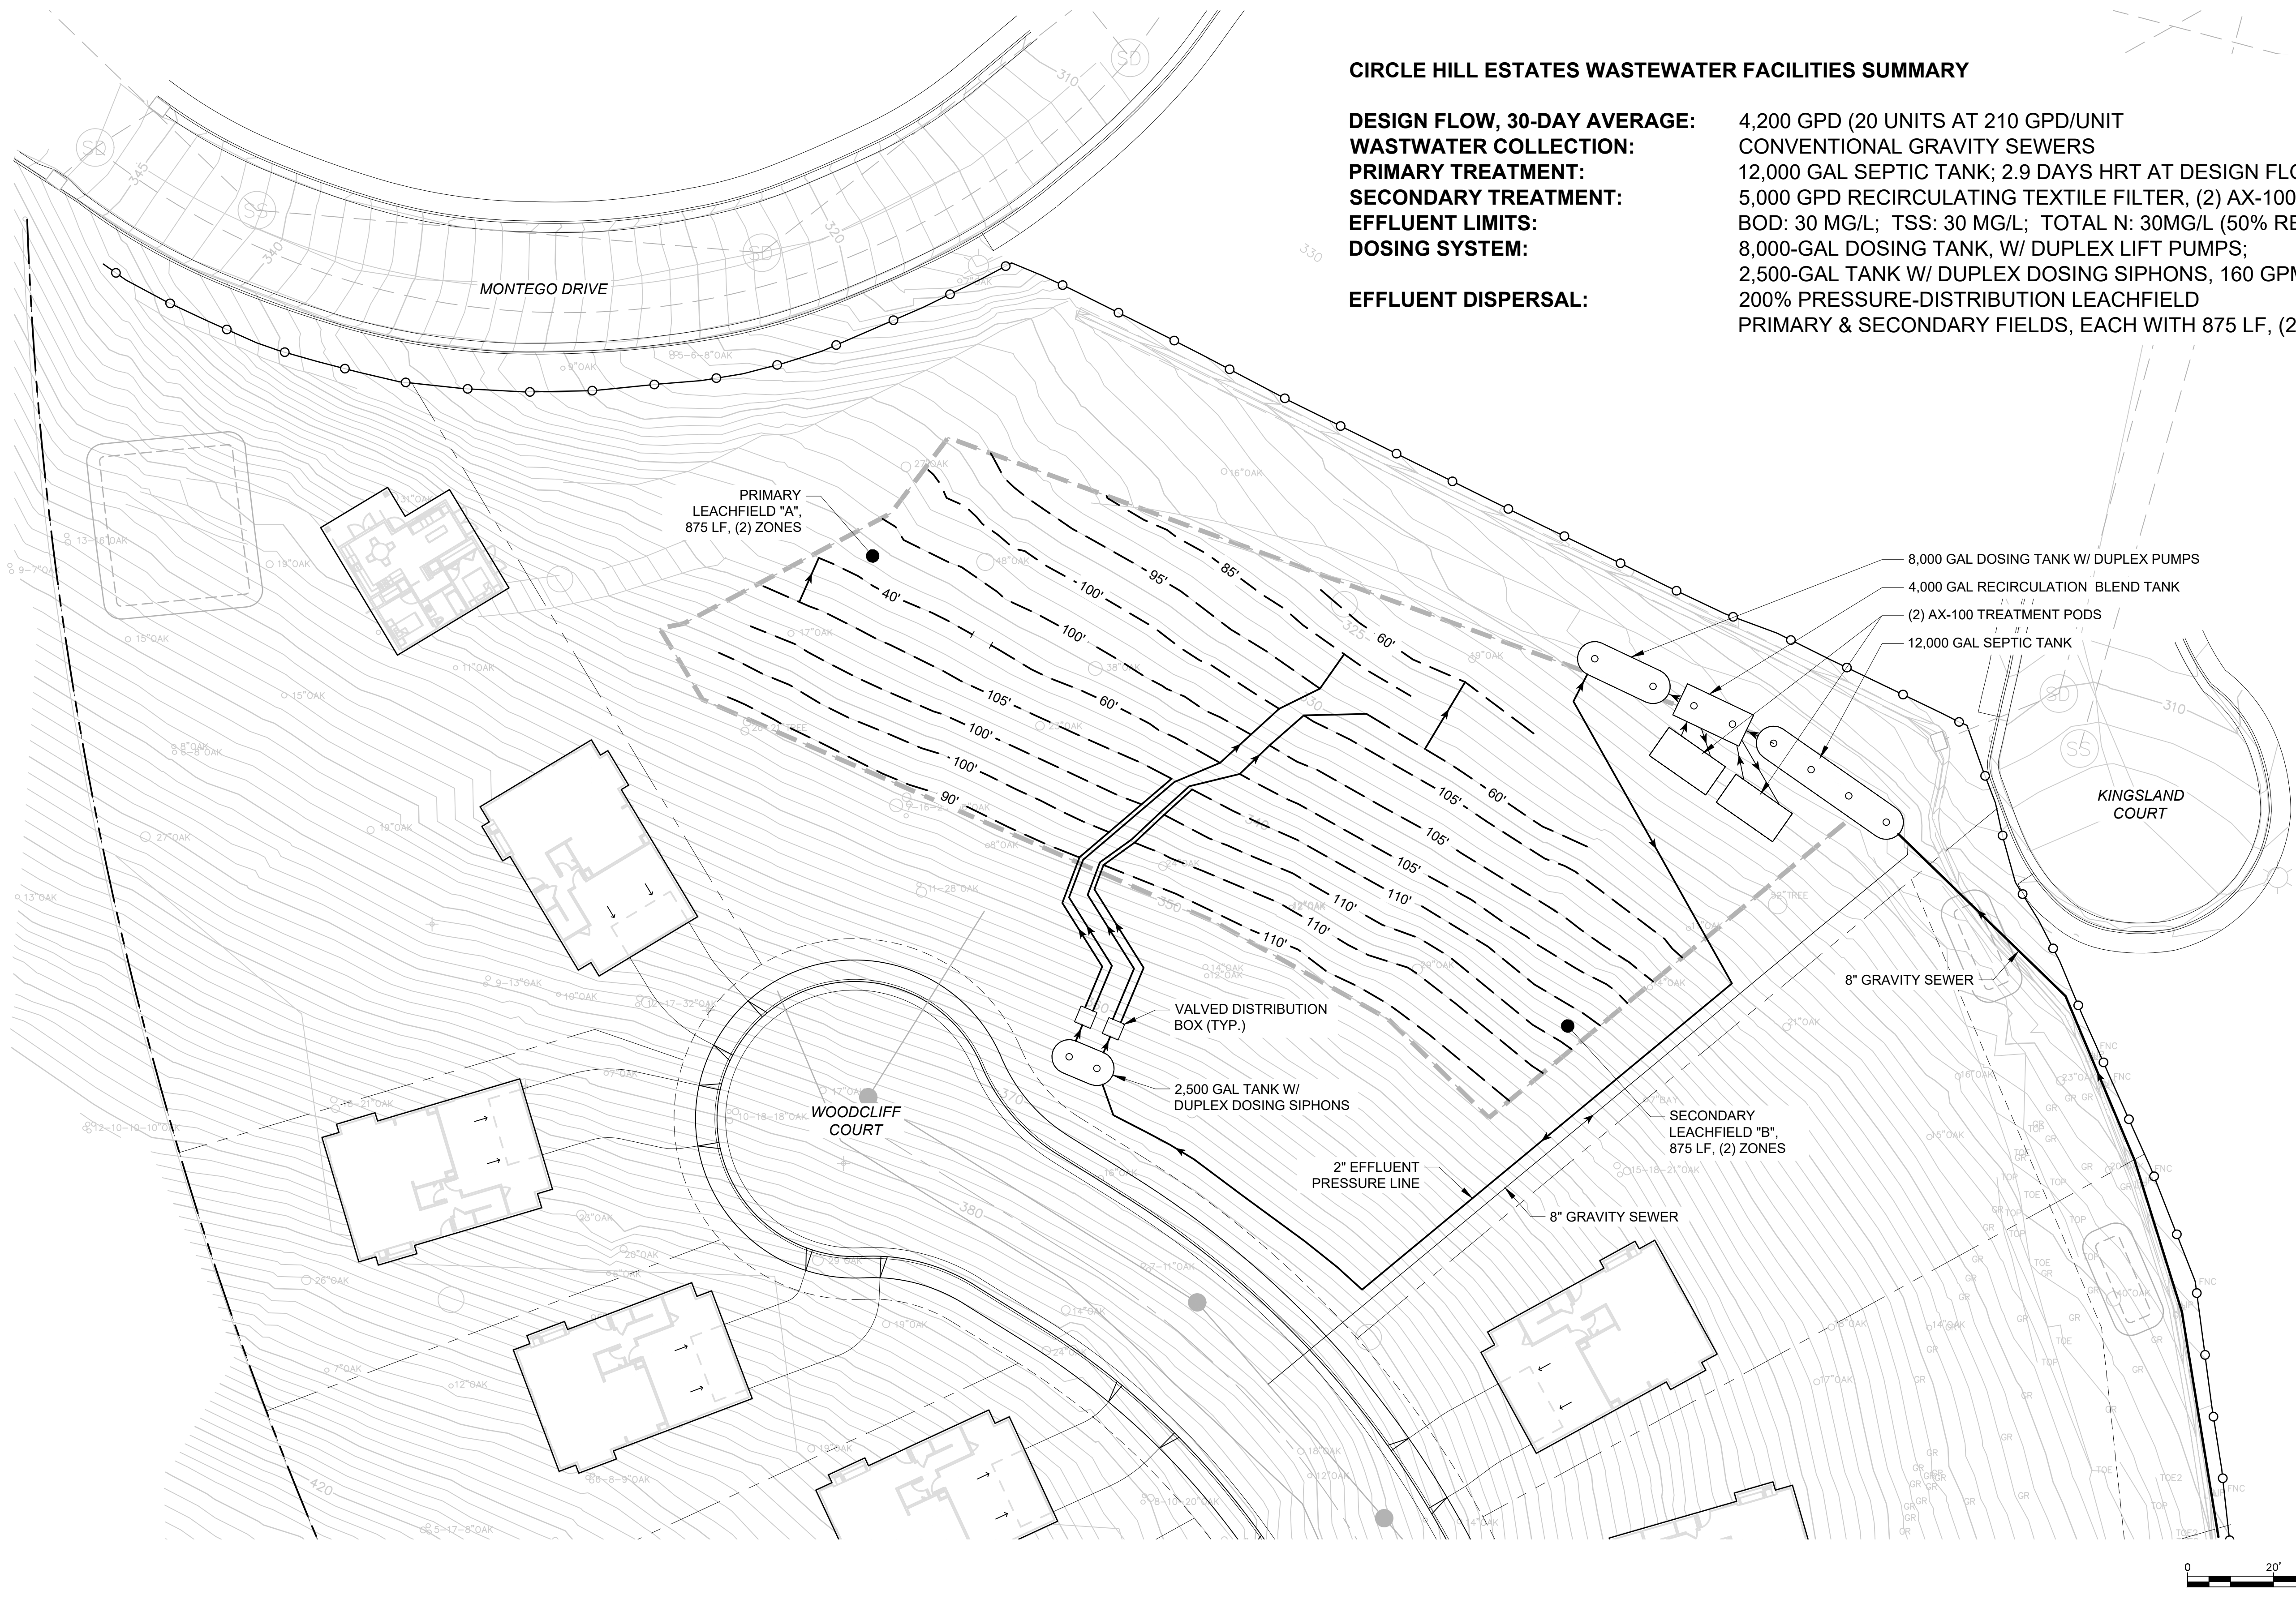

**CIRCLE HILL ESTATES WASTEWATER FACILITIES SUMMARY**

**DESIGN FLOW, 30-DAY AVERAGE:** 4,200 GPD (20 UNITS AT 210 GPD/UNIT)  
**WASTEWATER COLLECTION:** CONVENTIONAL GRAVITY SEWERS  
**PRIMARY TREATMENT:** 12,000 GAL SEPTIC TANK; 2.9 DAYS HRT AT DESIGN FLOW  
**SECONDARY TREATMENT:** 5,000 GPD RECIRCULATING TEXTILE FILTER, (2) AX-100 (OSI)  
**EFFLUENT LIMITS:** BOD: 30 MG/L; TSS: 30 MG/L; TOTAL N: 30MG/L (50% REMOVAL)  
**DOSING SYSTEM:** 8,000-GAL DOSING TANK, W/ DUPLEX LIFT PUMPS;  
 2,500-GAL TANK W/ DUPLEX DOSING SIPHONS, 160 GPM FLOW RATE  
**EFFLUENT DISPERSAL:** 200% PRESSURE-DISTRIBUTION LEACHFIELD  
 PRIMARY & SECONDARY FIELDS, EACH WITH 875 LF, (2) ZONES

PRIMARY LEACHFIELD "A", 875 LF, (2) ZONES

8,000 GAL DOSING TANK W/ DUPLEX PUMPS  
 4,000 GAL RECIRCULATION BLEND TANK  
 (2) AX-100 TREATMENT PODS  
 12,000 GAL SEPTIC TANK


VALVED DISTRIBUTION BOX (TYP.)  
 2,500 GAL TANK W/ DUPLEX DOSING SIPHONS

SECONDARY LEACHFIELD "B", 875 LF, (2) ZONES

KINGSLAND COURT

WOODCLIFF COURT

MONTEGO DRIVE

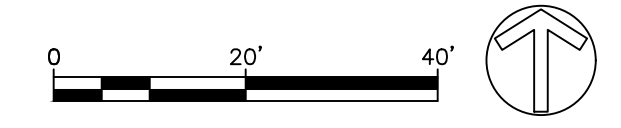

**CIRCLE HILL ESTATES  
 WASTEWATER TREATMENT SYSTEM**  
 SAN JOSE, CALIFORNIA

**QUESTA**  
 ENGINEERING CORP.  
 Civil Environmental & Water Resources  
 (510) 236-6114  
 P.O. Box 70356 1220 Brickyard Cove Road Point Richmond, CA 94807




Sht	Rev	Date	By	Description	App'd

Design: NH  
 Drawn: MN  
 Checked: NH  
 App'd: NH


**WASTEWATER FACILITIES LAYOUT**

Size D  
 Project 2300152  
 Scale: 1"=20'-0"  
 Date: 3/29/2024  
 Sheet: WW-1


P:\2023\2300152 WOODCLIFF CT-LABARRERA\CAD\SHEETS\WASTEWATER TREATMENT SET\2300152\_WOODCLIFF CT\_LW-1.LWG  
 LAST SAVED: 4/2/2024 11:04:00 AM  
 PLOT DATE: 4/2/2024  
 PLOT STYLE:

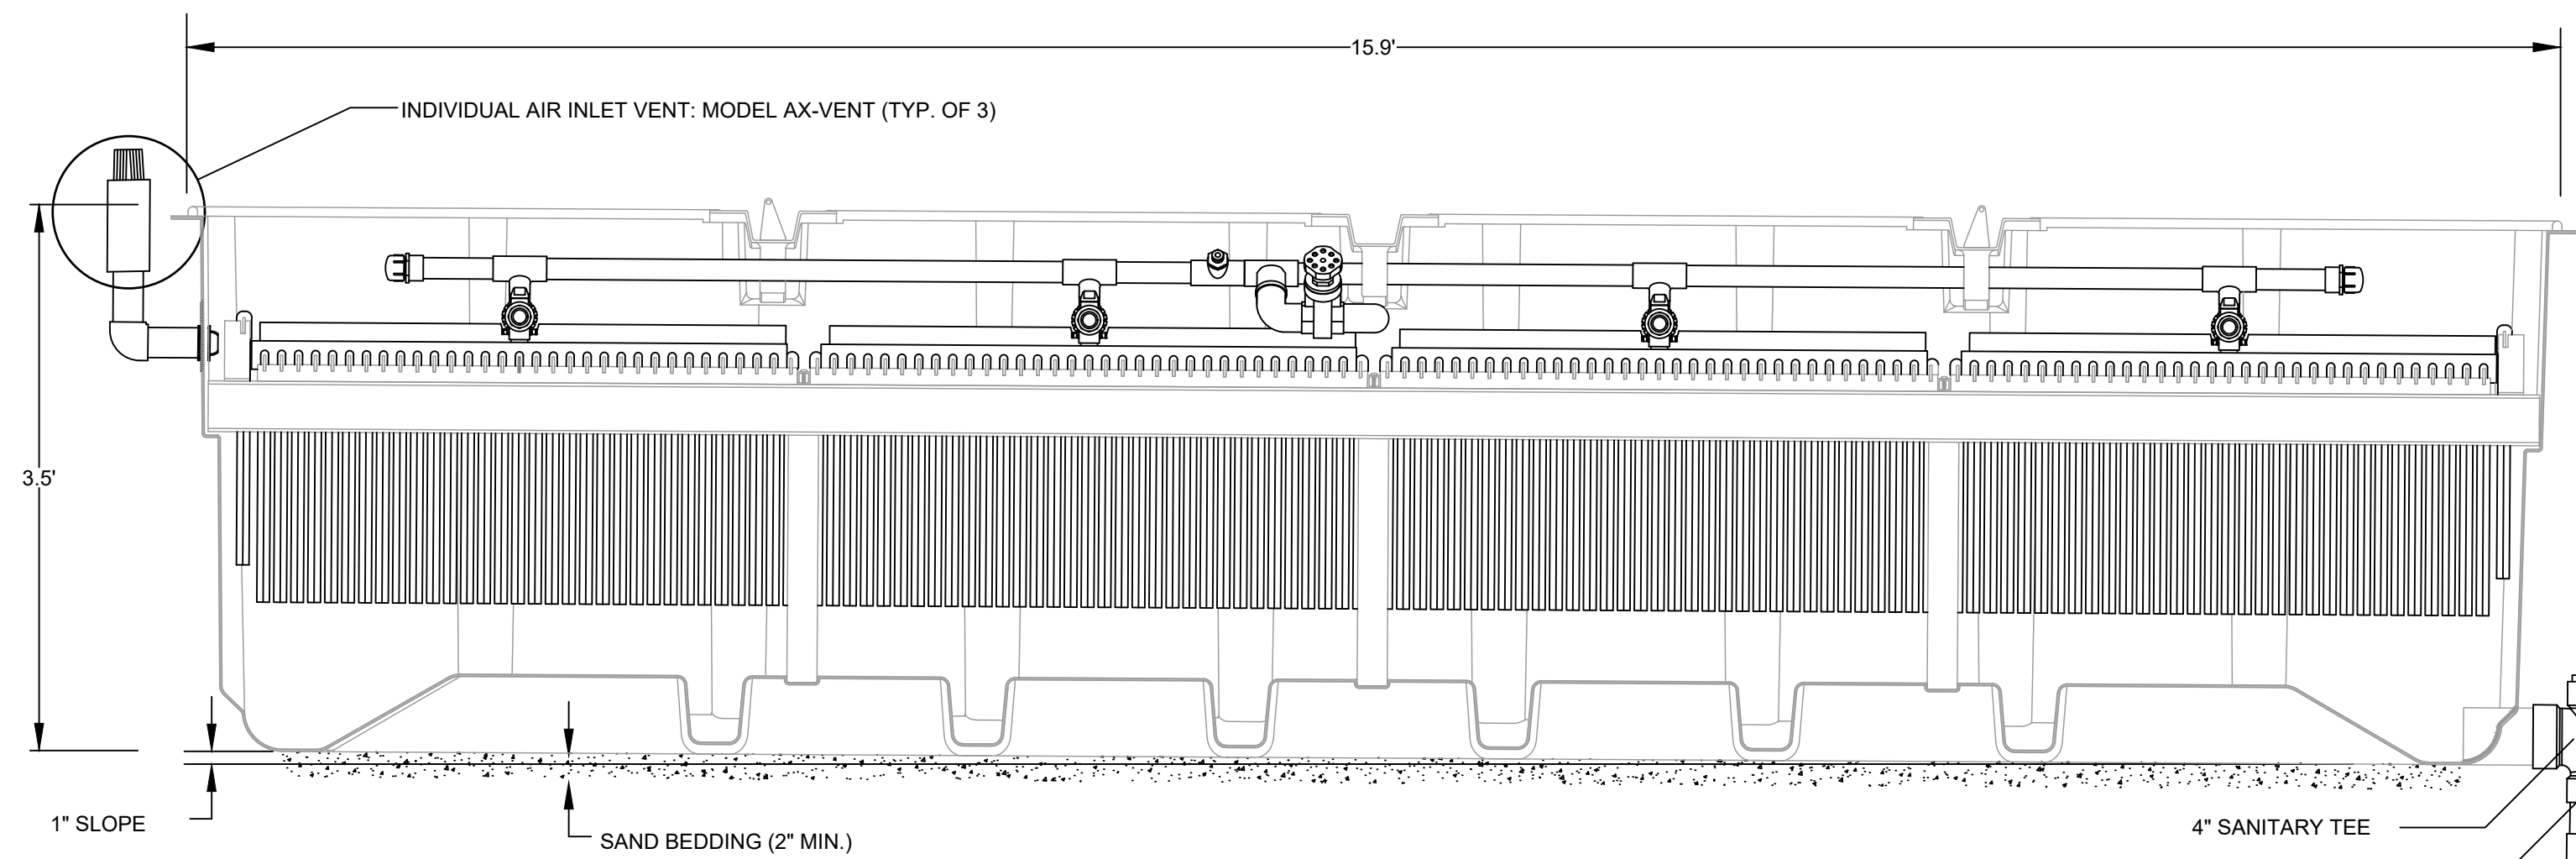


**Pod Detail**  
Scale: 1" = 2'-0"  
DIMENSIONS OF AX-100 POD: 3.5'D X 15.9'L X 7.9"W

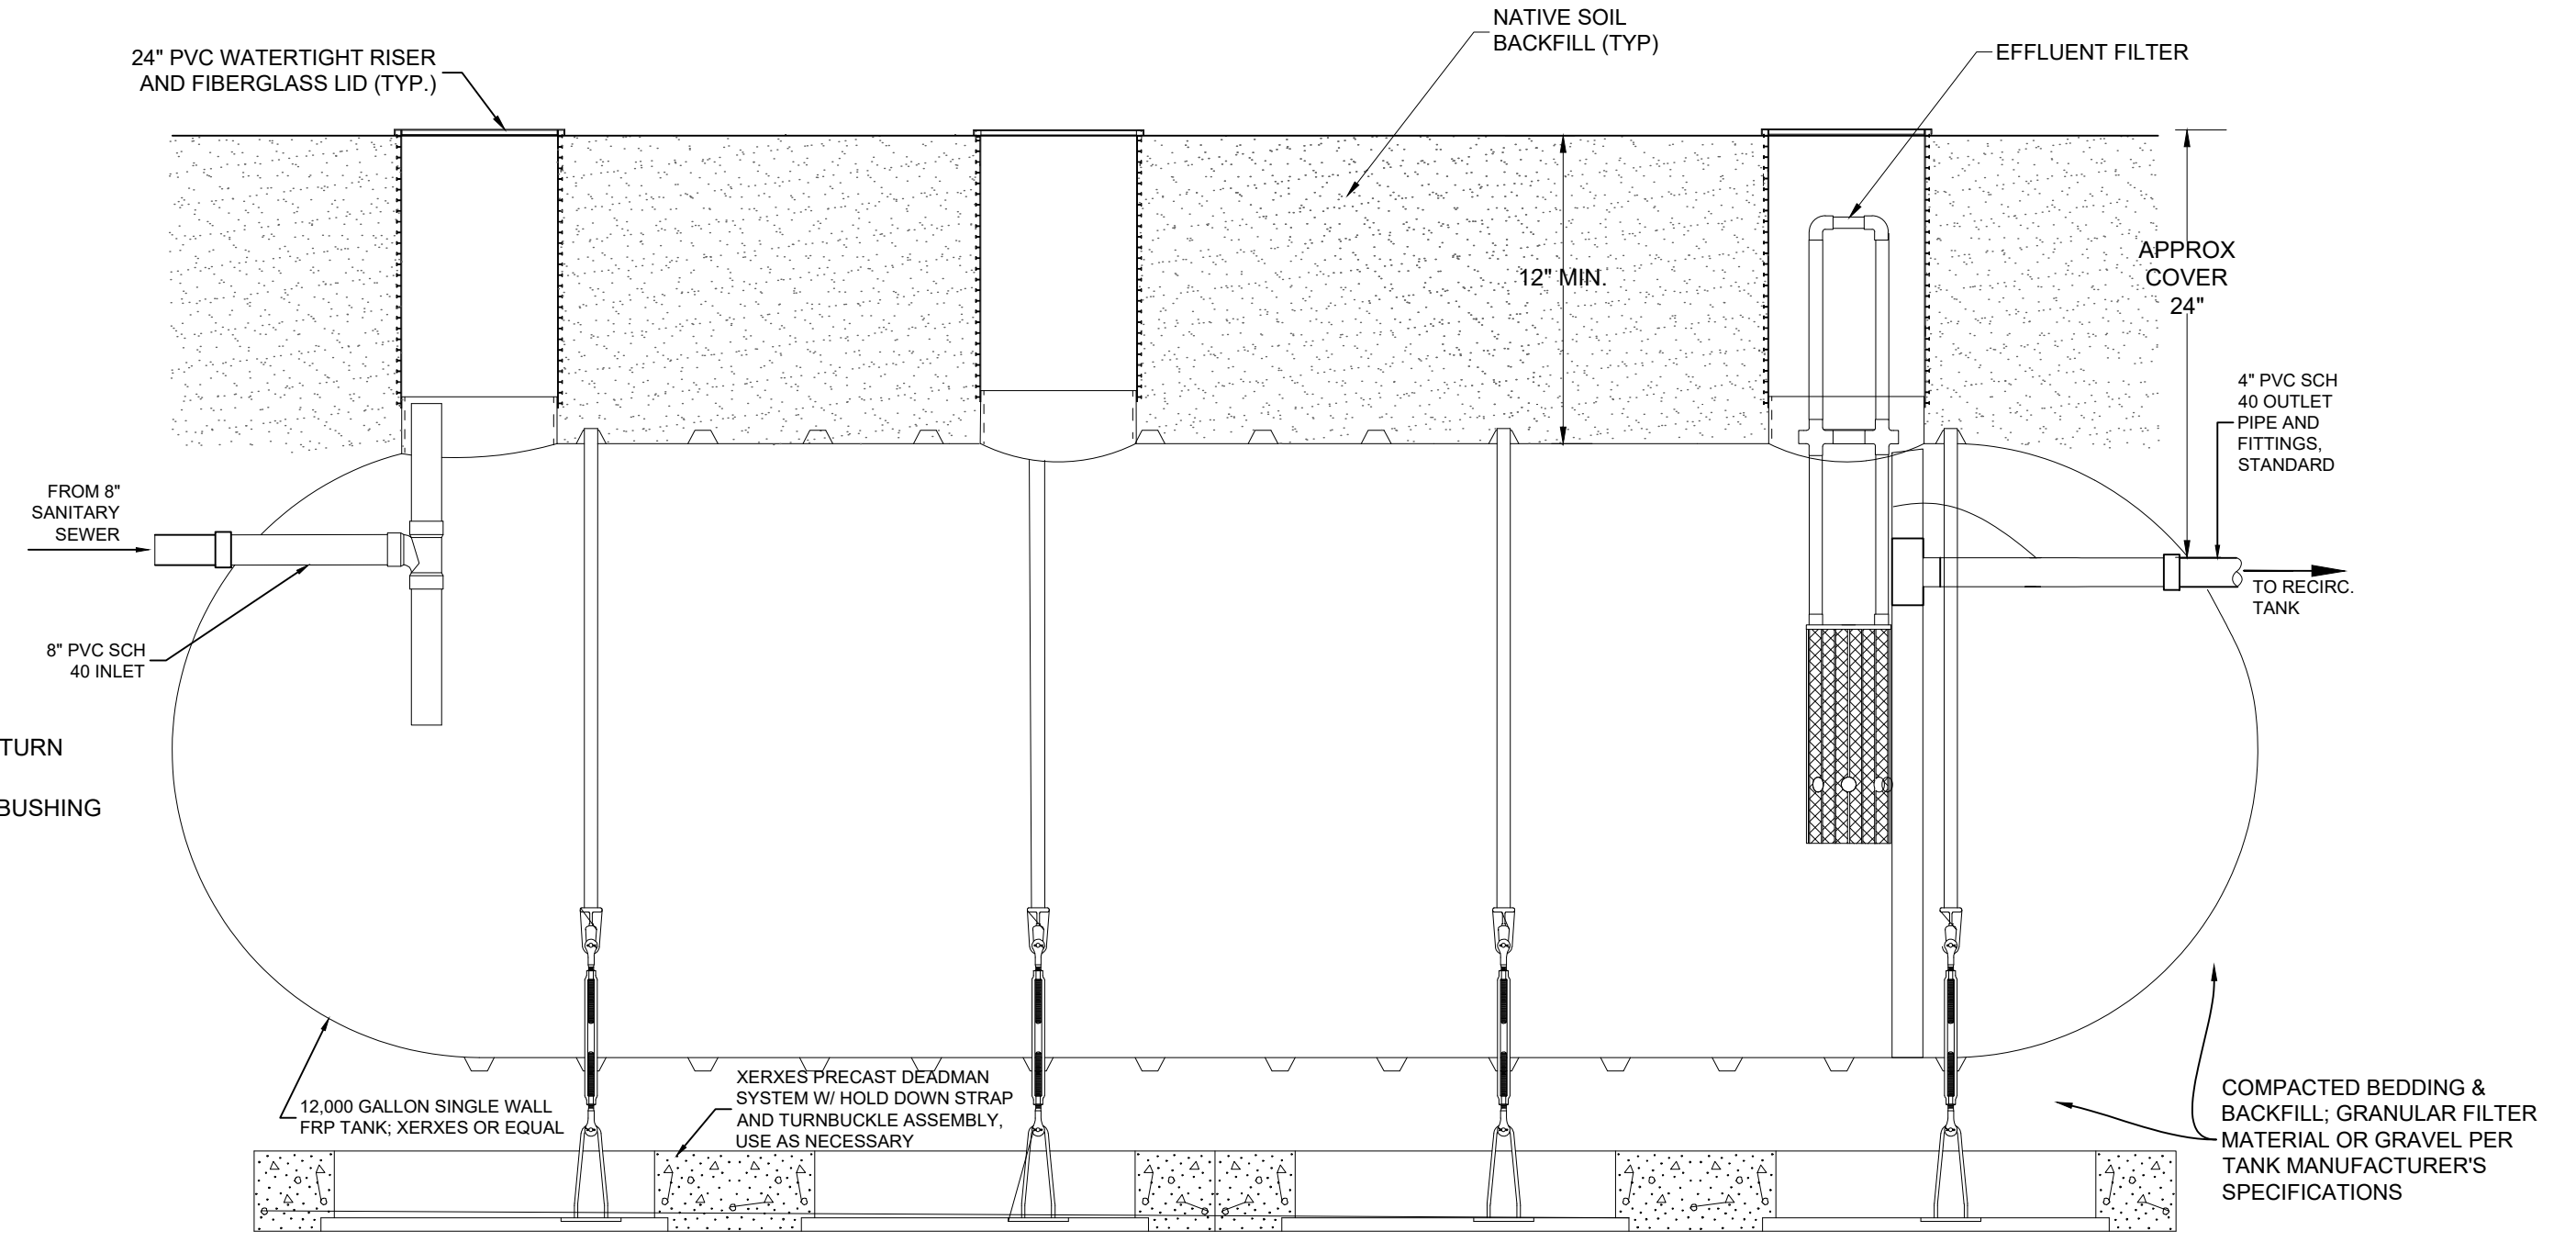


**2 12,000 GALLON SEPTIC TANK**  
NOT TO SCALE. 4 ACCESS RISERS AND BAFFLE (NOT SHOWN)

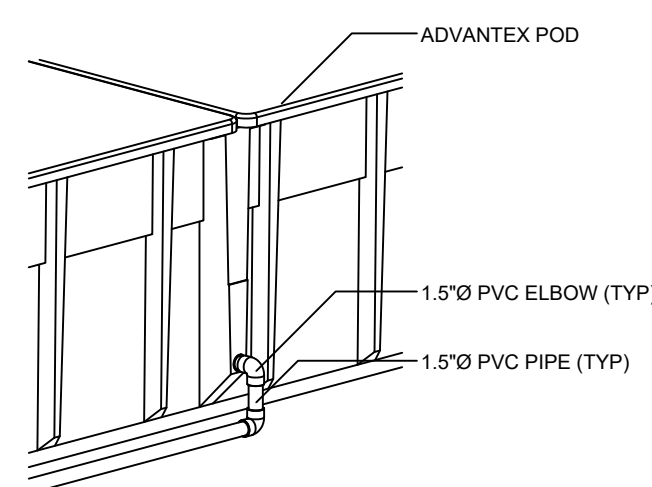


**TYPICAL POD INLET CONNECTION**  
NTS

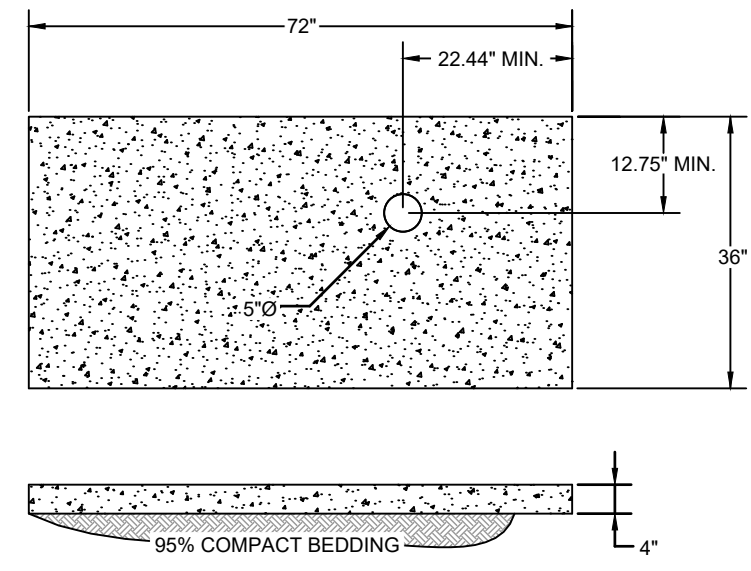

**FAN ASSEMBLY PAD DETAIL**

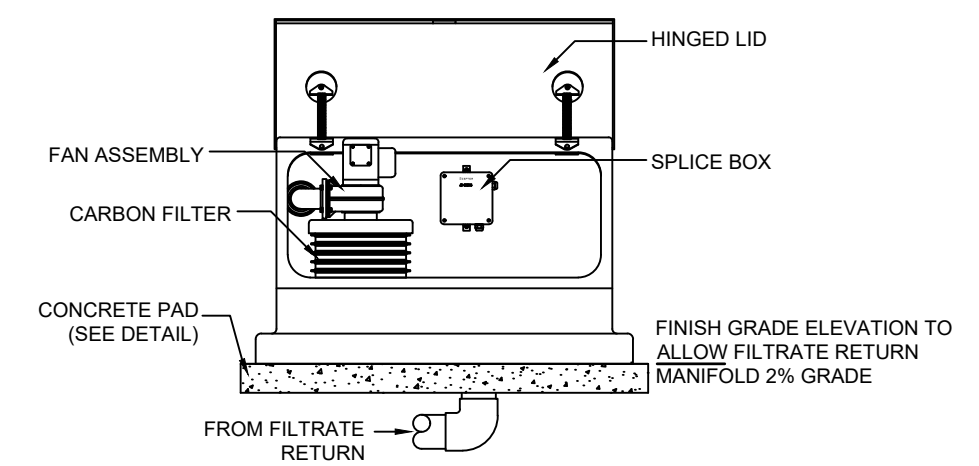


**ABOVE GROUND FAN ASSEMBLY, MODEL AX-VENT**

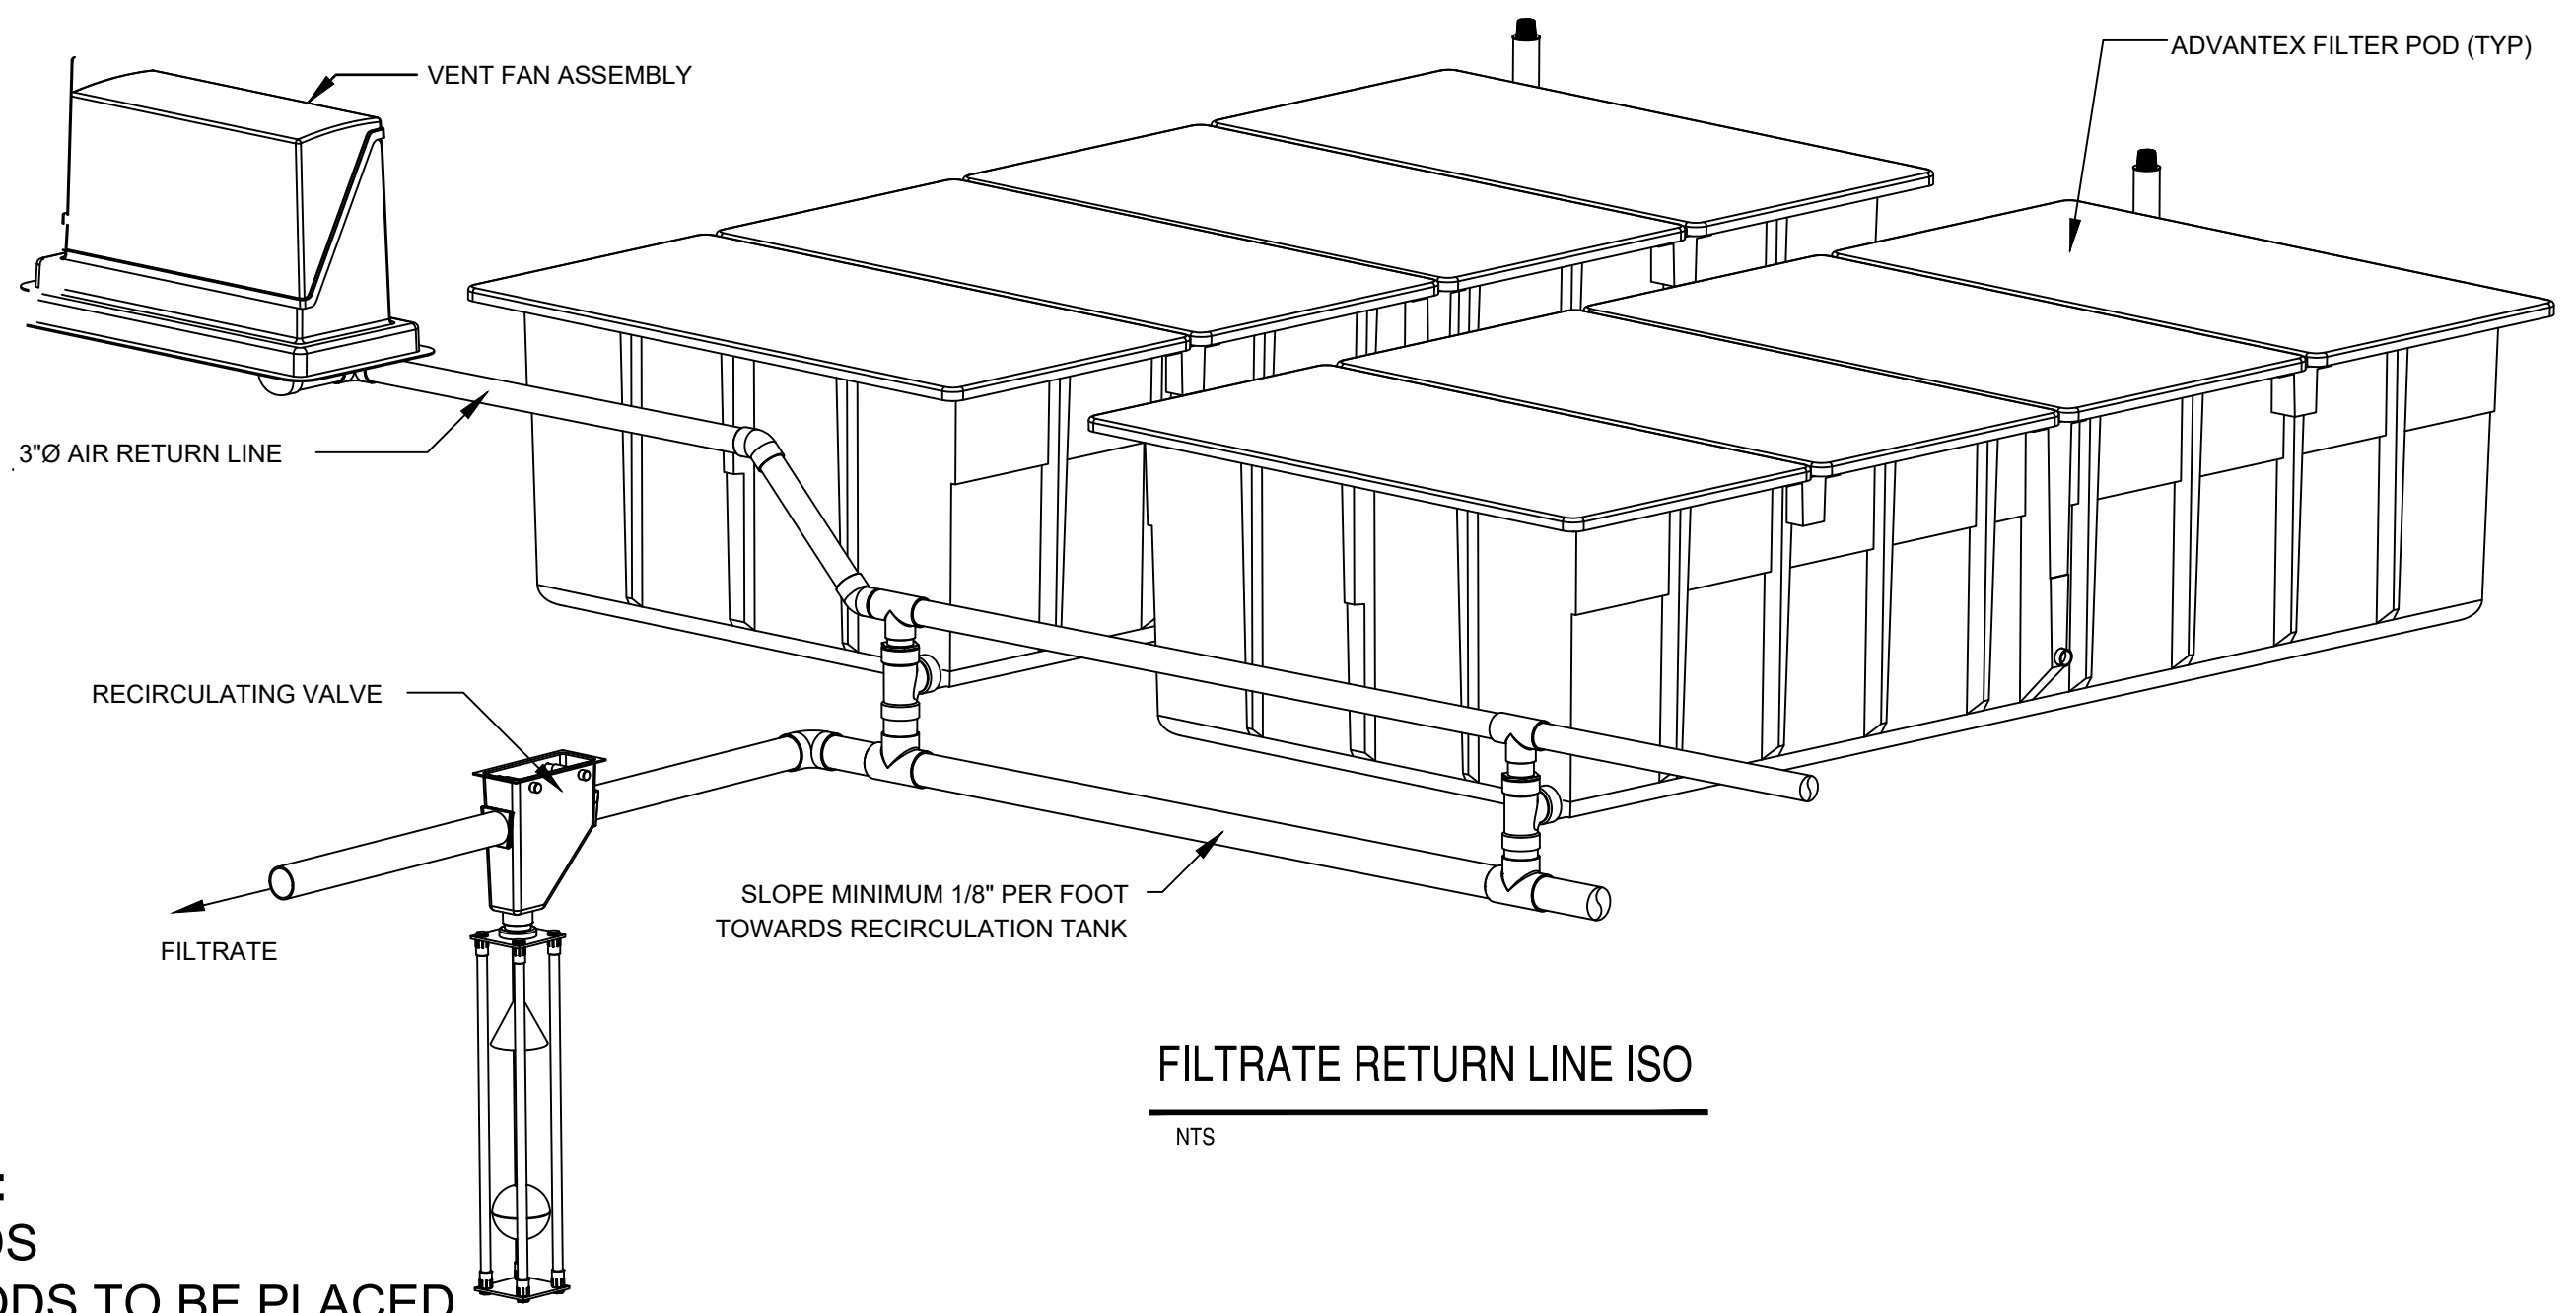

**FILTRATE RETURN LINE ISO**  
NTS

**NOTE:**  
2 PODS  
AX PODS TO BE PLACED  
ON EXCAVATED PAD,  
PARTIALLY BURIED.

**1 ADVANTEK AX-100 TEXTILE FILTER**  
NOT TO SCALE

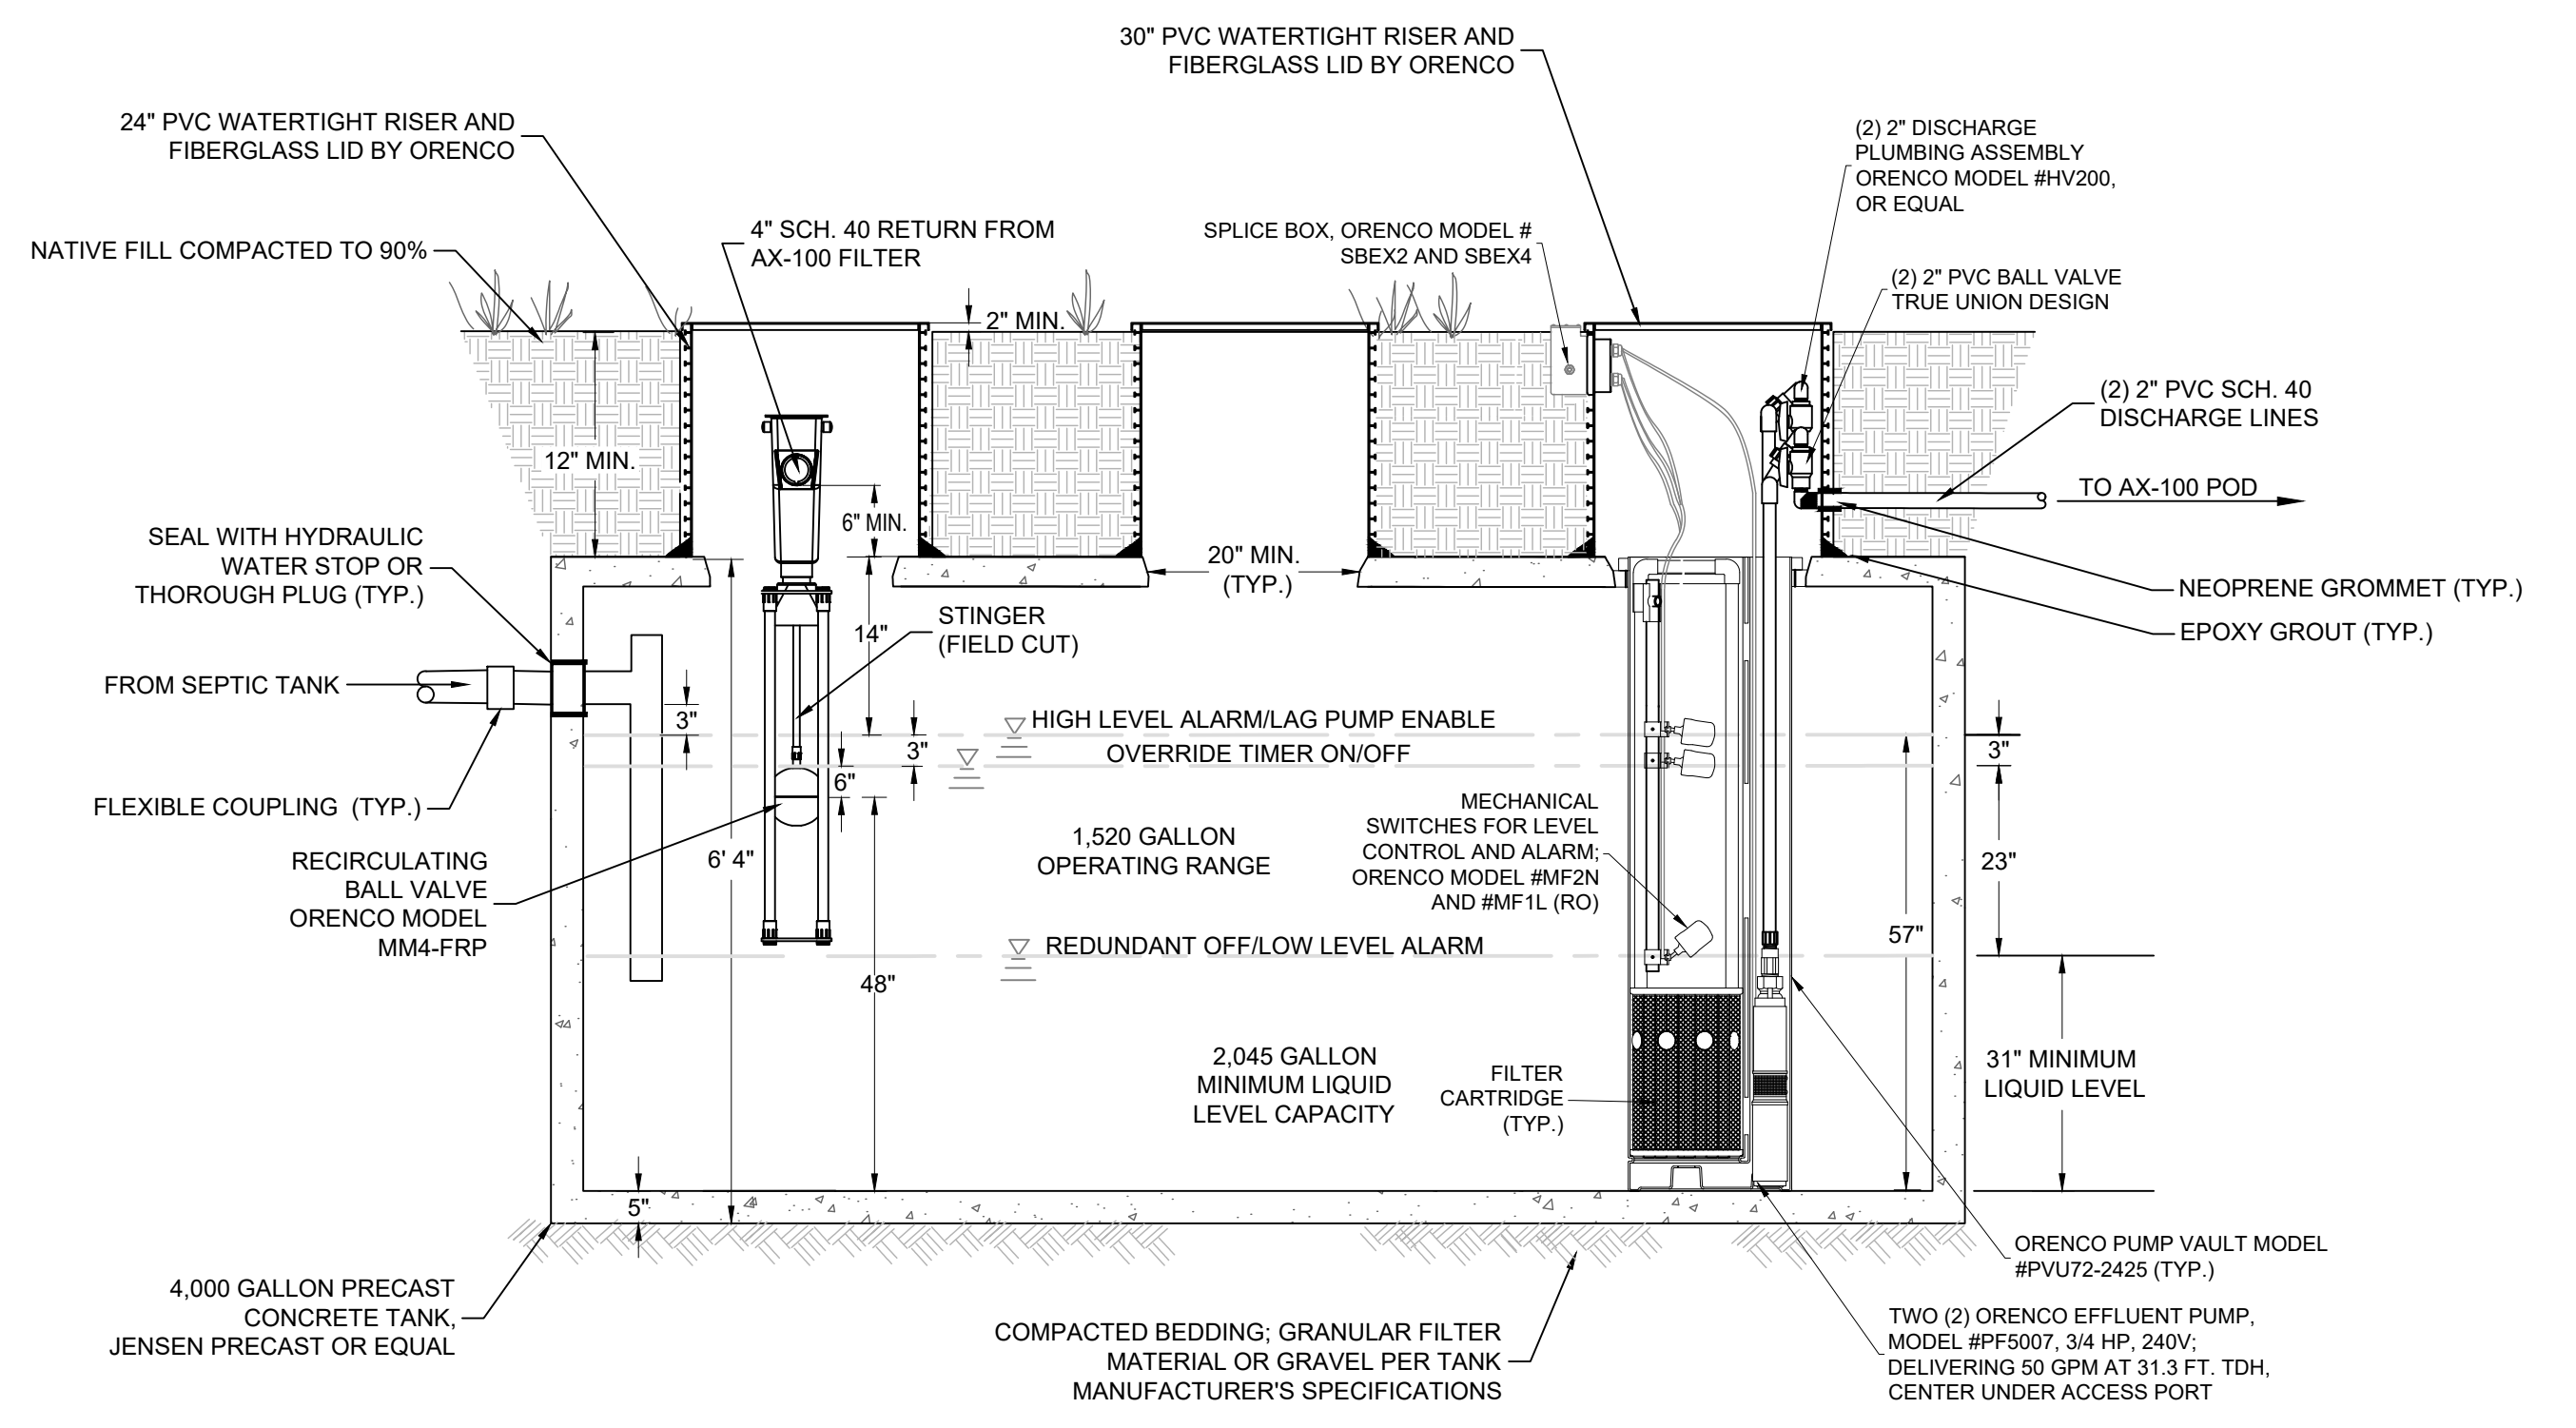

**3 4,000 GALLON RECIRCULATION TANK**  
SIDE VIEW, NTS. PUMPS TO AX-100 TEXTILE FILTERS (RECIRC)

**CIRCLE HILL ESTATES**  
WASTEWATER TREATMENT SYSTEM  
SAN JOSE, CALIFORNIA

**QUESTA**  
ENGINEERING CORP.  
Civil Environmental & Water Resources  
(510) 236-6114  
FAX (510) 236-2423  
questa@questaac.com  
P.O. Box 70356 1220 Brickyard Cove Road Point Richmond, CA 94807




Sht	Rev	Date	By	Description	App'd

Design: NH  
Drawn: MN  
Checked: NH  
App'd: NH

**WASTEWATER TREATMENT DETAILS**

Size D Project 2300152  
Scale: NOT TO SCALE  
Date: 3/29/2024  
Sheet: WW-2

PA\2023\2300152 WOODCLIFF CT-LABARRERA\CAD\SHEETS\WASTEWATER TREATMENT SET\2300152\_WOODCLIFF CT\_LW-2.DWG LAST SAVED: 4/2/2024 PLOT DATE: 4/2/2024 PLOT STYLE: ---

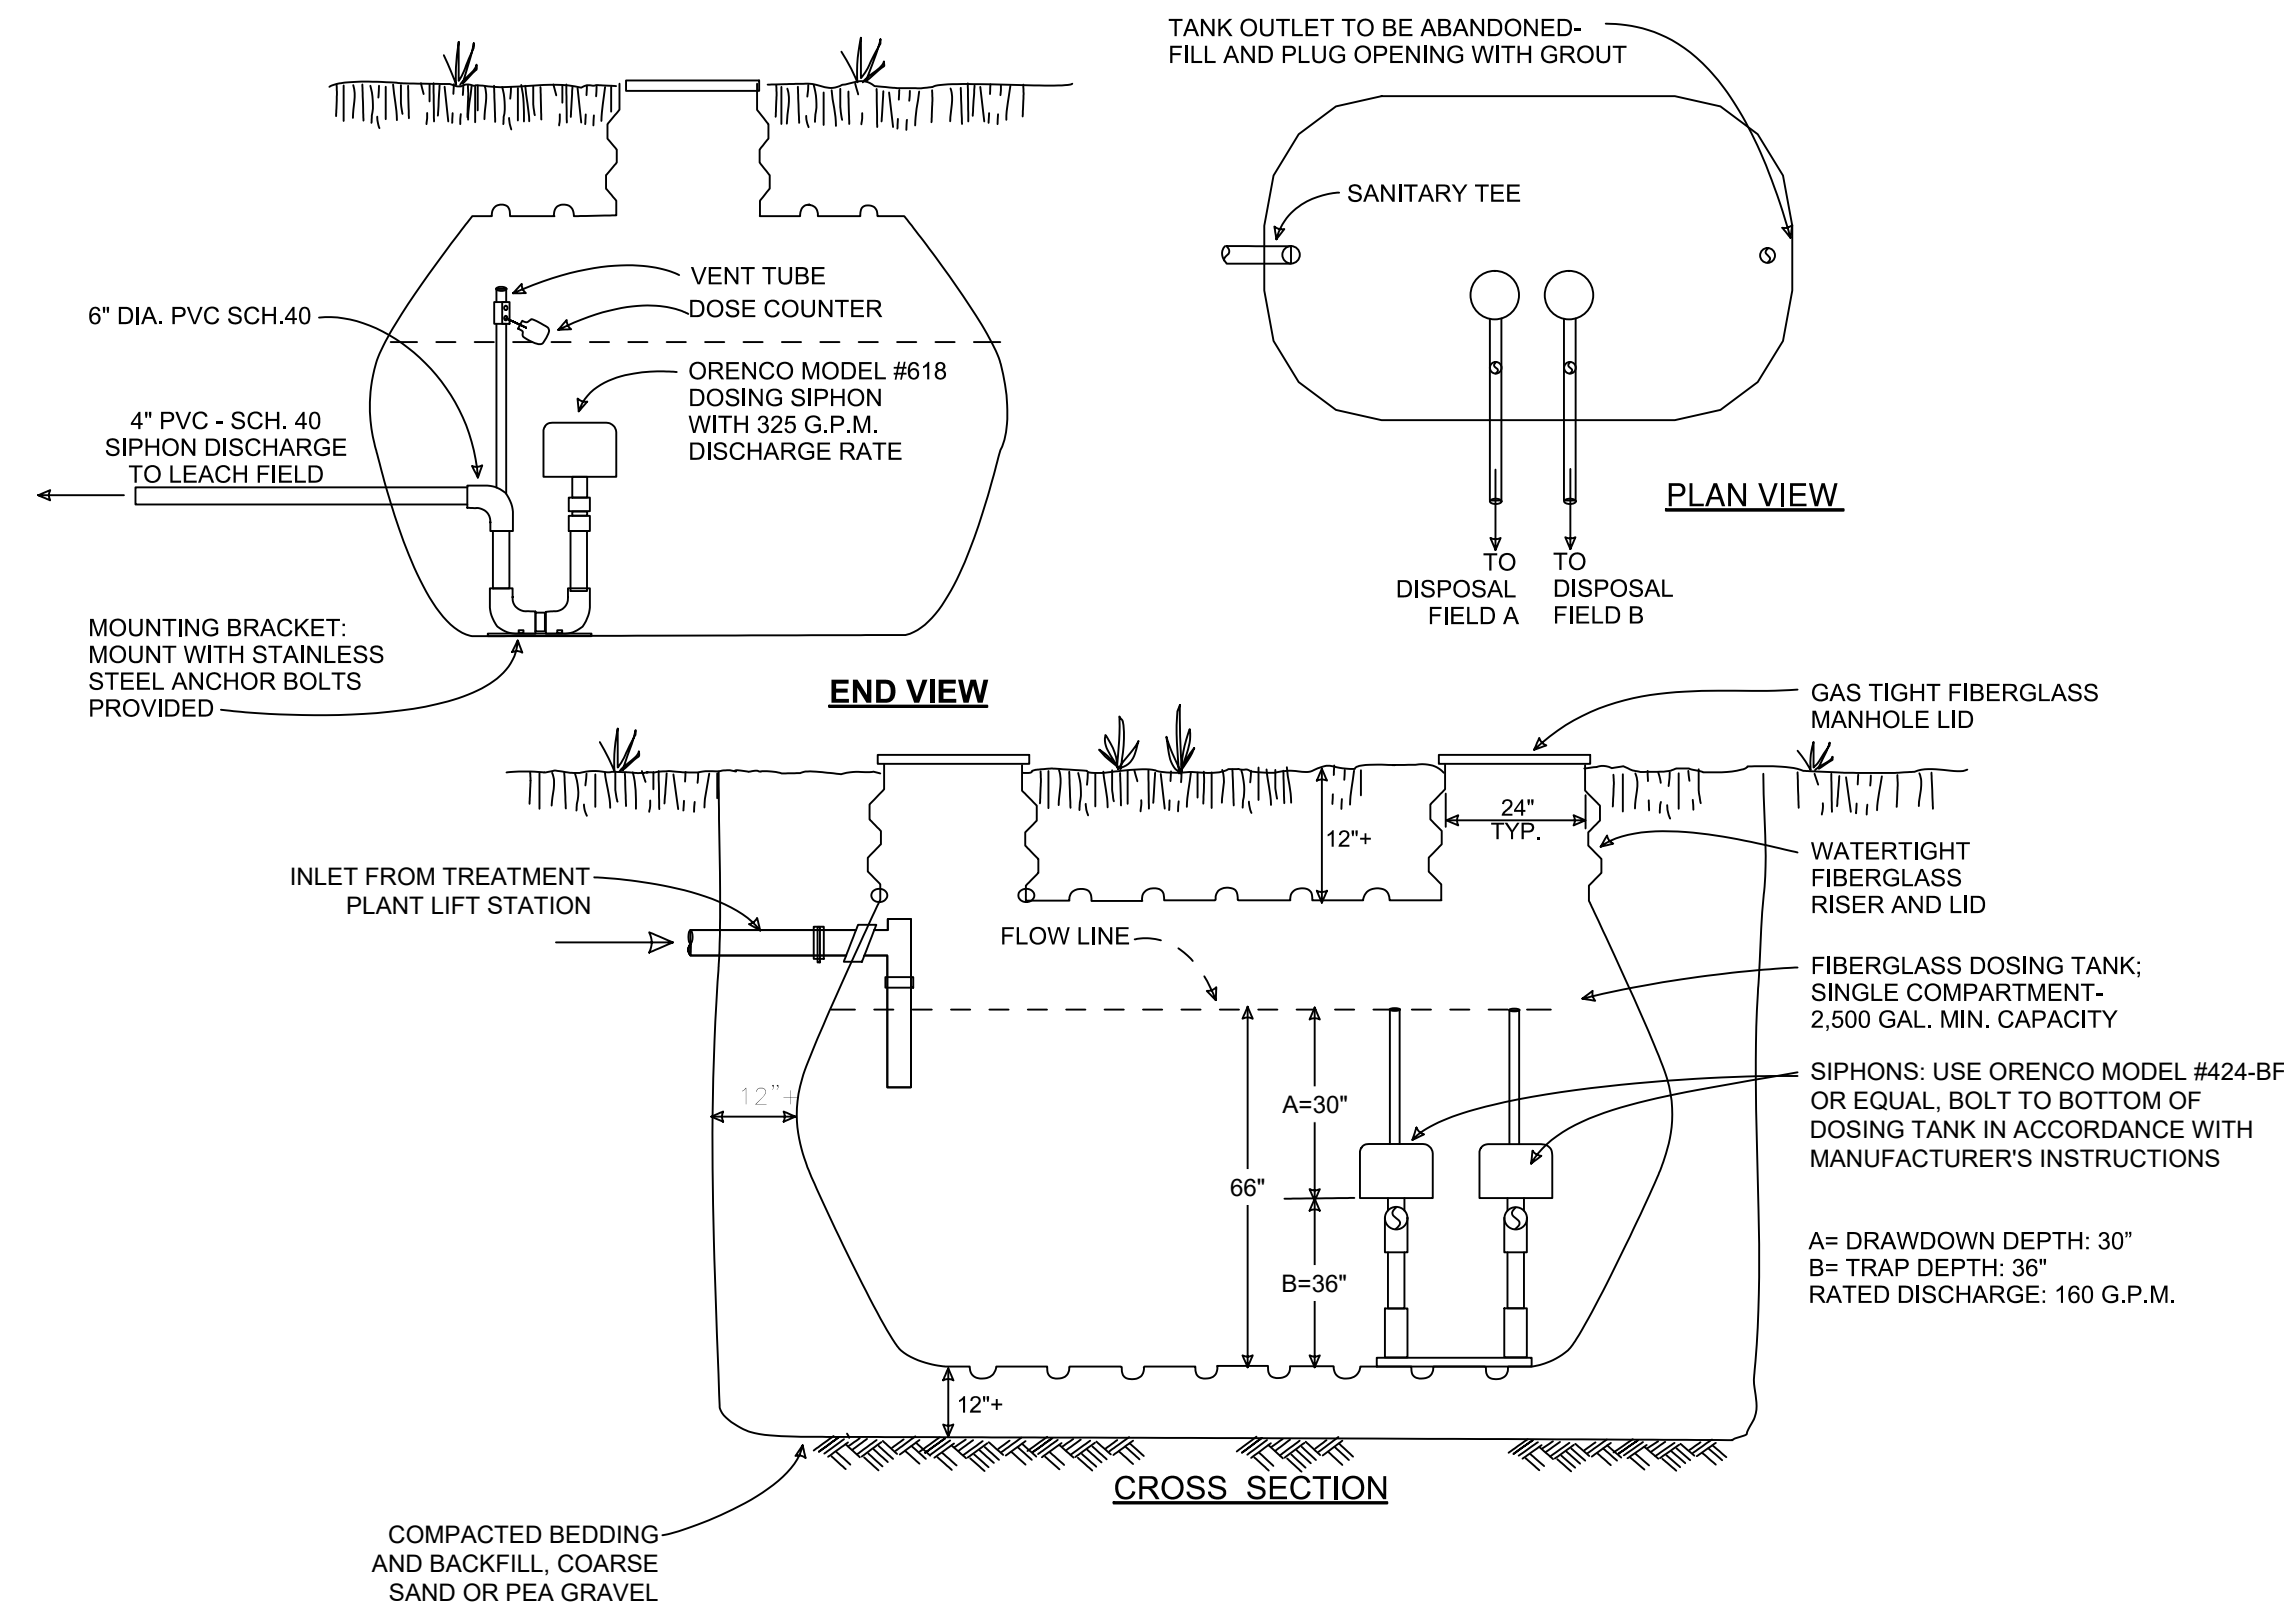


4 2,500 GALLON DOSING TANK  
NOT TO SCALE


**DISPOSAL SYSTEM DESIGN**

**PRESSURE-DISTRIBUTION LEACHING TRENCHES**

- DESIGN FLOW: 4,200 GPD
- TRENCH DIMENSIONS: 2-FT' WIDE X 2.5-FT DEEP
- EFFECTIVE INFILTRATIVE AREA: 4 SQ FT PER LF
- AVERAGE PERCOLATION RATE: 18 MPI
- APPLICATION RATE: 1.2 GPD PER SQ FT (SECONDARY TREATED WASTEWATER)
- TRENCH LOADING RATE:  $(4) \times (1.2) = 4.8$  GPD PER LF
- TOTAL REQUIRED TRENCH LENGTH:  $4,200 \text{ GPD} / 4.8 \text{ GPD/LF} = 875$  LF PER FIELD
- PROPOSED TRENCH LENGTHS:
  - PRIMARY FIELD A: 875 LF W/(2) ZONES
  - SECONDARY FIELD B: 875 LF W/(2) ZONES
- PRESSURE-DISTRIBUTION CALCULATIONS PER ZONE;
  - MAX ZONE LENGTH: 440 LF
  - 1/4 INCH DISCHARGE HOLES AT 4' O.C.
  - 440 LF/4-FT SPACING = 110 HOLES PER ZONE
  - MIN DISCHARGE RATE: 1/4" HOLE AT 2 FT HEAD = 1.04 GPM/HOLE
  - TOTAL DISCHARGE PER ZONE =  $110 \times 1.04 = 114$  GPM
  - PROPOSED DOSING SIPHON DISCHARGE: 160 GPM, OK

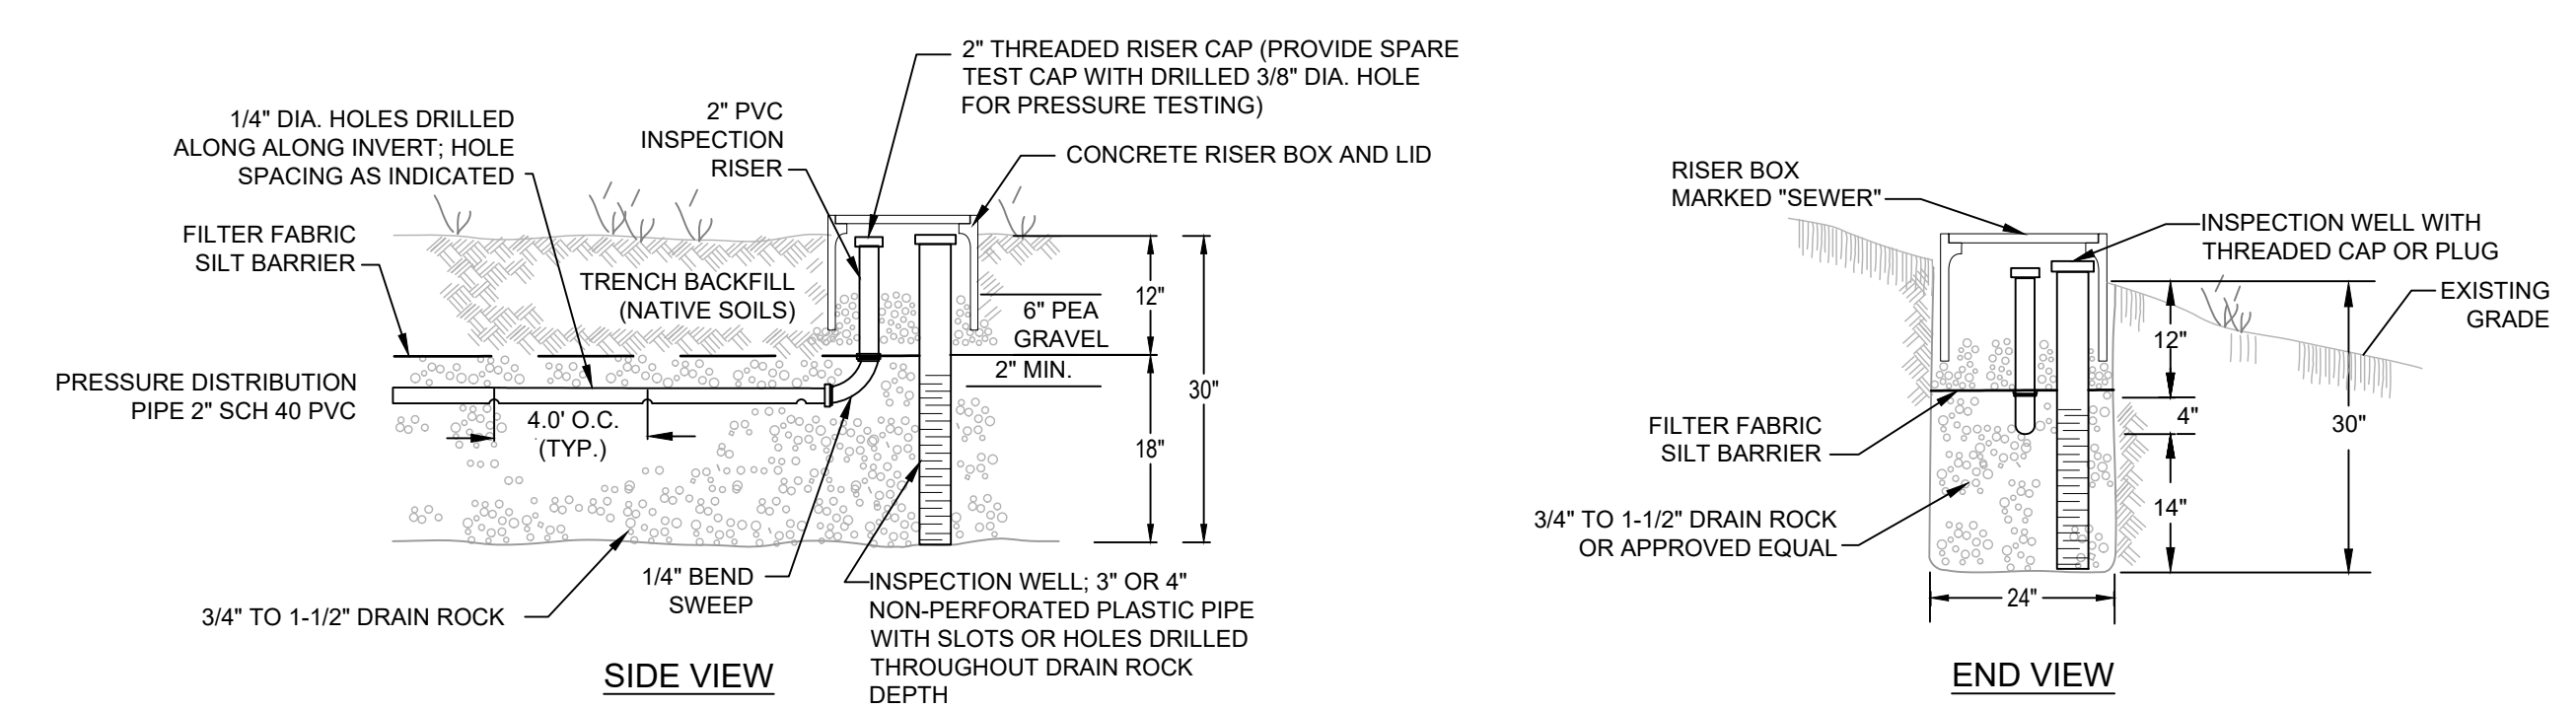

5 PRESSURE DISTRIBUTION LEACHING TRENCH  
NOT TO SCALE

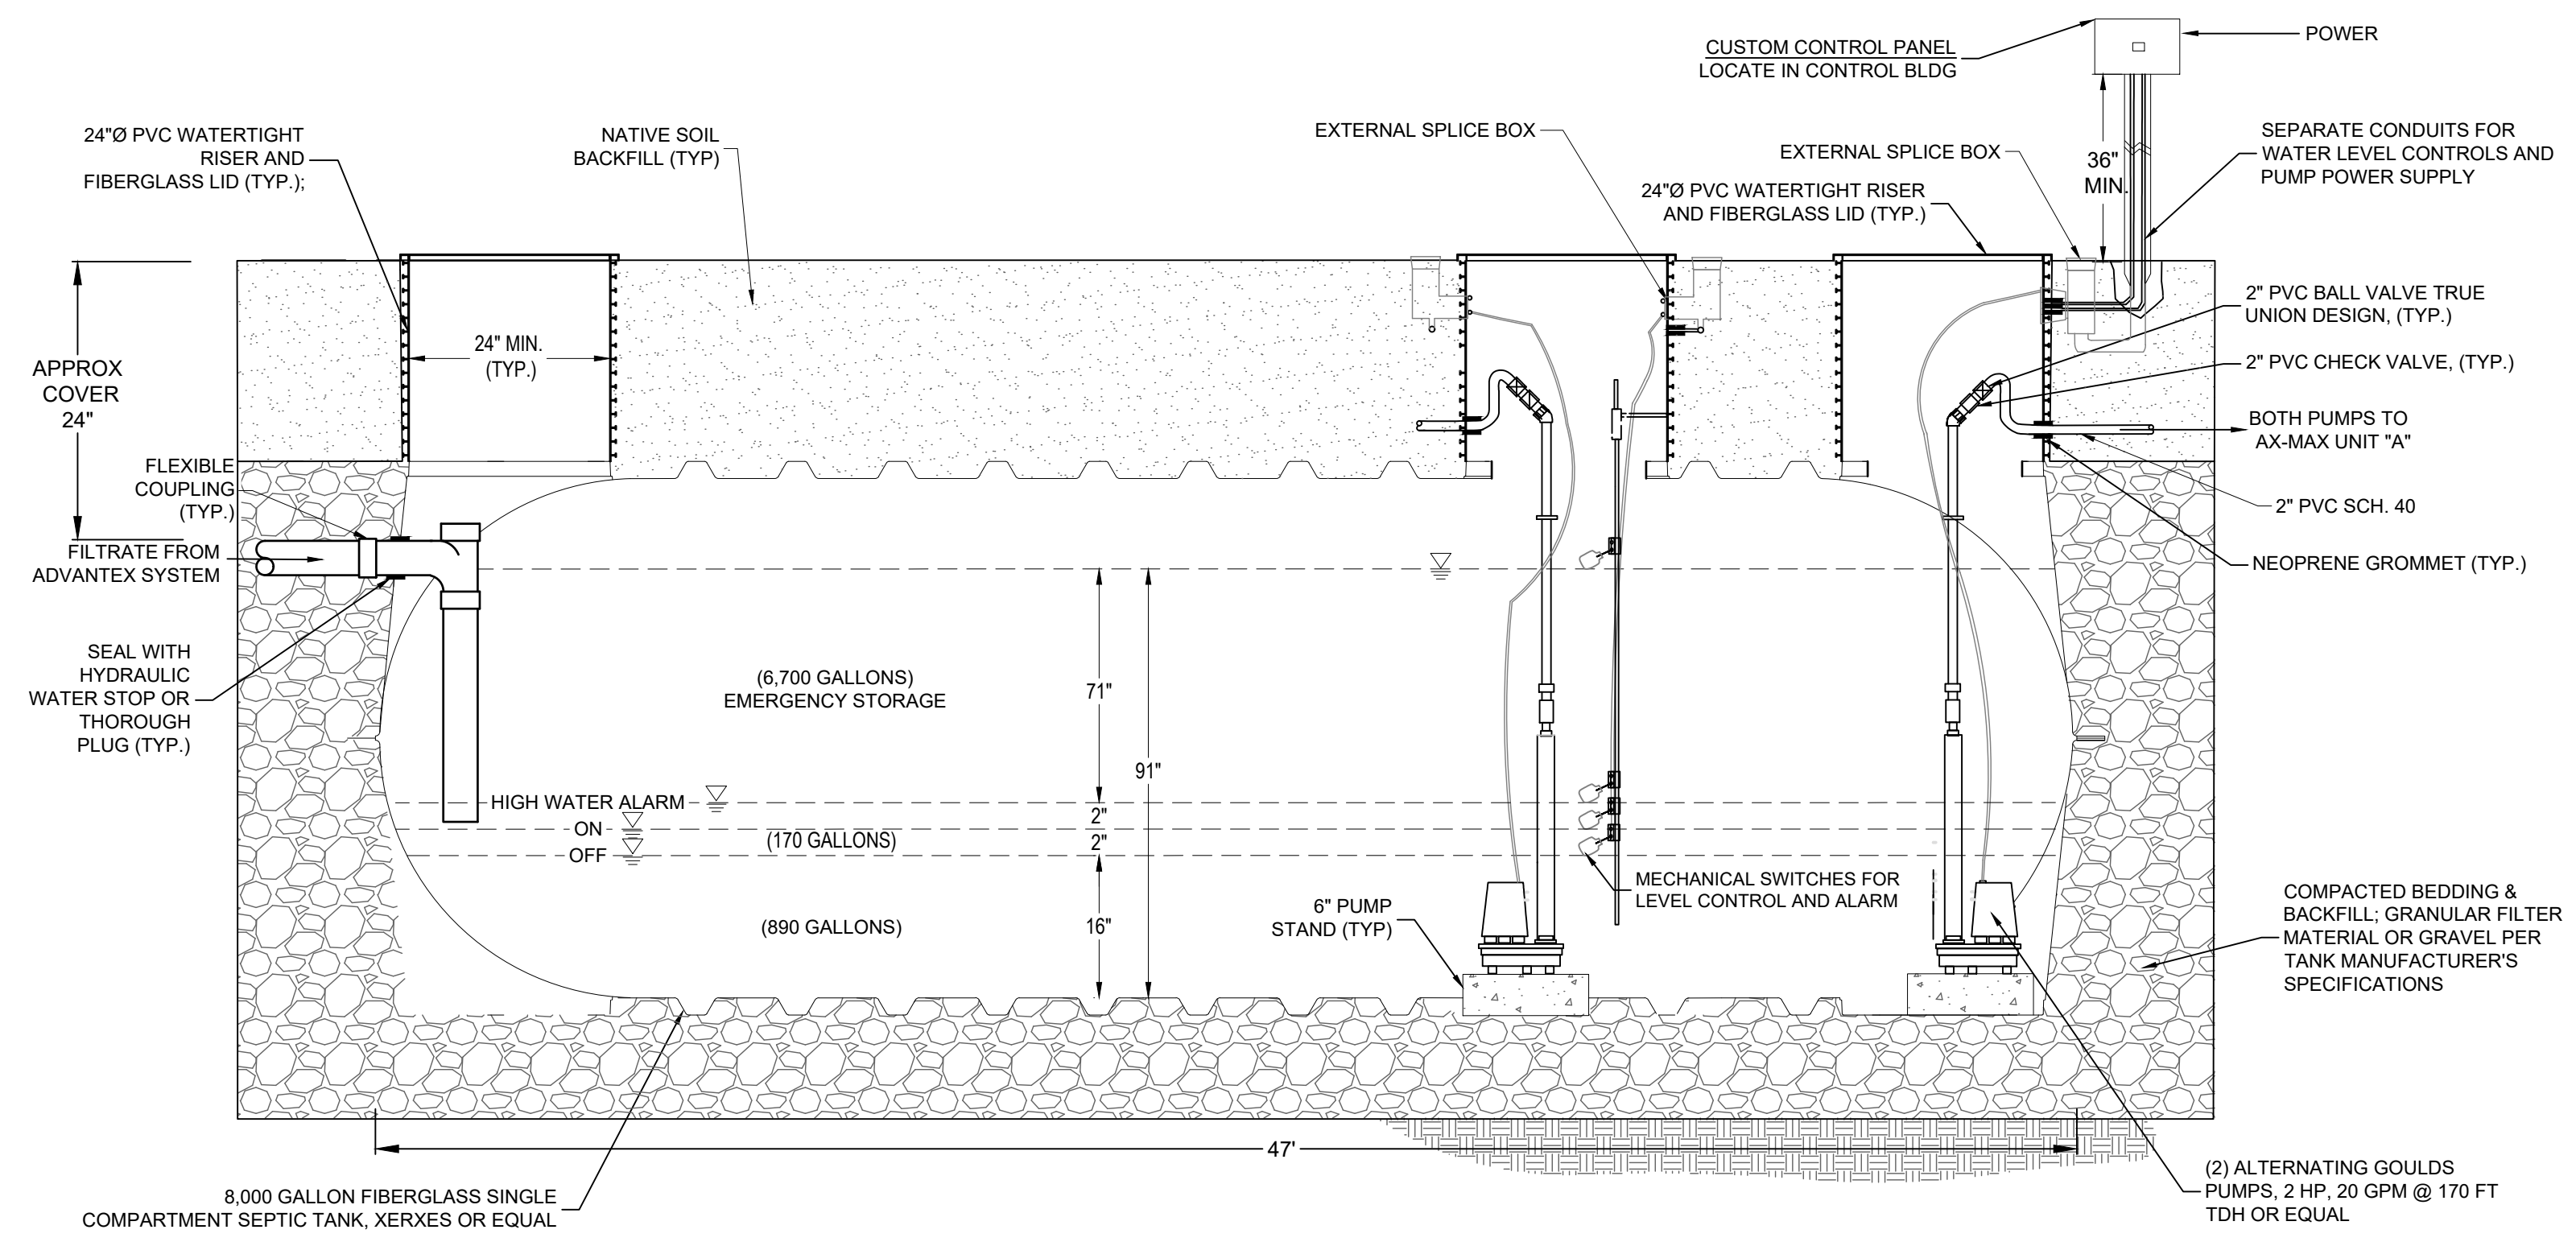

6 8,000 GALLON EFFLUENT DOSING TANK  
NOT TO SCALE

CIRCLE HILL ESTATES  
WASTEWATER TREATMENT SYSTEM  
SAN JOSE, CALIFORNIA

**QUESTA**  
ENGINEERING CORP.  
Civil Environmental & Water Resources  
(510) 236-6114  
FAX (510) 236-2423  
questa@questaac.com  
P.O. Box 70356 1220 Brickyard Cove Road Point Richmond, CA 94807



Sht	Rev	Date	By	Description	App'd

Design: NH  
Drawn: MN  
Checked: NH  
App'd: NH

**WASTEWATER DISPOSAL DETAILS**

Size D Project 2300152  
Scale: NOT TO SCALE  
Date: 3/29/2024  
Sheet: WW-3




P:\2023\2300152\_WOODCLIFF\_CROSSING\DWG\WWT\WWT-3.DWG  
 LAST SAVED: 4/2/2024 10:58:11 AM  
 PLOT DATE: 4/2/2024  
 PLOT STYLE:

**SOIL PROFILE FIELD LOG**  
 Job Number/Name: LaBarbera Condos Location Circle Hill Drive APN 575-20-037  
 Date Soil Sampled: 3-28-24 Time AM Vegetation Sparse Oaks  
 Elevation: Slope Gradient 10-20% Aspect North East Geomorphic Surface Base of Rolling Hills  
 Parent Material(s) Silstone Described by AB/DQ

DEPTH (ft)	MOISTURE	STRUCTURE	PORES	MOTTLES	CLAY FILLS	ROOTS	CONSISTENCE	TEXTURE	COLOR	HORIZON	CONTACTS
0-1.5	dry	loose	open	none	none	none	friable	loam	Dark Brown	Munsell (moist)	distinct / topog
1.5-3.5	dry	loose	open	none	none	none	friable	loam	Dark Brown	Munsell (moist)	distinct / topog
3.5-6.5	dry	loose	open	none	none	none	friable	loam	Dark Brown	Munsell (moist)	distinct / topog
6.5-9.5	dry	loose	open	none	none	none	friable	loam	Light Yellowish Brown	Munsell (moist)	distinct / topog
9.5-14	dry	loose	open	none	none	none	friable	loam	Light Yellowish Brown	Munsell (moist)	distinct / topog

**SOIL PROFILE FIELD LOG**  
 Job Number/Name: LaBarbera Condos Location Circle Hill Drive APN 575-20-037  
 Date Soil Sampled: 3-14-24 Time AM Vegetation Sparse Oaks  
 Elevation: Slope Gradient 20% Aspect North East Geomorphic Surface Base of Rolling Hills  
 Parent Material(s) Silstone Described by AB/DQ

DEPTH (ft)	MOISTURE	STRUCTURE	PORES	MOTTLES	CLAY FILLS	ROOTS	CONSISTENCE	TEXTURE	COLOR	HORIZON	CONTACTS
0-2.5	dry	loose	open	none	none	none	friable	loam	Very Dark Brown	Munsell (moist)	distinct / topog
2.5-6	dry	loose	open	none	none	none	friable	loam	Dark Brown	Munsell (moist)	distinct / topog
6-9	dry	loose	open	none	none	none	friable	loam	Medium Brown	Munsell (moist)	distinct / topog
9-13	dry	loose	open	none	none	none	friable	loam	Light Yellowish Brown	Munsell (moist)	distinct / topog
13-14	dry	loose	open	none	none	none	friable	loam	Light Yellowish Brown	Munsell (moist)	distinct / topog

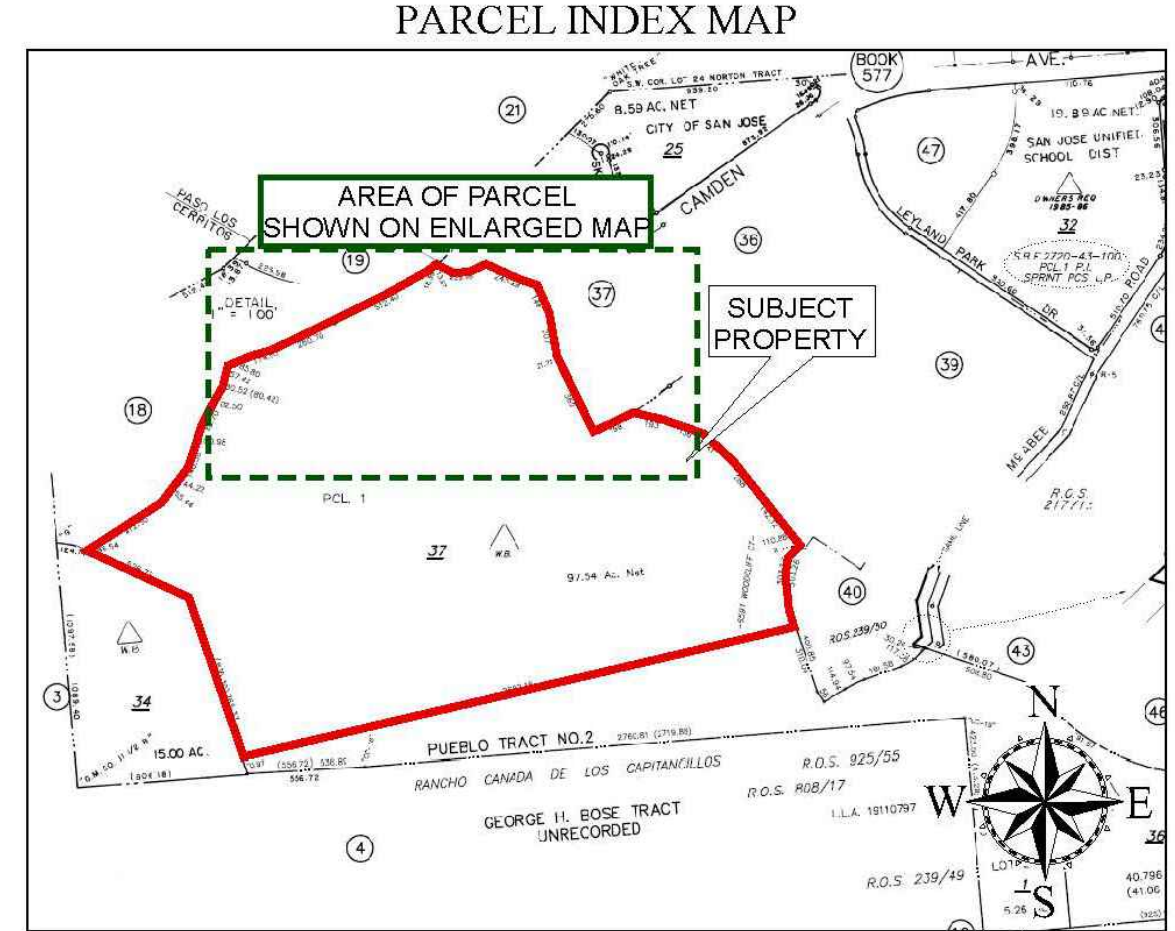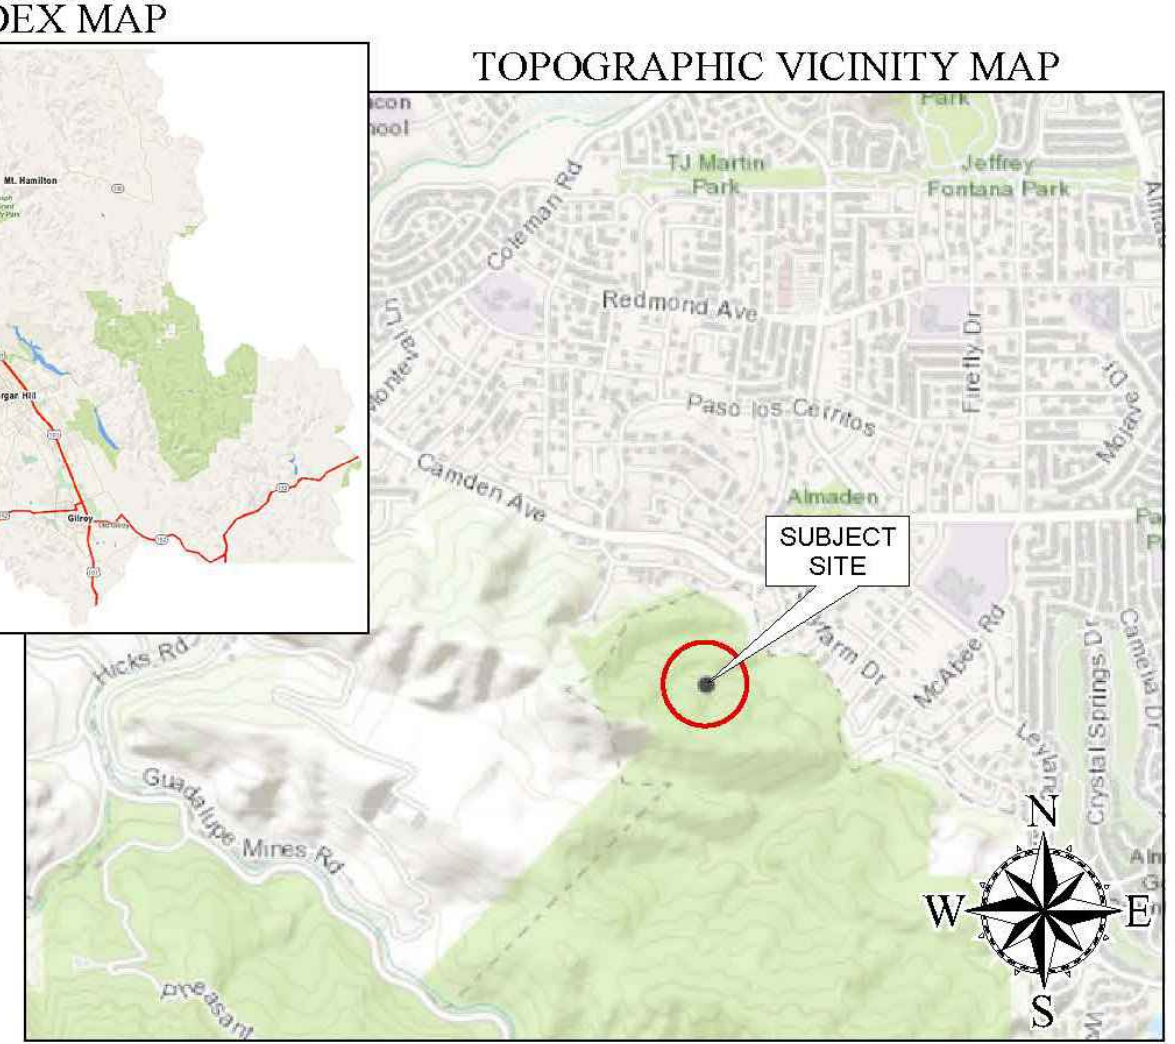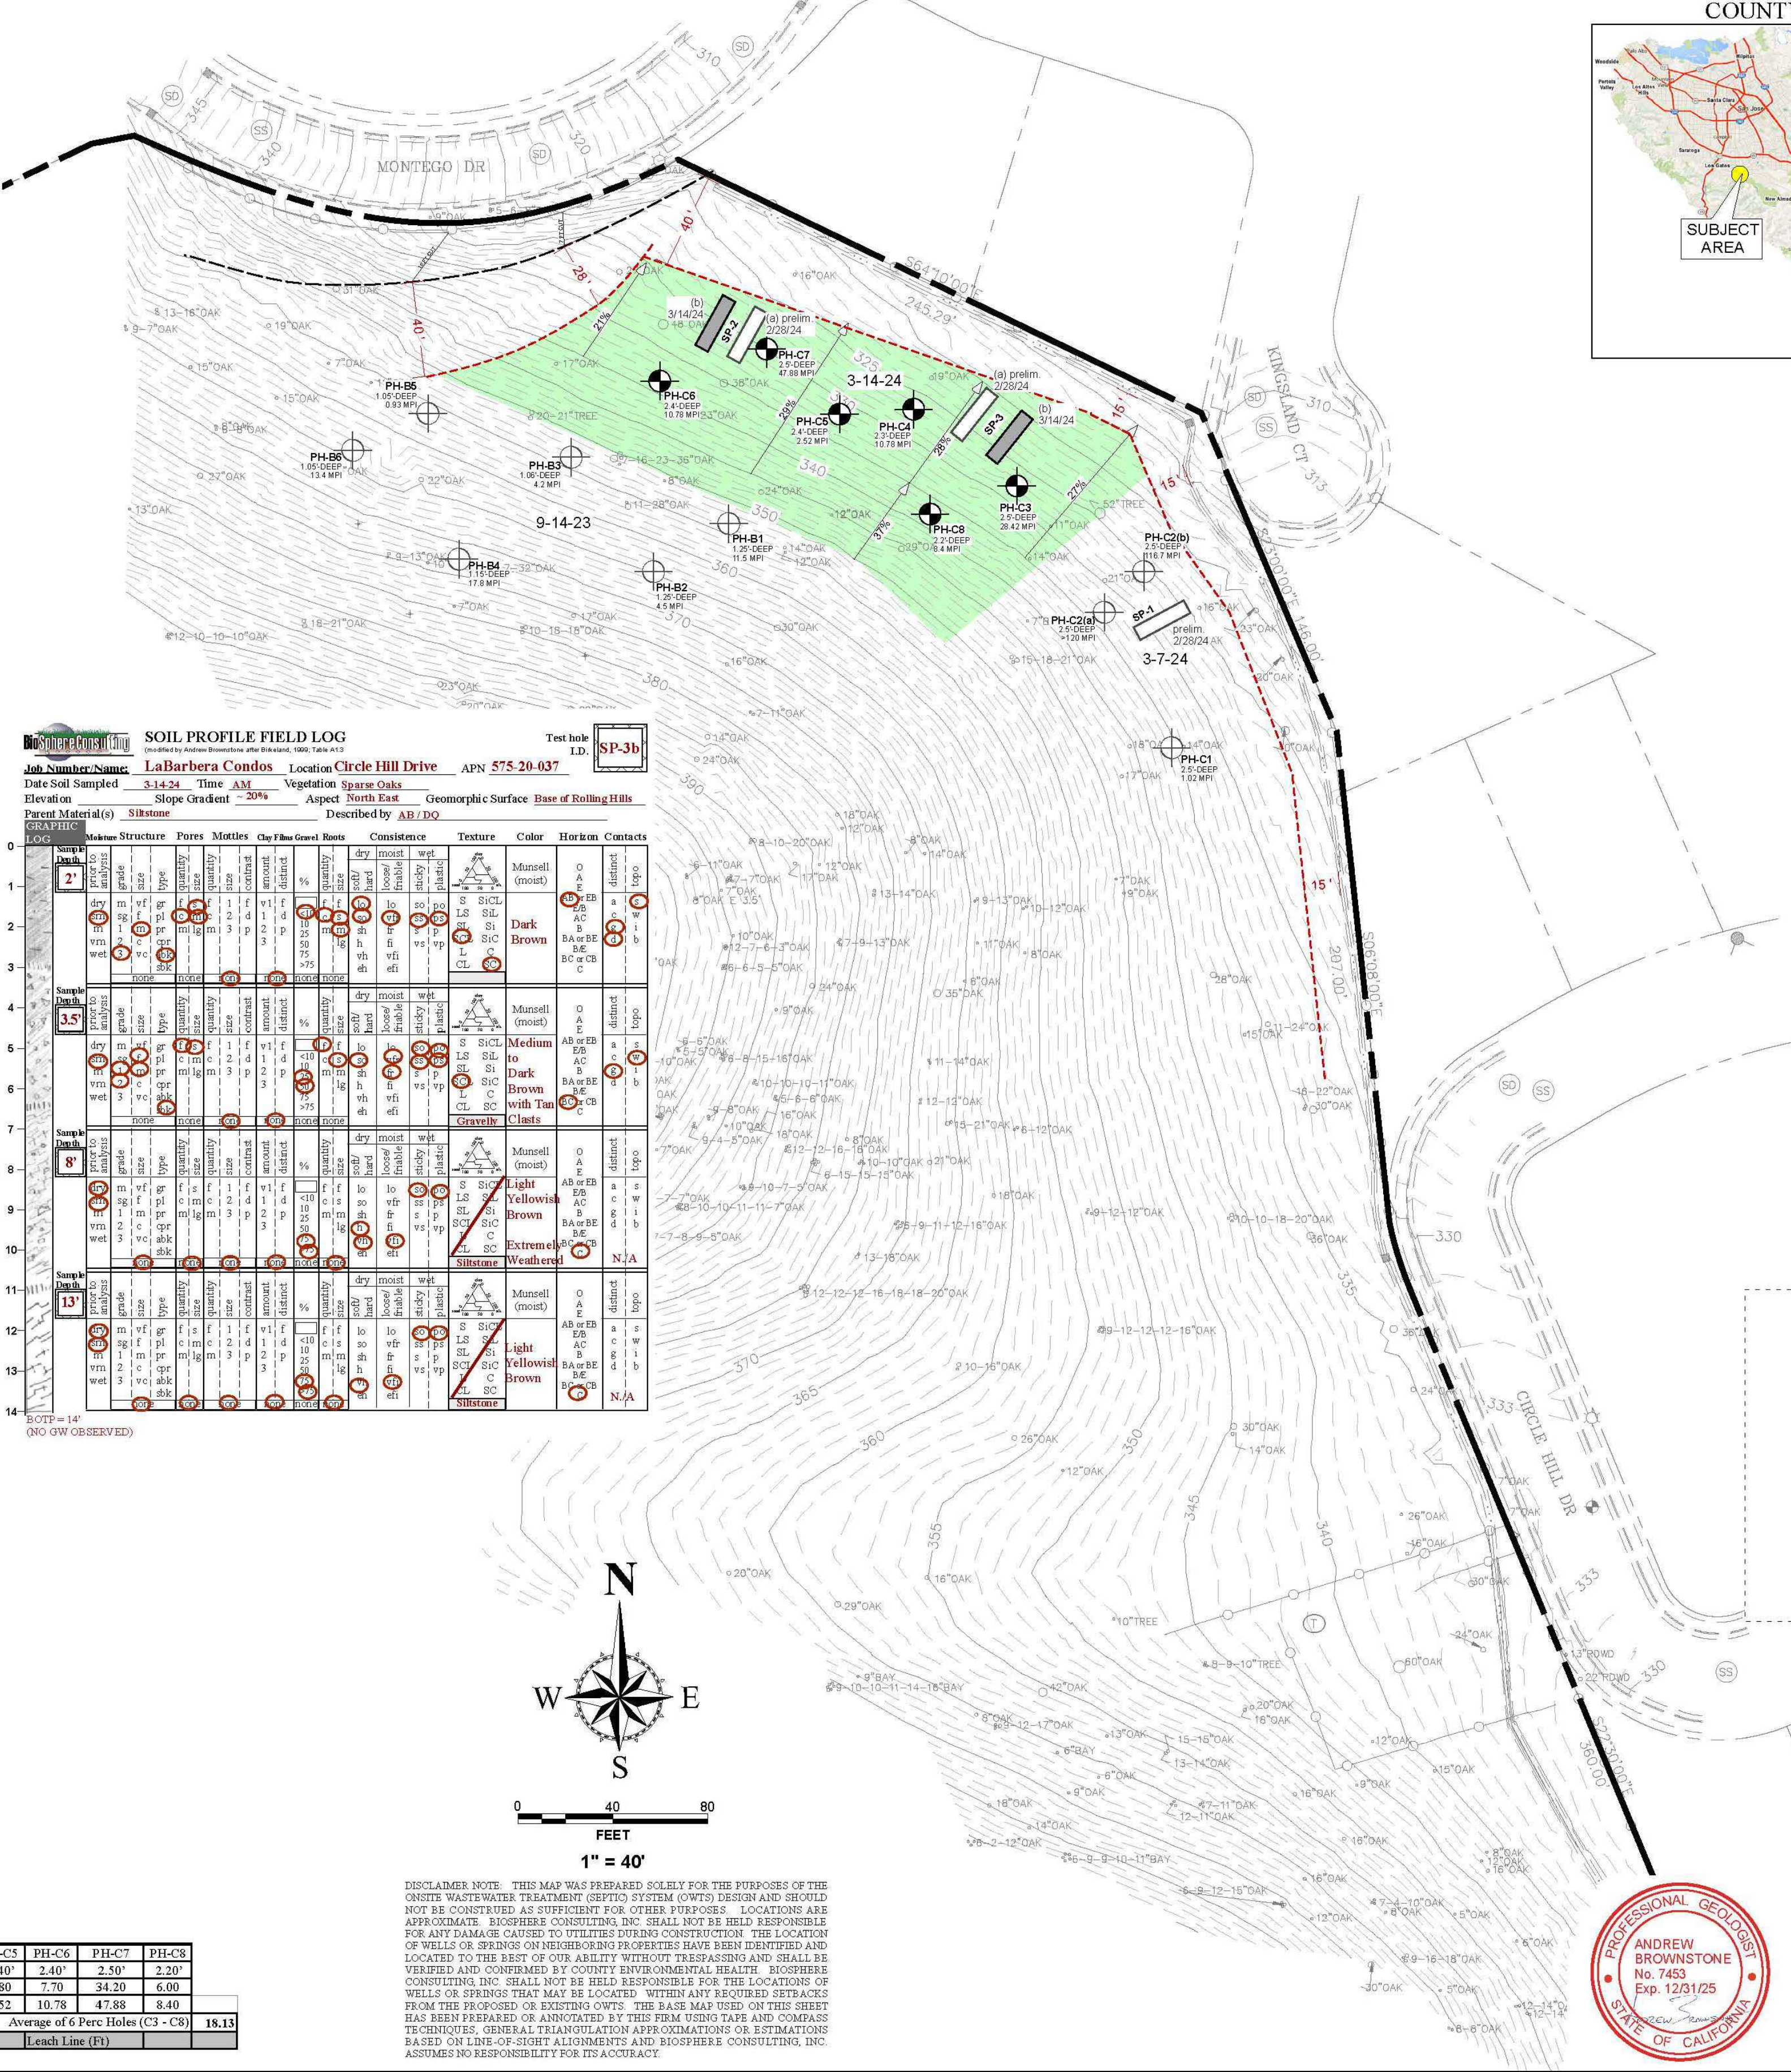

COUNTY E.H. ACCEPTANCE/APPROVAL STAMPS

**SOIL PERCOLATION SUMMARY TABLE -- 03/14/24**

Percolation Hole (PH)	PH-C3	PH-C4	PH-C5	PH-C6	PH-C7	PH-C8
Depth	2.50'	2.30'	2.40'	2.40'	2.50'	2.20'
Stabilized MPI	20.30	7.70	1.80	7.70	34.20	6.00
Adjusted Stabilized MPI	R = R x 1.4					
Avg. Adj. Stabilized MPI	28.42	10.78	2.52	10.78	47.88	8.40
# Bedrooms:	FOR OFFICE USE ONLY		TANK SIZE (Gal)		Leach Line (Ft)	
					18.15	

DISCLAIMER NOTE: THIS MAP WAS PREPARED SOLELY FOR THE PURPOSES OF THE ON-SITE WASTEWATER TREATMENT (SEPTIC) SYSTEM DESIGN AND SHOULD NOT BE CONSTRUED AS SUFFICIENT FOR OTHER PURPOSES. LOCATIONS ARE APPROXIMATE. BIOSPHERE CONSULTING, INC. SHALL NOT BE HELD RESPONSIBLE FOR ANY DAMAGE CAUSED TO UTILITIES DURING CONSTRUCTION. THE LOCATION OF WELLS OR SPRINGS ON NEIGHBORING PROPERTIES HAVE BEEN IDENTIFIED AND LOCATED TO THE BEST OF OUR ABILITY WITHOUT TRESPASSING AND SHALL BE VERIFIED AND CONFIRMED BY COUNTY ENVIRONMENTAL HEALTH. BIOSPHERE CONSULTING, INC. SHALL NOT BE HELD RESPONSIBLE FOR THE LOCATIONS OF WELLS OR SPRINGS THAT MAY BE LOCATED WITHIN ANY REQUIRED SETBACKS FROM THE PROPOSED OR EXISTING OWTS. THE BASE MAP USED ON THIS SHEET HAS BEEN PREPARED OR ANNOTATED BY THIS FIRM USING TAPE AND COMPASS TECHNIQUES. GENERAL TRIANGULATION APPROXIMATIONS OR ESTIMATIONS BASED ON LINE-OF-SIGHT ALIGNMENTS AND BIOSPHERE CONSULTING, INC. ASSUMES NO RESPONSIBILITY FOR THE ACCURACY.

**BioSphere Consulting**  
 1315 King Street  
 Santa Cruz, CA 95060  
 Tel: (831) 430-9116  
 www.biosphere-consulting.com

**SITE EVALUATION RESULTS MAP FOR PROPOSED OWTS**

Project Location:	6591 Woodcliff Court, San Jose, California	(Santa Clara County)
Property Owner:	Mike LaBarbera	
Mailing Address:	6107 Black Pool Court, San Jose, CA 95138	
Owner Phone #:	(408) 529-2017	
Date:	03/15/24	By: David Quinn / Andrew Brownstone
REVISIONS:		Sheet: 1 of 1

**CIRCLE HILL ESTATES**  
 WASTEWATER TREATMENT SYSTEM  
 SAN JOSE, CALIFORNIA

**QUESTA**  
 Environmental & Water Resources  
 (510) 236-6114  
 FAX (510) 236-2423  
 P.O. Box 70356 1220 Brickyard Cove Road Point Richmond, CA 94807



Sht	Rev	Date	By	Description	App'd

Design: NH  
 Drawn: MN  
 Checked: NH  
 Apprd: NH

**WASTEWATER SITE EVALUATION DATA**

Size D	Project 2300152
Scale:	NOT TO SCALE
Date:	3/29/2024
Sheet:	WW-4

THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. REPRODUCTION OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, WITHOUT THE WRITTEN PERMISSION OF BIOSPHERE CONSULTING, INC. IS PROHIBITED. BIOSPHERE CONSULTING, INC. MAINTAINS TITLE OWNERSHIP OF THE PLANS AND SPECIFICATIONS. VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE FRAUDULENT INFRINGEMENT OF THESE RESTRICTIONS. LAST SAVED: 4/2/2024 PLOT DATE: 4/2/2024 PLOT STYLE: F:\BROS NOT MEASURE 1" DRAWING IS NOT TO SCALE - ADJUST ACCORDING