

# ROSAS RESIDENCE

# 11461 CLAYTON RD, SAN JOSE, CA 95127 APN 612-38-031

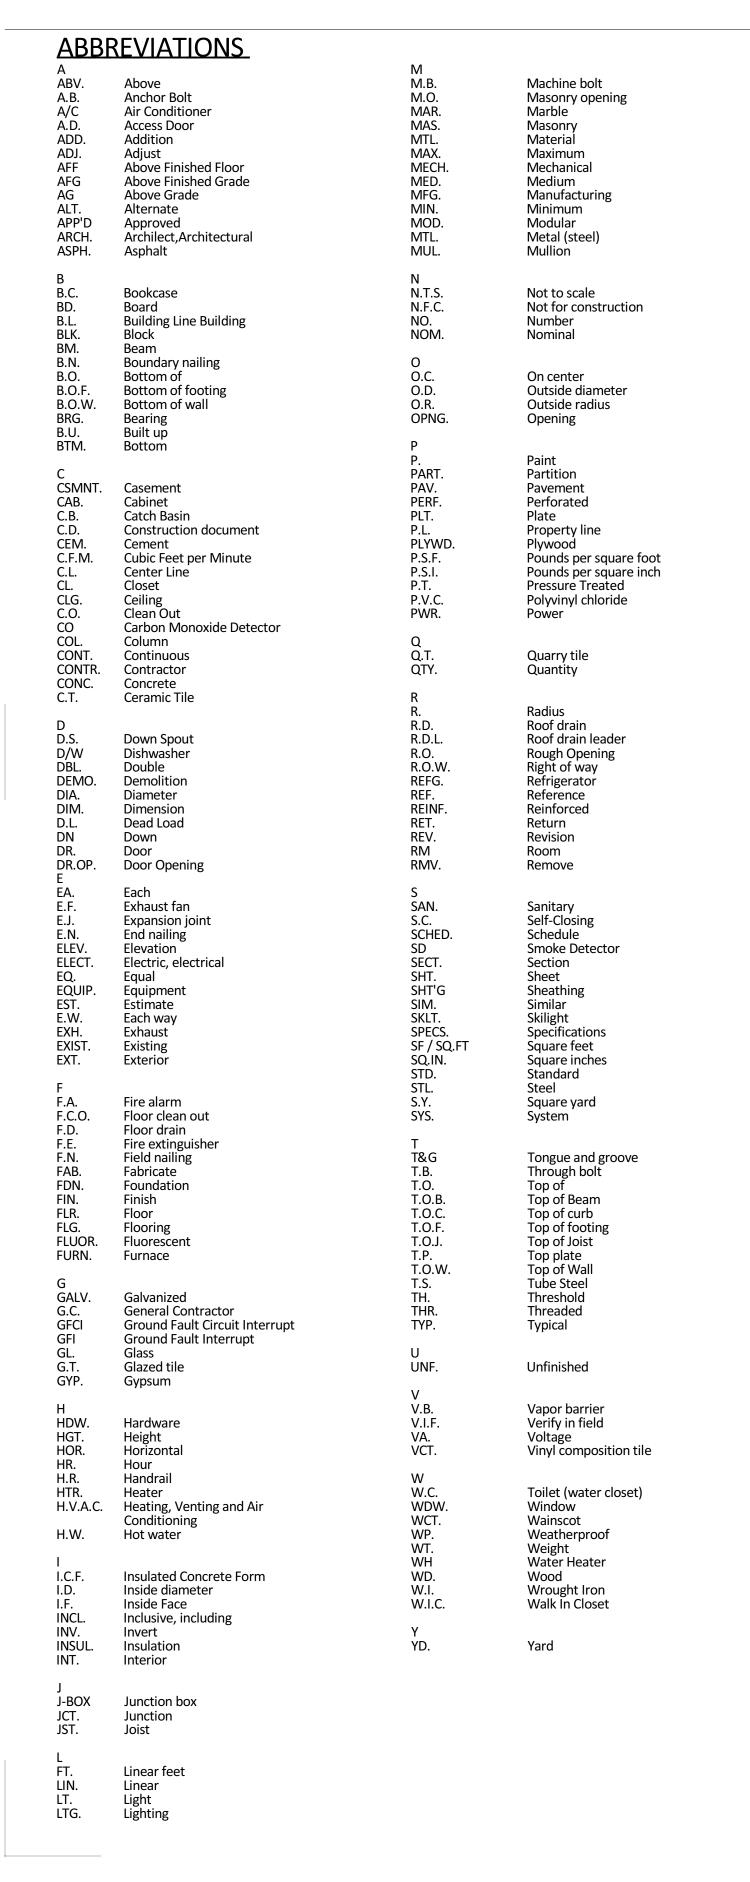

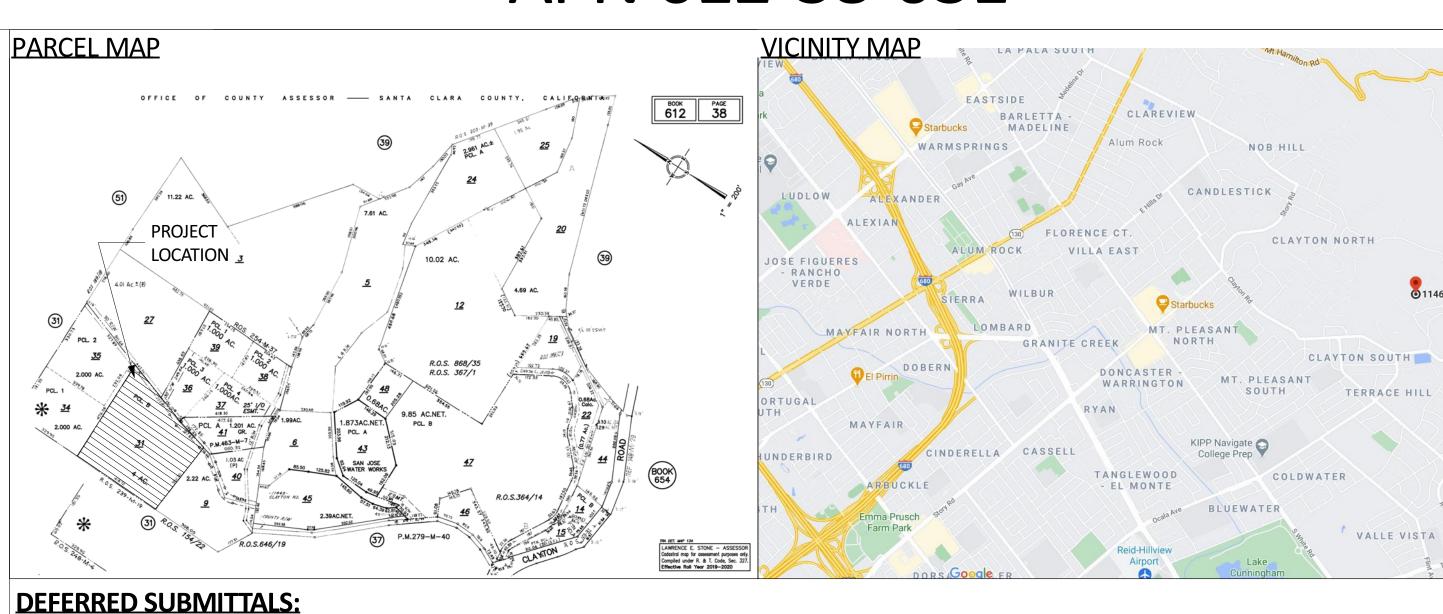

### - FIRE SPRINKLER SYSTEM

#### **FIRE PROTECTION INFORMATION:**

THE PARCEL IS WITHIN THE STATE RESPONSE AREA (SRA). THE PARCEL IS WITHIN THE WILDLAND URBAN INTERFACE (WUI)

**CONSTRUCTION SHALL CONFORM TO:** 2022 California Building Code 2022 California Residential Code 2022 California Plumbing Code 2022 California Mechanical Code 2022 California Electrical Code 2022 California Energy Code 2022 California Green Building Standards Code 2022 California Fire Code 2022 California Reference Standards Code

## **VYLCO**

4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

OWNER:

JUAN ROSAS 11461 CLAYTON RD SAN JOSE, CA 95127 (650) 704-0520

RESIDENCE

SINGLE

# DATE

4750 ALMADEN EXP STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

**PROJECT DESCRIPTION** 

RETAINING WALL.

**PROJECT DATA** 

612-38-031 HS-D1 ZONING OCCUPANCY **VB - SPRINKLERED** 174,240 SF (4 AC.) **FLOOR AREA:** 3,639.85 SF (N)1ST FLOOR 875.11 SF (N)2ND FLOOR **TOTAL** 4,514.96 SF (N)FAR 2.59 % 470.90 SF (N)COVERED TERRACE 666.72 SF (N)OPEN TERRACE 806.16 SF (N)COVERED CORRIDOR

NEW SINGLE FAMILY RESIDENCE, NEW DRIVEWAY, NEW

COVERED PATIO, NEW SWIMMING POOL AND NEW

## **SHEET INDEX**

(N)ACCESSORY BUILDING

**COVER SHEET CALGREEN SHEET CALGREEN SHEET** TOPOGRAPHIC SURVEY GRADING & DRAINAGE PLAN - COVER SHEET C1 GRADING & DRAINAGE PLAN C2 GRADING & DRAINAGE PLAN - CONSTRUCTION DETAILS **C3** GRADING & DRAINAGE PLAN - EROSION CONTROL **GRADING & DRAINAGE PLAN - BMP SHEET** ARCHITECTURAL A1.1 PROPOSED SITE PLAN A2.1 PROPOSED ROOF PLAN A3.1 PROPOSED FLOOR PLAN A4.1 PROPOSED EXTERIOR ELEVATIONS PROPOSED EXTERIOR ELEVATIONS A4.2 A5.1 SECTIONS FLOOR AREA DIAGRAM PRELIMINARY LANDSCAPE PLAN

740.09 SF

493.02 SF

### **APPROVAL STAMPS:**

10/15/2024 DRAWN BY:

**COVER SHEET** 

DESCRIPTION

1 12/2/24 COMMENT RESPONSES



# California 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES, SHEET 1 (January 2023) installed in close proximity to the location or the proposed location of the EV space at the time of original **CHAPTER 3** construction in accordance with the California Electrical Code. 4.106.4.2 New multifamily dwellings, hotels and motels and new residential parking facilities. **GREEN BUILDING** 4.304 OUTDOOR WATER USE When parking is provided, parking spaces for new multifamily dwellings, hotels and motels shall meet the 4.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS. Residential developments shall comply with requirements of Sections 4.106.4.2.1 and 4.106.4.2.2. Calculations for spaces shall be rounded up to the nearest **SECTION 301 GENERAL** The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water whole number. A parking space served by electric vehicle supply equipment or designed as a future EV charging future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code. Efficient Landscape Ordinance (MWELO), whichever is more stringent. space shall count as at least one standard automobile parking space only for the purpose of complying with any 301.1 SCOPE. Buildings shall be designed to include the green building measures specified as mandatory in 4.106.4.2.5 Electric Vehicle Ready Space Signage. applicable minimum parking space requirements established by a local jurisdiction. See Vehicle Code Section 22511.2 the application checklists contained in this code. Voluntary green building measures are also included in the Electric vehicle ready spaces shall be identified by signage or pavement markings, in compliance with Caltrans application checklists and may be included in the design and construction of structures covered by this code, Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its 1. The Model Water Efficient Landscape Ordinance (MWELO) is located in the California Code Regulations, but are not required unless adopted by a city, county, or city and county as specified in Section 101.7. 4.106.4.2.1Multifamily development projects with less than 20 dwelling units; and hotels and motels with less Title 23, Chapter 2.7, Division 2. MWELO and supporting documents, including water budget calculator, are 301.1.1 Additions and alterations. [HCD] The mandatory provisions of Chapter 4 shall be applied to available at: https://www.water.ca.gov/ 4.106.4.3 Electric vehicle charging for additions and alterations of parking facilities serving existing The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to additions or alterations of existing residential buildings where the addition or alteration increases the building's conditioned area, volume, or size. The requirements shall apply only to and/or within the DIVISION 4.4 MATERIAL CONSERVATION AND RESOURCE When new parking facilities are added, or electrical systems or lighting of existing parking facilities are added or specific area of the addition or alteration. 1.EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types altered and the work requires a building permit, ten (10) percent of the total number of parking spaces added or of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 The mandatory provision of Section 4.106.4.2 may apply to additions or alterations of existing parking altered shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical facilities or the addition of new parking facilities serving existing multifamily buildings. See Section 4.406 ENHANCED DURABILITY AND REDUCED MAINTENANCE system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all 4.406.1 RODENT PROOFING. Annular spaces around pipes, electric cables, conduits or other openings in EVs at all required EV spaces at a minimum of 40 amperes. sole/bottom plates at exterior walls shall be protected against the passage of rodents by closing such Note: Repairs including, but not limited to, resurfacing, restriping and repairing or maintaining existing 1.Construction documents are intended to demonstrate the project's capability and capacity for facilitating future openings with cement mortar, concrete masonry or a similar method acceptable to the enforcing The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved lighting fixtures are not considered alterations for the purpose of this section. for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code. 2. There is no requirement for EV spaces to be constructed or available until EV chargers are installed for use. Note: On and after January 1, 2014, residential buildings undergoing permitted alterations, additions, or 4.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING improvements shall replace noncompliant plumbing fixtures with water-conserving plumbing fixtures. 4.408.1 CONSTRUCTION WASTE MANAGEMENT. Recycle and/or salvage for reuse a minimum of 65 DIVISION 4.2 ENERGY EFFICIENCY Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate percent of the non-hazardous construction and demolition waste in accordance with either Section 1. When EV chargers (Level 2 EVSE) are installed in a number equal to or greater than the required number of occupancy or final permit approval by the local building department. See Civil Code Section 1101.1, 4.201 GENERAL 4.408.2, 4.408.3 or 4.408.4, or meet a more stringent local construction and demolition waste et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and **4.201.1 SCOPE.** For the purposes of mandatory energy efficiency standards in this code, the California Energy other important enactment dates. 2.When EV chargers (Level 2 EVSE) are installed in a number less than the required number of EV capable spaces, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed. 301.2 LOW-RISE AND HIGH-RISE RESIDENTIAL BUILDINGS. [HCD] The provisions of DIVISION 4.3 WATER EFFICIENCY AND CONSERVATION 1. Excavated soil and land-clearing debris. individual sections of CALGreen may apply to either low-rise residential buildings high-rise residential Alternate waste reduction methods developed by working with local agencies if diversion or 4.303 INDOOR WATER USE buildings, or both. Individual sections will be designated by banners to indicate where the section applies recycle facilities capable of compliance with this item do not exist or are not located reasonably 4.303.1 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures (water closets and specifically to low-rise only (LR) or high-rise only (HR). When the section applies to both low-rise and a. Construction documents are intended to demonstrate the project's capability and capacity for facilitating urinals) and fittings (faucets and showerheads) shall comply with the sections 4.303.1.1, 4.303.1.2, 4.303.1.3, high-rise buildings, no banner will be used. The enforcing agency may make exceptions to the requirements of this section when isolated jobsites are located in areas beyond the haul boundaries of the diversion facility. b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or SECTION 302 MIXED OCCUPANCY BUILDINGS Note: All noncompliant plumbing fixtures in any residential real property shall be replaced with water-conserving 4.408.2 CONSTRUCTION WASTE MANAGEMENT PLAN. Submit a construction waste management plan EV chargers are installed for use. plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final in conformance with Items 1 through 5. The construction waste management plan shall be updated as 302.1 MIXED OCCUPANCY BUILDINGS. In mixed occupancy buildings, each portion of a building completion, certificate of occupancy, or final permit approval by the local building department. See Civil necessary and shall be available during construction for examination by the enforcing agency. 2.EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power shall comply with the specific green building measures applicable to each specific occupancy. Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per buildings affected and other important enactment dates. 1. Identify the construction and demolition waste materials to be diverted from disposal by recycling, dwelling unit when more than one parking space is provided for use by a single dwelling unit. 1. [HCD] Accessory structures and accessory occupancies serving residential buildings shall reuse on the project or salvage for future use or sale. comply with Chapter 4 and Appendix A4, as applicable. **4.303.1.1 Water Closets.** The effective flush volume of all water closets shall not exceed 1.28 gallons per Specify if construction and demolition waste materials will be sorted on-site (source separated) or Exception: Areas of parking facilities served by parking lifts. 2. [HCD] For purposes of CALGreen, live/work units, complying with Section 419 of the California flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense bulk mixed (single stream). Building Code, shall not be considered mixed occupancies. Live/Work units shall comply with Identify diversion facilities where the construction and demolition waste material collected will be 4.106.4.2.2 Multifamily development projects with 20 or more dwelling units, hotels and motels with 20 or more Chapter 4 and Appendix A4, as applicable. sleeping units or quest rooms. Note: The effective flush volume of dual flush toilets is defined as the composite, average flush volume 4. Identify construction methods employed to reduce the amount of construction and demolition waste The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to **DIVISION 4.1 PLANNING AND DESIGN** of two reduced flushes and one full flush. Specify that the amount of construction and demolition waste materials diverted shall be calculated ABBREVIATION DEFINITIONS: 4.303.1.2 Urinals. The effective flush volume of wall mounted urinals shall not exceed 0.125 gallons per flush. by weight or volume, but not by both. 1.EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types Department of Housing and Community Development The effective flush volume of all other urinals shall not exceed 0.5 gallons per flush. of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 California Building Standards Commission .408.3 WASTE MANAGEMENT COMPANY. Utilize a waste management company, approved by the EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical Division of the State Architect, Structural Safety enforcing agency, which can provide verifiable documentation that the percentage of construction and system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge al Office of Statewide Health Planning and Development OSHPD demolition waste material diverted from the landfill complies with Section 4.408.1. EVs at all required EV spaces at a minimum of 40 amperes. Low Rise 4.303.1.3.1 Single Showerhead. Showerheads shall have a maximum flow rate of not more than 1.8 High Rise gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA Note: The owner or contractor may make the determination if the construction and demolition waste The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved Additions and Alterations WaterSense Specification for Showerheads. materials will be diverted by a waste management company. for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code. **4.303.1.3.2** Multiple showerheads serving one shower. When a shower is served by more than one .408.4 WASTE STREAM REDUCTION ALTERNATIVE [LR]. Projects that generate a total combined Exception: When EV chargers (Level 2 EVSE) are installed in a number greater than five (5) percent of **CHAPTER 4** showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled by weight of construction and demolition waste disposed of in landfills, which do not exceed 3.4 parking spaces required by Section 4.106.4.2.2. Item 3, the number of EV capable spaces required may be a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to only lbs./sq.ft. of the building area shall meet the minimum 65% construction waste reduction requirement in RESIDENTIAL MANDATORY MEASURES reduced by a number equal to the number of EV chargers installed over the five (5) percent required. allow one shower outlet to be in operation at a time. 4.408.4.1 WASTE STREAM REDUCTION ALTERNATIVE. Projects that generate a total combined Note: A hand-held shower shall be considered a showerhead weight of construction and demolition waste disposed of in landfills, which do not exceed 2 pounds **SECTION 4.102 DEFINITIONS** a. Construction documents shall show locations of future EV spaces. per square foot of the building area, shall meet the minimum 65% construction waste reduction 4.102.1 DEFINITIONS requirement in Section 4 408 1 b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or The following terms are defined in Chapter 2 (and are included here for reference) 4.303.1.4.1 Residential Lavatory Faucets. The maximum flow rate of residential lavatory faucets shall EV chargers are installed for use. not exceed 1.2 gallons per minute at 60 psi. The minimum flow rate of residential lavatory faucets shall 4.408.5 DOCUMENTATION. Documentation shall be provided to the enforcing agency which demonstrates FRENCH DRAIN. A trench, hole or other depressed area loosely filled with rock, gravel, fragments of brick or similar not be less than 0.8 gallons per minute at 20 psi. compliance with Section 4.408.2, items 1 through 5, Section 4.408.3 or Section 4.408.4... 2.EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power pervious material used to collect or channel drainage or runoff water. 4.303.1.4.2 Lavatory Faucets in Common and Public Use Areas. The maximum flow rate of lavatory WATTLES. Wattles are used to reduce sediment in runoff. Wattles are often constructed of natural plant materials dwelling unit when more than one parking space is provided for use by a single dwelling unit. faucets installed in common and public use areas (outside of dwellings or sleeping units) in residential such as hay, straw or similar material shaped in the form of tubes and placed on a downflow slope. Wattles are also buildings shall not exceed 0.5 gallons per minute at 60 psi. 1. Sample forms found in "A Guide to the California Green Building Standards Code used for perimeter and inlet controls. Exception: Areas of parking facilities served by parking lifts. (Residential)" located at www.hcd.ca.gov/CALGreen.html may be used to assist in 4.303.1.4.3 Metering Faucets. Metering faucets when installed in residential buildings shall not deliver documenting compliance with this section. 4.106 SITE DEVELOPMENT 3.EV Chargers. Five (5) percent of the total number of parking spaces shall be equipped with Level 2 EVSE. more than 0.2 gallons per cycle. 2. Mixed construction and demolition debris (C & D) processors can be located at the California 4.106.1 GENERAL. Preservation and use of available natural resources shall be accomplished through evaluation Where common use parking is provided, at least one EV charger shall be located in the common use parking Department of Resources Recycling and Recovery (CalRecycle). and careful planning to minimize negative effects on the site and adjacent areas. Preservation of slopes, area and shall be available for use by all residents or guests. 4.303.1.4.4 Kitchen Faucets. The maximum flow rate of kitchen faucets shall not exceed 1.8 gallons management of storm water drainage and erosion controls shall comply with this section. 4.410 BUILDING MAINTENANCE AND OPERATION per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not When low power Level 2 EV charging receptacles or Level 2 EVSE are installed beyond the minimum required, to exceed 2.2 gallons per minute at 60 psi, and must default to a maximum flow rate of 1.8 gallons per 4.410.1 OPERATION AND MAINTENANCE MANUAL. At the time of final inspection, a manual, compact 4.106.2 STORM WATER DRAINAGE AND RETENTION DURING CONSTRUCTION. Projects which disturb less an automatic load management system (ALMS) may be used to reduce the maximum required electrical disc, web-based reference or other media acceptable to the enforcing agency which includes all of the than one acre of soil and are not part of a larger common plan of development which in total disturbs one acre capacity to each space served by the ALMS. The electrical system and any on-site distribution transformers following shall be placed in the building: or more, shall manage storm water drainage during construction. In order to manage storm water drainage shall have sufficient capacity to deliver at least 3.3 kW simultaneously to each EV charging station (EVCS) Note: Where complying faucets are unavailable, aerators or other means may be used to achieve served by the ALMS. The branch circuit shall have a minimum capacity of 40 amperes, and installed EVSE shall during construction, one or more of the following measures shall be implemented to prevent flooding of adjacent 1. Directions to the owner or occupant that the manual shall remain with the building throughout the property, prevent erosion and retain soil runoff on the site. have a capacity of not less than 30 amperes. ALMS shall not be used to reduce the minimum required electrical life cycle of the structure. 4.303.1.4.5 Pre-rinse spray valves. Operation and maintenance instructions for the following: 1. Retention basins of sufficient size shall be utilized to retain storm water on the site. When installed, shall meet the requirements in the California Code of Regulations, Title 20 (Appliance a. Equipment and appliances, including water-saving devices and systems, HVAC systems, 2. Where storm water is conveyed to a public drainage system, collection point, gutter or similar 4.106.4.2.2.1 Electric vehicle charging stations (EVCS). Efficiency Regulations), Sections 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1607 photovoltaic systems, electric vehicle chargers, water-heating systems and other major disposal method, water shall be filtered by use of a barrier system, wattle or other method approved Electric vehicle charging stations required by Section 4.106.4.2.2, Item 3, shall comply with Section 4.106.4.2.2.1 (d)(7) and shall be equipped with an integral automatic shutoff. appliances and equipment. Roof and yard drainage, including gutters and downspouts. 3. Compliance with a lawfully enacted storm water management ordinance. Exception: Electric vehicle charging stations serving public accommodations, public housing, motels and hotels FOR REFERENCE ONLY: The following table and code section have been reprinted from the California c. Space conditioning systems, including condensers and air filters. shall not be required to comply with this section. See California Building Code, Chapter 11B, for applicable Code of Regulations, Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) and Section d. Landscape irrigation systems. Note: Refer to the State Water Resources Control Board for projects which disturb one acre or more of soil, or e. Water reuse systems are part of a larger common plan of development which in total disturbs one acre or more of soil. 3. Information from local utility, water and waste recovery providers on methods to further reduce resource consumption, including recycle programs and locations. (Website: https://www.waterboards.ca.gov/water\_issues/programs/stormwater/construction.html) EVCS shall comply with at least one of the following options: TABLE H-2 4. Public transportation and/or carpool options available in the area. Educational material on the positive impacts of an interior relative humidity between 30-60 percent 4.106.3 GRADING AND PAVING. Construction plans shall indicate how the site grading or drainage system will 1.The charging space shall be located adjacent to an accessible parking space meeting the requirements of and what methods an occupant may use to maintain the relative humidity level in that range. manage all surface water flows to keep water from entering buildings. Examples of methods to manage surface the California Building Code, Chapter 11A, to allow use of the EV charger from the accessible parking space. STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY 6. Information about water-conserving landscape and irrigation design and controllers which conserve water include, but are not limited to, the following: VALUES MANUFACTURED ON OR AFTER JANUARY 28, 2019 2.The charging space shall be located on an accessible route, as defined in the California Building Code, 7. Instructions for maintaining gutters and downspouts and the importance of diverting water at least 5 feet away from the foundatio 2. Water collection and disposal systems PRODUCT CLASS 8. Information on required routine maintenance measures, including, but not limited to, caulking, MAXIMUM FLOW RATE (gpm) Exception: Electric vehicle charging stations designed and constructed in compliance with the California [spray force in ounce force (ozf)] painting, grading around the building, etc. Building Code, Chapter 11B, are not required to comply with Section 4.106.4.2.2.1.1 and Section 4. Water retention gardens Information about state solar energy and incentive programs available. 5. Other water measures which keep surface water away from buildings and aid in groundwater 10. A copy of all special inspections verifications required by the enforcing agency or this code. Product Class 1 (≤ 5.0 ozf) 1.00 11. Information from the Department of Forestry and Fire Protection on maintenance of defensible 4.106.4.2.2.1.2 Electric vehicle charging stations (EVCS) dimensions. space around residential structures. **Exception**: Additions and alterations not altering the drainage path. The charging spaces shall be designed to comply with the following: Product Class 2 (> 5.0 ozf and  $\leq$  8.0 ozf) 1.20 12. Information and/or drawings identifying the location of grab bar reinforcements. Product Class 3 (> 8.0 ozf) 4.106.4 Electric vehicle (EV) charging for new construction. New construction shall comply with Sections 1. The minimum length of each EV space shall be 18 feet (5486 mm). 4.410.2 RECYCLING BY OCCUPANTS. Where 5 or more multifamily dwelling units are constructed on a 4.106.4.1 or 4.106.4.2 to facilitate future installation and use of EV chargers. Electric vehicle supply Title 20 Section 1605.3 (h)(4)(A): Commercial prerinse spray values manufactured on or after January building site, provide readily accessible area(s) that serves all buildings on the site and are identified for the equipment (EVSE) shall be installed in accordance with the California Electrical Code, Article 625. 2. The minimum width of each EV space shall be 9 feet (2743 mm). 1, 2006, shall have a minimum spray force of not less than 4.0 ounces-force (ozf)[113 grams-force(gf)] depositing, storage and collection of non-hazardous materials for recycling, including (at a minimum) paper, corrugated cardboard, glass, plastics, organic waster, and metals, or meet a lawfully enacted local recycling 3. One in every 25 charging spaces, but not less than one, shall also have an 8-foot (2438 mm) wide minimum 4.303.2 Submeters for multifamily buildings and dwelling units in mixed-used residential/commercial ordinance, if more restrictive. 1. On a case-by-case basis, where the local enforcing agency has determined EV charging and aisle. A 5-foot (1524 mm) wide minimum aisle shall be permitted provided the minimum width of the EV space is infrastructure are not feasible based upon one or more of the following conditions: Submeters shall be installed to measure water usage of individual rental dwelling units in accordance with the Exception: Rural jurisdictions that meet and apply for the exemption in Public Resources Code Section 1.1 Where there is no local utility power supply or the local utility is unable to supply adequate 42649.82 (a)(2)(A) et seq. are note required to comply with the organic waste portion of a.Surface slope for this EV space and the aisle shall not exceed 1 unit vertical in 48 units horizontal (2.083 1.2 Where there is evidence suitable to the local enforcing agency substantiating that additional **4.303.3 Standards for plumbing fixtures and fittings.** Plumbing fixtures and fittings shall be installed in local utility infrastructure design requirements, directly related to the implementation of Section accordance with the California Plumbing Code, and shall meet the applicable standards referenced in Table 4.106.4, may adversely impact the construction cost of the project. 4.106.4.2.2.1.3 Accessible EV spaces. 1701.1 of the California Plumbing Code. In addition to the requirements in Sections 4.106.4.2.2.1.1 and 4.106.4.2.2.1.2, all EVSE, when installed, shall 2. Accessory Dwelling Units (ADU) and Junior Accessory Dwelling Units (JADU) without additional DIVISION 4.5 ENVIRONMENTAL QUALITY comply with the accessibility provisions for EV chargers in the California Building Code, Chapter 11B, EV ready parking facilities. spaces and EVCS in multifamily developments shall comply with California Building Code, Chapter 11A, Section **SECTION 4.501 GENERAL** THIS TABLE COMPILES THE DATA IN SECTION 4.303.1, AND IS INCLUDED AS A 4.106.4.1 New one- and two-family dwellings and townhouses with attached private garages. For each The provisions of this chapter shall outline means of reducing the quality of air contaminants that are odorous, dwelling unit, install a listed raceway to accommodate a dedicated 208/240-volt branch circuit. The raceway 4.106.4.2.3 EV space requirements. TABLE - MAXIMUM FIXTURE WATER USE rritating and/or harmful to the comfort and well being of a building's installers, occupants and neighbors. 1. Single EV space required. Install a listed raceway capable of accommodating a 208/240-volt dedicated branch shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or other enclosure in close proximity to the circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall FIXTURE TYPE FLOW RATE SECTION 4.502 DEFINITIONS proposed location of an EV charger. Raceways are required to be continuous at enclosed, inaccessible or originate at the main service or subpanel and shall terminate into a listed cabinet, box or enclosure in close concealed areas and spaces. The service panel and/or subpanel shall provide capacity to install a 40-ampere proximity to the location or the proposed location of the EV space. Construction documents shall identify the SHOWER HEADS (RESIDENTIAL) 1.8 GMP @ 80 PSI The following terms are defined in Chapter 2 (and are included here for reference) raceway termination point, receptacle or charger location, as applicable. The service panel and/ or subpanel shall 208/240-volt minimum dedicated branch circuit and space(s) reserved to permit installation of a branch circuit overcurrent protective device. have a 40-ampere minimum dedicated branch circuit, including branch circuit overcurrent protective device AGRIFIBER PRODUCTS. Agrifiber products include wheatboard, strawboard, panel substrates and door MAX. 1.2 GPM @ 60 PSI MIN. 0.8 GPM @ 20 installed, or space(s) reserved to permit installation of a branch circuit overcurrent protective device. LAVATORY FAUCETS (RESIDENTIAL) cores, not including furniture, fixtures and equipment (FF&E) not considered base building elements. Exemption: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the proposed location of an EV charger at the time of original construction in LAVATORY FAUCETS IN COMMON & PUBLIC COMPOSITE WOOD PRODUCTS. Composite wood products include hardwood plywood, particleboard and 0.5 GPM @ 60 PSI accordance with the California Electrical Code. installed in close proximity to the location or the proposed location of the EV space, at the time of original medium density fiberboard. "Composite wood products" does not include hardboard, structural plywood, USE AREAS construction in accordance with the California Electrical Code. structural panels, structural composite lumber, oriented strand board, glued laminated timber, prefabricated 4.106.4.1.1 Identification. The service panel or subpanel circuit directory shall identify the overcurrent KITCHEN FAUCETS 1.8 GPM @ 60 PSI wood I-joists or finger-jointed lumber, all as specified in California Code of regulations (CCR), title 17. Section protective device space(s) reserved for future EV charging as "EV CAPABLE". The raceway termination 2.Multiple EV spaces required. Construction documents shall indicate the raceway termination point and the METERING FAUCETS location shall be permanently and visibly marked as "EV CAPABLE". 0.2 GAL/CYCLE location of installed or future EV spaces, receptacles or EV chargers. Construction documents shall also provide information on amperage of installed or future receptacles or EVSE, raceway method(s), wiring schematics and DIRECT-VENT APPLIANCE. A fuel-burning appliance with a sealed combustion system that draws all air for WATER CLOSET 1.28 GAL/FLUSH electrical load calculations. Plan design shall be based upon a 40-ampere minimum branch circuit. Required combustion from the outside atmosphere and discharges all flue gases to the outside atmosphere raceways and related components that are planned to be installed underground, enclosed, inaccessible or in 0.125 GAL/FLUSH

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

ncealed areas and spaces shall be installed at the time of original construction.


4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

OWNER:

JUAN ROSAS 11461 CLAYTON RD SAN JOSE, CA 95127 (650) 704-0520

LERIKA LISCANO **4750 ALMADEN EXPY** STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

RESIDENCE

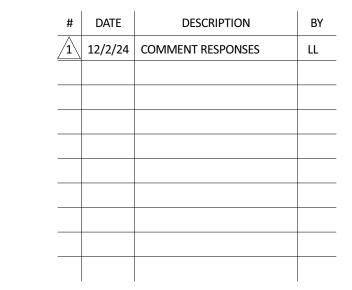



## California 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

	RESIDENTIAL	MAN	DATORY MEASURES,	SHE	ET :	<b>2</b> (January 2023)		Y = YES  N/A = NOT APPLICABLE  RESPON. PARTY = RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)
Y N/A RESPON. PARTY		Y N/A RESPON. PARTY	•	Y	N/A RESPON.		Y N/A RESPO	N.
				_		l i		CHARTER 7
MA	XIMUM INCREMENTAL REACTIVITY (MIR). The maximum change in weight of ozone formed by adding a npound to the "Base Reactive Organic Gas (ROG) Mixture" per weight of compound added, expressed to		TABLE 4.504.2 - SEALANT VOC LIMIT  (Less Water and Less Exempt Compounds in Grams per Liter)	4 1		TABLE 4.504.5 - FORMALDEHYDE LIMITS		CHAPTER 7 INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS
hun Not	ndredths of a gram (g O³/g ROC). te: MIR values for individual compounds and hydrocarbon solvents are specified in CCR, Title 17, Sections 94700		SEALANTS VOC LIMIT			MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION PRODUCT CURRENT LIMIT		702 QUALIFICATIONS
	d 94701.  DISTURE CONTENT. The weight of the water in wood expressed in percentage of the weight of the oven-dry wood.		ARCHITECTURAL 250 MARINE DECK 760			HARDWOOD PLYWOOD VENEER CORE 0.05 HARDWOOD PLYWOOD COMPOSITE CORE 0.05		702.1 INSTALLER TRAINING. HVAC system installers shall be trained and certified in the proper installation of HVAC systems including ducts and equipment by a nationally or regionally recognized training or certification program. Uncertified persons may perform HVAC installations when under the direct supervision and
PR	ODUCT-WEIGHTED MIR (PWMIR). The sum of all weighted-MIR for all ingredients in a product subject to this		NONMEMBRANE ROOF 300			PARTICLE BOARD 0.09		responsibility of a person trained and certified to install HVAC systems or contractor licensed to install HVAC systems. Examples of acceptable HVAC training and certification programs include but are not limited to the following:
pro	cle. The PWMIR is the total product reactivity expressed to hundredths of a gram of ozone formed per gram of duct (excluding container and packaging). te: PWMIR is calculated according to equations found in CCR, Title 17, Section 94521 (a).		ROADWAY 250 SINGLE-PLY ROOF MEMBRANE 450			MEDIUM DENSITY FIBERBOARD 0.11  THIN MEDIUM DENSITY FIBERBOARD2 0.13		State certified apprenticeship programs.     Public utility training programs.
	ACTIVE ORGANIC COMPOUND (ROC). Any compound that has the potential, once emitted, to contribute to one formation in the troposphere.		OTHER 420			VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED		<ol> <li>Training programs sponsored by trade, labor or statewide energy consulting or verification organizations.</li> <li>Programs sponsored by manufacturing organizations.</li> <li>Other programs acceptable to the enforcing agency.</li> </ol>
vo	C. A volatile organic compound (VOC) broadly defined as a chemical compound based on carbon chains or rings		SEALANT PRIMERS  ARCHITECTURAL			BY THE CALIF. AIR RESOURCES BOARD, AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD AS TESTED IN ACCORDANCE WITH ASTM E 1333. FOR ADDITIONAL INFORMATION. SEE CALIF.		702.2 SPECIAL INSPECTION [HCD]. When required by the enforcing agency, the owner or the
hyd	h vapor pressures greater than 0.1 millimeters of mercury at room temperature. These compounds typically contain drogen and may contain oxygen, nitrogen and other elements. See CCR Title 17, Section 94508(a).		NON-POROUS 250			CODE OF REGULATIONS, TITLE 17, SECTIONS 93120 THROUGH 93120.12.		responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition to
□ □ 4.5	503 FIREPLACES 03.1 GENERAL. Any installed gas fireplace shall be a direct-vent sealed-combustion type. Any installed odstove or pellet stove shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as		POROUS 775 MODIFIED BITUMINOUS 500			2. THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF 5/16" (8 MM).		other certifications or qualifications acceptable to the enforcing agency, the following certifications or education may be considered by the enforcing agency when evaluating the qualifications of a special inspector:
арр	obstove of peliet stove small comply with 0.5. EPA New Source Performance Standards (NSPS) emission limits as oblicable, and shall have a permanent label indicating they are certified to meet the emission limits. Woodstoves, let stoves and fireplaces shall also comply with applicable local ordinances.		MARINE DECK 760			DIVISION 4.5 ENVIRONMENTAL QUALITY (continued)		<ol> <li>Certification by a national or regional green building program or standard publisher.</li> <li>Certification by a statewide energy consulting or verification organization, such as HERS raters, building</li> </ol>
4.5	504 POLLUTANT CONTROL 04.1 COVERING OF DUCT OPENINGS & PROTECTION OF MECHANICAL EQUIPMENT DURING		OTHER 750	<b>」</b>		<b>4.504.3 CARPET SYSTEMS.</b> All carpet installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions		<ul> <li>performance contractors, and home energy auditors.</li> <li>3. Successful completion of a third party apprentice training program in the appropriate trade.</li> <li>4. Other programs acceptable to the enforcing agency.</li> </ul>
CO	INSTRUCTION. At the time of rough installation, during storage on the construction site and until final rtup of the heating, cooling and ventilating equipment, all duct and other related air distribution component					from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)		Notes:
red	enings shall be covered with tape, plastic, sheet metal or other methods acceptable to the enforcing agency to uce the amount of water, dust or debris which may enter the system.					See California Department of Public Health's website for certification programs and testing labs.		<ol> <li>Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.</li> <li>HERS raters are special inspectors certified by the California Energy Commission (CEC) to rate</li> </ol>
	04.2 FINISH MATERIAL POLLUTANT CONTROL. Finish materials shall comply with this section. 4.504.2.1 Adhesives, Sealants and Caulks. Adhesives, sealant and caulks used on the project shall meet the		TABLE 4.504.3 - VOC CONTENT LIMITS FOR	<b>1</b>		https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx.  4.504.3.1 Carpet cushion. All carpet cushion installed in the building interior shall meet the requirements of the		homes in California according to the Home Energy Rating System (HERS).  [BSC] When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall
	requirements of the following standards unless more stringent local or regional air pollution or air quality management district rules apply:		ARCHITECTURAL COATINGS <sub>2,3</sub> GRAMS OF VOC PER LITER OF COATING, LESS WATER & LESS EXEMPT	- I		California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)		employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the
	Adhesives, adhesive bonding primers, adhesive primers, sealants, sealant primers and caulks shall comply with local or regional air pollution control or air quality management district rules where		COMPOUNDS  COATING CATEGORY  VOC LIMIT	- I		(Emission testing method for California Specification 01350)  See California Department of Public Health's website for certification programs and testing labs.		particular type of inspection or task to be performed. In addition, the special inspector shall have a certification from a recognized state, national or international association, as determined by the local agency. The area of certification shall be closely related to the primary job function, as determined by the local agency.
	applicable or SCAQMD Rule 1168 VOC limits, as shown in Table 4.504.1 or 4.504.2, as applicable. Such products also shall comply with the Rule 1168 prohibition on the use of certain toxic		FLAT COATINGS 50	1		https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx.		Note: Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.
	compounds (chloroform, ethylene dichloride, methylene chloride, perchloroethylene and tricloroethylene), except for aerosol products, as specified in Subsection 2 below.		NON-FLAT COATINGS 100  NONFLAT-HIGH GLOSS COATINGS 150			4.504.3.2 Carpet adhesive. All carpet adhesive shall meet the requirements of Table 4.504.1.		
	<ol><li>Aerosol adhesives, and smaller unit sizes of adhesives, and sealant or caulking compounds (in units of product, less packaging, which do not weigh more than 1 pound and do not consist of more than 16 fluid ounces) shall comply with statewide VOC standards and other requirements, including</li></ol>		SPECIALTY COATINGS	1 F		<ul> <li>4.504.4 RESILIENT FLOORING SYSTEMS. Where resilient flooring is installed, at least 80% of floor area receiving resilient flooring shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers,"</li> </ul>		703 VERIFICATIONS 703.1 DOCUMENTATION. Documentation used to show compliance with this code shall include but is not
	prohibitions on use of certain toxic compounds, of <i>California Code of Regulations</i> , Title 17, commencing with section 94507.		ALUMINUM ROOF COATINGS 400  BASEMENT SPECIALTY COATINGS 400	- 1		Version 1.2, January 2017 (Emission testing method for California Specification 01350)  See California Department of Public Health's website for certification programs and testing labs.		limited to, construction documents, plans, specifications, builder or installer certification, inspection reports, or other methods acceptable to the enforcing agency which demonstrate substantial conformance. When specific documentation or special inspection is necessary to verify compliance, that method of compliance will be specified in
	<b>4.504.2.2 Paints and Coatings.</b> Architectural paints and coatings shall comply with VOC limits in Table 1 of the ARB Architectural Suggested Control Measure, as shown in Table 4.504.3, unless more stringent local limits		BITUMINOUS ROOF COATINGS 50	1 <b>I</b>		hhtps://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx.		the appropriate section or identified applicable checklist.
	apply. The VOC content limit for coatings that do not meet the definitions for the specialty coatings categories listed in Table 4.504.3 shall be determined by classifying the coating as a Flat, Nonflat or Nonflat-High Gloss coating, based on its gloss, as defined in subsections 4.21, 4.36, and 4.37 of the 2007 California Air Resources		BITUMINOUS ROOF PRIMERS 350  BOND BREAKERS 350	-		4.504.5 COMPOSITE WOOD PRODUCTS. Hardwood plywood, particleboard and medium density fiberboard		
	Board, Suggested Control Measure, and the corresponding Flat, Nonflat or Nonflat-High Gloss VOC limit in Table 4.504.3 shall apply.		CONCRETE CURING COMPOUNDS 350	<u> </u>		composite wood products used on the interior or exterior of the buildings shall meet the requirements for formaldehyde as specified in ARB's Air Toxics Control Measure for Composite Wood (17 CCR 93120 et seq.), by or before the dates specified in those sections, as shown in Table 4.504.5		
	<b>4.504.2.3 Aerosol Paints and Coatings.</b> Aerosol paints and coatings shall meet the Product-weighted MIR Limits for ROC in Section 94522(a)(2) and other requirements, including prohibitions on use of certain toxic		CONCRETE/MASONRY SEALERS 100 DRIVEWAY SEALERS 50	-		4.504.5.1 Documentation. Verification of compliance with this section shall be provided as requested		
	compounds and ozone depleting substances, in Sections 94522(e)(1) and (f)(1) of California Code of Regulations, Title 17, commencing with Section 94520; and in areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation		DRY FOG COATINGS 150	1 1		by the enforcing agency. Documentation shall include at least one of the following:  1. Product certifications and specifications.		
	8, Rule 49.		FAUX FINISHING COATINGS 350  FIRE RESISTIVE COATINGS 350	- I		<ol> <li>Chain of custody certifications.</li> <li>Product labeled and invoiced as meeting the Composite Wood Products regulation (see CCR, Title 17, Section 93120, et seg.).</li> </ol>		
	4.504.2.4 Verification. Verification of compliance with this section shall be provided at the request of the enforcing agency. Documentation may include, but is not limited to, the following:		FLOOR COATINGS 100	]		<ol> <li>Exterior grade products marked as meeting the PS-1 or PS-2 standards of the Engineered Wood Association, the Australian AS/NZS 2269, European 636 3S standards, and Canadian CSA</li> </ol>		
	<ol> <li>Manufacturer's product specification.</li> <li>Field verification of on-site product containers.</li> </ol>		FORM-RELEASE COMPOUNDS 250 GRAPHIC ARTS COATINGS (SIGN PAINTS) 500	- I		0121, CSA 0151, CSA 0153 and CSA 0325 standards. 5. Other methods acceptable to the enforcing agency.		
			HIGH TEMPERATURE COATINGS 420 INDUSTRIAL MAINTENANCE COATINGS 250	]		4.505 INTERIOR MOISTURE CONTROL		
	TABLE 4.504.1 - ADHESIVE VOC LIMIT <sub>1,2</sub> (Less Water and Less Exempt Compounds in Grams per Liter)		LOW SOLIDS COATINGS 230  LOW SOLIDS COATINGS1 120	<b>_</b> _		<b>4.505.1 General.</b> Buildings shall meet or exceed the provisions of the California Building Standards Code.		
	ARCHITECTURAL APPLICATIONS VOC LIMIT		MAGNESITE CEMENT COATINGS 450  MASTIC TEXTURE COATINGS 100	-		4.505.2 CONCRETE SLAB FOUNDATIONS. Concrete slab foundations required to have a vapor retarder by California Building Code, Chapter 19, or concrete slab-on-ground floors required to have a vapor retarder by the California Residential Code, Chapter 5, shall also comply with this section.		
	INDOOR CARPET ADHESIVES 50  CARPET PAD ADHESIVES 50		METALLIC PIGMENTED COATINGS 500	<u> </u>		4.505.2.1 Capillary break. A capillary break shall be installed in compliance with at least one of the following:		
	OUTDOOR CARPET ADHESIVES 150		MULTICOLOR COATINGS 250 PRETREATMENT WASH PRIMERS 420	- 1		A 4-inch (101.6 mm) thick base of 1/2 inch (12.7mm) or larger clean aggregate shall be provided with		
	WOOD FLOORING ADHESIVES 100 RUBBER FLOOR ADHESIVES 60		PRIMERS, SEALERS, & UNDERCOATERS 100	<u> </u>		a vapor barrier in direct contact with concrete and a concrete mix design, which will address bleeding, shrinkage, and curling, shall be used. For additional information, see American Concrete Institute, ACI 302.2R-06.		
	SUBFLOOR ADHESIVES 50		REACTIVE PENETRATING SEALERS 350 RECYCLED COATINGS 250	- I		<ol> <li>Other equivalent methods approved by the enforcing agency.</li> <li>A slab design specified by a licensed design professional.</li> </ol>		
	CERAMIC TILE ADHESIVES 65  VCT & ASPHALT TILE ADHESIVES 50		ROOF COATINGS 50	<u> </u>		4.505.3 MOISTURE CONTENT OF BUILDING MATERIALS. Building materials with visible signs of water damage shall not be installed. Wall and floor framing shall not be enclosed when the framing members exceed 19 percent		
	DRYWALL & PANEL ADHESIVES 50		RUST PREVENTATIVE COATINGS 250 SHELLACS	- I		moisture content. Moisture content shall be verified in compliance with the following:  1. Moisture content shall be determined with either a probe-type or contact-type moisture meter. Equivalent		
	COVE BASE ADHESIVES 50  MULTIPURPOSE CONSTRUCTION ADHESIVE 70		CLEAR 730	1 <b>I</b>		moisture verification methods may be approved by the enforcing agency and shall satisfy requirements found in Section 101.8 of this code.  2. Moisture readings shall be taken at a point 2 feet (610 mm) to 4 feet (1219 mm) from the grade stamped end		
	STRUCTURAL GLAZING ADHESIVES 100		OPAQUE 550  SPECIALTY PRIMERS, SEALERS & 100	- I		of each piece verified.  3. At least three random moisture readings shall be performed on wall and floor framing with documentation		
	SINGLE-PLY ROOF MEMBRANE ADHESIVES 250 OTHER ADHESIVES NOT LISTED 50		UNDERCOATERS 100 STAINS 250	- I		acceptable to the enforcing agency provided at the time of approval to enclose the wall and floor framing.  Insulation products which are visibly wet or have a high moisture content shall be replaced or allowed to dry prior to		
	SPECIALTY APPLICATIONS		STONE CONSOLIDANTS 450	] <b> </b>		enclosure in wall or floor cavities. Wet-applied insulation products shall follow the manufacturers' drying recommendations prior to enclosure.		
	PVC WELDING 510 CPVC WELDING 490		SWIMMING POOL COATINGS 340 TRAFFIC MARKING COATINGS 100	┨		4.506 INDOOR AIR QUALITY AND EXHAUST 4.506.1 Bathroom exhaust fans. Each bathroom shall be mechanically ventilated and shall comply with the		
	ABS WELDING 325		TUB & TILE REFINISH COATINGS 420			following:  1. Fans shall be ENERGY STAR compliant and be ducted to terminate outside the building.		
	PLASTIC CEMENT WELDING 250 ADHESIVE PRIMER FOR PLASTIC 550		WATERPROOFING MEMBRANES 250 WOOD COATINGS 275	<u> </u>		Unless functioning as a component of a whole house ventilation system, fans must be controlled by a humidity control.		
	CONTACT ADHESIVE 80  SPECIAL PURPOSE CONTACT ADHESIVE 250		WOOD PRESERVATIVES 350 ZINC-RICH PRIMERS 340	] [		<ul> <li>Humidity controls shall be capable of adjustment between a relative humidity range less than or equal to 50% to a maximum of 80%. A humidity control may utilize manual or automatic means of</li> </ul>		
	SPECIAL PURPOSE CONTACT ADHESIVE 250  STRUCTURAL WOOD MEMBER ADHESIVE 140		GRAMS OF VOC PER LITER OF COATING, INCLUDING WATER & EXEMPT COMPOUNDS	<b> </b>		adjustment.  b. A humidity control may be a separate component to the exhaust fan and is not required to be integral (i.e., built-in)		
	TOP & TRIM ADHESIVE 250 SUBSTRATE SPECIFIC APPLICATIONS		2. THE SPECIFIED LIMITS REMAIN IN EFFECT UNLESS REVISED LIMITS ARE LISTED IN SUBSEQUENT COLUMNS IN THE TABLE.			Notes:		
	METAL TO METAL 30		3. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, ARCHITECTURAL COATINGS			For the purposes of this section, a bathroom is a room which contains a bathtub, shower or tub/shower combination.		
	PLASTIC FOAMS 50 POROUS MATERIAL (EXCEPT WOOD) 50		SUGGESTED CONTROL MEASURE, FEB. 1, 2008. MORE INFORMATION IS AVAILABLE FROM THE AIR RESOURCES BOARD.			Lighting integral to bathroom exhaust fans shall comply with the California Energy Code.  4.507 ENVIRONMENTAL COMFORT		
	WOOD 30					4.507.2 HEATING AND AIR-CONDITIONING SYSTEM DESIGN. Heating and air conditioning systems shall be sized, designed and have their equipment selected using the following methods:		
	FIBERGLASS 80					<ol> <li>The heat loss and heat gain is established according to ANSI/ACCA 2 Manual J - 2011 (Residential Load Calculation), ASHRAE handbooks or other equivalent design software or methods.</li> </ol>		
	1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER,					<ol> <li>Duct systems are sized according to ANSI/ACCA 1 Manual D - 2014 (Residential Duct Systems),         ASHRAE handbooks or other equivalent design software or methods.</li> <li>Select heating and cooling equipment according to ANSI/ACCA 3 Manual S - 2014 (Residential</li> </ol>		
	THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED.  2. FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE					Equipment Selection), or other equivalent design software or methods.		
	THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168.					Exception: Use of alternate design temperatures necessary to ensure the system functions are acceptable.		

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

**VYLCO** 

SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM


JUAN ROSAS 11461 CLAYTON RD, SAN JOSE, CA 95127 (650) 704-0520

LERIKA LISCANO 4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

**NEW SINGLE FAMILY RESIDENCE** 

1\ 12/2/24 | COMMENT RESPONSES

**CALGREEN SHEET** 

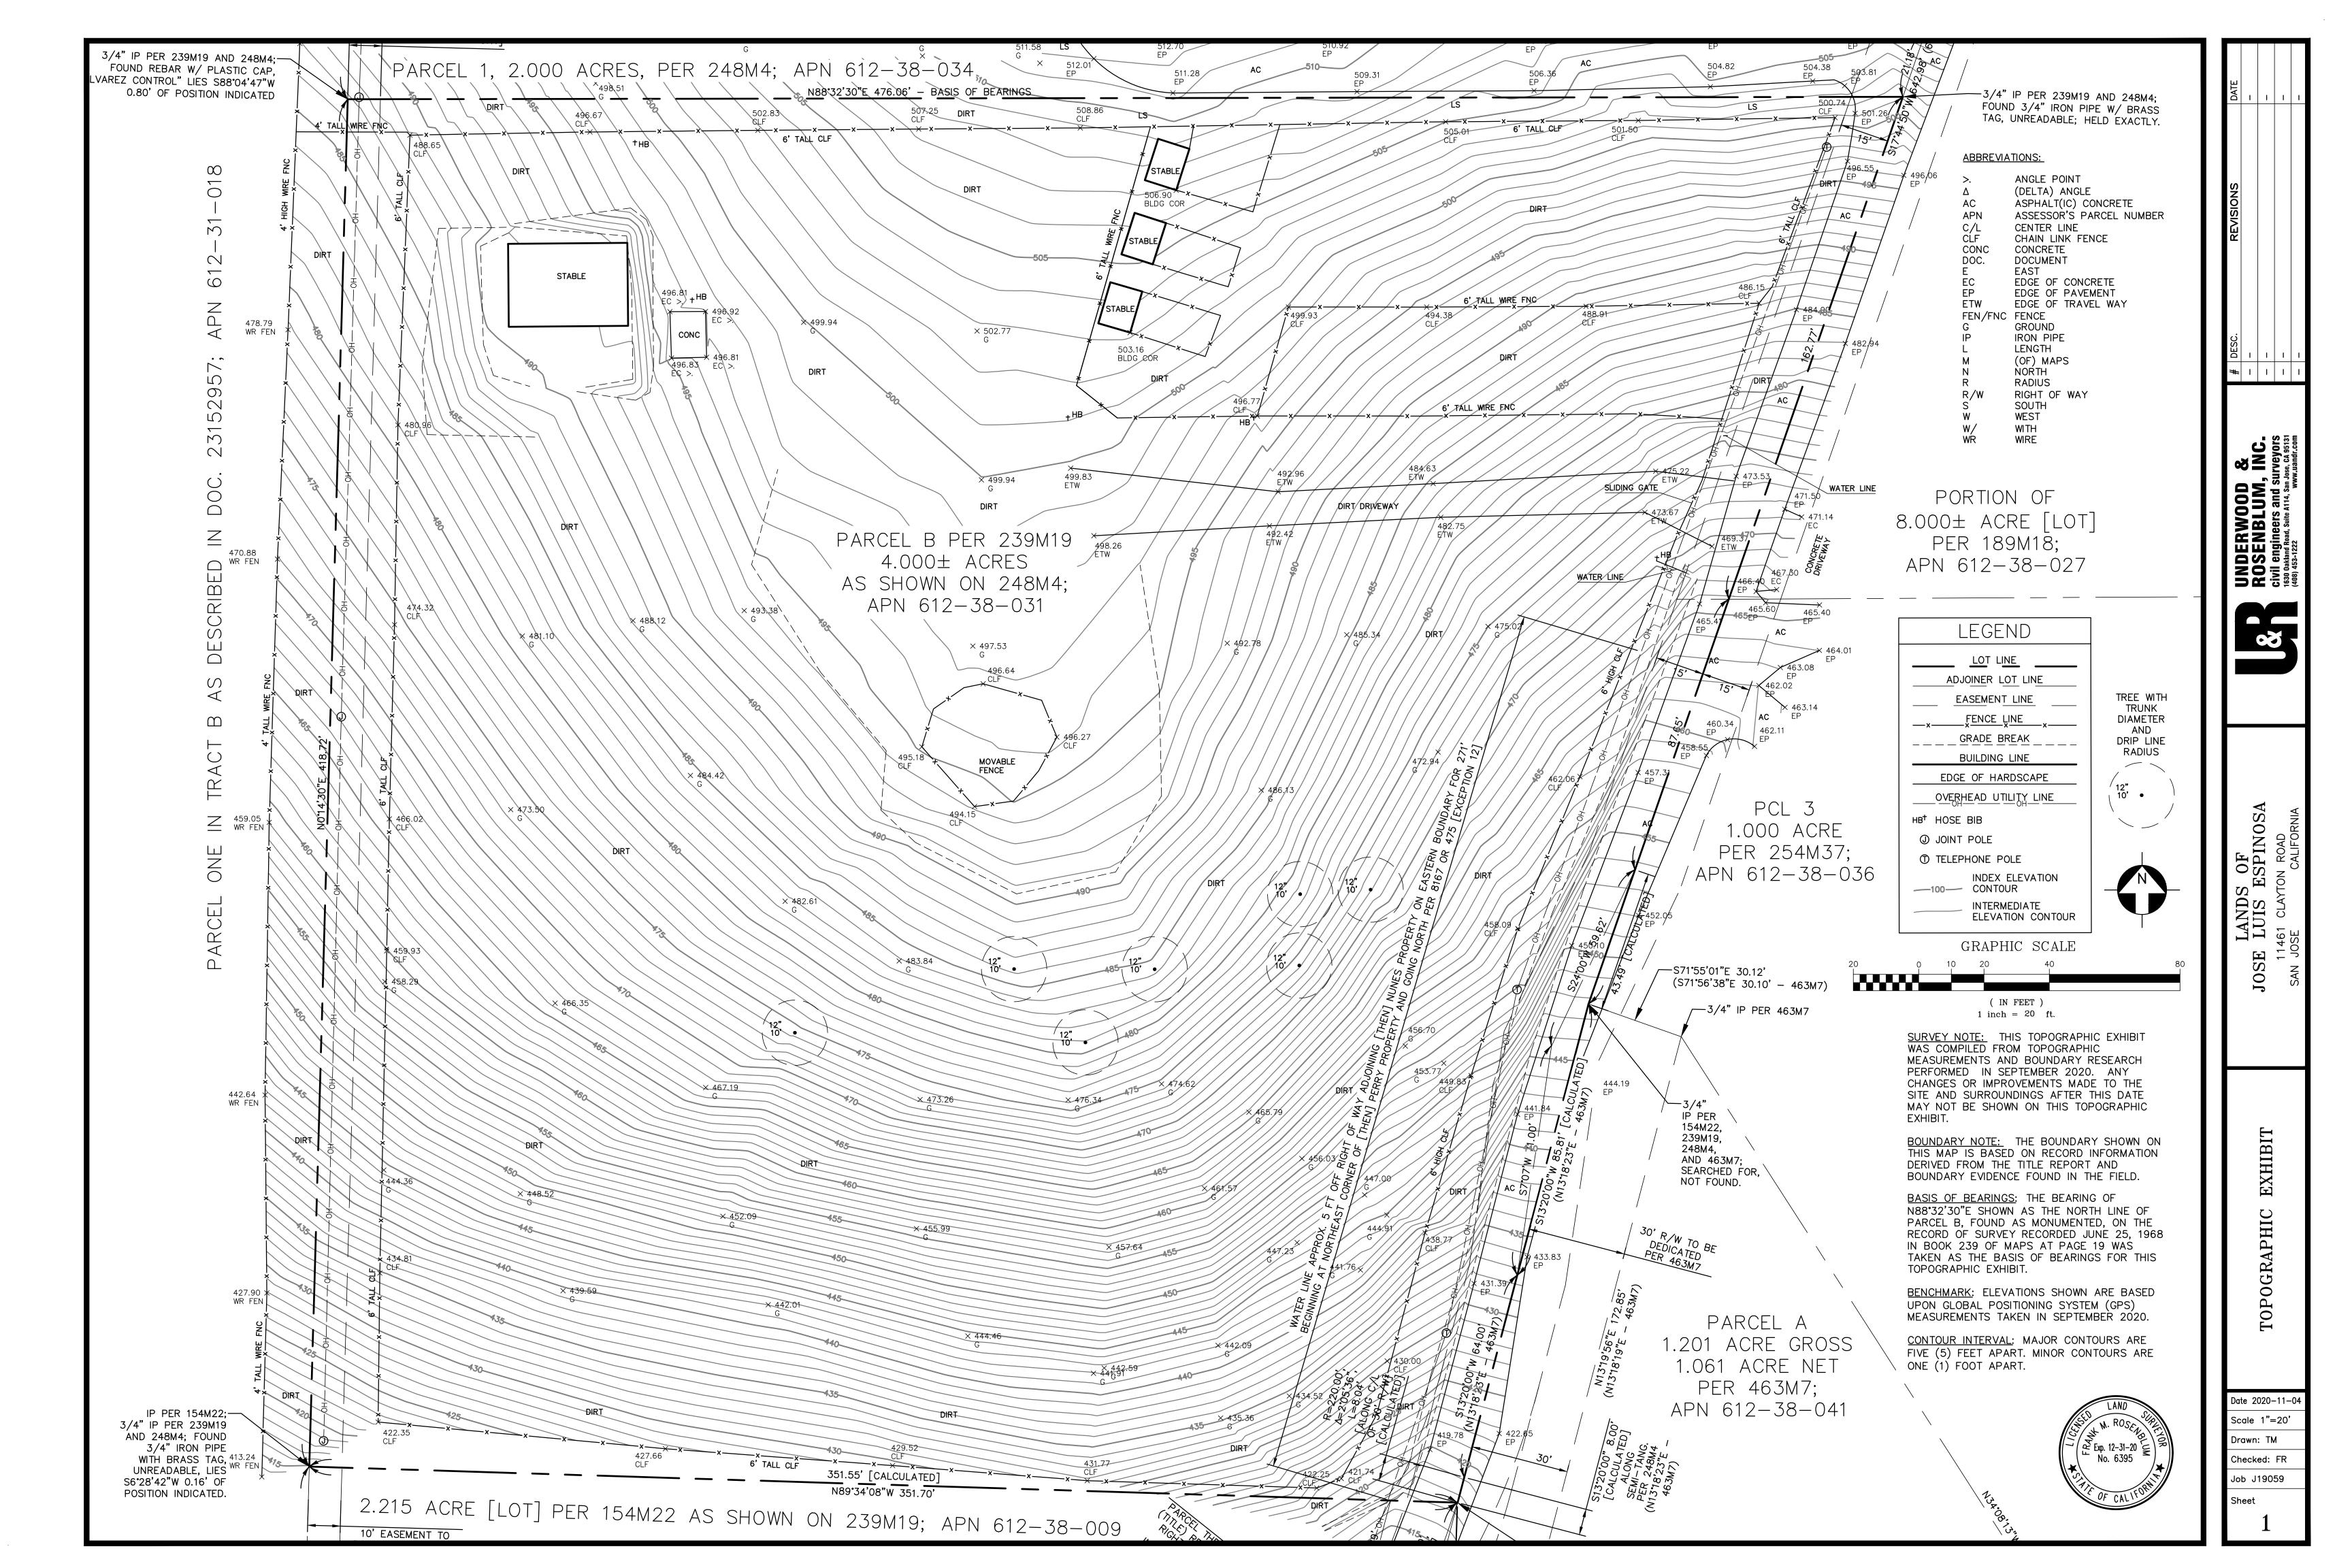

#### GRADING & DRAINAGE NOTES:

#### NOTE: THIS DRAWING IS APPROVED SUBJECT TO:

- 1. ALL GRADING IS SUBJECT TO OBSERVATION BY THE CITY. PERMITTEE OR REPRESENTATIVE SHALL NOTIFY THE CITY OF SAN JOSE DEPARTMENT OF PUBLIC WORKS PROJECT INSPECTOR AT LEAST 48 HOURS BEFORE START OF ANY
- APPROVAL OF THIS PLAN APPLIES ONLY TO (A) THE EXCAVATION, PLACEMENT, AND COMPACTION OF NATURAL EARTH MATERIALS, (B) THE INSTALLATION OF ON-SITE (I.E. PRIVATE PROPERTY) STORM WATER CONVEYANCE AND TREATMENT FACILITIES THAT ARE OUTSIDE OF THE 5-FOOT BUILDING ENVELOPE, AND (C) THE INSTALLATION OF RETAINING STRUCTURES. THIS APPROVAL DOES NOT CONFER ANY RIGHTS OF ENTRY TO EITHER PUBLIC PROPERTY OR THE PRIVATE PROPERTY OF OTHERS. APPROVAL OF THIS PLAN ALSO DOES NOT CONSTITUTE APPROVAL OF ANY IMPROVEMENTS WITH THE EXCEPTION OF THOSE LISTED ABOVE. PROPOSED IMPROVEMENTS, WITH THE EXCEPTION OF THOSE LISTED ABOVE, ARE SUBJECT TO REVIEW AND APPROVAL BY THE RESPONSIBLE AUTHORITIES AND ALL OTHER REQUIRED PERMITS SHALL BE OBTAINED.
- UNLESS OTHERWISE NOTED ON THE PLAN, ANY DEPICTION OF A RETAINING STRUCTURE ON THIS PLAN SHALL NOT CONSTITUTE APPROVAL FOR CONSTRUCTION OF THE RETAINING STRUCTURE UNLESS A SEPARATE STRUCTURAL REVIEW, BY THE DEPARTMENT OF PUBLIC WORKS IS COMPLETED AND APPROVED.
- 4. IT SHALL BE THE RESPONSIBILITY OF THE PERMITTEE OR AGENT TO IDENTIFY, LOCATE AND PROTECT ALL UNDERGROUND FACILITIES.
- THE PERMITTEE OR AGENT SHALL MAINTAIN THE STREETS, SIDEWALKS AND ALL OTHER PUBLIC RIGHTS-OF-WAY IN A CLEAN, SAFE AND USABLE CONDITION. ALL SPILLS OF SOIL, ROCK OR CONSTRUCTION DEBRIS SHALL BE REMOVED FROM THE PUBLICLY OWNED PROPERTY DURING CONSTRUCTION AND UPON COMPLETION OF THE PROJECT. ALL ADJACENT PROPERTY, PRIVATE OR PUBLIC SHALL BE MAINTAINED IN A CLEAN, SAFE AND USABLE CONDITION.
- ALL GRADING SHALL BE PERFORMED IN SUCH A MANNER AS TO COMPLY WITH THE STANDARDS ESTABLISHED BY THE AIR QUALITY MANAGEMENT DISTRICT FOR
- 7. IN THE EVENT THAT HUMAN REMAINS AND/OR CULTURAL MATERIALS ARE FOUND, ALL PROJECT-RELATED CONSTRUCTION SHOULD CEASE WITHIN A 100-FOOT RADIUS. THE CONTRACTOR SHALL, PURSUANT TO SECTION 7050.5 OF THE HEALTH AND SAFETY CODE, AND SECTION 5097.94 OF THE PUBLIC RESOURCES CODE OF THE STATE OF CALIFORNIA, NOTIFY THE MARIN COUNTY CORONER
- THIS PLAN DOES NOT APPROVE THE REMOVAL OF TREES. APPROPRIATE TREE REMOVAL PERMITS AND METHODS OF TREE PRESERVATION SHOULD BE OBTAINED FROM THE CITY'S PLANNING DEPARTMENT AND THE CITY ARBORIST.
- FOR NON-RESIDENTIAL PROJECTS, ANY NON-HAZARDOUS EXPORT RESULTING FROM PROJECT RELATED EXCAVATION OR LAND CLEARING SHALL BE 100% REUSED AND RECYCLED PER CALIFORNIA GREEN BUILDING STANDARDS CODE SECTION 5.408.
- 10. ALL GRADING WORK SHALL CONFORM TO THE RECOMMENDATIONS OF THE PROJECT GEOTECHNICAL REPORT AND/OR THE PROJECT SOIL ENGINEER. ALL GRADING WORK SHALL BE OBSERVED AND APPROVED BY THE SOIL ENGINEER. REPORT NUMBER: SOILS ENGINEERING COMPANY:
- CONTACT INFORMATION:
- 11. THE SOIL ENGINEER SHALL BE NOTIFIED AT LEAST 48 HOURS BEFORE BEGINNING ANY GRADING. UNOBSERVED AND/OR UNAPPROVED GRADING WORK SHALL BE REMOVED AND REPLACED UNDER ÓBSERVATION.
- 12. PERIMETER BUILDING GRADES SHALL SLOPE AWAY FROM BUILDINGS AT LEAST 5%
- 13. ALL DOWNSPOUTS SHALL HAVE SPLASH BOXES AS SHOWN ON THE GRADING
- BENCH MARK
- ALL TOPOGRAPHIC FEATURES AND ELEVATIONS HAD BEEN TAKEN FROM SURVEYS BY OTHERS, PROVIDED BY THE OWNER

## EARTH WORK QUANTITIES

CUT: <u>1721 CY</u> FILL: <u>1019 CY</u>

EXPORT: 702 CY IMPORT: 0 CY

NOTE: EARTHWORK QUANTITIES SHOWN ARE APPROXIMATE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO INDEPENDENTLY ESTIMATE QUANTITIES FOR HIS/HER OWN USE. THE PAD OF THE HOUSE IS NOT INCLUDED


#### *ABBREVATIONS*


BS = BOTTOM OF STAIR  BU = BUBBLE UP  BVC = BEGIN VERTICAL CURVE  BRW = BOTTOM OF RETAINED GRADE AT WALL  CB = CATCH BASIN  CL = CENTERLINE  CO = CLEANOUT  DS = DOWNSPOUT WITH SPLASH BOX  EC = END CURVE  ELEV. = ELEVATION  EVC = END VERTICAL CURVE  EX. = EXISTING  F/C = FACE OF CURB	PL = PROPERTY LINE PV = PAVEMENT GRADE PVC = POLYVINYL CHLORIDE PIPE PVI = POINT OF VERTICAL INTERSECTION RCP = REINFORCED CONCRETE PIPE ROW = RIGHT OF WAY S=.004> SLOPE SD = STORM DRAIN SDMH = STORM DRAIN MANHOLE SG = SUBGRADE ELEVATION SS = SANITARY SEWER SSMH = SANITARY SEWER MANHOLE STA = STATION TC = TOP OF CURB TF = TOP OF FENCE
FF = FINISHED FLOOR ELEVATION FH = FIRE HYDRANT	TF = TOP OF FENCE TRW = TOP OF RETAINED GRADE AT WALI
FL = FLOW LINE GB = GRADE BREAK GFF = GARAGE FINISH FLOOR	TS = TOP OF STAIR  TW = TOP OF WALL  VCP = VITRIFIED CLAY PIPE
HP = HIGH POINT HC = HANDICAP UNIT INV = INVERT	WM = WATER METER WV = WATER VALVE

## GRADING AND DRAINAGE PLAN

11461 CLAYTON RD, SAN JOSE, CA 95127

APN: 612-38-031

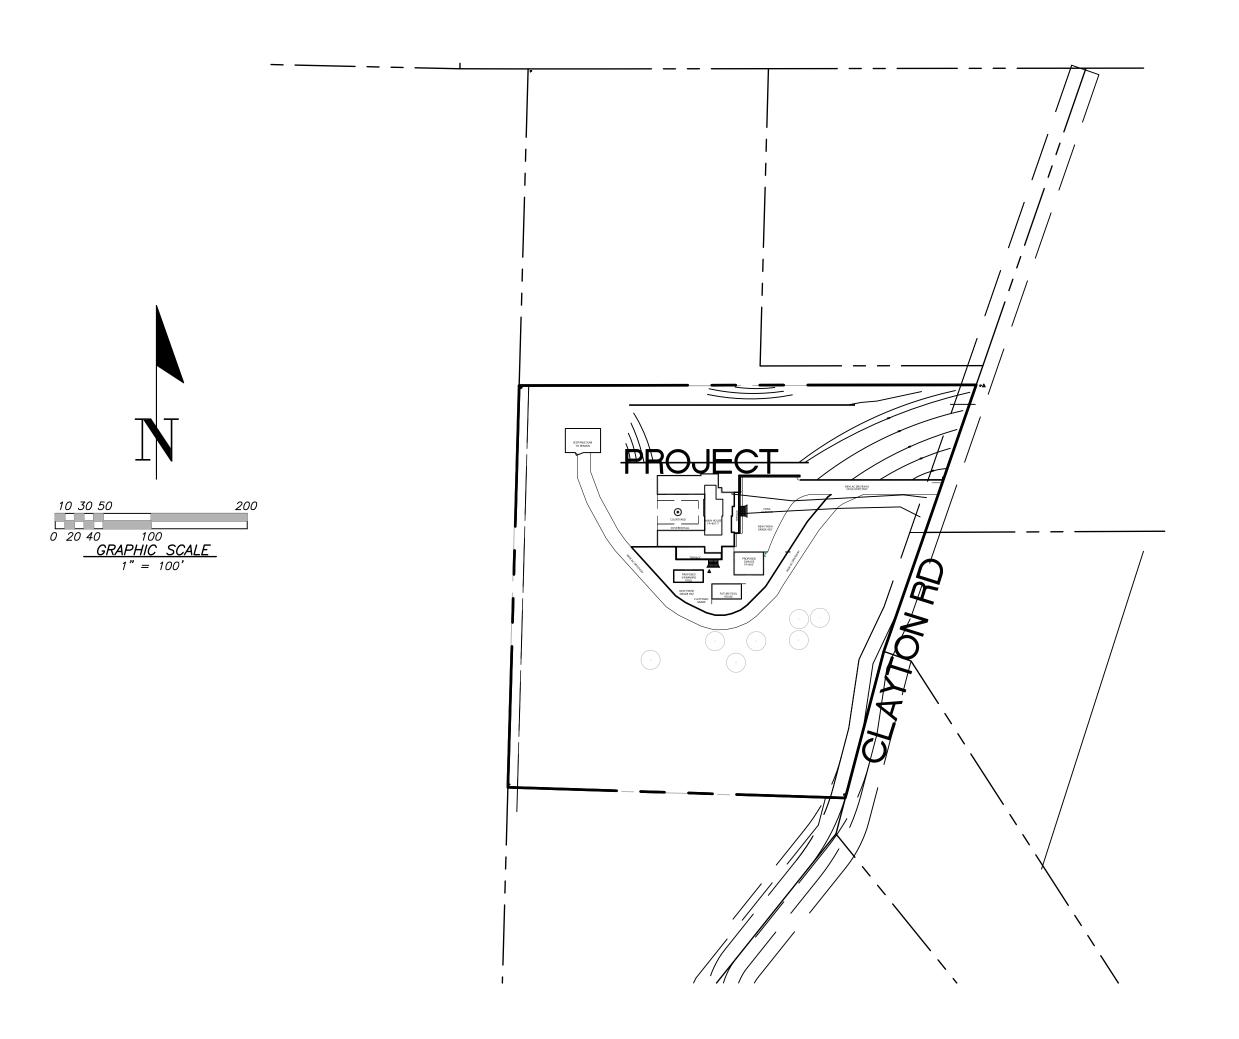

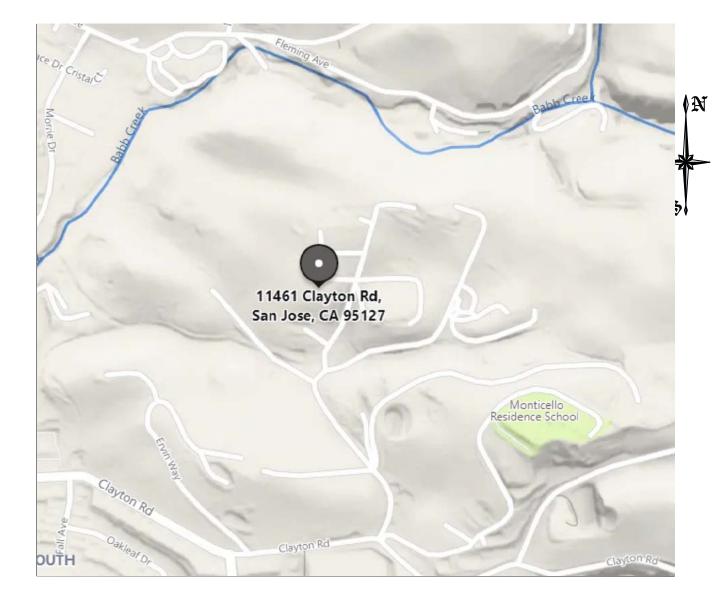



## LOCATION MAP

#### LEGEND

DESCRIPTION	SYMBOL
BOUNDARY LINE	
LOT LINE	
EASEMENT LINE	
SIDEWALK	
WOOD FENCE	xx
CHAIN LINK FENCE	<del></del>
RETAINING WALL	0 0
DRIVEWAY DRAIN INLET	
AREA DRAIN	
DROP INLET	
MONUMENT	
FIRE HYDRANT	
ELECTROLIER	<u> </u>
WATER METER	<b>≥</b>
AC UNIT	
SANITARY SEWER LATERAL	•— —
STORM DRAIN	—— SD <del>——</del>
SANITARY SEWER	—— ss ——
STREET LIGHT CONDUITS	—— SL ——
WATER	—— w ——
JOINT TRENCH	—— JT ——
HOUSE SERVICE	——————————————————————————————————————
SLOPE ARROW	
EXISTING CONTOUR	- <b>—</b> - 100 - <b>—</b> -
PROPOSED CONTOUR	
OVERLAND RELEASE	
DIRECTION OF SURFACE DRAINIAGE	<del></del>
5% SLOPE AWAY FROM BUILDING	<i>&gt;&gt;</i>
GAS LINE	GAS
OVERHEAD ELECTRICAL LINE	——OE———
UNDERGROUND ELECTRICAL LINE	UE
DOWNSPOUTS W/SPLASH BOX	
TREE TO BE REMOVED	
ADJECENT GRADE	AG
AGGREGATE BASE (AB)	
ASPHALT PAVEMENT (AC)	

SHEET INDEX					
COVER SHEET	CO				
GRADING AND DRAINAGE PLAN	CI				
CONSTRUCTION DETAILS	C2				
EROSION AND SEDIMENT CONTROL PL	AN C3				
BEST MANAGEMENT PRACTICES (BMP	SHEET) C4				

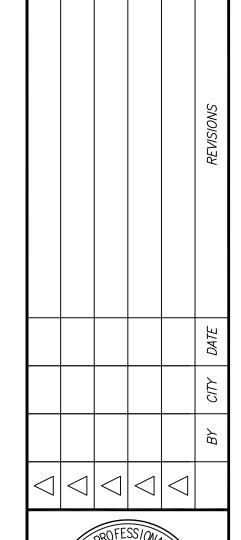










SHEET

OF 5 SHEETS

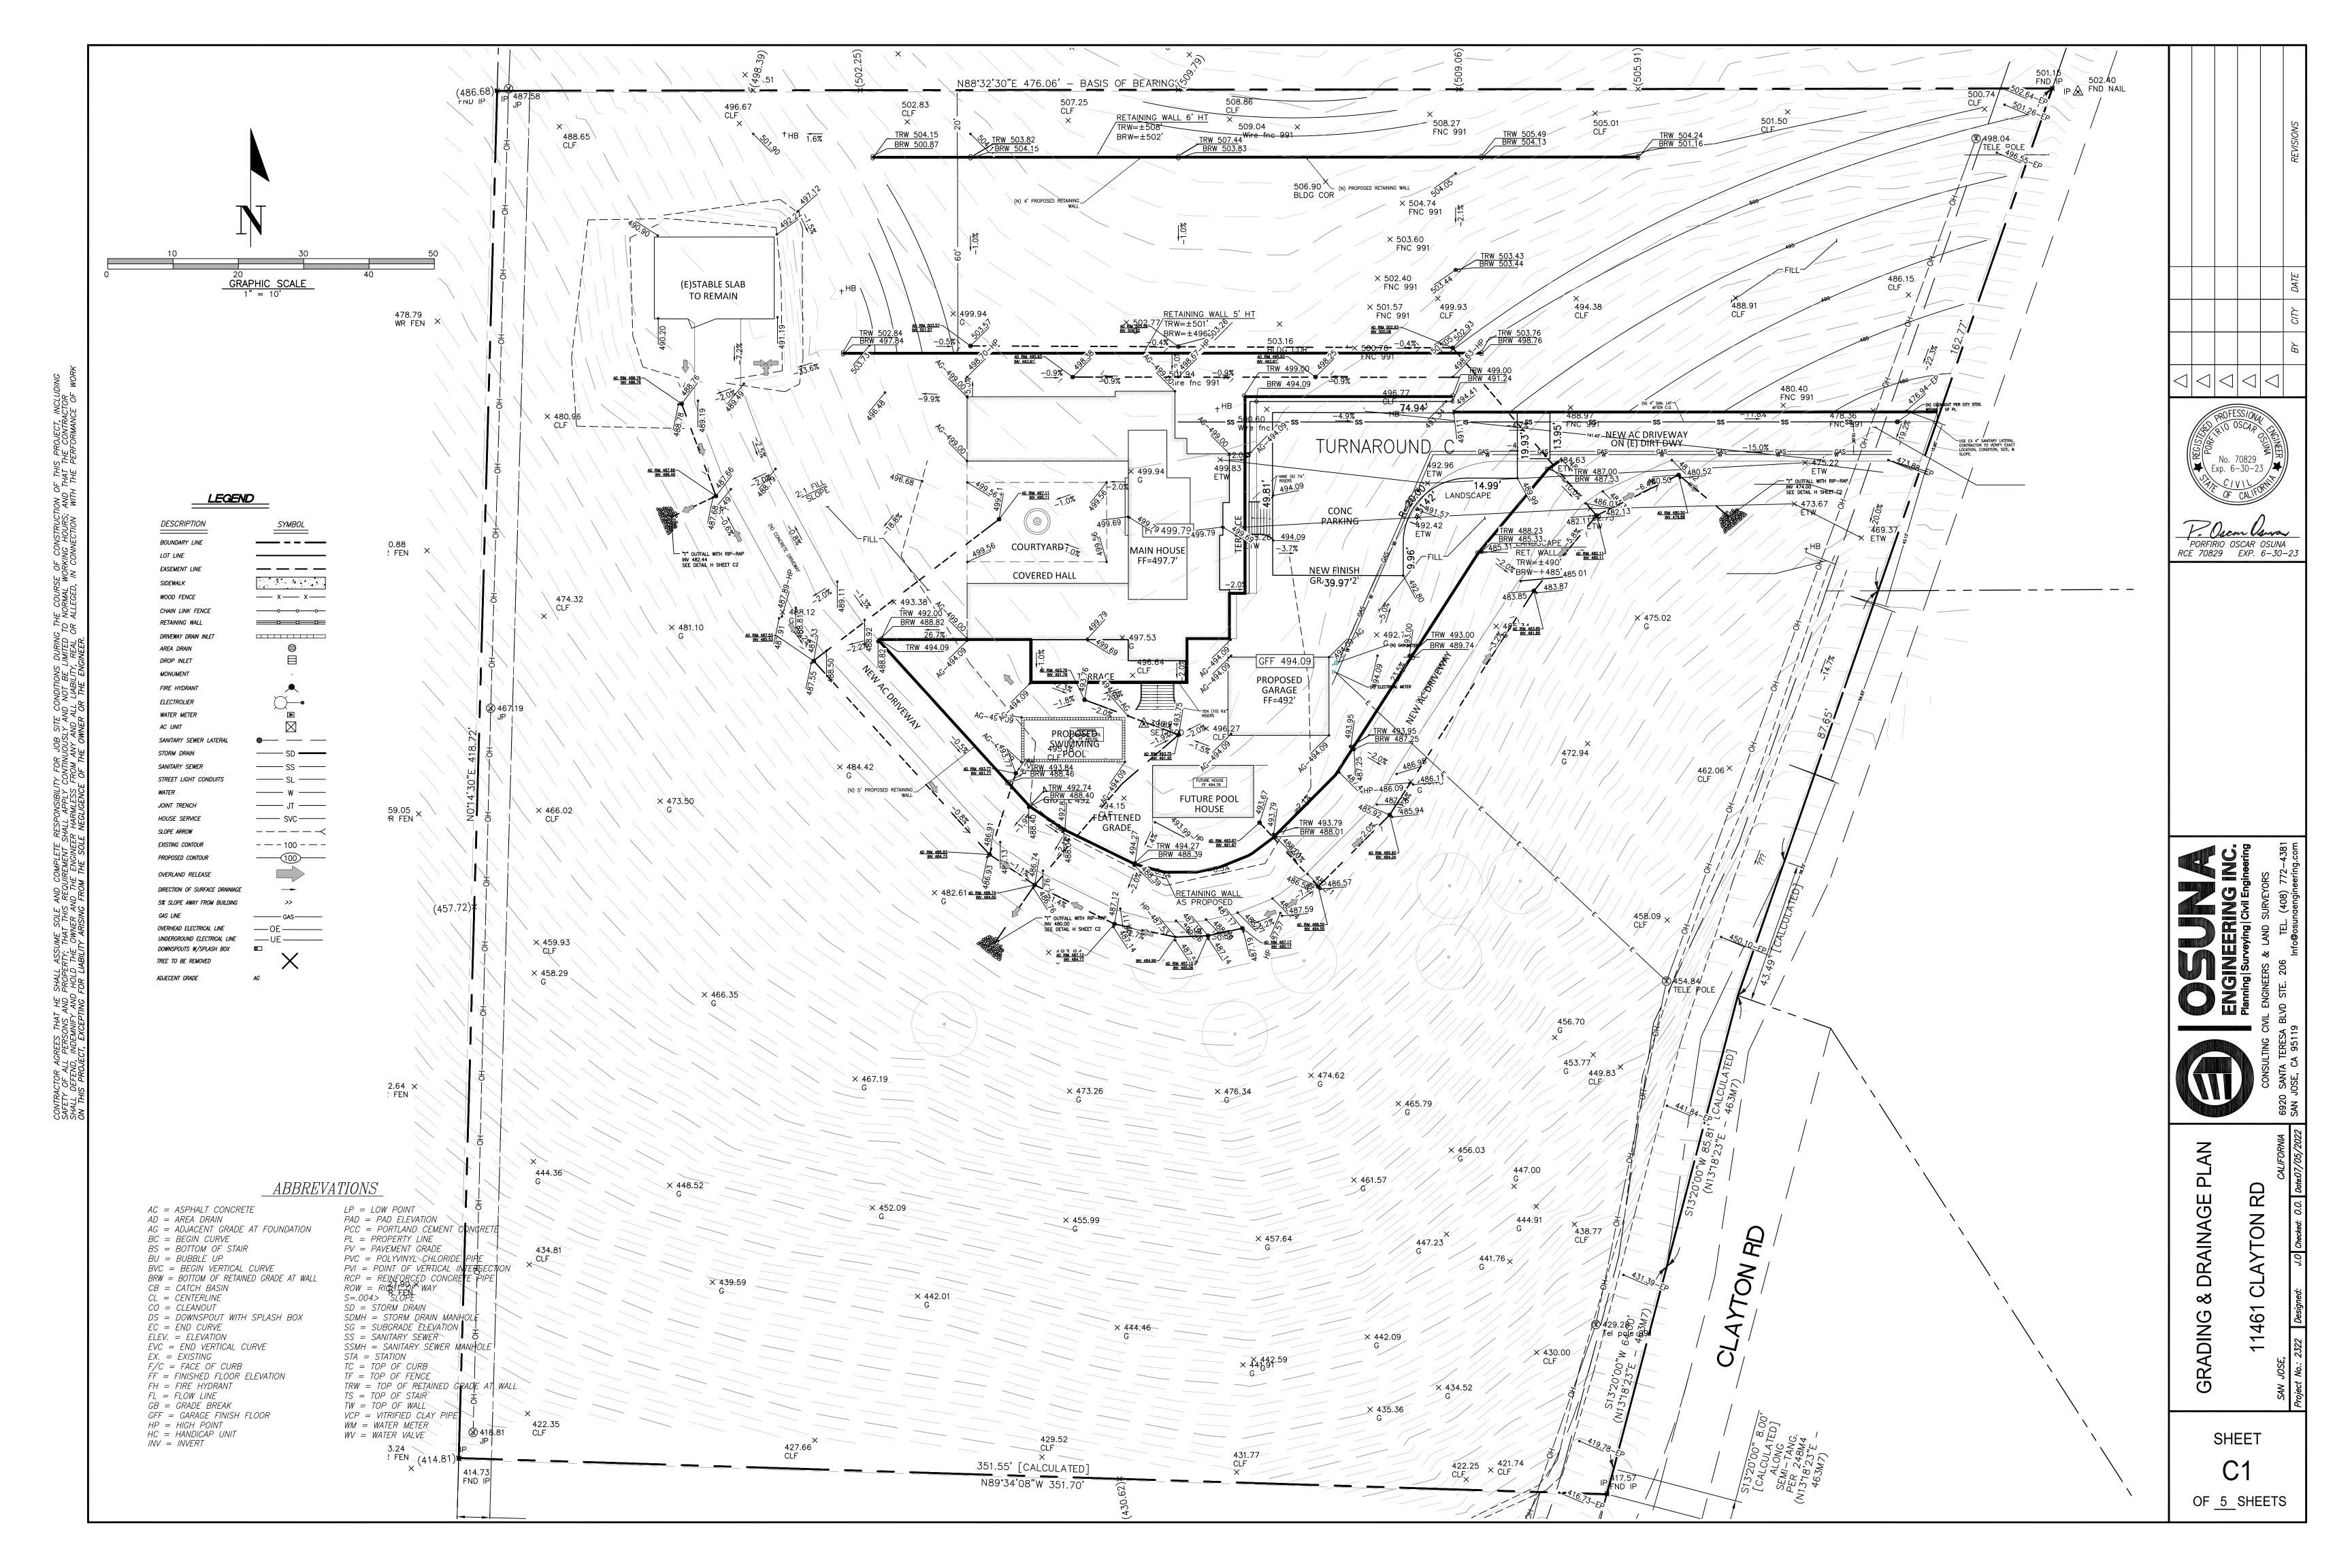

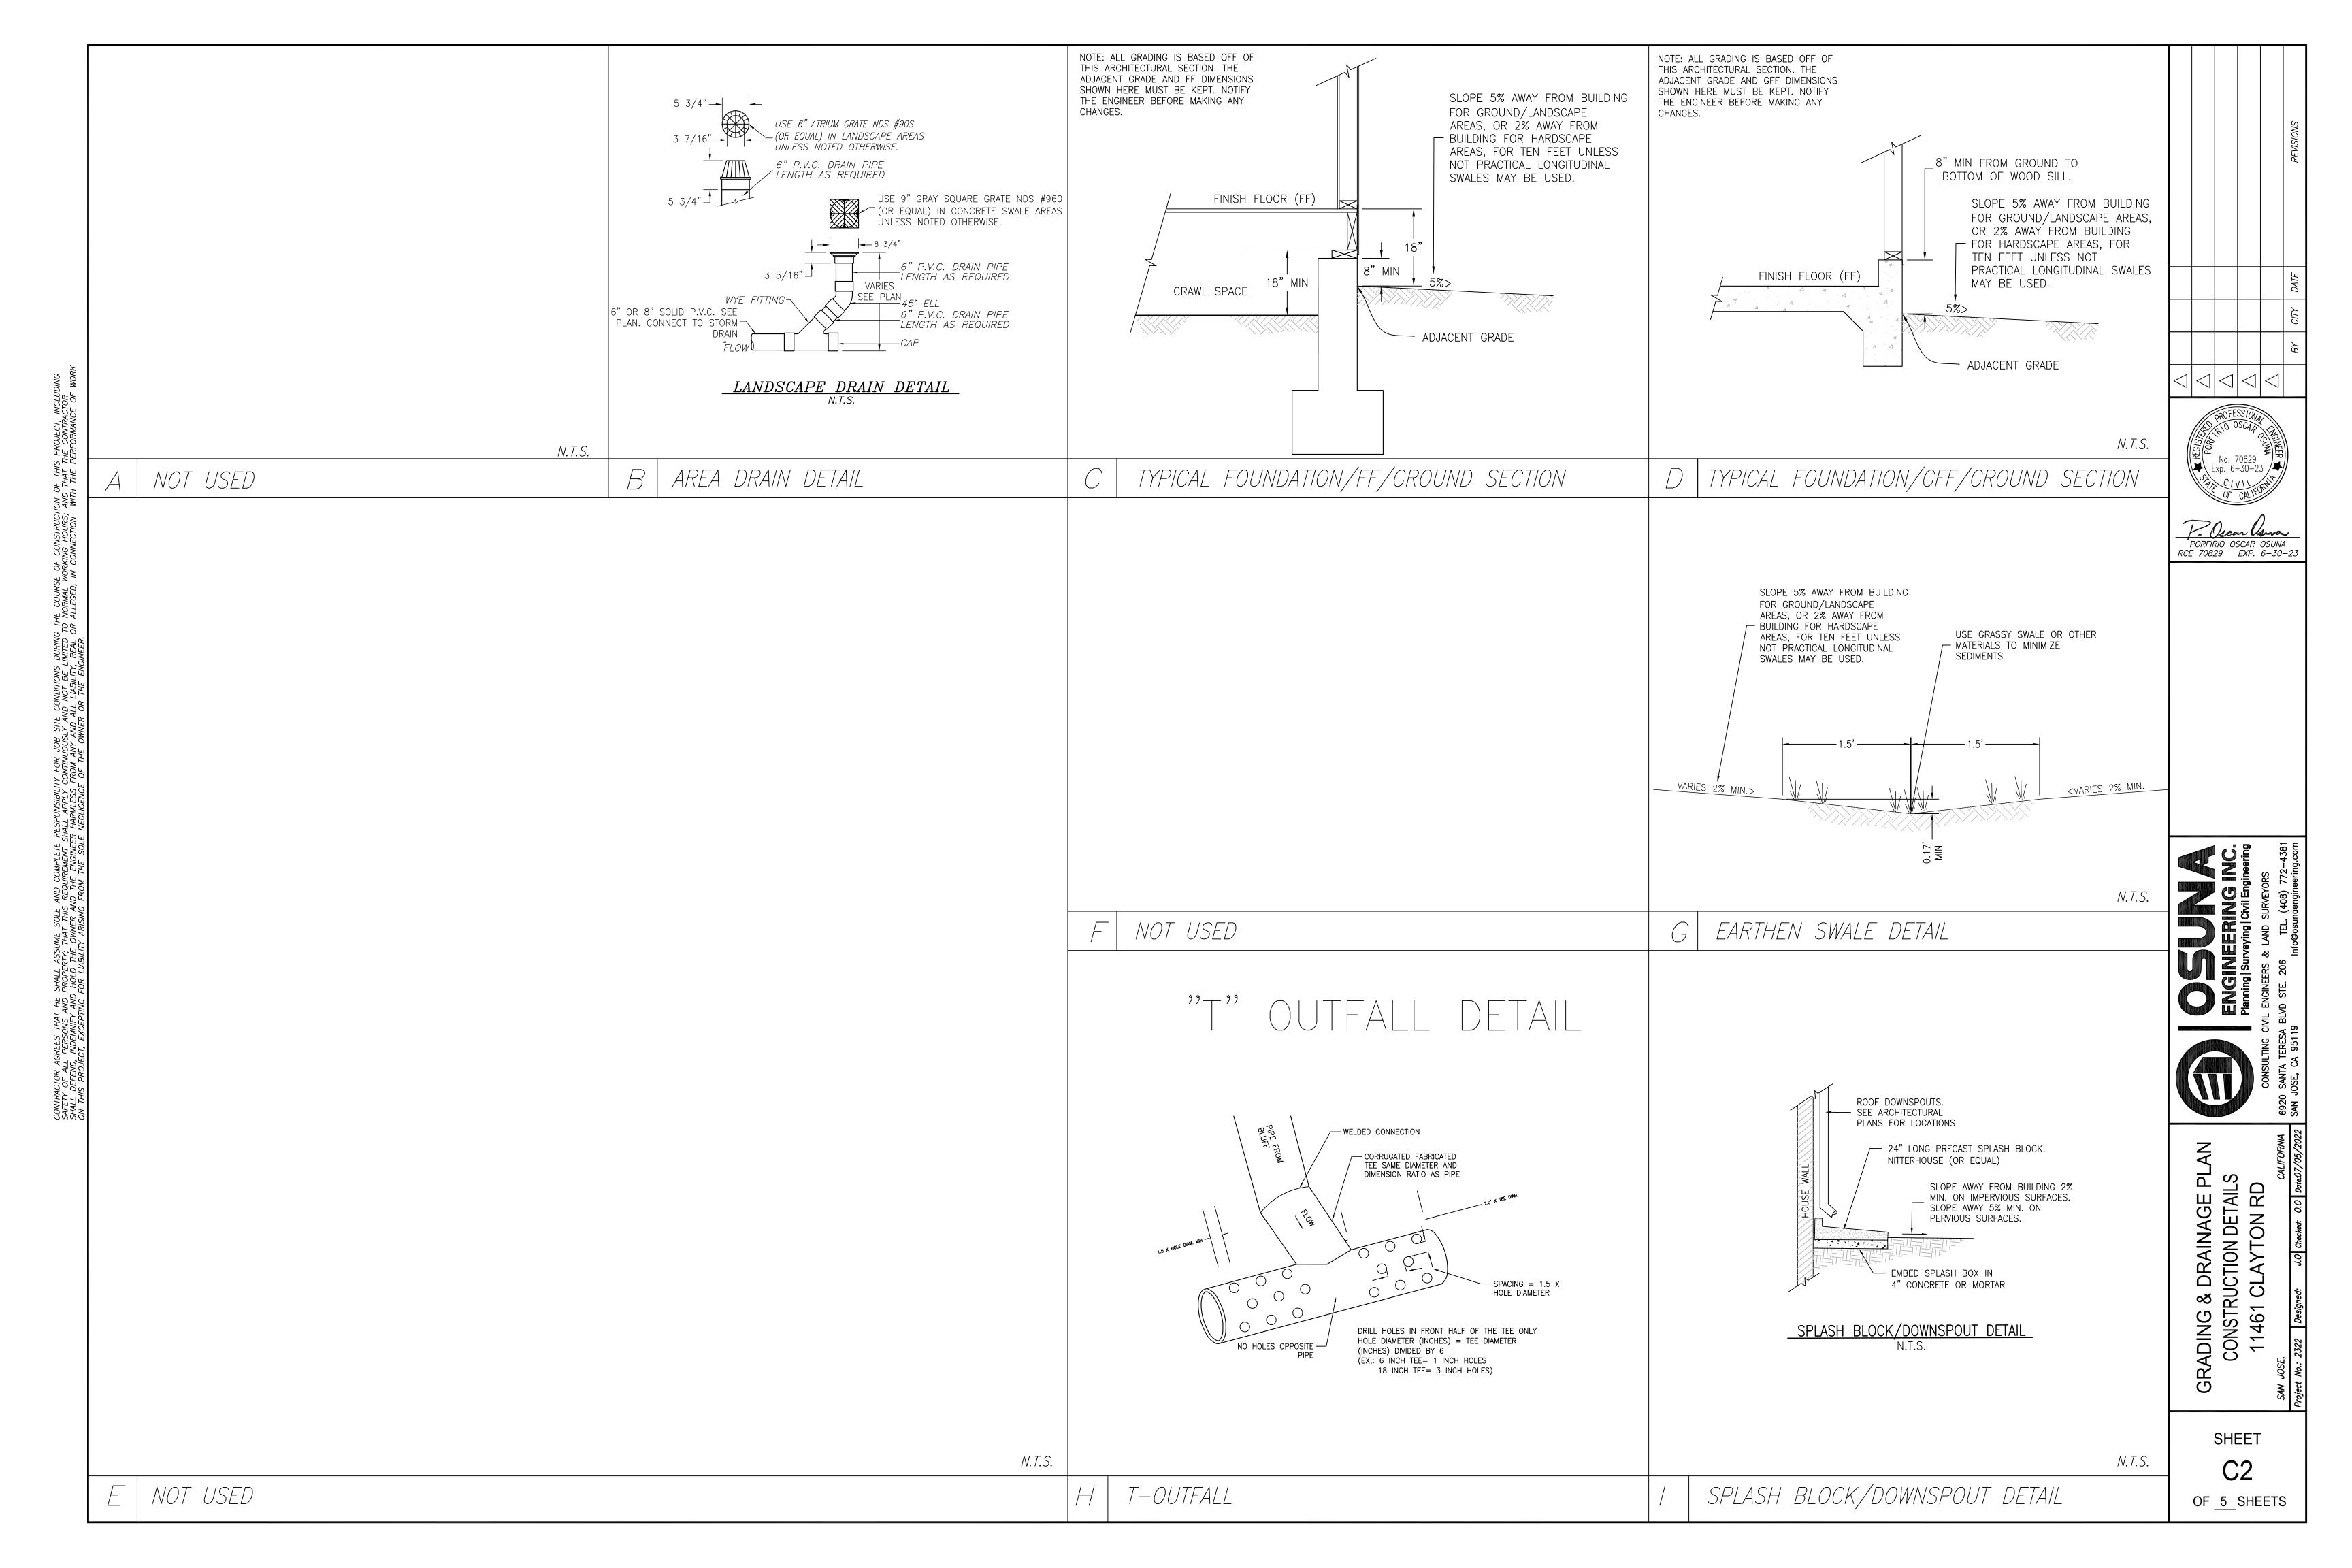

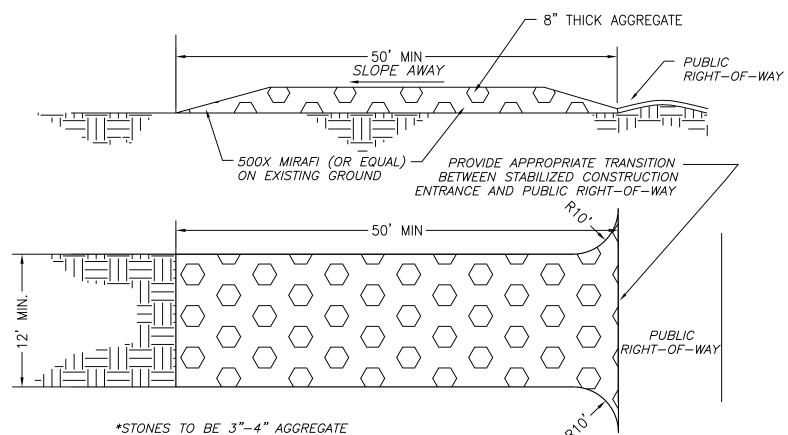

MAINTENANCE:

THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING SEDIMENT ONTO PUBLIC RIGHTS—OF—WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND, AND REPAIR AND/OR CLEAN OUT ANY MEASURES USED TO TRAP SEDIMENT.

ALL SEDIMENT SPILLED, DROPPED, WASHED, OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY SHALL BE REMOVED

WHEN NECESSARY, WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS—OF—WAY. THIS SHALL BE DONE AT AN AREA STABILIZED WITH CRUSHED STONE, WHICH DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN.

STABILIZED
CONSTRUCTION ENTRANCE

## LEGEND

PROPOSED

DESCRIPTION

SITE BOUNDARY

STABILIZED CONSTRUCTION ENTRANCE
2"-3" ROCK (MIN)


FIBER ROLL

INLET PROTECTION


#### MAINTENANCE NOTES

MAINTENANCE IS TO BE PERFORMED AS FOLLOWS:

- 1. REPAIR DAMAGES CAUSED BY SOIL EROSION OR CONSTRUCTION AT THE END OF EACH WORKING DAY.
- 2. SWALES SHALL BE INSPECTED PERIODICALLY AND MAINTAINED AS NEEDED.
- 3. SEDIMENT TRAPS, BERMS, AND SWALES ARE TO BE INSPECTED AFTER EACH STORM AND REPAIRS MADE AS NEEDED.
- 4. SEDIMENT SHALL BE REMOVED AND SEDIMENT TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN SEDIMENT HAS ACCUMULATED TO A DEPTH OF 1 FOOT.
- 5. SEDIMENT REMOVED FROM TRAP SHALL BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
- 6. RILLS AND GULLIES MUST BE REPAIRED.

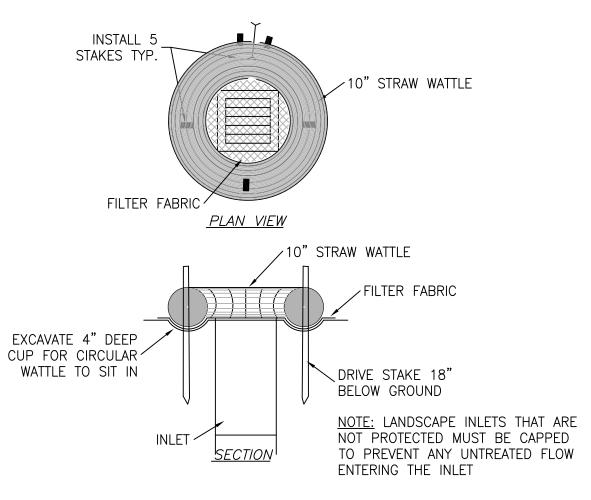

ALTERNATE FIBER ROLL INLET PROTECTION
MAY BE USED IN LANDSCAPE AREA DRAINS
N.T.S.

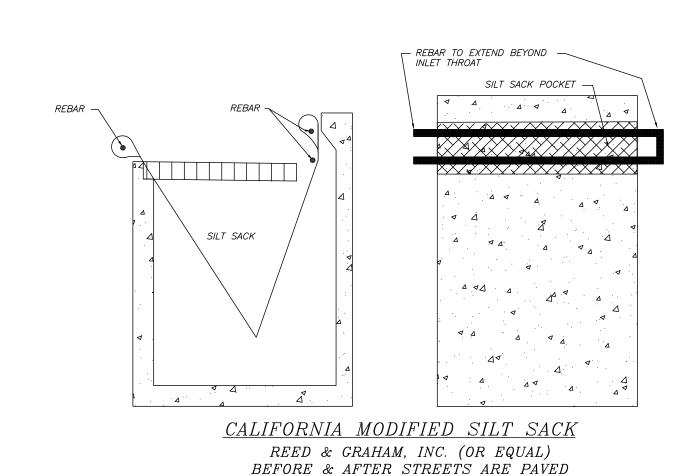

N.T.S.


<u>EROSION & SEDIMENT CONTROL NOTES</u>

TO REVIEW AND APPROVAL OF UNION SANITARY DISTRICT.


- NOT USED
- 2. THE DEVELOPER IS RESPONSIBLE FOR ENSURING THAT ALL CONTRACTORS AND SUBCONTRACTORS ARE AWARE OF ALL STORM WATER QUALITY MEASURES AND IMPLEMENT SUCH MEASURES. FAILURE TO COMPLY WITH THE APPROVED CONSTRUCTION BEST MANAGEMENT PRACTICES WILL RESULT IN THE ISSUANCE OF CORRECTION NOTICES, CITATIONS, AND/OR STOP ORDERS.
- 3. ANY VEHICLE OR EQUIPMENT WASHING/STEAM CLEANING MUST BE DONE AT AN APPROPRIATELY EQUIPPED FACILITY WHICH DRAINS TO THE SANITARY SEWER. OUTDOOR WASHING MUST BE MANAGED IN SUCH A WAY THAT THERE IS NO DISCHARGE OF SOAPS, SOLVENTS, CLEANING AGENTS OR OTHER POLLUTANTS TO THE STORM DRAINS. WASH WATER SHALL DISCHARGE TO THE SANITARY SEWER, SUBJECT
- 4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR LITTER CONTROL AND SWEEPING OF ALL PAVED SURFACES DURING CONSTRUCTION.
- 5. THE FACILITIES SHOWN ON THIS PLAN ARE DESIGNED TO CONTROL EROSION AND SEDIMENT DURING THE RAINY SEASON, OCTOBER 1 TO APRIL 15. EROSION CONTROL MEASURES ARE TO BE FUNCTIONAL PRIOR TO OCTOBER 1ST OF ANY YEAR GRADING OPERATIONS HAVE LEFT AREAS UNPROTECTED FROM EROSION.
- 6. ALL ON-SITE STORM DRAINS SHALL BE CLEANED IMMEDIATELY BEFORE THE START OF THE RAINY SEASON BEGINNING ON OCTOBER 1ST EACH YEAR, SUBJECT TO THE REVIEW OF THE BUILDING/ENGINEERING INSPECTOR.
- 7. IF RAINY WEATHER BECOMES IMMINENT, GRADING OPERATIONS SHALL BE STOPPED AND EROSION CONTROL MEASURES SHALL BE IMPLEMENTED TO PROTECT DISTURBED AREAS.
- 8. DURING THE RAINY SEASON, ALL PAVED AREAS SHALL BE KEPT CLEAR OF EARTH MATERIAL AND DEBRIS. THE SITE SHALL BE MAINTAINED SO AS TO MINIMIZE SEDIMENT LADEN RUNOFF TO ANY STORM DRAIN SYSTEM.
- 9. CONSTRUCTION ENTRANCES SHALL CONSIST OF A MINIMUM 8" THICK LAYER OF 3"-4" FRACTURED STONE AGGREGATE UNLAID WITH GEOTEXTILE LINER FOR A MINIMUM DISTANCE OF 50 FEET, AND IS TO BE PROVIDED AT EACH VEHICLE ACCESS POINT TO EXISTING PAVED STREETS. THE DEPTH AND LENGTH OF AGGREGATE MAY NEED TO BE ADJUSTED IN THE FIELD TO ENSURE NO TRACKING OF SEDIMENT ONTO EXISTING PAVED STREETS. CONSTRUCTION ENTRANCES SHALL SLOPE AWAY FROM EXISTING PAVED STREETS.
- 10. INLETS NOT USED IN CONJUNCTION WITH EROSION CONTROL MEASURES ARE TO BE BLOCKED UNLESS THE AREA DRAINED IS UNDISTURBED OR STABILIZED.
- 11. BORROW AREAS AND TEMPORARY STOCKPILES SHALL BE PROTECTED WITH APPROPRIATE EROSION CONTORL MEASURES TO THE SATISFACTION OF THE CITY ENGINEER.
- 12. NO STRAW BALES OR SILT FENCES SHALL BE USED AS EROSION CONTROL MEASURES. SILT FENCES MAY ONLY BE USED AS A PHYSICAL BARRIER TO PREVENT VEHICULAR AND PEDESTRIAN TRAFFIC FROM USING NON-APPROVED ACCESS POINTS (E.G. ALONG RIGHT-OF-WAY).
- 13. ALL DISTURBED AREAS INCLUDING FLAT PADS ARE TO BE TREATED WITH STRAW AND TACKIFIER AT A RATE OF 2 TONS PER ACRE APPROXIMATELY 3 INCHES THICK.

#### SUPPLEMENTAL EROSION & SEDIMENT CONTROL NOTES

- 1. SEE STANDARD EROSION & SEDIMENT CONTROL NOTES ABOVE.
- 2. THE FACILITIES SHOWN ON THIS PLAN ARE DESIGNED TO CONTROL EROSION AND SEDIMENT DURING THE RAINY SEASON, OCTOBER 1 TO APRIL 30. FACILITIES ARE TO BE OPERABLE PRIOR TO OCTOBER 1 OF ANY YEAR. GRADING OPERATIONS DURING THE RAINY SEASON WHICH LEAVE DENUDED SLOPES SHALL BE PROTECTED WITH <u>EROSION CONTROL</u> MEASURES IMMEDIATELY FOLLOWING GRADING ON THE SLOPES.
- 3. CONSTRUCTION ENTRANCES SHALL BE INSTALLED PRIOR TO COMMENCEMENT OF GRADING. ALL CONSTRUCTION TRAFFIC ENTERING ONTO THE PAVED ROADS MUST CROSS THE STABILIZED CONSTRUCTION ENTRANCE WAYS.
- 4. CONTRACTOR SHALL MAINTAIN STABILIZED ENTRANCE AT EACH VEHICLE ACCESS POINT TO EXISTING PAVED STREETS. ANY MUD OR DEBRIS TRACKED ONTO PUBLIC STREETS SHALL BE REMOVED DAILY AND AS REQUIRED BY THE CITY.
- 5. INLET PROTECTION SHALL BE INSTALLED AT OPEN INLETS TO PREVENT SEDIMENT FROM ENTERING THE STORM DRAIN SYSTEM. INLETS NOT USED IN CONJUNCTION WITH EROSION CONTROL ARE TO BE BLOCKED TO PREVENT ENTRY OF SEDIMENT.
- 6. THIS EROSION AND SEDIMENT CONTROL PLAN MAY NOT COVER ALL THE SITUATIONS THAT MAY ARISE DURING CONSTRUCTION DUE TO UNANTICIPATED FIELD CONDITIONS. VARIATIONS AND ADDITIONS MAY BE MADE TO THIS PLAN IN THE FIELD. NOTIFY THE CITY REPRESENTATIVE OF ANY FIELD CHANGES.

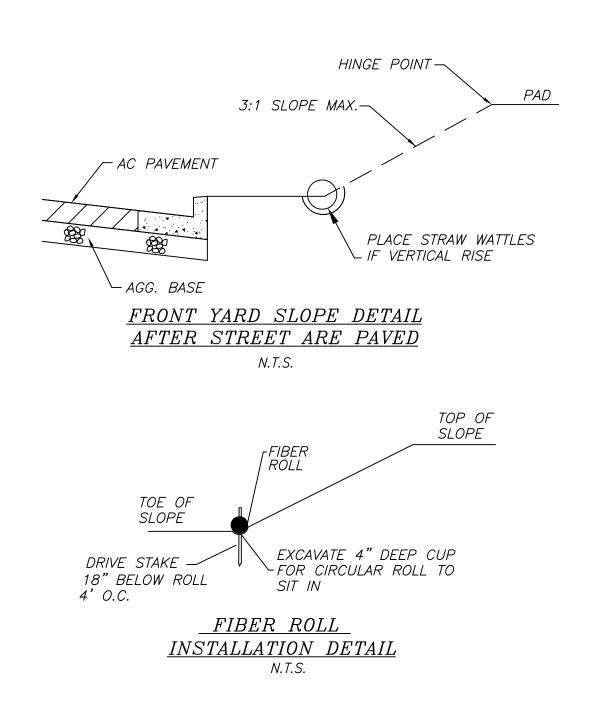

BY CITY DATE REVISIONS



RCE 70829 EXP. 6-30-23

ENGINEERING INC
Planning | Surveying | Civil Engineeri
TING CIVIL ENGINEERS & LAND SURVEYORS

CONSULTING CIVIL ENG
6920 SANTA TERESA BLVD S
SAN JOSE CA 95119

DING & DRAINAGE PLA EROSION CONTROL 11461 CLAYTON RD

11461 SAN JOSE,

SHEET

C3


OF 5 SHEETS

(7)

# Construction Best Management Practices (BMPs)

Construction projects are required to implement year-round stormwater BMPs.

## **Materials & Waste Management**

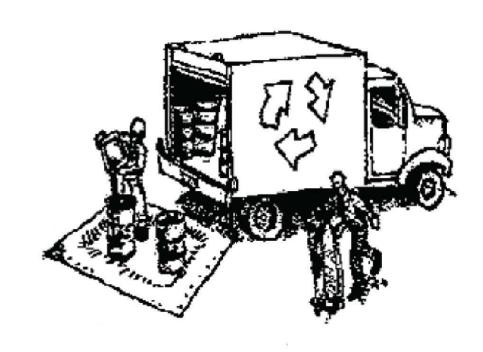

#### Non-Hazardous Materials

- ☐ Berm and cover stockpiles of sand, dirt or other construction material with tarps when rain is forecast or when they are not in use.
- ☐ Use (but don't overuse) reclaimed water for dust control.
- ☐ Ensure dust control water doesn't leave site or discharge to storm drains

#### **Hazardous Materials**

- ☐ Label all hazardous materials and hazardous wastes (such as pesticides, paints, thinners, solvents, fuel, oil, and antifreeze) in accordance with City, County, State and Federal regulations.
- ☐ Store hazardous materials and wastes in water tight containers, store in appropriate secondary containment, and cover them at the end of every work day or during wet weather or when rain is forecast.
- ☐ Follow manufacturer's application instructions for hazardous materials and do not use more than necessary. Do not apply chemicals outdoors when rain is forecast within 24 hours.
- ☐ Arrange for appropriate disposal of all hazardous wastes.

#### Waste Management

- ☐ Cover and maintain dumpsters. Check frequently for leaks. Place dumpsters under roofs or cover with tarps or plastic sheeting secured around the outside of the dumpster. A plastic liner is recommended to prevent leaks. Never clean out a dumpster by hosing it down on the construction site.
- ☐ Place portable toilets away from storm drains. Make sure they are in good working order. Check frequently for leaks.
- ☐ Dispose of all wastes and demolition debris properly. Recycle materials and wastes that can be recycled, including solvents, waterbased paints, vehicle fluids, broken asphalt and concrete, wood, and cleared vegetation.
- ☐ Dispose of liquid residues from paints, thinners, solvents, glues, and cleaning fluids as hazardous waste.
- ☐ Keep site free of litter (e.g. lunch items, cigarette butts).
- ☐ Prevent litter from uncovered loads by covering loads that are being transported to and from site.

#### **Construction Entrances and Perimeter**

- ☐ Establish and maintain effective perimeter controls and stabilize all construction entrances and exits to sufficiently control erosion and sediment discharges from site and tracking off site.
- ☐ Sweep or vacuum any street tracking immediately and secure sediment source to prevent further tracking. Never hose down streets to clean up tracking.

## **Equipment Management & Spill Control**




#### **Maintenance and Parking**

- ☐ Designate an area of the construction site, well away from streams or storm drain inlets and fitted with appropriate BMPs, for auto and equipment parking, and storage.
- ☐ Perform major maintenance, repair jobs, and vehicle and equipment washing off site.
- ☐ If refueling or vehicle maintenance must be done onsite, work in a bermed area away from storm drains and over a drip pan or drop cloths big enough to collect fluids. Recycle or dispose of fluids as hazardous waste.
- ☐ If vehicle or equipment cleaning must be done onsite, clean with water only in a bermed area that will not allow rinse water to run into gutters, streets, storm drains, or surface waters.
- ☐ Do not clean vehicle or equipment onsite using soaps, solvents, degreasers, or steam cleaning equipment, and do not use diesel oil to lubricate equipment or parts

#### **Spill Prevention and Control**

- ☐ Keep spill cleanup materials (e.g., rags, absorbents and cat litter) available at the construction site at all times.
- ☐ Maintain all vehicles and heavy equipment. Inspect frequently for and repair leaks. Use drip pans to catch leaks until repairs are made.
- ☐ Clean up leaks, drips and other spills immediately and dispose of cleanup materials properly.
- ☐ Use dry cleanup methods whenever possible (absorbent materials, cat litter and/or rags).
- ☐ Sweep up spilled dry materials immediately. Never attempt to "wash them away" with water, or bury
- ☐ Clean up spills on dirt areas by digging up and properly disposing of contaminated soil.
- ☐ Report significant spills to the appropriate local spill response agencies immediately. If the spill poses a significant hazrd to human health and safety, property or the environment, you must report it to the State Office of Emergency Services. (800) 852-7550 (24 hours).

## **Earthmoving**

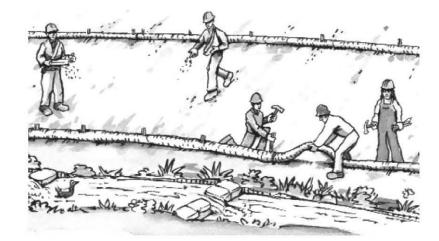

#### **Grading and Earthwork**

- ☐ Schedule grading and excavation work during dry weather.
- ☐ Stabilize all denuded areas, install and maintain temporary erosion controls (such as erosion control fabric or bonded fiber matrix) until vegetation is established.
- ☐ Remove existing vegetation only when absolutely necessary, plant temporary vegetation for erosion control on slopes or where construction is not immediately planned
- ☐ Prevent sediment from migrating offsite and protect storm drain inlets, drainage courses and streams by installing and maintaining appropriate BMPs (i.e. silt fences, gravel bags, fiber rolls, temporary swales, etc.).
- ☐ Keep excavated soil on site and transfer it to dump trucks on site, not in the streets.

#### **Contaminated Soils**

- ☐ If any of the following conditions are observed, test for contamination and contact the Regional Water Quality Control Board:
- Unusual soil conditions, discoloration, or odor.
- Abandoned underground tanks.
- Abandoned wells
- Buried barrels, debris, or trash.
- ☐ If the above conditions are observed. document any signs of potential contamination and clearly mark them so they are not distrurbed by construction activities.

#### Landscaping

- ☐ Protect stockpiled landscaping materials from wind and rain by storing them under tarps all year-round.
- ☐ Stack bagged material on pallets and under cover.
- ☐ Discontinue application of any erodible landscape material within 2 days before a forecast rain event or during wet weather.

## **Concrete Management** and Dewatering



#### Concrete Management

- ☐ Store both dry and wet materials under cover, protected from rainfall and runoff and away from storm drains or waterways. Store materials off the ground, on pallets. Protect dry materials from wind.
- ☐ Wash down exposed aggregate concrete only when the wash water can (1) flow onto a dirt area; (2) drain onto a bermed surface from which it can be pumped and disposed of properly; or (3) block any storm drain inlets and vacuum washwater from the gutter. If possible, sweep first.
- ☐ Wash out concrete equipment/trucks offsite or in a designated washout area onsite, where the water will flow into a temporary waste pit, and make sure wash water does not leach into the underlying soil. (See CASQA Construction BMP Handbook for properly designed concrete washouts.)

#### Dewatering

- ☐ Discharges of groundwater or captured runoff from dewatering operations must be properly managed and disposed. When possible, send dewatering discharge to landscaped area or sanitary sewer. If discharging to the sanitary sewer, call your local wastewater treatment plant.
- ☐ Divert run-on water from offsite away from all disturbed areas.
- ☐ When dewatering, notify and obtain approval from the local municipality before discharging water to a street gutter or storm drain. Filtration or diversion through a basin, tank, or sediment trap may be required.
- ☐ In areas of known or suspected contamination, call your local agency to determine whether the ground water must be tested. Pumped groundwater may need to be collected and hauled off-site for treatment and proper disposal.

## Paving/Asphalt Work




#### **Paving**

- ☐ Avoid paving and seal coating in wet weather or when rain is forecast, to prevent materials that have not cured from contacting stormwater runoff.
- ☐ Cover storm drain inlets and manholes when applying seal coat, slurry seal, fog seal, or similar materials.
- ☐ Collect and recycle or properly dispose of excess abrasive gravel or sand. Do NOT sweep or wash it into gutters.

## Sawcutting & Asphalt/Concrete Removal

- ☐ Protect storm drain inlets during saw
- ☐ If saw cut slurry enters a catch basin, clean it up immediately.
- ☐ Shovel or vacuum saw cut slurry deposits and remove from the site. When making saw cuts, use as little water as possible. Sweep up, and properly dispose of all residues.

## **Painting & Paint Removal**

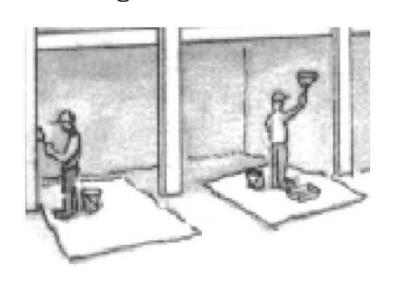

#### Painting Cleanup and Removal


- ☐ Never clean brushes or rinse paint containers into a street, gutter, storm drain, or stream.
- ☐ For water-based paints, paint out brushes to the extent possible, and rinse into a drain that goes to the sanitary sewer. Never pour paint down a storm drain.
- ☐ For oil-based paints, paint out brushes to the extent possible and clean with thinner or solvent in a proper container. Filter and reuse thinners and solvents. Dispose of excess liquids as hazardous waste.
- from non-hazardous dry stripping and sand blasting into plastic drop cloths and dispose of as trash.
- ☐ Chemical paint stripping residue and chips and dust from marine paints or paints containing lead, mercury, or tributyltin must be disposed of as hazardous waste. Lead based paint removal requires a statecertified contractor.




- ☐ Sweep up or collect paint chips and dust

**Pollution Prevention Program** 

Storm drain polluters may be liable for fines of up to \$10,000 per day!

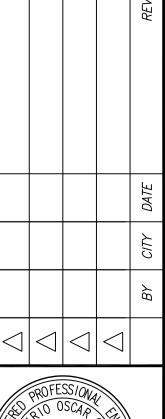








S & DRAINAGE F BMP SHEET GRADING

SHEET

OF 5 SHEETS

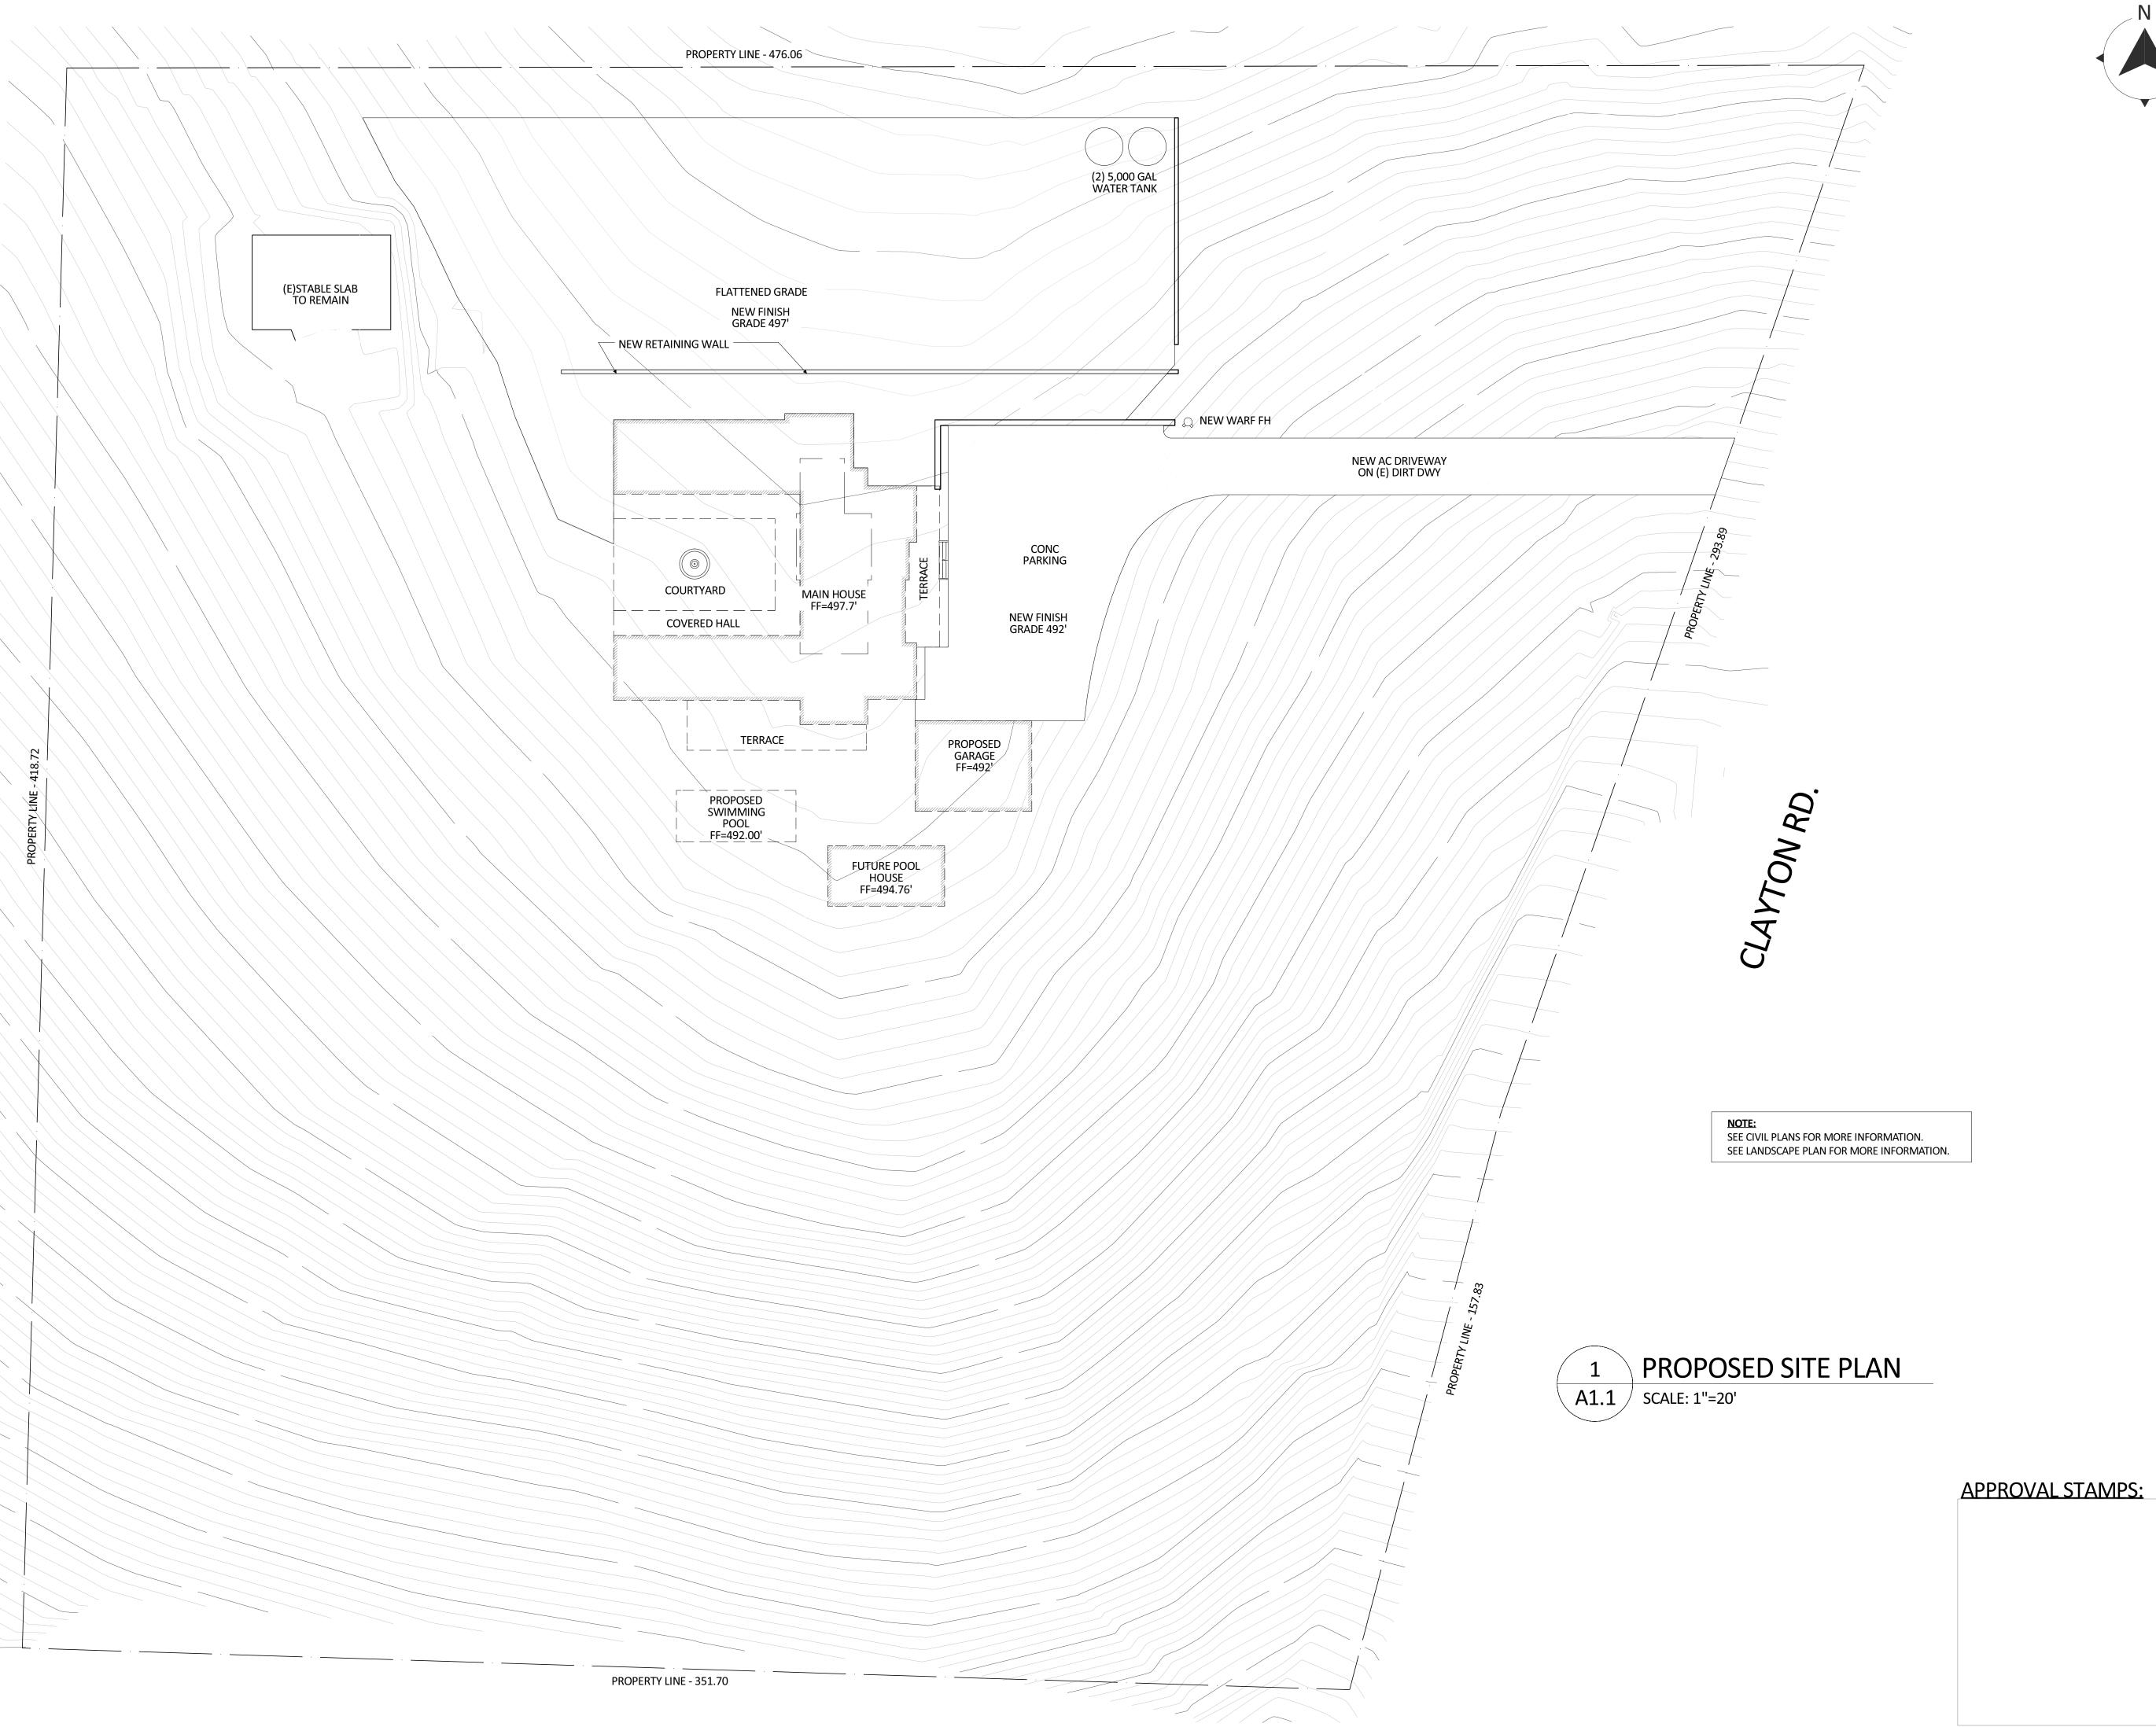



OWNER:

JUAN ROSAS 11461 CLAYTON RD, SAN JOSE, CA 95127 (650) 704-0520

DRAFTER:

LERIKA LISCANO 4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

FAMILY RESIDENCE **NEW SINGLE** 

1 12/2/24 COMMENT RESPONSES


PROPOSED SITE PLAN



JUAN ROSAS 11461 CLAYTON RD, SAN JOSE, CA 95127 (650) 704-0520

LERIKA LISCANO 4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM


**NEW SINGLE FAMILY RESIDENCE** 

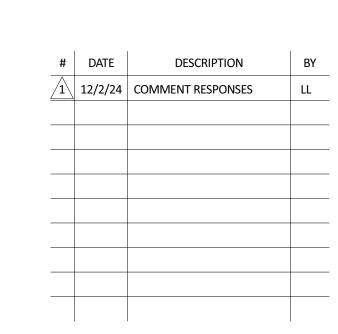

DRAWN BY: LL


PROPOSED ROOF

PLAN

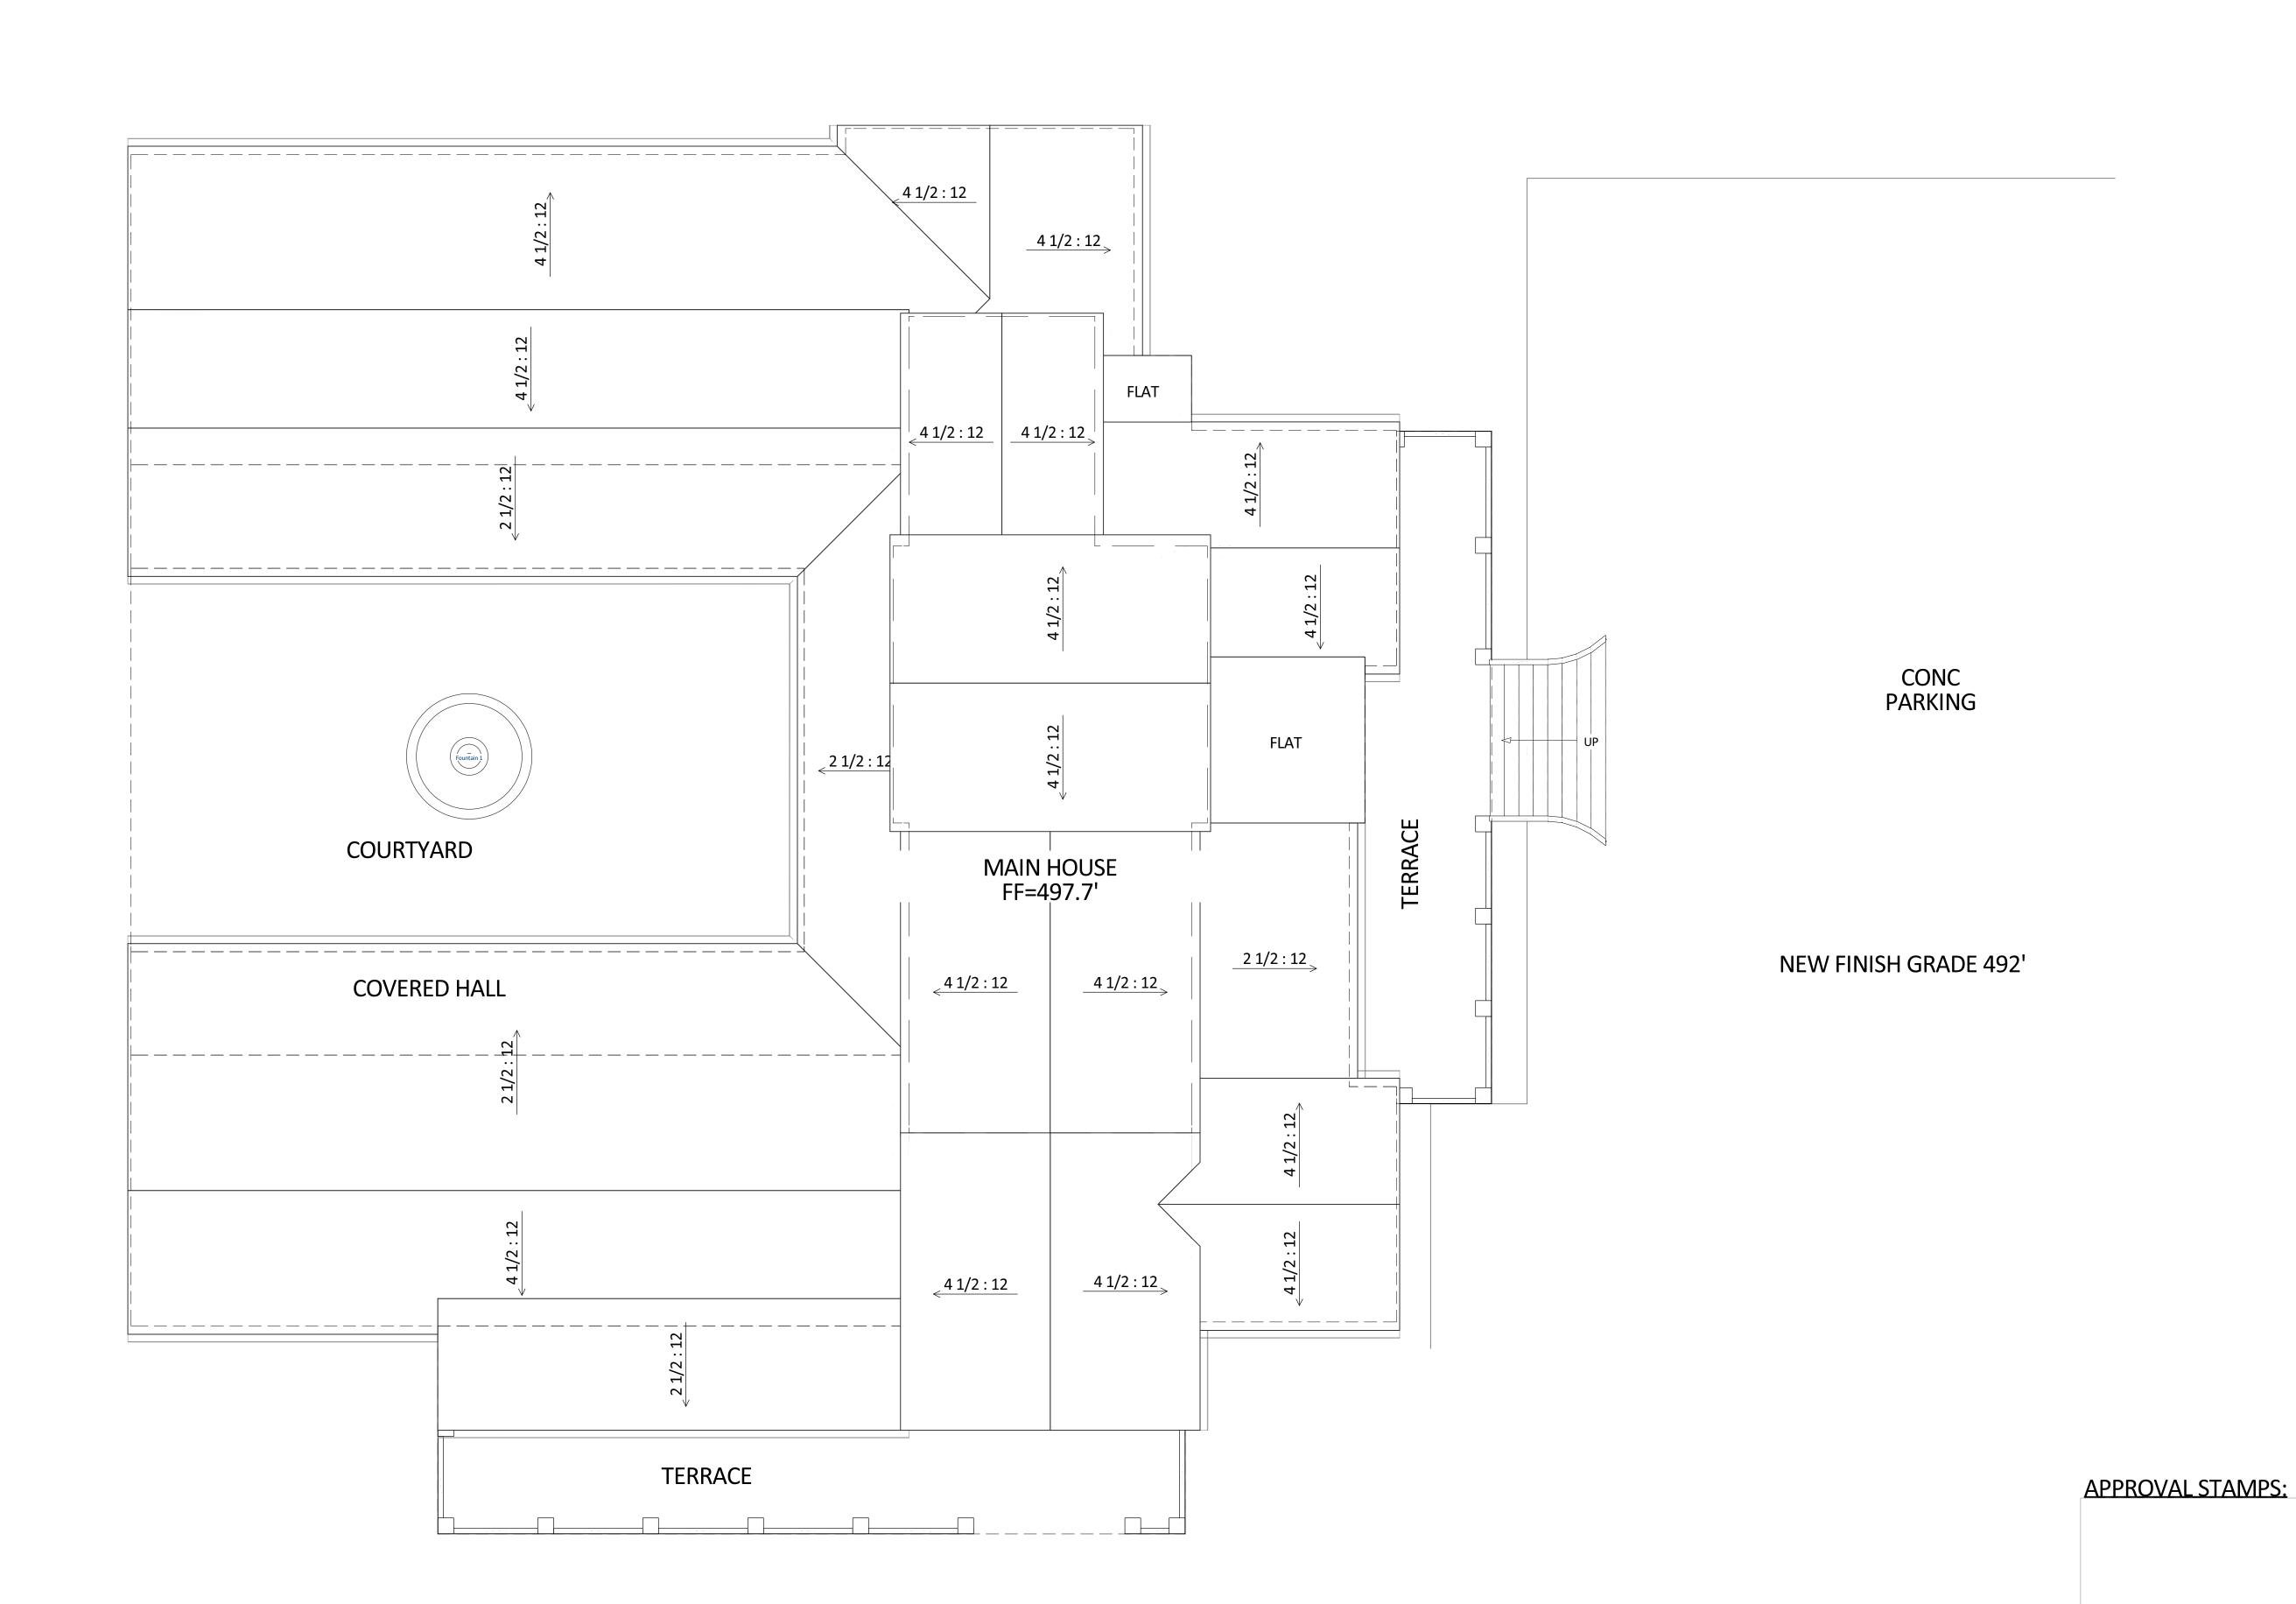

PROPOSED ROOF PLAN

A2.1 SCALE: 3/16" = 1' - 0"

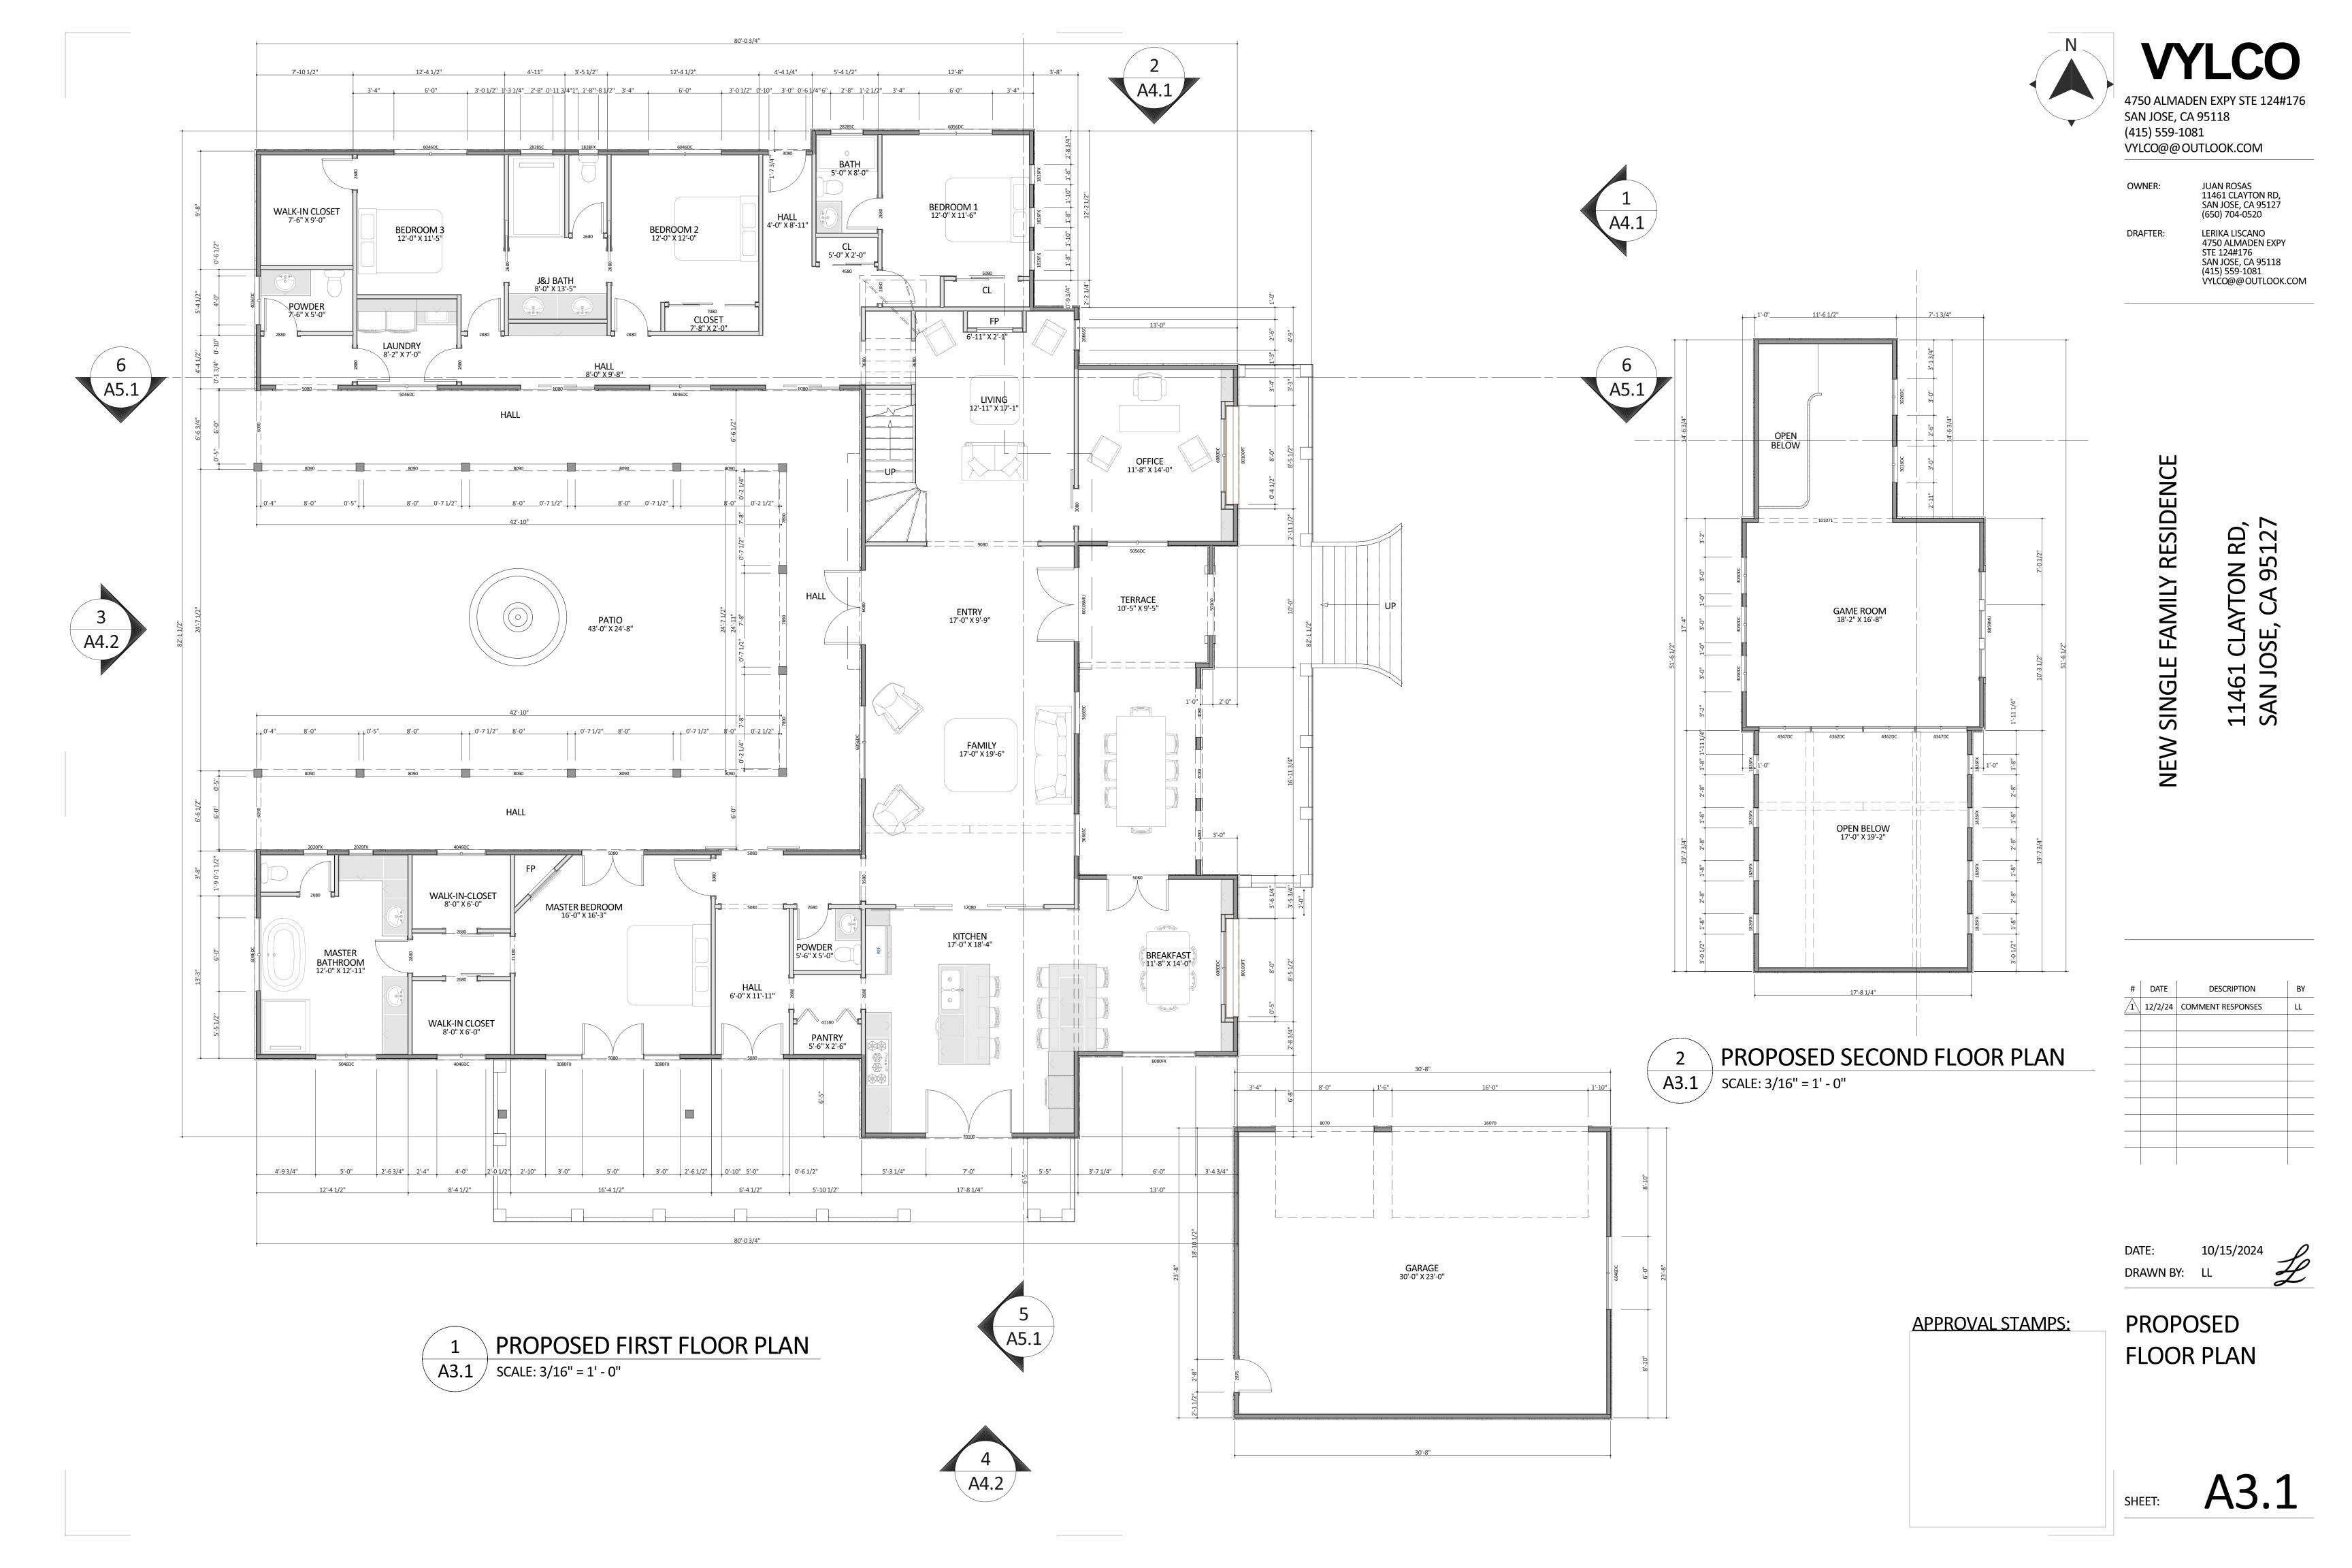

NEW

**EXISTING TO REMAIN** REMOVE AND RELOCATE (E) CONSTRUCTION TO BE REMOVED

**VYLCO** 

4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

OWNER:

JUAN ROSAS 11461 CLAYTON RD, SAN JOSE, CA 95127 (650) 704-0520

LERIKA LISCANO 4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

**NEW SINGLE FAMILY RESIDENCE** 



10/15/2024

DRAWN BY:

**APPROVAL STAMPS:** 

PROPOSED **EXTERIOR ELEVATIONS** 



## PROPOSED NORTH ELEVATION **A4.1** SCALE: 3/16" = 1' - 0"



**EXISTING TO REMAIN** 

REMOVE AND RELOCATE (E) CONSTRUCTION TO BE REMOVED **VYLCO** 

4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

OWNER:

JUAN ROSAS 11461 CLAYTON RD, SAN JOSE, CA 95127 (650) 704-0520

LERIKA LISCANO 4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

**NEW SINGLE FAMILY RESIDENCE** 

1 12/2/24 COMMENT RESPONSES

DRAWN BY:

**APPROVAL STAMPS:** 

PROPOSED **EXTERIOR ELEVATIONS** 






A4.2 | SCALE: 3/16" = 1' - 0"

PROPOSED SOUTH ELEVATION **A4.2** SCALE: 3/16" = 1' - 0"

**BUILDING SECTION** A5.1 SCALE: 1/4" = 1' - 0"

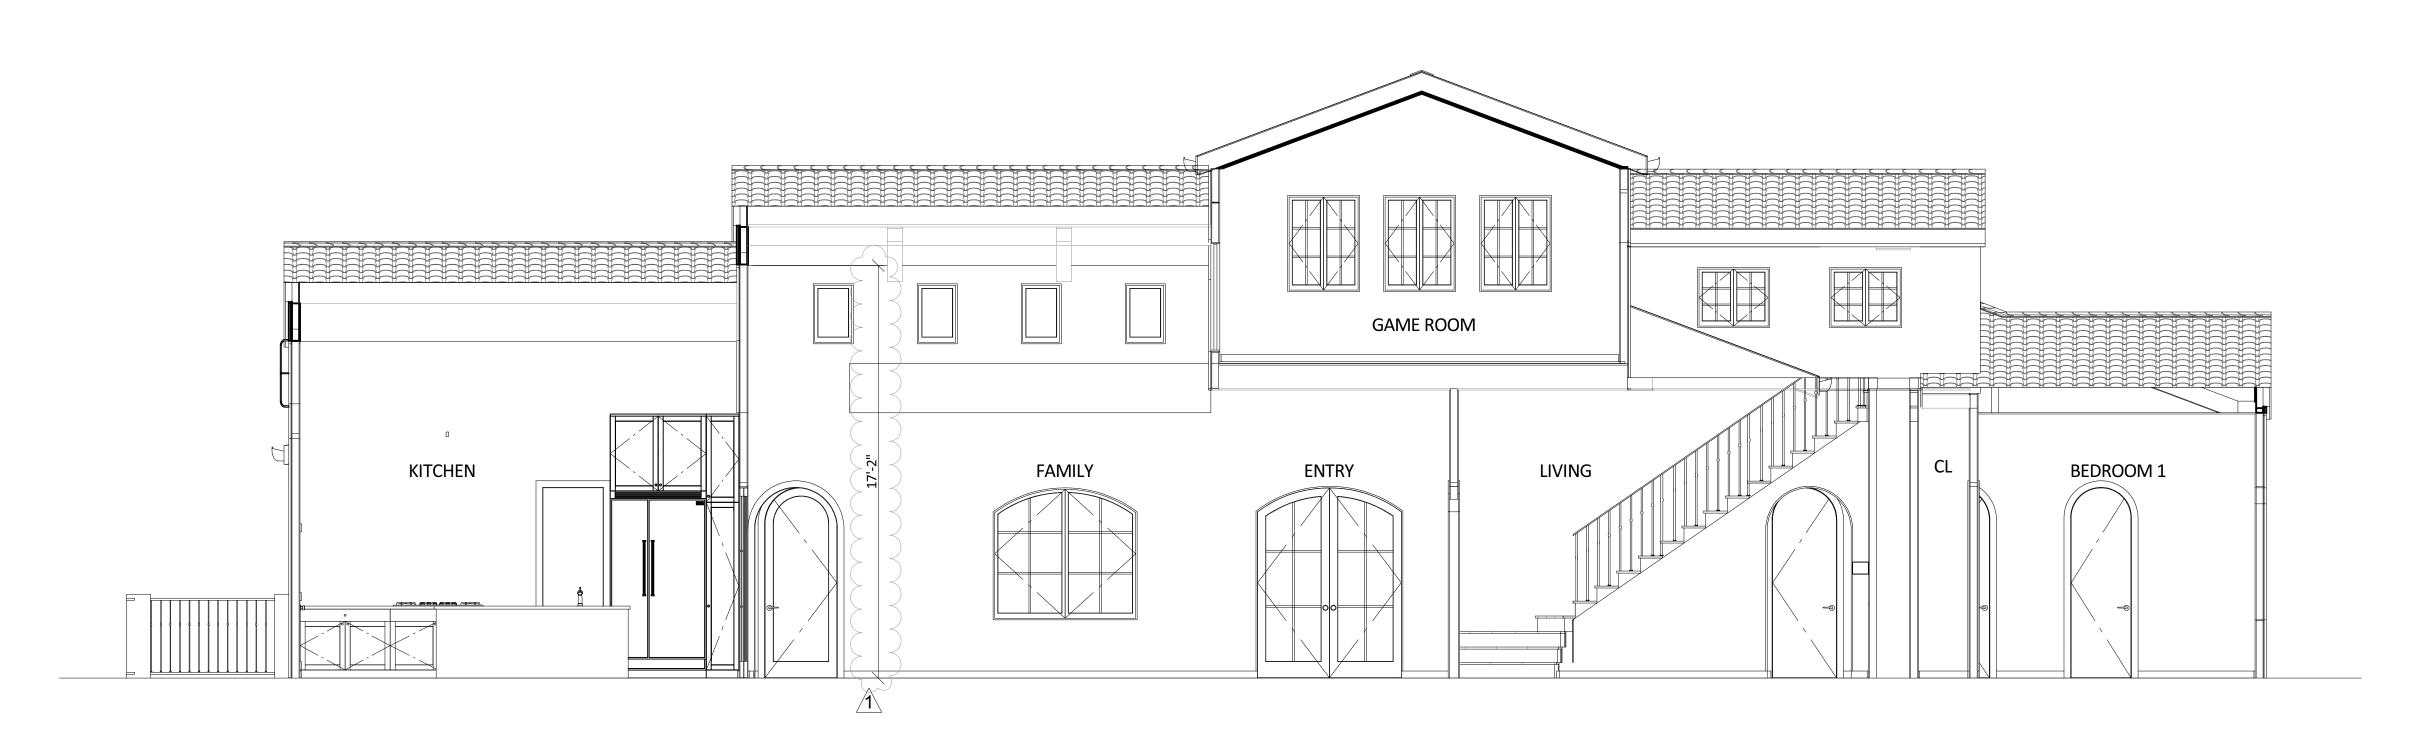

**BUILDING SECTION** A5.1 | SCALE: 1/4" = 1' - 0"

**VYLCO** 

4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

OWNER:

JUAN ROSAS 11461 CLAYTON RD, SAN JOSE, CA 95127 (650) 704-0520

LERIKA LISCANO 4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

**NEW SINGLE FAMILY RESIDENCE** 

1 12/2/24 COMMENT RESPONSES

DRAWN BY: LL

**SECTIONS** 

**APPROVAL STAMPS:** 



PROPOSED SECOND FLOOR PLAN A6.1 SCALE: 3/16" = 1' - 0"  **VYLCO** 


4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

OWNER:

JUAN ROSAS 11461 CLAYTON RD, SAN JOSE, CA 95127 (650) 704-0520

LERIKA LISCANO 4750 ALMADEN EXPY STE 124#176 SAN JOSE, CA 95118 (415) 559-1081 VYLCO@@OUTLOOK.COM

FAMILY RESIDENCE **NEW SINGLE** 

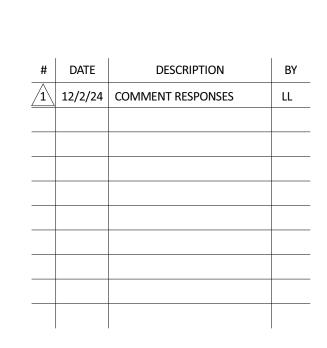

**APPROVAL STAMPS:** 

10/15/2024

DRAWN BY:

FLOOR AREA DIAGRAM

PROPOSED FIRST FLOOR PLAN

FIRST FLOOR 3,639,85 sq ft

COVERED CORRIDOR

806.16 sq ft

COVERED TERRACE 193.77 sq ft

OPEN TERRACE 338.93 sq ft

LIVING AREA 3640 SQ FT

OPEN

COVERED

TERRACE 277.13 sq ft

ACCESSORY STRUCTURE 493.02 sq ft

TERRACE 327.79 sq ft

GARAGE 740.09 sq ft

A6.1 | SCALE: 1/8" = 1' - 0"

